


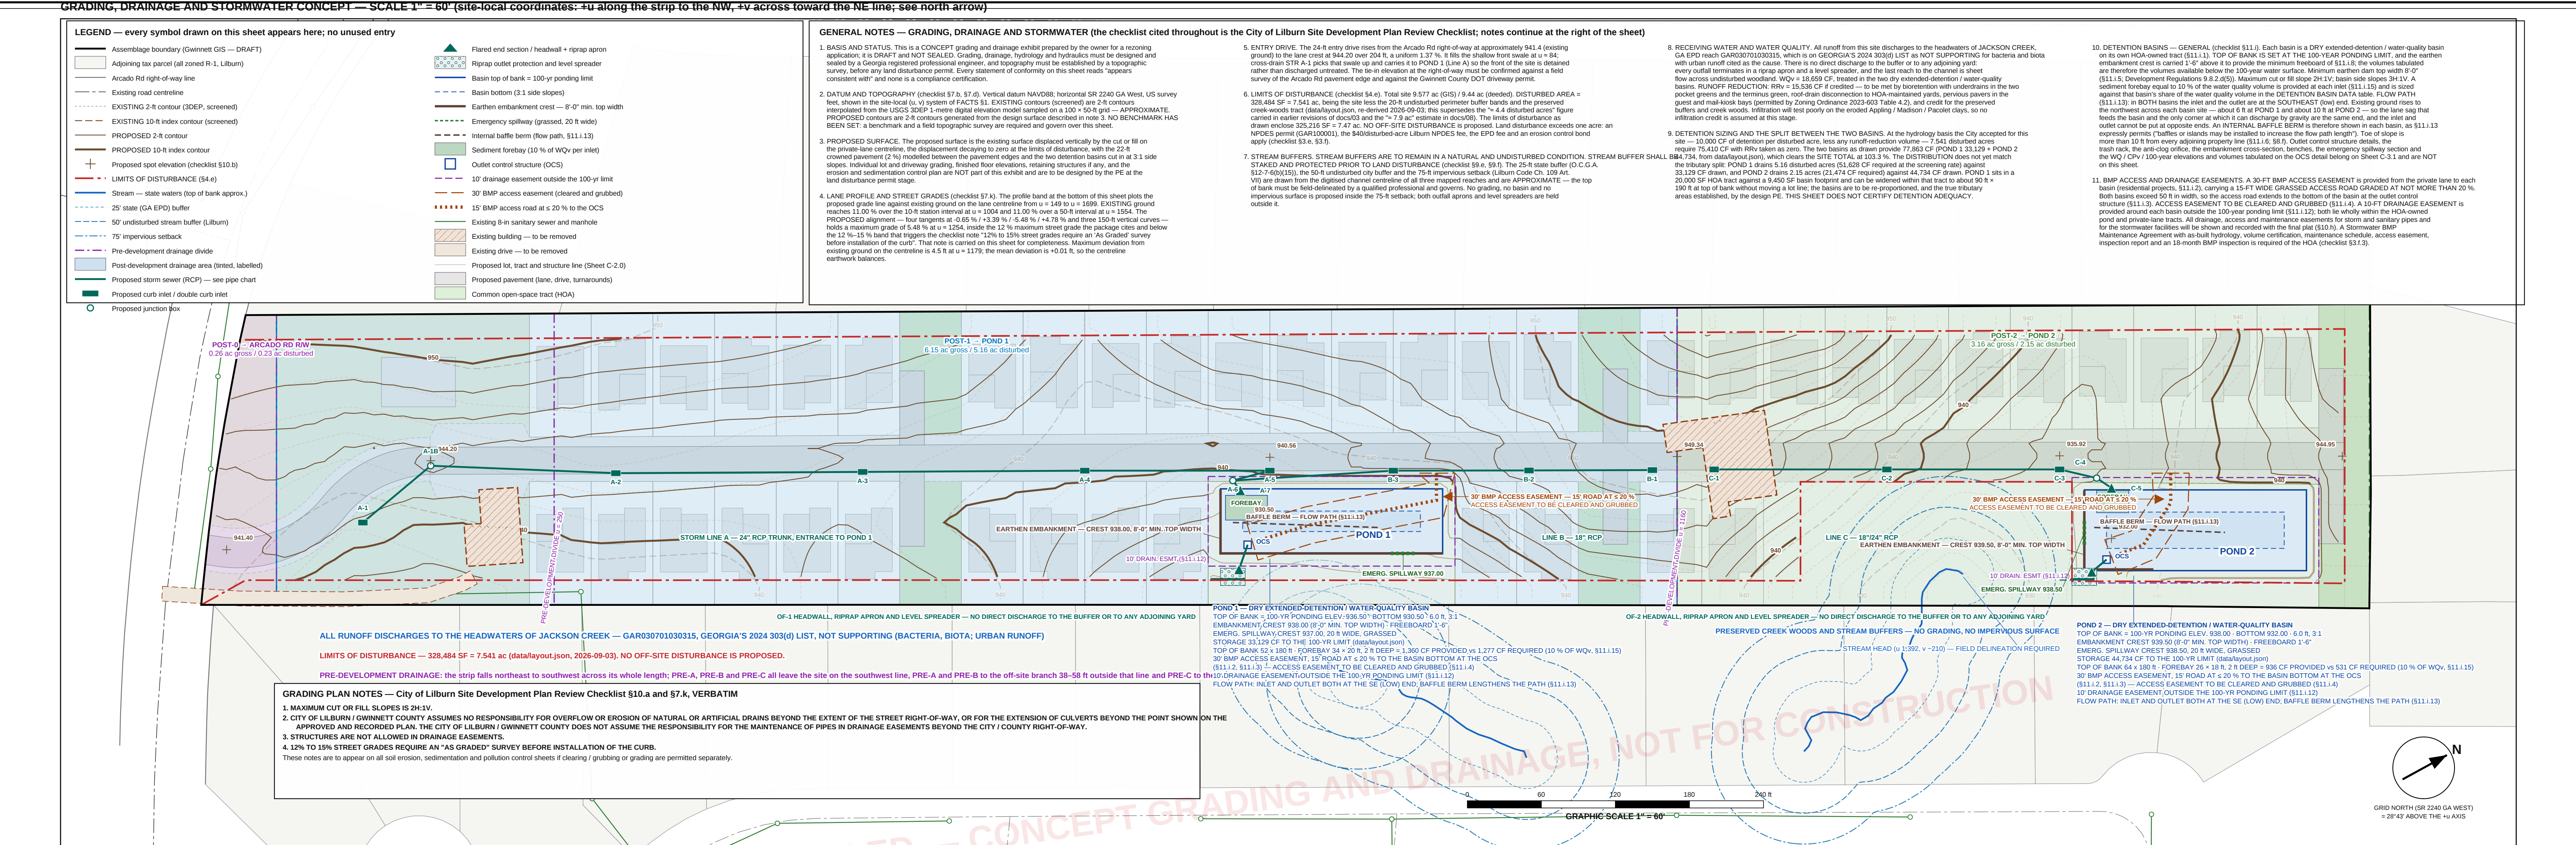

STORM STRUCTURE SCHEDULE — concept, checklist S10.c (rim elevations read from the proposed surface of this sheet)

STR.	TYPE	LOCATION (u, v)	RIM / GRADE	DESCRIPTION / LOCATION
A-1	DOUBLE CURB INLET	(95, -169)	941.58	entry drive at the existing front swale
A-1B	JUNCTION BOX	(150, -122)	944.12	entry drive / lane junction — bend
A-2	CURB INLET	(300, -128)	943.02	lane, southwest edge of pavement
A-3	CURB INLET	(500, -127)	941.72	lane, southwest edge of pavement
A-4	CURB INLET	(650, -126)	940.56	lane, southwest edge of pavement
A-5	DOUBLE CURB INLET	(850, -126)	940.34	lane sag at PVI 2
A-6	JUNCTION BOX	(806, -134)	938.74	Pond 1 tract; also receives Line B
A-7	FLARED END SECTION	(806, -142)	936.07	into the Pond 1 forebay
B-1	CURB INLET	(1140, -129)	949.21	lane, southeast of the crest at PVI 3
B-2	CURB INLET	(1046, -126)	946.70	lane, southwest edge of pavement
B-3	CURB INLET	(930, -126)	941.40	lane, southwest edge of pavement
C-1	CURB INLET	(1190, -125)	948.54	lane tract at the Pond 2 access
C-2	CURB INLET	(1330, -125)	941.46	lane, southwest edge of pavement
C-3	DOUBLE CURB INLET	(1470, -125)	935.70	lane sag at PVI 4
C-4	JUNCTION BOX	(1550, -132)	935.99	lane tract at the Pond 2 access
C-5	FLARED END SECTION	(1512, -140)	937.48	into the Pond 2 forebay
OF-1	HEADWALL + RIPRAP APRON	(805, -206)	932.74	Pond 1 outlet, thence level spreader
OF-2	HEADWALL + RIPRAP APRON	(1496, -206)	937.65	Pond 2 outlet, thence level spreader


PIPE CHART — concept sizes and slopes; final design by the PE

REACH	PIPE	LENGTH	SLOPE %	INV. UP	INV. DN	COVER R
A-1 ~ A-1B	24" RCP	72	0.35	936.20	935.95	1.4
A-1B ~ A-2	24" RCP	150	0.35	935.95	935.42	6.2
A-2 ~ A-3	24" RCP	200	0.35	935.42	934.72	5.6
A-3 ~ A-4	24" RCP	180	0.35	934.72	934.09	5.0
A-4 ~ A-5	24" RCP	150	0.35	934.09	933.57	4.5
A-5 ~ A-6	24" RCP	31	0.50	933.57	933.41	4.8
A-6 ~ A-7	24" RCP	147	0.50	933.41	933.36	3.3
B-1 ~ B-2	18" RCP	100	2.50	945.20	942.70	2.5
B-2 ~ B-3	18" RCP	110	4.80	942.70	937.42	2.5
B-3 ~ A-6	18" RCP	130	3.00	937.42	933.51	2.5
C-1 ~ C-2	18" RCP	140	5.10	944.20	937.06	2.8
C-2 ~ C-3	18" RCP	140	4.20	937.06	931.18	2.9
C-3 ~ C-4	24" RCP	31	0.50	931.18	931.03	2.5
C-4 ~ C-5	24" RCP	147	0.50	931.03	930.56	3.0
POND 1 OCS ~ OF-1	24" RCP	21	1.40	930.50	930.20	—
POND 2 OCS ~ OF-2	24" RCP	16	1.40	932.00	931.78	—

Cover is measured from the structure rim to the top of the pipe barrel. All pipe reinforced concrete to Gwinnett County standards.

LANE PROFILE — PRIVATE LANE CENTRELINE, u = 149 TO u = 1699

HORIZONTAL 1" = 60' · VERTICAL 1" = 10' · EXAGGERATION 6:1 · DATUM ELEV. 930 · NAVD83 · DRAFT — NOT SEALED — grading and profile design must be sealed by a Georgia PE

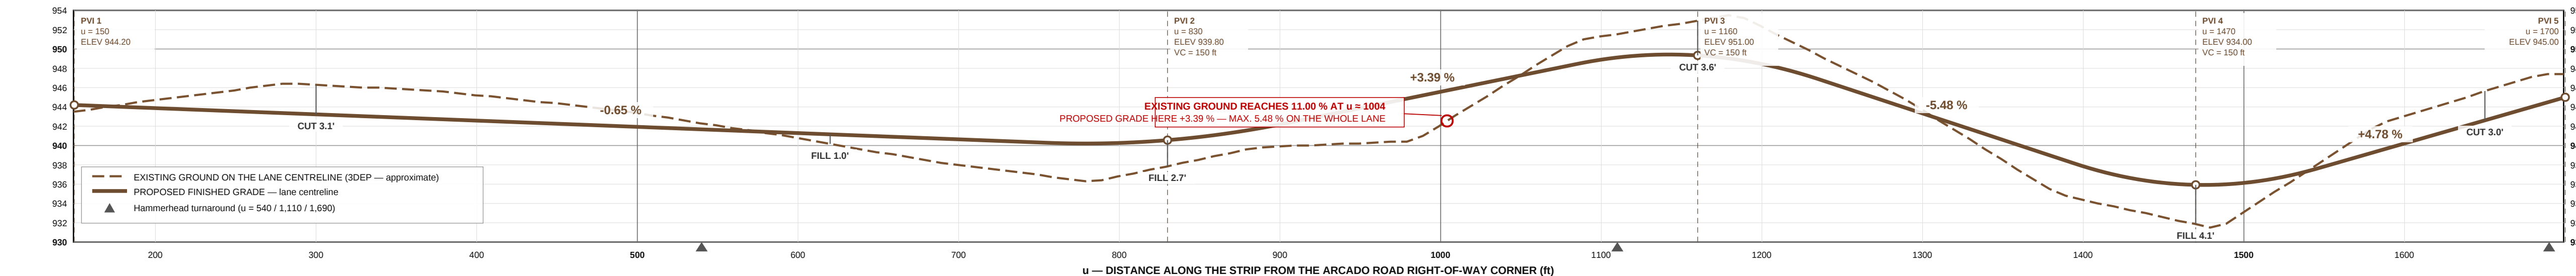

Disclaimer: This is an AI-generated analysis for preliminary planning purposes. All findings must be verified by a licensed professional before use in design, permitting, or regulatory submissions.

Label: DRAFT / NOT SEALED — every item that must be sealed by a Georgia RLS, PE, architect or landscape architect is shown as a concept only. Statements of conformity read "appears consistent with".

THE COTTAGES AT ARCADE SPRINGS

GRADING, DRAINAGE AND STORMWATER CONCEPT — Rezoning R-1 → R-2 (City of Lilburn, Georgia)

4535 / 4537 / 4539 / 4541 Arcado Rd SW, Lilburn, GA 30047 — Land Lot 123, 6th District, Gwinnett County — PINs R6123 033, 015, 014, 162 — 9.44 ac (deeded)

Proposed grading, drainage-area map, detention concept and lane profile — 2026 Application Instructions item 8; City of Lilburn Site Development Plan Review Checklist S4.e, S7, S10, S11

APPLICANT / OWNER

Mohammed Awad

4541 Arcado Rd SW, Lilburn GA 30047-3968 (parcels 033, 015); Mendez / Roblero de Leon (parcels 014, 162) — co-applicants, owner signatures required

PREPARED FOR

Pre-application conference, City of Lilburn Planning & Zoning (340 Main St) — rezoning application per Ord. 2023-603 S1003 (2026 Application Instructions)

STATUS