


Round 2 diagnostic only — this is an inner safe-ball certificate, not an upper bound on all safe inputs

(a) Sufficient Strong-Allee amplitude certificate



(b) Certified-ball fraction of generic energy cap

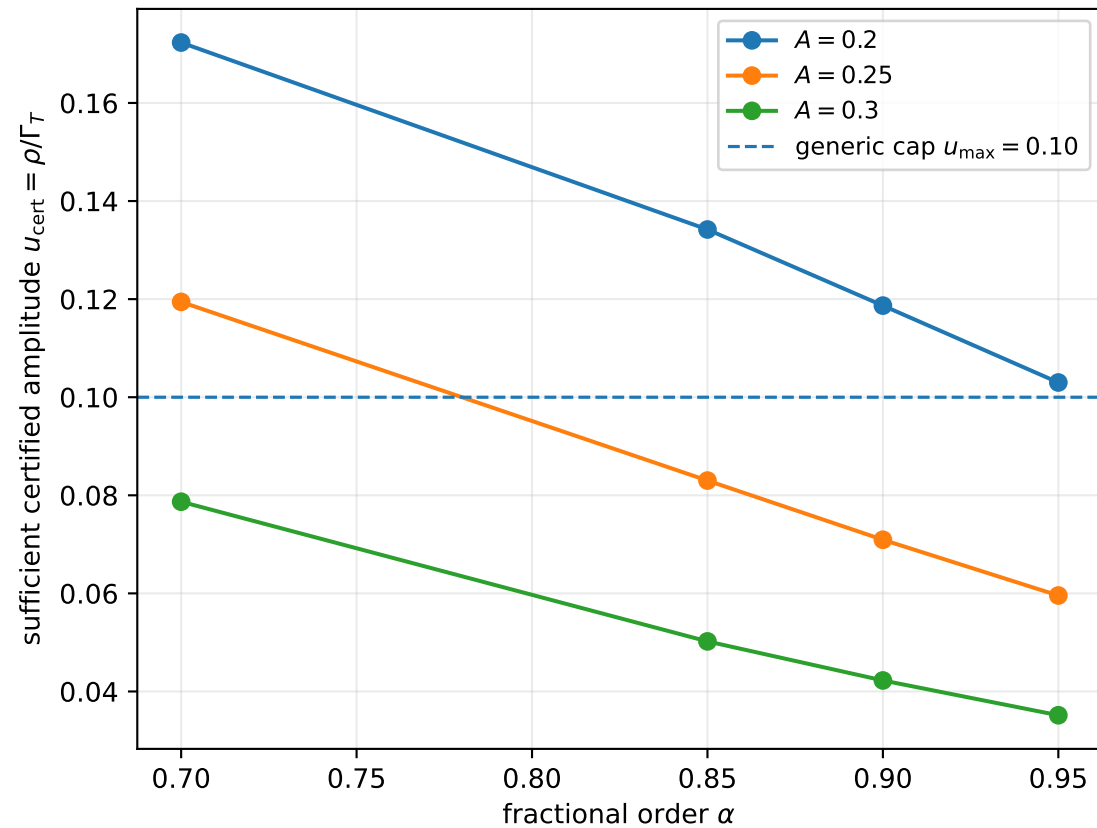