MASTER COPY

BIOMEDICAL LIMITED

TEMPERATURE MAPPING

INFUSION STORES

LOCATION – INFUSION STORES

DOC. NO. – BML/QDF/QA/TMR/001

PROVIDED BY:

BIOMEDICAL LIMTED

KWARA STATE, NIGERIA

CONTROL COPY

MASTER COPY

Contents

APPROVAL 3
INTRODUCTION 4
TEMPERATURE MAPPING STUDY OVERVIEW 5
DATA COLLECTION GUIDE 6
SPATIAL MAP 7
TEMPERATURE/HUMIDITY MAPPING DATA 9
- APPROVED FINISHED GOODS STORE: AUGUST 2025 9
- QUARANTINE FINISHED GOODS STORE: AUGUST 2025 11
- PACKAGING MATERIAL STORE: AUGUST 2025 13
- APPROVED RAW MATERIAL STORE: AUGUST 2025 15
- QUARANTINED RAW MATERIAL STORE: AUGUST 2025 17

SUMMARY OF DATA 19
DISCUSSION OF DATA 20
CONCLUSION 20
RECOMMENDATION 20
ATTACHMENT 21

CONTROL COPY

MASTER COPY

APPROVAL

	WRITTEN:	REVIEWED:
Signature:		
Position:		
Date:		

	APPROVED	AUTHORISED
Signature:		
Position:		
Date:		

CONTROL COPY

MASTER COPY

INTRODUCTION

This mapping study document explains how conditions change in the store and its suitability for its use. The study determines where hot and cold spots appear and proffers recommendations for continuous use of the storage area.

The mapping exercise of the storage areas will ensure that the company will understand its storage area and identify any potential areas therein that may be unsuitable for storing materials/medicines.

The study results are included in this report and observing the standard operating procedure (BML/QDG/QA/043) in mind against overall regulatory requirements for the storage of drug substances, intermediates, and products.

CONTROL COPY

MASTER COPY

TEMPERATURE MAPPING STUDY OVERVIEW

Company and Location	BIOMEDICAL LIMITED 1, Ohimege Road, Gaa-Imam Industrial Estate, Ilorin. Kwara state
Facility	Infusion plant: Raw Material Store Packaging Material Store Finished Goods Store (Quarantine and Approved)
Raining season / Dry season	Wet
Temperature/Relative Humidity Type	*See Protocol for Calibration of Thermohygrometers* Analogue Thermohygrometer BL/THM/THA/xxx
Number of Devices Used	Approved Raw Materials Store (ARMS) – 8, Quarantine Raw Material Store (QRMS) – 5 Quarantine Finished Goods Store (QFGS) – 8, Approved Finished Goods Store (AFGS) – 8, Packaging Material Store (PMS) - 6
Device Position	Corners and spatial centers
Date mapping started	11/08/2025
Date mapping Ended	17/08/2025
Required Range	Temperature, T: not more than 32°C, Humidity, H: not more than 75%
Alert Limit	T:30°C, H: 68%
Action limit	T:32°C, H:70%

TEMPERATURE/RELATIVE HUMIDITY SPECIFICATION

Temperature/Relative Humidity Type	Analogue thermohygrometer
Thermohygrometer bandwidth	T:1°C, H:1%
Recording Interval	2 Hours
Temperature Range	Not more than 32°C
Relative Humidity Range	Not More Than 75%

CONTROL COPY

MASTER COPY

DATA COLLECTION GUIDE

Data shall be collected for the raw material store, packaging material store, bottle room, approved finished goods store, and cold room. Data collected shall be statistically treated and discussed, and recommendations shall be proffered when the need arises. Data collected shall be for seven consecutive days, including five work-days and two weekend days in the season. All values of Temperature (T) and Relative Humidity (H) have units °C and % respectively.

Collection Schedule:

Dry season (December to March): January & February

Raining season (April to November): August & September

CONTROL COPY

SPATIAL MAP

QUARANTINVE AND APPROVED FINISHED GOODS STORE SPATIAL POSITIONING OF SENSORS

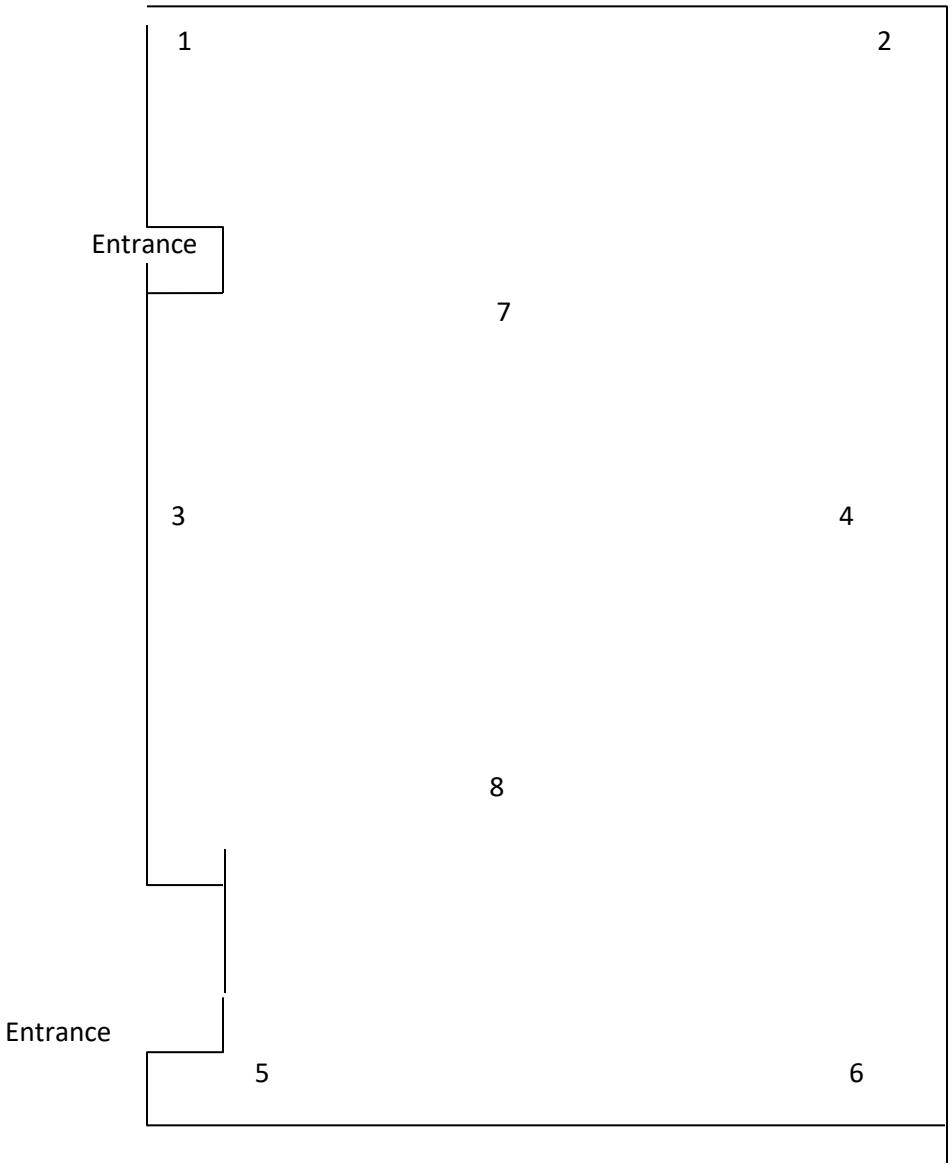

PACKAGING MATERIAL STORE SPATIAL POSITIONING OF SENSORS

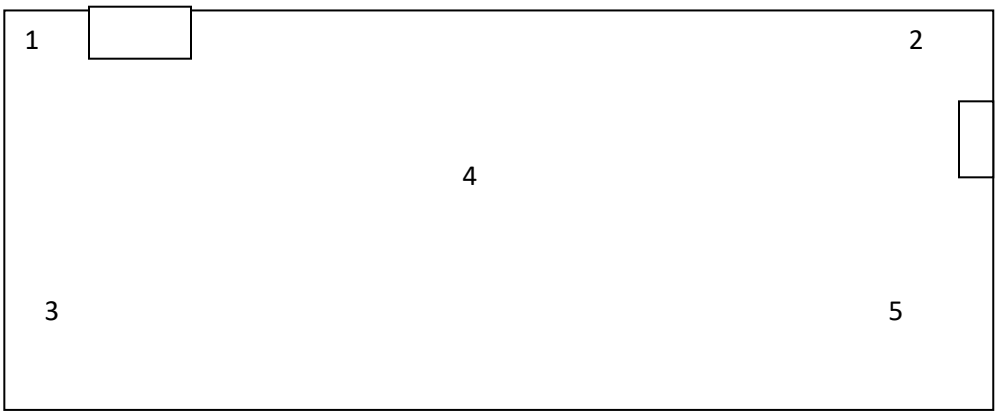

RAW MATERIAL STORE SPATIAL POSITIONING OF SENSORS

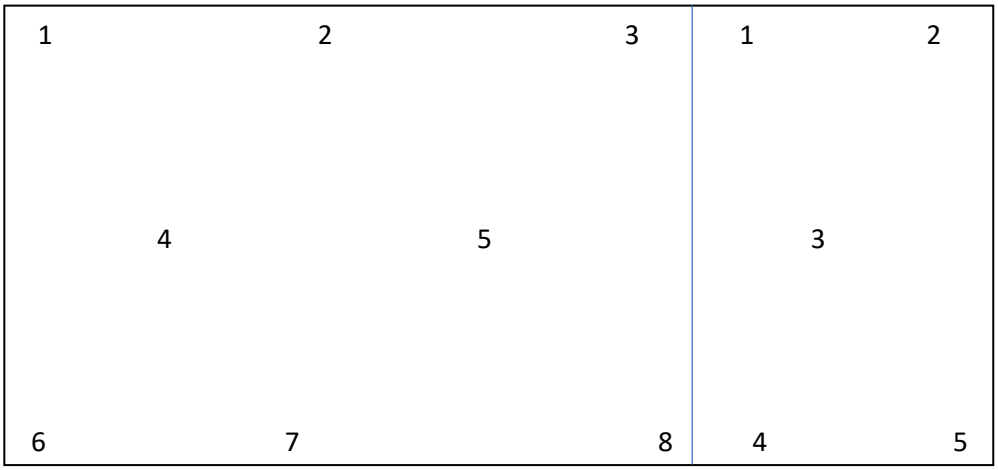

TEMPERATURE/HUMIDITY MAPPING DATA

APPROVED FINISHED GOODS STORE: AUGUST 2025

S/N	DATE	TIME	DEPT	READINGS																MEAN	
				1		2		3		4		5		6		7		8			
				T	H	T	H	T	H	T	H	T	H	T	H	T	H	T	H	T	H
1	11/08/2025	9:00 AM	AFGS	23	63	22	64	23	62	22	65	21	64	22	63	23	64	22	62	22.25	63.38
		11:00 AM	AFGS	25	60	26	61	24	62	25	60	25	61	24	62	26	60	25	61	25	60.88
		1:00 PM	AFGS	27	58	28	59	27	57	26	58	26	57	27	58	26	57	27	56	26.75	57.5
		3:00 PM	AFGS	29	55	28	56	29	54	28	55	27	54	28	55	28	53	29	54	28.25	54.5
2	12/08/2025	9:00 AM	AFGS	22	64	23	65	22	64	23	63	22	65	24	64	23	66	22	64	22.63	64.38
		11:00 AM	AFGS	24	61	25	60	24	62	25	61	26	60	25	61	24	62	25	60	24.75	60.88
		1:00 PM	AFGS	27	58	26	59	27	57	26	58	27	57	26	58	27	56	26	58	26.5	57.63
		3:00 PM	AFGS	29	54	28	55	27	56	28	54	29	53	28	54	29	55	28	54	28.25	54.38
3	13/08/2025	9:00 AM	AFGS	23	64	22	63	23	65	22	64	21	66	23	64	22	65	22	63	22.25	64.25
		11:00 AM	AFGS	25	61	26	62	25	63	26	62	25	63	24	61	26	62	25	61	25.25	61.88
		1:00 PM	AFGS	27	57	26	58	27	59	26	57	27	58	26	57	27	58	26	57	26.5	57.63
		3:00 PM	AFGS	28	56	29	54	28	55	27	56	29	55	28	54	29	53	28	55	28.25	54.75
4	14/08/2025	9:00 AM	AFGS	22	65	23	64	22	63	21	64	22	65	23	64	22	63	23	64	22.25	64
		11:00 AM	AFGS	24	62	25	61	24	62	25	60	26	61	25	62	24	61	25	60	24.75	61.13
		1:00 PM	AFGS	27	59	28	58	27	57	26	58	27	57	28	58	27	56	26	57	27	57.5
		3:00 PM	AFGS	29	55	28	56	29	54	28	55	27	54	28	55	29	53	28	54	28.25	54.5
5	15/08/2025	9:00 AM	AFGS	22	63	23	64	22	63	21	62	22	63	23	64	22	63	23	64	22.25	63.25
		11:00 AM	AFGS	24	60	25	61	24	60	23	59	25	60	24	61	25	60	24	61	24.25	60.25

CONTROL COPY

		1:00 PM	AFGS	26	56	27	57	26	58	27	57	26	56	27	57	26	56	27	58	26.5	56.88
		3:00 PM	AFGS	28	54	29	53	28	55	27	54	28	53	27	54	29	52	28	54	28	53.63
6	16/08/2023	9:00 AM	AFGS	22	64	21	63	22	63	23	62	23	63	22	64	21	63	22	62	22	63
		11:00 AM	AFGS	24	61	25	60	24	61	26	60	25	60	23	62	23	61	24	60	24.25	60.63
		1:00 PM	AFGS	27	57	26	57	27	58	27	57	26	57	25	59	26	58	25	57	26.13	57.5
		3:00 PM	AFGS	28	54	28	55	28	55	29	54	28	55	27	56	27	55	26	54	27.63	54.75
7	17/08/2023	9:00 AM	AFGS	21	63	22	64	23	62	22	63	22	63	23	62	22	64	23	63	22.25	63
		11:00 AM	AFGS	24	59	25	62	25	59	24	61	24	60	25	60	25	62	25	61	24.63	60.5
		1:00 PM	AFGS	26	56	26	59	27	57	26	58	26	57	27	57	27	58	27	57	26.5	57.38
		3:00 PM	AFGS	28	54	27	56	28	54	28	55	27	54	29	55	28	56	29	55	28	54.88
Mean																				25.4025	59.1007143
MIN				21	54	21	53	22	54	21	54	21	53	22	54	21	52	22	54		
MAX				29	65	29	65	29	65	29	65	29	66	29	64	29	66	29	64		

QUARANTINE FINISHED GOODS STORE: AUGUST 2025

				READINGS																MEAN	
				1		2		3		4		5		6		7		8			
S/N	DATE	TIME	DEPT	T	H	T	H	T	H	T	H	T	H	T	H	T	H	T	H	T	H
1	11/08/2025	9:00 AM	QFGS	24	63	22	66	21	64	23	65	22	62	24	64	21	65	23	63	22.5	64
		11:00 AM	QFGS	23	62	26	60	24	63	25	61	23	62	26	60	24	62	25	61	24.5	61.375
		1:00 PM	QFGS	28	57	25	60	27	58	26	60	28	57	25	59	27	58	26	60	26.5	58.625
		3:00 PM	QFGS	29	55	27	56	30	53	28	56	27	54	29	55	27	56	28	54	28.125	54.875
2	12/08/2025	9:00 AM	QFGS	23	64	21	66	22	63	24	64	23	62	22	65	24	63	21	64	22.5	63.875
		11:00 AM	QFGS	26	62	23	61	25	63	24	62	26	61	23	60	25	62	24	63	24.5	61.75
		1:00 PM	QFGS	25	59	27	60	26	61	27	58	25	60	27	59	26	60	27	59	26.25	59.5
		3:00 PM	QFGS	28	57	29	55	27	58	30	54	28	57	29	56	27	57	28	55	28.25	56.125
3	13/08/2025	9:00 AM	QFGS	23	62	22	66	21	64	23	65	22	63	24	64	21	66	22	63	22.25	64.125
		11:00 AM	QFGS	26	61	23	63	25	62	24	61	26	63	24	60	23	62	25	61	24.5	61.625
		1:00 PM	QFGS	27	61	26	59	25	60	27	58	26	61	28	59	25	60	27	58	26.375	59.5
		3:00 PM	QFGS	29	55	28	57	30	54	27	56	28	55	29	57	27	54	28	56	28.25	55.5
4	14/08/2025	9:00 AM	QFGS	24	62	21	65	22	63	23	64	24	61	22	64	23	62	21	65	22.5	63.25
		11:00 AM	QFGS	25	62	24	61	26	60	23	62	24	63	25	61	24	62	26	60	24.625	61.375
		1:00 PM	QFGS	27	59	26	60	25	58	28	59	26	57	27	58	25	59	26	58	26.25	58.5
		3:00 PM	QFGS	30	54	28	55	27	56	29	54	28	53	27	55	30	54	28	55	28.375	54.5
5	15/08/2025	9:00 AM	QFGS	23	62	21	64	24	63	22	62	23	63	24	62	21	64	22	63	22.5	62.875
		11:00 AM	QFGS	24	61	26	59	25	60	23	61	24	60	25	61	26	59	23	60	24.5	60.125
		1:00 PM	QFGS	27	56	25	58	26	57	27	59	26	56	25	58	27	57	26	59	26.125	57.5
		3:00 PM	QFGS	28	54	27	56	30	53	28	55	27	54	29	53	28	56	27	55	28	54.5
6	16/08/2025	9:00 AM	QFGS	22	64	24	62	21	65	23	63	22	64	21	63	23	62	22	65	22.25	63.5

		11:00 AM	QFGS	25	60	24	62	23	61	26	59	25	60	24	62	23	61	24	60	24.25	60.625
		1:00 PM	QFGS	26	58	27	57	25	59	26	57	27	56	25	58	26	57	27	58	26.125	57.5
		3:00 PM	QFGS	29	54	27	55	28	54	30	53	27	55	28	54	29	53	27	54	28.125	54
7	17/08/2025	9:00 AM	QFGS	22	65	23	63	24	62	21	64	23	63	22	62	24	63	21	64	22.5	63.25
		11:00 AM	QFGS	25	60	24	61	23	62	26	59	25	60	24	62	23	61	25	59	24.375	60.5
		1:00 PM	QFGS	26	59	27	57	25	58	26	60	27	56	26	58	25	59	27	57	26.125	58
		3:00 PM	QFGS	28	56	27	54	29	55	28	57	27	56	29	54	28	55	27	56	27.875	55.375
Mean																				25.3214286	59.5089286
MIN				22	54	21	54	21	53	21	53	22	53	21	53	21	53	21	54		
MAX				30	65	29	66	30	65	30	65	28	64	29	65	30	66	28	65		

PACKAGING MATERIAL STORE: AUGUST 2025

				READINGS										MEAN	
				1		2		3		4		5			
S/N	DATE	TIME	DEPT	T	H	T	H	T	H	T	H	T	H	T	H
1	11/08/2025	9:00 AM	PMS	23	62	21	65	24	61	22	64	23	62	22.6	62.8
		11:00 AM	PMS	24	61	25	59	23	62	26	60	24	58	24.4	60
		1:00 PM	PMS	28	56	27	58	26	57	25	59	27	56	26.6	57.2
		3:00 PM	PMS	30	54	29	55	28	53	27	56	29	54	28.6	54.4
2	12/08/2025	9:00 AM	PMS	23	64	22	63	24	65	21	62	23	63	22.6	63.4
		11:00 AM	PMS	27	60	24	62	25	61	26	59	24	60	25.2	60.4
		1:00 PM	PMS	28	58	26	57	27	59	25	58	26	56	26.4	57.6
		3:00 PM	PMS	29	55	30	54	28	56	27	54	28	53	28.4	54.4
3	13/08/2025	9:00 AM	PMS	22	63	23	64	21	62	24	65	22	63	22.4	63.4
		11:00 AM	PMS	26	60	25	61	24	63	23	59	24	62	24.4	61
		1:00 PM	PMS	27	57	28	56	26	58	27	59	25	57	26.6	57.4
		3:00 PM	PMS	30	54	28	55	29	54	27	56	28	55	28.4	54.8
4	14/08/2025	9:00 AM	PMS	24	64	22	63	23	65	21	62	24	63	22.8	63.4
		11:00 AM	PMS	25	61	26	60	24	62	23	59	25	60	24.6	60.4
		1:00 PM	PMS	28	57	27	58	26	56	25	59	27	57	26.6	57.4
		3:00 PM	PMS	30	55	29	54	28	56	27	53	28	55	28.4	54.6
5	15/08/2025	9:00 AM	PMS	23	63	24	62	22	64	23	65	21	63	22.6	63.4
		11:00 AM	PMS	26	60	24	61	25	62	23	59	24	60	24.4	60.4
		1:00 PM	PMS	27	58	28	57	26	59	25	56	27	58	26.6	57.6
		3:00 PM	PMS	29	54	27	55	28	53	30	56	28	54	28.4	54.4
6	16/08/2023	9:00 AM	PMS	22	62	23	63	21	64	24	65	22	63	22.4	63.4
		11:00 AM	PMS	24	60	26	61	25	62	23	59	24	60	24.4	60.4

CONTROL COPY

		1:00 PM	PMS	27	57	26	58	28	56	25	59	27	58	26.6	57.6
		3:00 PM	PMS	29	55	28	54	27	56	30	53	28	55	28.4	54.6
7	17/08/2023	9:00 AM	PMS	23	63	22	64	24	62	21	65	23	63	22.6	63.4
		11:00 AM	PMS	25	61	24	60	26	62	23	59	24	60	24.4	60.4
		1:00 PM	PMS	27	58	26	57	28	56	25	59	27	58	26.6	57.6
		3:00 PM	PMS	30	54	29	55	28	53	27	56	28	54	28.4	54.4
Mean														25.52857143	58.93571429
MIN				22	54	21	54	21	53	21	53	21	53		
MAX				30	64	30	65	29	65	30	65	29	63		

APPROVED RAW MATERIAL STORE: AUGUST 2025

				READINGS																MEAN	
				1		2		3		4		5		6		7		8			
S/N	DATE	TIME	DEPT	T	H	T	H	T	H	T	H	T	H	T	H	T	H	T	H	T	H
1	11/08/2025	9:00 AM	ARM	23	62	22	64	24	61	23	63	22	62	24	61	23	62	22	63	22.875	62.25
		11:00 AM	ARM	25	60	23	61	24	59	26	60	24	58	25	59	26	58	24	60	24.625	59.375
		1:00 PM	ARM	28	57	26	58	27	56	26	57	25	59	27	56	28	55	26	57	26.625	56.875
		3:00 PM	ARM	29	54	28	55	30	53	27	54	28	55	29	53	28	54	27	55	28.25	54.125
2	12/08/2025	9:00 AM	ARM	22	63	21	65	23	62	22	64	24	63	23	62	22	63	23	62	22.5	63
		11:00 AM	ARM	24	61	26	60	25	59	23	61	24	60	25	59	26	58	24	60	24.625	59.75
		1:00 PM	ARM	27	58	26	57	28	59	25	56	27	57	26	56	27	55	26	57	26.5	56.875
		3:00 PM	ARM	28	54	29	55	27	53	28	54	26	55	27	54	28	53	27	54	27.5	54
3	13/08/2025	9:00 AM	ARM	23	63	24	62	22	64	21	65	23	63	22	63	23	62	22	64	22.5	63.25
		11:00 AM	ARM	26	60	25	62	24	61	23	59	24	60	25	61	24	60	25	59	24.5	60.25
		1:00 PM	ARM	27	57	28	58	26	56	27	59	25	57	26	58	27	57	26	56	26.5	57.25
		3:00 PM	ARM	30	54	29	55	28	53	27	54	29	56	28	55	29	54	28	55	28.5	54.5
4	14/08/2025	9:00 AM	ARM	21	64	23	63	22	65	24	62	22	63	23	62	22	64	23	63	22.5	63.25
		11:00 AM	ARM	24	60	25	61	26	59	23	60	24	61	25	60	24	61	25	60	24.5	60.25
		1:00 PM	ARM	28	56	27	57	26	58	25	59	27	57	26	58	27	57	26	58	26.5	57.5
		3:00 PM	ARM	29	55	28	54	30	56	27	53	28	55	29	54	28	55	27	54	28.25	54.5
5	15/08/2025	9:00 AM	ARM	23	62	22	64	21	63	24	65	22	63	23	63	22	64	23	63	22.5	63.375
		11:00 AM	ARM	25	60	24	61	26	59	23	60	24	62	25	60	24	61	25	60	24.5	60.375
		1:00 PM	ARM	27	58	26	57	28	56	25	59	27	57	26	58	27	57	26	58	26.5	57.5
		3:00 PM	ARM	28	54	29	55	27	53	30	56	28	54	29	55	28	54	27	55	28.25	54.5
6	16/08/2023	9:00 AM	ARM	22	63	23	62	24	64	21	65	22	63	23	62	22	64	23	63	22.5	63.25

		11:00 AM	ARM	26	60	24	61	25	59	23	62	24	60	25	60	24	61	25	60	24.5	60.375
		1:00 PM	ARM	27	57	28	58	26	59	27	56	25	57	26	58	27	57	26	58	26.5	57.5
		3:00 PM	ARM	29	55	28	54	27	56	30	53	28	55	29	54	28	55	27	54	28.25	54.5
7	17/08/2023	9:00 AM	ARM	23	63	22	65	21	64	24	62	23	63	22	63	23	62	22	64	22.5	63.25
		11:00 AM	ARM	24	61	25	60	23	62	26	61	24	60	25	61	24	60	25	61	24.5	60.75
		1:00 PM	ARM	28	57	26	58	27	59	25	56	27	57	26	58	27	57	26	58	26.5	57.5
		3:00 PM	ARM	30	54	28	55	29	53	27	56	28	54	29	55	28	54	27	55	28.25	54.5
Mean																				25.44642857	58.72767857
MIN				21	54	21	54	21	53	21	53	22	54	22	53	22	53	22	54		
MAX				30	64	29	65	30	65	30	65	29	63	29	63	29	64	28	64		

QUARANTINED RAW MATERIAL STORE: AUGUST 2025

				READINGS										MEAN	
				1		2		3		4		5			
S/N	DATE	TIME	DEPT	T	H	T	H	T	H	T	H	T	H	T	H
1	11/08/2025	9:00 AM	QRMS	23	62	22	64	21	63	23	62	22	63	22.2	62.8
		11:00 AM	QRMS	25	60	24	61	23	60	24	62	23	61	23.8	60.8
		1:00 PM	QRMS	26	57	25	58	27	59	26	57	25	58	25.8	57.8
		3:00 PM	QRMS	28	54	27	55	26	56	27	54	28	53	27.2	54.4
2	12/08/2025	9:00 AM	QRMS	22	63	23	62	22	64	21	63	23	64	22.2	63.2
		11:00 AM	QRMS	24	61	25	60	24	62	23	61	25	60	24.2	60.8
		1:00 PM	QRMS	27	58	26	57	28	58	26	59	27	57	26.8	57.8
		3:00 PM	QRMS	29	55	28	54	27	56	28	55	29	54	28.2	54.8
3	13/08/2025	9:00 AM	QRMS	21	63	22	62	23	64	22	63	21	64	21.8	63.2
		11:00 AM	QRMS	24	61	25	60	23	62	24	59	24	61	24	60.6
		1:00 PM	QRMS	26	58	27	57	26	59	27	56	26	57	26.4	57.4
		3:00 PM	QRMS	28	55	27	56	29	54	28	53	27	55	27.8	54.6
4	14/08/2025	9:00 AM	QRMS	23	62	22	63	24	62	23	64	22	63	22.8	62.8
		11:00 AM	QRMS	25	61	24	60	26	60	24	61	25	59	24.8	60.2
		1:00 PM	QRMS	27	58	26	57	25	59	27	58	26	57	26.2	57.8
		3:00 PM	QRMS	29	56	27	54	28	55	27	56	28	54	27.8	55
5	15/08/2025	9:00 AM	QRMS	22	63	21	64	23	63	22	62	23	64	22.2	63.2
		11:00 AM	QRMS	24	60	25	61	24	62	23	60	24	61	24	60.8
		1:00 PM	QRMS	27	58	26	57	25	59	27	58	26	57	26.2	57.8
		3:00 PM	QRMS	28	55	29	54	27	56	28	55	27	54	27.8	54.8
6	16/08/2023	9:00 AM	QRMS	23	62	22	64	21	63	23	62	22	63	22.2	62.8

CONTROL COPY

		11:00 AM	QRMS	25	60	24	61	23	60	25	61	24	59	24.2	60.2
		1:00 PM	QRMS	27	56	26	58	27	59	26	58	27	57	26.6	57.6
		3:00 PM	QRMS	28	53	27	56	29	54	27	55	28	54	27.8	54.4
7	17/08/2023	9:00 AM	QRMS	22	62	23	63	22	64	21	63	23	62	22.2	62.8
		11:00 AM	QRMS	25	59	24	61	25	60	23	61	24	60	24.2	60.2
		1:00 PM	QRMS	27	57	26	58	25	57	26	58	27	56	26.2	57.2
		3:00 PM	QRMS	29	54	28	55	27	54	28	53	27	54	27.8	54
Mean														25.12142857	58.92142857
MIN				21	53	21	54	21	54	21	53	21	53		
MAX				29	63	29	64	29	64	28	64	29	64		

SUMMARY OF DATA

S/N	Unit	Average daily condition for the duration		Minimum for the duration		Maximum for the duration	
		T	H	T	H	T	H
1	A. Finished Goods Store	25.403	59.101	21	53	29	66
2	Q. Finished Goods Store	25.3321	59.509	21	53	30	65
3	Packaging Material Store	25.529	59.936	21	53	30	65
4	A. Raw Material Store	25.446	58.728	21	53	30	65
5	Q. Raw Material Store	25.121	58.92	21	53	29	64

DISCUSSION OF DATA

Environmental monitoring of temperature and relative humidity was conducted in the Finished Goods Stores, Raw Material Stores, and Packaging Material Store over the monitoring period. The results indicate that the average daily temperature across the monitored locations ranged from 25.121 °C to 25.529 °C, while the average relative humidity ranged from 58.728 % to 59.936 % RH. During the monitoring period, the recorded minimum temperature and relative humidity were 21 °C and 53 % RH, respectively, while the maximum temperature and relative humidity observed were 30 °C and 66 % RH.

Overall, the environmental conditions across all storage areas remained generally consistent and within acceptable operational ranges for controlled warehouse storage conditions, with only minor fluctuations observed during the monitoring period. The recorded values demonstrate that the facility maintains stable environmental control across the Finished Goods Store, Raw Material Store, and Packaging Material Store, indicating that the environmental control systems are functioning adequately to support proper storage conditions. Based on the results obtained, the monitored storage areas are considered suitable for the intended storage of materials and finished products under the specified environmental conditions.

CONCLUSION

These results indicate that the environmental conditions within the monitored storage areas were adequately controlled and maintained within acceptable operational ranges for warehouse storage conditions. Overall, the monitoring data collected in August 2025 demonstrate that the facility's environmental control systems are functioning effectively and that the storage areas are suitable for maintaining the quality and integrity of stored raw materials, packaging materials, and finished products.

RECOMMENDATION

Environmental monitoring of temperature and relative humidity in all storage areas should be continued at the established frequency to ensure that the environmental conditions remain within acceptable limits for the storage of raw materials, packaging materials, and finished products. Continuous monitoring and proper documentation will help maintain compliance with good storage and Good Manufacturing Practice

CONTROL COPY

(GMP) requirements while ensuring that any variations in environmental conditions are promptly detected and addressed.

Preventive maintenance of the AHUs should be carried out regularly to ensure consistent environmental control within the facility. In addition, all temperature and humidity monitoring devices should be calibrated according to the approved calibration schedule to ensure the accuracy and reliability of recorded data used for quality and regulatory purposes.

The Quality Unit should perform periodic reviews of environmental monitoring records to identify any unusual trends, fluctuations, or deviations from the expected conditions. Any out-of-specification readings should be documented and investigated appropriately, and corrective and preventive actions should be implemented where necessary to prevent recurrence.

Furthermore, it is recommended that environmental monitoring be conducted again during the next season to assess potential seasonal variations in temperature and relative humidity within the storage areas. This will help confirm that the facility's environmental control systems remain effective under different climatic conditions and will provide additional assurance of the suitability of the storage environment throughout the year.

ATTACHMENT

The following attachments are provided for this report.

s/no	Attachment	Description
1	Graph	Graphical representation for temperature distribution for each store
2	Graph	Graphical representation for humidity distribution for each store
3	Graph	Graphical representation for periodic mean distribution for each store

CONTROL COPY

MASTER COPY

FIGURES		
s/no	Figure	location
1	Fig. 1	Approved Finished Goods Store
2	Fig. 2	Quarantine Finished Goods Store
3	Fig. 3	Packaging Material Store
4	Fig. 4	Approved Raw Material Store
5	Fig. 6	Quarantine Raw Material Store

CONTROL COPY

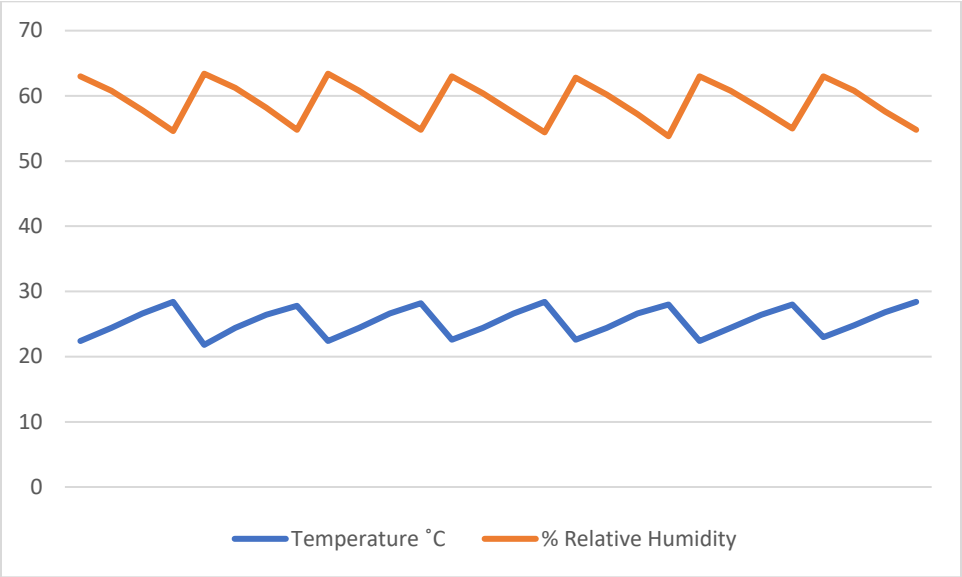

Fig. 1: distribution for the Approved Finished Goods Store

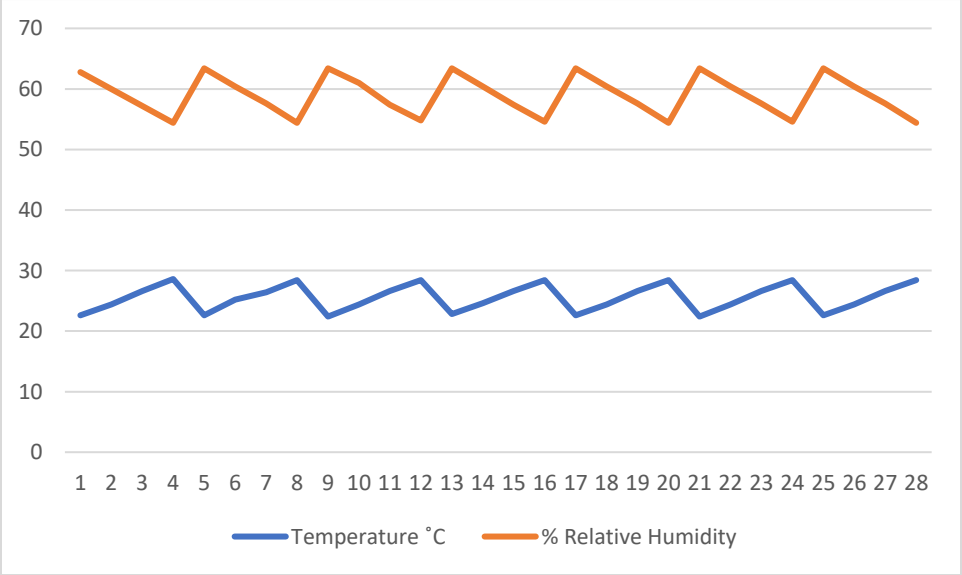

Fig. 2: distribution for the Quarantine Finished Goods Store

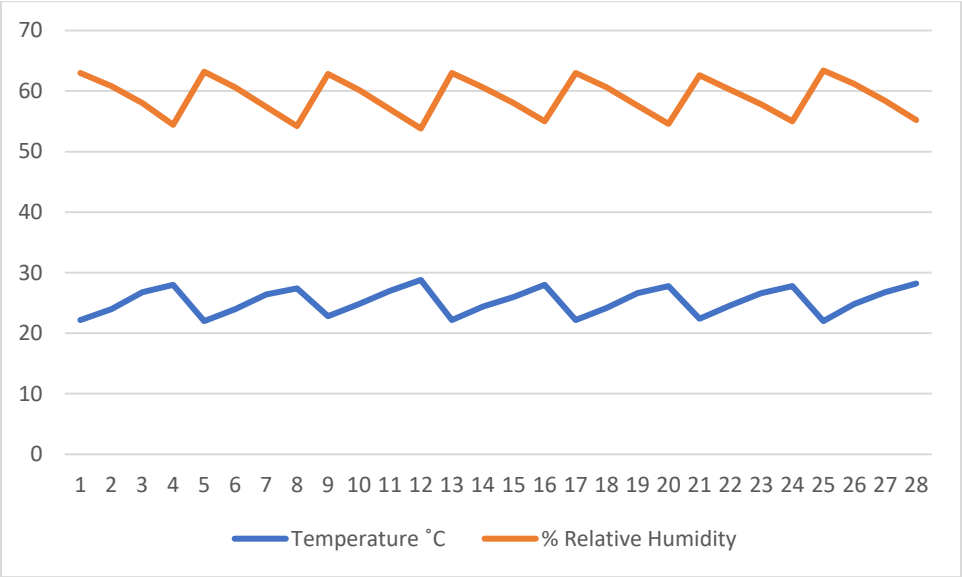

Fig. 3: distribution for the Packaging Material Store

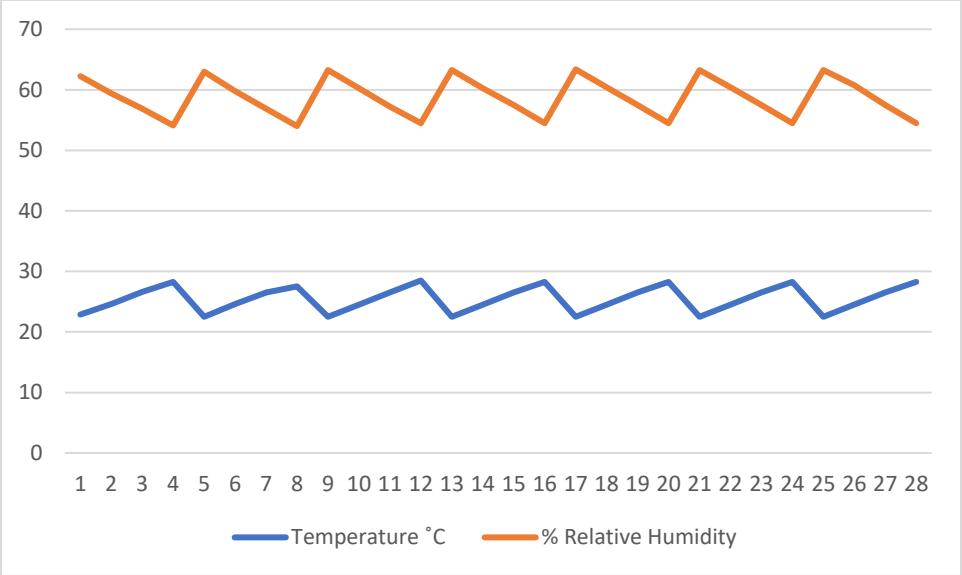

Fig. 4: distribution for the Approved Raw Material Store

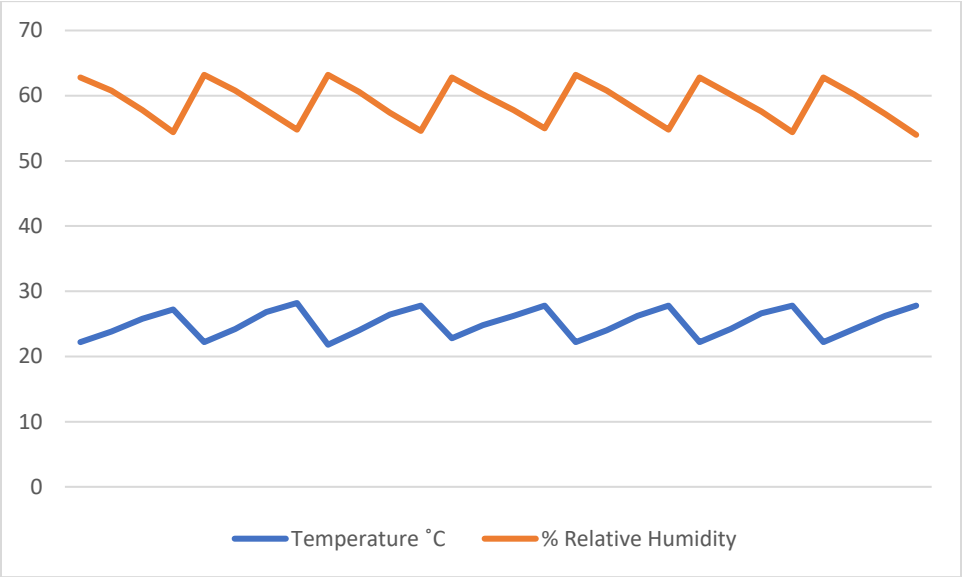

Fig. 5: environmental distribution for Quarantine Raw Material Store