Cable ID	Summary	Test Limit	Length	Headroom	Date / Time
1	PASS	TIA Cat 6 Channel	19.3 m	8.2 dB (NEXT)	12/21/2020 03:05 PM
2	PASS	TIA Cat 6 Channel	23.2 m	6.7 dB (NEXT)	12/21/2020 03:06 PM
3	PASS	TIA Cat 6 Channel	18.9 m	4.2 dB (NEXT)	12/20/2020 10:36 PM
4	PASS	TIA Cat 6 Channel	21.1 m	7.0 dB (NEXT)	12/20/2020 09:36 PM
5	PASS	TIA Cat 6 Channel	23.0 m	8.1 dB (NEXT)	12/21/2020 01:53 PM
6	PASS	TIA Cat 6 Channel	22.8 m	5.8 dB (NEXT)	12/20/2020 09:38 PM
7	PASS	TIA Cat 6 Channel	20.9 m	5.3 dB (NEXT)	12/20/2020 09:39 PM
8	PASS	TIA Cat 6 Channel	18.7 m	6.6 dB (NEXT)	12/20/2020 09:40 PM
9	PASS	TIA Cat 6 Channel	18.9 m	6.6 dB (NEXT)	12/21/2020 05:13 PM
10	PASS	TIA Cat 6 Channel	20.9 m	4.0 dB (NEXT)	12/21/2020 05:14 PM
11	PASS	TIA Cat 6 Channel	22.8 m	4.3 dB (NEXT)	12/21/2020 05:14 PM
12	PASS	TIA Cat 6 Channel	17.2 m	3.5 dB (NEXT)	12/21/2020 05:16 PM
13	PASS	TIA Cat 6 Channel	19.3 m	2.6 dB (NEXT)	12/21/2020 05:23 PM
14	PASS	TIA Cat 6 Channel	21.1 m	3.1 dB (NEXT)	12/21/2020 05:18 PM
15	PASS	TIA Cat 6 Channel	21.1 m	5.0 dB (NEXT)	12/20/2020 09:28 PM
16	PASS	TIA Cat 6 Channel	19.1 m	6.0 dB (NEXT)	12/20/2020 09:29 PM
17	PASS	TIA Cat 6 Channel	17.4 m	4.8 dB (NEXT)	12/20/2020 09:29 PM
18	PASS	TIA Cat 6 Channel	19.6 m	2.0 dB (NEXT)	12/20/2020 09:30 PM
19	PASS	TIA Cat 6 Channel	22.1 m	3.8 dB (NEXT)	12/20/2020 09:30 PM
20	PASS	TIA Cat 6 Channel	26.7 m	5.9 dB (NEXT)	12/20/2020 09:31 PM
21	PASS	TIA Cat 6 Channel	19.1 m	4.1 dB (NEXT)	12/20/2020 09:32 PM
22	PASS	TIA Cat 6 Channel	16.8 m	3.0 dB (NEXT)	12/21/2020 05:27 PM
23	PASS	TIA Cat 6 Channel	18.7 m	4.0 dB (NEXT)	12/21/2020 05:30 PM
24	PASS	TIA Cat 6 Channel	20.6 m	5.5 dB (NEXT)	12/20/2020 10:05 PM
25	PASS	TIA Cat 6 Channel	19.1 m	4.5 dB (NEXT)	12/21/2020 03:38 PM
26	PASS	TIA Cat 6 Channel	17.2 m	5.2 dB (NEXT)	12/21/2020 03:39 PM
27	PASS	TIA Cat 6 Channel	21.9 m	3.6 dB (NEXT)	12/21/2020 03:49 PM
28	PASS	TIA Cat 6 Channel	19.6 m	7.8 dB (NEXT)	12/21/2020 03:40 PM
29	PASS	TIA Cat 6 Channel	19.3 m	5.9 dB (NEXT)	12/21/2020 02:25 PM
30	PASS	TIA Cat 6 Channel	21.7 m	4.1 dB (NEXT)	12/21/2020 03:09 PM
31	PASS	TIA Cat 6 Channel	24.3 m	2.6 dB (NEXT)	12/21/2020 03:10 PM
32	PASS	TIA Cat 6 Channel	24.1 m	6.1 dB (NEXT)	12/21/2020 03:11 PM
33	PASS	TIA Cat 6 Channel	21.7 m	6.5 dB (NEXT)	12/21/2020 03:12 PM
34	PASS	TIA Cat 6 Channel	19.3 m	7.4 dB (NEXT)	12/21/2020 04:33 PM
35	PASS	TIA Cat 6 Channel	19.6 m	6.7 dB (NEXT)	12/21/2020 02:08 PM
36	PASS	TIA Cat 6 Channel	21.9 m	6.2 dB (NEXT)	12/21/2020 02:07 PM
37	PASS	TIA Cat 6 Channel	26.4 m	4.0 dB (NEXT)	12/21/2020 02:05 PM
38	PASS	TIA Cat 6 Channel	28.4 m	6.3 dB (NEXT)	12/21/2020 02:04 PM
39	PASS	TIA Cat 6 Channel	30.1 m	6.8 dB (NEXT)	12/20/2020 09:41 PM
40	PASS	TIA Cat 6 Channel	28.2 m	6.4 dB (NEXT)	12/20/2020 09:42 PM
41	PASS	TIA Cat 6 Channel	26.4 m	6.7 dB (NEXT)	12/20/2020 09:42 PM
42	PASS	TIA Cat 6 Channel	28.6 m	6.5 dB (NEXT)	12/21/2020 05:04 PM
43	PASS	TIA Cat 6 Channel	36.3 m	6.6 dB (NEXT)	12/20/2020 09:44 PM
44	PASS	TIA Cat 6 Channel	31.6 m	6.6 dB (NEXT)	12/20/2020 09:45 PM
45	PASS	TIA Cat 6 Channel	28.8 m	5.4 dB (NEXT)	12/20/2020 09:46 PM
46	PASS	TIA Cat 6 Channel	26.7 m	5.8 dB (NEXT)	12/21/2020 04:59 PM
47	PASS	TIA Cat 6 Channel	28.6 m	4.8 dB (NEXT)	12/21/2020 04:43 PM
48	PASS	TIA Cat 6 Channel	30.3 m	6.3 dB (NEXT)	12/21/2020 05:00 PM

Total Length:	1089.4 m
Number of Reports:	48
Number of Passing Reports:	48
Number of Failing Reports:	0
Number of Warning Reports:	0
Documentation Only:	0

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 1


Date / Time: 12/21/2020 03:05:16 PM
Headroom 8.2 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	92
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 3,6]	3.6
Insertion Loss Margin (dB)	[Pair 4,5]	29.2
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	8.2	8.4	8.2	8.5
Freq. (MHz)	247.5	234.5	247.5	247.0
Limit (dB)	33.2	33.6	33.2	33.2
Worst Pair	4,5	3,6	3,6	3,6
PS NEXT (dB)	9.3	9.4	9.9	9.5
Freq. (MHz)	78.5	57.8	247.0	246.5
Limit (dB)	38.9	41.2	30.2	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	17.0	20.1	20.0
Freq. (MHz)	3.6	3.6	248.5	248.5
Limit (dB)	52.1	52.1	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	17.3	17.5	20.7	19.8
Freq. (MHz)	1.0	5.1	248.5	248.0
Limit (dB)	60.3	46.1	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	15.5	14.8	37.5	37.8
Freq. (MHz)	5.9	6.1	247.5	247.0
Limit (dB)	55.5	55.1	-2.5	-2.5
Worst Pair	4,5	3,6	3,6	3,6
PS ACR-N (dB)	14.9	14.7	39.1	38.8
Freq. (MHz)	5.9	6.0	247.0	246.5
Limit (dB)	53.0	52.8	-5.4	-5.4





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	7.7	9.1	7.7	9.3
Freq. (MHz)	239.0	77.8	239.0	224.5
Limit (dB)	8.2	13.1	8.2	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 2

Date / Time: 12/21/2020 03:06:48 PM
Headroom 6.7 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	23.2
Prop. Delay (ns), Limit 555	[Pair 1,2]	111
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 7,8]	4.2
Insertion Loss Margin (dB)	[Pair 1,2]	28.1
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	6.7	8.2	8.3	8.2
Freq. (MHz)	147.5	231.0	233.0	231.0
Limit (dB)	37.1	33.7	33.6	33.7
Worst Pair	4,5	3,6	3,6	3,6
PS NEXT (dB)	8.0	9.3	9.6	9.5
Freq. (MHz)	78.3	231.0	233.0	247.0
Limit (dB)	38.9	30.8	30.7	30.2


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.3	16.3	18.6	18.7
Freq. (MHz)	3.6	3.6	247.5	247.5
Limit (dB)	52.1	52.1	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.7	16.8	19.6	18.7
Freq. (MHz)	1.1	1.1	247.5	247.5
Limit (dB)	59.2	59.2	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
ACR-N (dB)	14.3	14.5	35.3	36.7
Freq. (MHz)	4.3	4.4	233.0	246.5
Limit (dB)	58.5	58.2	-0.8	-2.4
Worst Pair	4,5	4,5	3,6	3,6
PS ACR-N (dB)	13.1	13.1	36.7	37.3
Freq. (MHz)	4.6	4.9	233.0	247.0
Limit (dB)	55.2	54.7	-3.8	-5.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.4	9.3	8.4	9.6
Freq. (MHz)	74.8	44.0	244.5	223.0
Limit (dB)	13.3	15.6	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

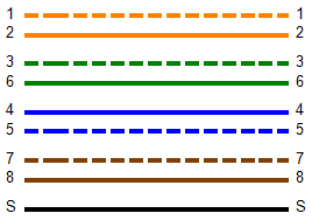
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 3

Date / Time: 12/20/2020 10:36:24 PM
Headroom 4.2 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	18.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	91
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.4
Insertion Loss Margin (dB)	[Pair 3,6]	29.3
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.2	5.3	5.3	5.3
Freq. (MHz)	73.5	60.0	228.5	215.0
Limit (dB)	42.2	43.7	33.8	34.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.3	5.7	7.9	6.6
Freq. (MHz)	66.5	60.0	242.0	236.0
Limit (dB)	40.1	40.9	30.4	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.2	17.3	17.2	17.4
Freq. (MHz)	245.5	4.0	246.0	246.0
Limit (dB)	15.5	51.2	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.9	16.0	19.2	18.4
Freq. (MHz)	1.0	1.0	245.0	245.5
Limit (dB)	60.3	60.3	12.5	12.5

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.7	10.1	35.4	34.5
Freq. (MHz)	6.3	6.4	248.5	235.5
Limit (dB)	54.9	54.7	-2.7	-1.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.5	10.6	36.8	35.8
Freq. (MHz)	6.0	6.3	242.0	243.0
Limit (dB)	52.8	52.4	-4.9	-5.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	6.9	8.2	8.0	8.2
Freq. (MHz)	175.5	120.0	243.0	216.5
Limit (dB)	9.6	11.2	8.1	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 4


Date / Time: 12/20/2020 09:36:40 PM
Headroom 7.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	100
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.6
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	7.0	7.8	8.2	8.5
Freq. (MHz)	76.8	99.5	247.0	230.0
Limit (dB)	41.9	40.0	33.2	33.7
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.5	8.0	9.5	9.2
Freq. (MHz)	70.3	100.0	246.5	236.5
Limit (dB)	39.7	37.1	30.3	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	17.0	18.6	18.3
Freq. (MHz)	3.6	3.6	248.5	248.0
Limit (dB)	52.1	52.1	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.9	15.9	19.5	19.2
Freq. (MHz)	1.0	1.0	248.5	248.5
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	12.9	12.3	37.0	37.8
Freq. (MHz)	5.5	5.8	247.0	247.0
Limit (dB)	56.1	55.7	-2.5	-2.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.8	12.7	38.3	37.9
Freq. (MHz)	5.5	5.6	246.5	243.0
Limit (dB)	53.6	53.4	-5.4	-5.0





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.5	8.8	8.8	8.8
Freq. (MHz)	173.5	221.0	244.5	221.0
Limit (dB)	9.6	8.6	8.1	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 5

Date / Time: 12/21/2020 01:53:55 PM
Headroom 8.1 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	23.0
Prop. Delay (ns), Limit 555	[Pair 1,2]	110
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 7,8]	4.1
Insertion Loss Margin (dB)	[Pair 1,2]	28.1
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	8.1	8.3	8.8	9.0
Freq. (MHz)	69.0	53.0	220.0	245.5
Limit (dB)	42.7	44.6	34.1	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.7	8.4	9.5	10.1
Freq. (MHz)	74.3	101.5	241.5	246.0
Limit (dB)	39.3	37.0	30.4	30.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.2	17.2	17.2	17.2
Freq. (MHz)	246.0	246.0	246.0	250.0
Limit (dB)	15.4	15.4	15.4	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	17.0	17.0	18.7	18.3
Freq. (MHz)	17.1	38.8	250.0	246.0
Limit (dB)	35.6	28.5	12.3	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	13.7	13.4	35.1	37.1
Freq. (MHz)	4.8	5.0	220.0	245.5
Limit (dB)	57.5	57.0	0.7	-2.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.4	13.1	37.2	38.1
Freq. (MHz)	4.9	4.9	241.5	246.0
Limit (dB)	54.7	54.7	-4.8	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	4,5	4,5	4,5
RL (dB)	8.4	8.8	8.8	9.5
Freq. (MHz)	45.3	48.8	243.0	226.0
Limit (dB)	15.4	15.1	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 6


Date / Time: 12/20/2020 09:38:34 PM
Headroom 5.8 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	22.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	109
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.1
Insertion Loss Margin (dB)	[Pair 3,6]	28.2
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	5.8	6.3	6.5	7.9
Freq. (MHz)	184.5	185.0	223.0	248.5
Limit (dB)	35.4	35.4	34.0	33.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.0	7.5	8.4	8.4
Freq. (MHz)	151.5	157.0	223.0	240.5
Limit (dB)	34.0	33.7	31.0	30.4

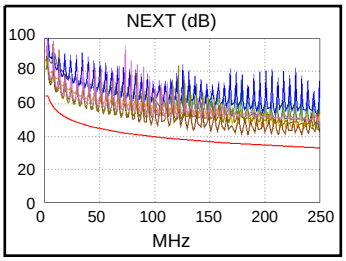





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.0	18.0	18.7	18.7
Freq. (MHz)	176.5	176.5	244.0	244.0
Limit (dB)	18.3	18.3	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.1	17.0	19.7	19.4
Freq. (MHz)	1.0	1.0	244.0	244.0
Limit (dB)	60.3	60.3	12.5	12.5

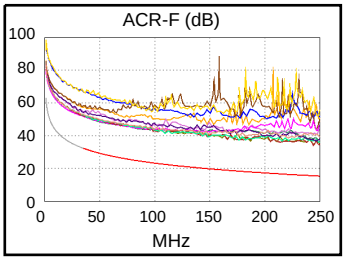





N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	13.7	13.9	32.9	36.5
Freq. (MHz)	4.9	5.1	223.0	248.5
Limit (dB)	57.2	56.8	0.4	-2.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.8	12.9	34.8	36.0
Freq. (MHz)	4.9	4.9	223.0	240.5
Limit (dB)	54.7	54.7	-2.6	-4.7

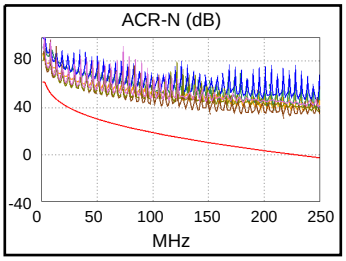



PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	4,5	4,5	4,5
RL (dB)	8.5	8.7	9.2	8.7
Freq. (MHz)	42.3	219.0	245.5	219.0
Limit (dB)	15.7	8.6	8.1	8.6

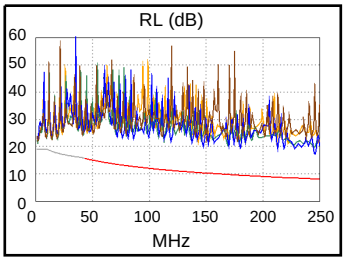



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 7


Date / Time: 12/20/2020 09:39:19 PM
Headroom 5.3 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	20.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	99
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.7
Insertion Loss Margin (dB)	[Pair 4,5]	28.6
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	5.3	5.9	5.3	6.4
Freq. (MHz)	223.0	59.3	223.0	233.5
Limit (dB)	34.0	43.8	34.0	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.1	6.4	7.7	6.6
Freq. (MHz)	71.8	95.8	223.0	237.0
Limit (dB)	39.6	37.4	31.0	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	17.6	17.6	19.9	19.6
Freq. (MHz)	4.3	3.9	245.5	245.5
Limit (dB)	50.7	51.5	15.5	15.5
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.4	16.9	21.5	20.1
Freq. (MHz)	1.0	1.1	245.5	246.0
Limit (dB)	60.3	59.2	12.5	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	12.3	12.2	35.0	34.3
Freq. (MHz)	5.5	5.9	247.5	233.5
Limit (dB)	56.1	55.5	-2.5	-0.9
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	12.7	11.7	37.5	34.7
Freq. (MHz)	5.5	5.9	247.5	237.0
Limit (dB)	53.6	53.0	-5.5	-4.3





PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	4,5	4,5	4,5
RL (dB)	8.2	8.1	8.8	8.1
Freq. (MHz)	174.5	120.0	248.0	219.0
Limit (dB)	9.6	11.2	8.1	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 8


Date / Time: 12/20/2020 09:40:03 PM
Headroom 6.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	18.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	89
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.5
Insertion Loss Margin (dB)	[Pair 1,2]	29.5
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	1,2-3,6	3,6-4,5
NEXT (dB)	6.8	6.6	7.9	6.6
Freq. (MHz)	68.0	212.0	248.0	219.0
Limit (dB)	42.8	34.3	33.2	34.1
Worst Pair	3,6	3,6	1,2	3,6
PS NEXT (dB)	7.7	6.8	9.4	7.4
Freq. (MHz)	20.0	54.0	248.5	234.5
Limit (dB)	49.0	41.7	30.2	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	3,6-4,5	4,5-3,6
ACR-F (dB)	17.9	17.9	18.1	18.1
Freq. (MHz)	4.3	4.3	250.0	250.0
Limit (dB)	50.7	50.7	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.2	16.4	18.6	18.8
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	1,2-3,6	3,6-4,5
ACR-N (dB)	12.5	11.7	37.4	36.9
Freq. (MHz)	6.3	6.8	248.0	246.5
Limit (dB)	54.9	54.2	-2.6	-2.4
Worst Pair	3,6	3,6	1,2	3,6
PS ACR-N (dB)	13.1	11.9	38.8	36.5
Freq. (MHz)	6.3	6.5	248.5	241.0
Limit (dB)	52.4	52.0	-5.6	-4.7





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.0	8.3	8.2	8.3
Freq. (MHz)	178.5	220.0	219.5	220.0
Limit (dB)	9.5	8.6	8.6	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 9

Date / Time: 12/21/2020 05:13:38 PM
Headroom 6.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	18.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	90
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 7,8]	3.5
Insertion Loss Margin (dB)	[Pair 1,2]	29.5
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.6	7.5	6.7	8.1
Freq. (MHz)	196.5	190.0	230.5	238.0
Limit (dB)	34.9	35.2	33.7	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.5	8.0	7.9	8.2
Freq. (MHz)	80.5	47.0	230.0	238.0
Limit (dB)	38.7	42.7	30.8	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.8	17.8	18.6	18.6
Freq. (MHz)	7.3	7.3	242.0	242.0
Limit (dB)	46.1	46.1	15.6	15.6
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.4	17.5	19.8	19.0
Freq. (MHz)	1.0	5.8	242.5	248.0
Limit (dB)	60.3	45.1	12.6	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	12.8	12.4	34.9	36.9
Freq. (MHz)	6.0	6.3	230.5	238.0
Limit (dB)	55.3	54.9	-0.5	-1.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.2	12.7	37.5	36.9
Freq. (MHz)	6.0	6.3	244.0	238.5
Limit (dB)	52.8	52.4	-5.1	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.7	8.2	7.7	8.9
Freq. (MHz)	245.5	177.5	245.5	224.5
Limit (dB)	8.1	9.5	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

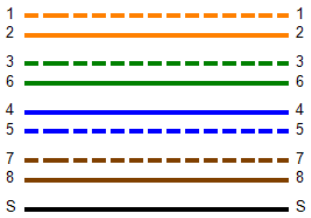
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 10


Date / Time: 12/21/2020 05:14:20 PM
Headroom 4.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	20.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	100
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 7,8]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.4
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.1	4.0	4.4	4.0
Freq. (MHz)	222.0	191.5	234.0	191.5
Limit (dB)	34.0	35.1	33.6	35.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.1	5.1	6.1	5.1
Freq. (MHz)	222.0	192.0	222.0	192.5
Limit (dB)	31.1	32.2	31.1	32.1







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-7,8	7,8-4,5	3,6-4,5	3,6-4,5
ACR-F (dB)	16.9	16.5	18.9	19.1
Freq. (MHz)	181.5	181.5	245.5	245.5
Limit (dB)	18.1	18.1	15.5	15.5
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	17.2	17.4	20.4	19.8
Freq. (MHz)	1.1	1.1	245.5	245.0
Limit (dB)	59.2	59.2	12.5	12.5







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	13.6	12.3	31.9	34.4
Freq. (MHz)	5.5	5.5	234.0	247.5
Limit (dB)	56.1	56.1	-1.0	-2.5
Worst Pair	3,6	3,6	3,6	4,5
PS ACR-N (dB)	13.9	12.9	34.3	36.1
Freq. (MHz)	5.6	5.4	234.0	248.0
Limit (dB)	53.4	53.8	-3.9	-5.6





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.4	8.7	8.4	8.7
Freq. (MHz)	241.5	223.5	241.5	223.5
Limit (dB)	8.2	8.5	8.2	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 11


Date / Time: 12/21/2020 05:14:45 PM
Headroom 4.3 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	22.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	109
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 7,8]	4.1
Insertion Loss Margin (dB)	[Pair 4,5]	28.0
Frequency (MHz)	[Pair 4,5]	249.5
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	4.3	6.5	5.8	8.4
Freq. (MHz)	112.5	64.0	242.0	247.5
Limit (dB)	39.1	43.2	33.4	33.2
Worst Pair	3,6	7,8	3,6	7,8
PS NEXT (dB)	6.2	8.1	8.1	9.5
Freq. (MHz)	112.5	53.3	242.5	241.5
Limit (dB)	36.2	41.8	30.4	30.4







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	17.0	17.0	19.3	19.0
Freq. (MHz)	3.8	3.8	247.5	247.5
Limit (dB)	51.8	51.8	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.7	17.7	21.8	20.2
Freq. (MHz)	1.0	1.0	248.0	247.5
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	12.0	11.9	33.7	36.6
Freq. (MHz)	5.0	5.0	242.0	247.5
Limit (dB)	57.0	57.0	-1.9	-2.5
Worst Pair	3,6	3,6	3,6	7,8
PS ACR-N (dB)	12.8	12.9	36.0	37.8
Freq. (MHz)	5.0	5.0	242.5	247.0
Limit (dB)	54.5	54.5	-4.9	-5.4





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	7.7	8.2	8.4	8.6
Freq. (MHz)	45.0	118.5	249.5	222.5
Limit (dB)	15.5	11.3	8.0	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 12


Date / Time: 12/21/2020 05:16:28 PM
Headroom 3.5 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	17.2
Prop. Delay (ns), Limit 555	[Pair 1,2]	82
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.2
Insertion Loss Margin (dB)	[Pair 4,5]	29.8
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	3.5	4.6	5.0	5.8
Freq. (MHz)	74.8	44.8	248.5	233.5
Limit (dB)	42.1	45.8	33.2	33.6
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	6.1	7.1	7.5	7.8
Freq. (MHz)	74.8	44.8	248.5	241.5
Limit (dB)	39.3	43.1	30.2	30.4







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	18.1	18.1	20.2	20.1
Freq. (MHz)	4.3	4.3	244.0	244.0
Limit (dB)	50.7	50.7	15.5	15.5
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	18.1	18.1	20.4	19.9
Freq. (MHz)	1.1	1.0	245.5	244.5
Limit (dB)	59.2	60.3	12.5	12.5







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	9.9	9.6	34.8	36.1
Freq. (MHz)	7.3	7.1	248.5	248.5
Limit (dB)	53.5	53.6	-2.7	-2.7
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	12.2	11.8	37.2	38.1
Freq. (MHz)	7.0	7.1	248.5	249.0
Limit (dB)	51.3	51.1	-5.6	-5.7





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.7	8.5	7.7	9.2
Freq. (MHz)	248.5	113.0	248.5	225.5
Limit (dB)	8.0	11.5	8.0	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 13

Date / Time: 12/21/2020 05:23:35 PM
Headroom 2.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	92
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.5
Insertion Loss Margin (dB)	[Pair 3,6]	29.2
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	2.6	4.4	3.2	4.9
Freq. (MHz)	217.5	178.0	237.5	238.0
Limit (dB)	34.2	35.7	33.5	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	4.0	5.6	4.3	6.0
Freq. (MHz)	177.5	184.5	237.5	238.0
Limit (dB)	32.8	32.5	30.5	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.5	17.4	17.5	17.4
Freq. (MHz)	242.0	242.5	242.0	242.5
Limit (dB)	15.6	15.6	15.6	15.6
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.4	17.3	19.6	18.2
Freq. (MHz)	5.3	5.8	248.5	242.0
Limit (dB)	45.9	45.1	12.4	12.6

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.6	10.6	32.2	33.3
Freq. (MHz)	5.9	6.1	244.0	238.0
Limit (dB)	55.5	55.1	-2.1	-1.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.8	10.5	32.7	34.5
Freq. (MHz)	6.1	6.3	237.5	238.0
Limit (dB)	52.6	52.4	-4.3	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.6	9.4	8.6	10.2
Freq. (MHz)	245.0	183.5	245.0	224.5
Limit (dB)	8.1	9.4	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 14


Date / Time: 12/21/2020 05:18:21 PM
Headroom 3.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	21.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	100
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.7
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	4,5-7,8	3,6-4,5	4,5-7,8
NEXT (dB)	3.1	4.9	3.4	5.5
Freq. (MHz)	173.0	211.5	221.0	242.0
Limit (dB)	35.9	34.4	34.0	33.4
Worst Pair	4,5	4,5	3,6	7,8
PS NEXT (dB)	4.9	6.6	6.1	6.9
Freq. (MHz)	142.5	53.3	226.5	248.0
Limit (dB)	34.4	41.8	30.9	30.2

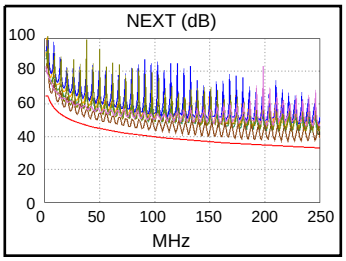





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	16.3	16.3	18.7	18.4
Freq. (MHz)	3.4	81.3	243.0	243.0
Limit (dB)	52.7	25.1	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	16.6	19.0	18.6
Freq. (MHz)	1.0	1.0	218.5	243.5
Limit (dB)	60.3	60.3	13.5	12.5

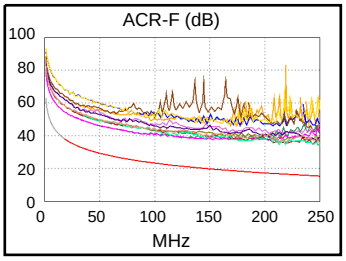





N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	4,5-7,8
ACR-N (dB)	9.8	10.6	31.4	34.0
Freq. (MHz)	5.5	5.6	233.0	242.0
Limit (dB)	56.1	55.9	-0.8	-1.9
Worst Pair	4,5	3,6	4,5	7,8
PS ACR-N (dB)	10.7	11.1	33.8	35.9
Freq. (MHz)	5.5	5.6	232.5	248.0
Limit (dB)	53.6	53.4	-3.7	-5.6

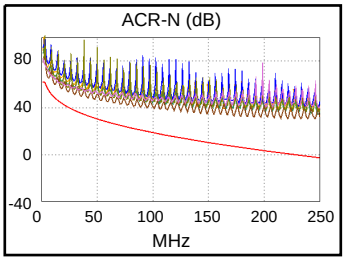



PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	1,2	4,5	4,5
RL (dB)	8.6	9.2	8.6	9.8
Freq. (MHz)	240.0	47.8	240.0	184.5
Limit (dB)	8.2	15.2	8.2	9.3

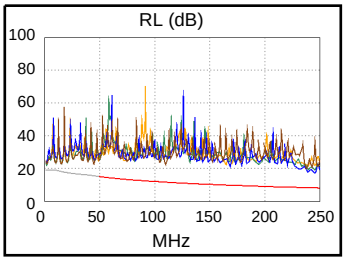



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 15


Date / Time: 12/20/2020 09:28:25 PM
Headroom 5.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	21.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	100
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 7,8]	4.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.6
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS

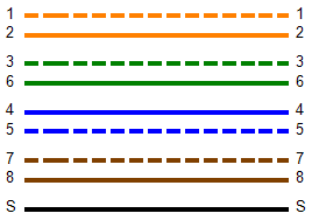





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	5.0	5.0	6.2	6.6
Freq. (MHz)	71.5	59.3	245.5	250.0
Limit (dB)	42.4	43.8	33.3	33.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.1	5.7	6.8	7.4
Freq. (MHz)	65.3	47.3	244.5	233.0
Limit (dB)	40.3	42.7	30.3	30.7







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.3	18.1	20.7	20.4
Freq. (MHz)	81.0	81.3	250.0	250.0
Limit (dB)	25.1	25.1	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	18.7	18.8	21.8	21.0
Freq. (MHz)	1.0	4.9	219.5	250.0
Limit (dB)	60.3	46.5	13.4	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-4,5	3,6-7,8
ACR-N (dB)	10.9	10.5	34.6	35.5
Freq. (MHz)	5.6	5.4	245.5	250.0
Limit (dB)	55.9	56.3	-2.3	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.7	10.1	35.4	36.4
Freq. (MHz)	5.5	5.6	244.5	245.0
Limit (dB)	53.6	53.4	-5.2	-5.2





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.0	8.1	8.6	9.0
Freq. (MHz)	113.5	114.0	241.0	222.5
Limit (dB)	11.5	11.4	8.2	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 16

Date / Time: 12/20/2020 09:29:23 PM
Headroom 6.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	91
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	6.1
Insertion Loss Margin (dB)	[Pair 4,5]	28.9
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.0	6.8	6.7	7.4
Freq. (MHz)	72.8	66.3	247.5	234.5
Limit (dB)	42.3	43.0	33.2	33.6
Worst Pair	3,6	4,5	3,6	4,5
PS NEXT (dB)	7.5	8.3	8.5	8.3
Freq. (MHz)	72.8	228.0	247.5	228.0
Limit (dB)	39.5	30.9	30.2	30.9


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.3	18.3	20.1	19.6
Freq. (MHz)	91.5	4.4	245.0	245.0
Limit (dB)	24.0	50.4	15.5	15.5
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	17.4	17.5	21.2	20.1
Freq. (MHz)	1.0	1.0	244.5	245.0
Limit (dB)	60.3	60.3	12.5	12.5

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	12.2	11.6	35.6	36.7
Freq. (MHz)	6.0	6.1	247.5	247.5
Limit (dB)	55.3	55.1	-2.5	-2.5
Worst Pair	3,6	3,6	3,6	4,5
PS ACR-N (dB)	13.6	13.1	37.9	38.0
Freq. (MHz)	6.0	6.1	247.5	248.5
Limit (dB)	52.8	52.6	-5.5	-5.6

PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.0	7.7	8.5	7.7
Freq. (MHz)	181.0	222.0	228.0	222.0
Limit (dB)	9.4	8.5	8.4	8.5

Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

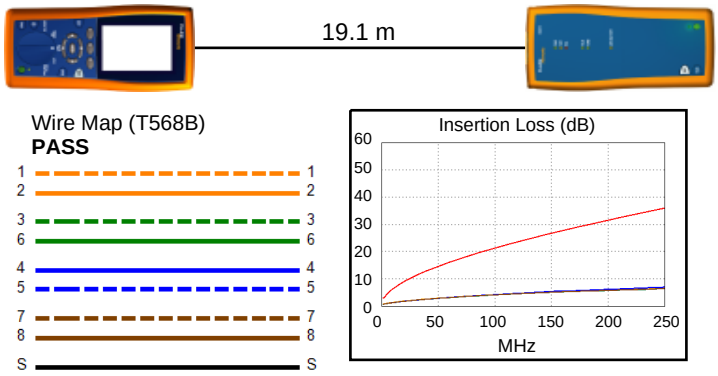

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 17

Date / Time: 12/20/2020 09:29:51 PM
Headroom 4.8 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	17.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	83
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	5.4
Insertion Loss Margin (dB)	[Pair 1,2]	29.9
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	5.4	4.8	6.5	6.2
Freq. (MHz)	67.0	96.3	246.5	246.0
Limit (dB)	42.9	40.2	33.2	33.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.1	5.1	5.9	5.6
Freq. (MHz)	67.0	104.0	239.0	247.0
Limit (dB)	40.1	36.8	30.5	30.2


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.3	16.4	18.9	18.9
Freq. (MHz)	3.5	3.5	250.0	250.0
Limit (dB)	52.4	52.4	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	16.8	19.4	19.0
Freq. (MHz)	1.0	1.0	221.0	250.0
Limit (dB)	60.3	60.3	13.4	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	11.8	11.0	36.2	36.1
Freq. (MHz)	7.0	7.1	246.5	246.0
Limit (dB)	53.8	53.6	-2.4	-2.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.0	10.5	35.2	35.3
Freq. (MHz)	7.0	7.1	239.0	247.0
Limit (dB)	51.3	51.1	-4.5	-5.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.4	7.8	8.7	7.8
Freq. (MHz)	75.8	219.0	218.0	219.0
Limit (dB)	13.2	8.6	8.6	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 18

Date / Time: 12/20/2020 09:30:24 PM
Headroom 2.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	93
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 3,6]	29.0
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	2.0	3.8	2.0	3.8
Freq. (MHz)	221.0	215.0	221.0	215.0
Limit (dB)	34.0	34.2	34.0	34.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	4.2	5.3	4.2	5.5
Freq. (MHz)	221.5	215.5	221.5	235.0
Limit (dB)	31.1	31.3	31.1	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	4,5-3,6
ACR-F (dB)	17.6	17.5	19.0	19.1
Freq. (MHz)	3.9	3.9	239.0	245.0
Limit (dB)	51.5	51.5	15.7	15.5
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.9	17.1	20.2	20.0
Freq. (MHz)	1.0	1.0	250.0	239.0
Limit (dB)	60.3	60.3	12.3	12.7

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.2	10.5	32.2	34.0
Freq. (MHz)	5.8	6.1	247.5	247.5
Limit (dB)	55.7	55.1	-2.5	-2.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.8	11.2	34.3	33.5
Freq. (MHz)	5.8	5.9	248.0	235.0
Limit (dB)	53.2	53.0	-5.6	-4.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.4	8.6	7.4	8.6
Freq. (MHz)	176.5	216.5	176.5	216.5
Limit (dB)	9.5	8.6	9.5	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

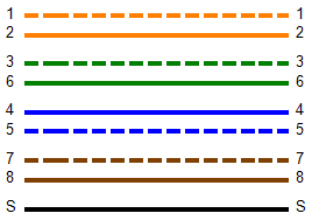
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 19

Date / Time: 12/20/2020 09:30:57 PM
Headroom 3.8 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	22.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	106
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	6.8
Insertion Loss Margin (dB)	[Pair 1,2]	28.2
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	3.8	5.8	4.7	5.8
Freq. (MHz)	184.5	219.0	230.0	219.0
Limit (dB)	35.4	34.1	33.7	34.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.1	5.9	5.2	6.6
Freq. (MHz)	213.5	185.0	224.5	236.0
Limit (dB)	31.4	32.4	31.0	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	1,2-4,5	3,6-4,5
ACR-F (dB)	16.6	16.7	18.8	18.4
Freq. (MHz)	3.5	3.5	249.5	245.5
Limit (dB)	52.4	52.4	15.3	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	16.5	19.0	18.6
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.1	9.9	31.7	31.8
Freq. (MHz)	5.1	5.4	230.0	219.0
Limit (dB)	56.8	56.3	-0.5	0.9
Worst Pair	4,5	3,6	3,6	3,6
PS ACR-N (dB)	11.5	10.8	34.4	34.2
Freq. (MHz)	5.0	5.4	247.5	236.0
Limit (dB)	54.5	53.8	-5.5	-4.1


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	8.1	8.1	9.6	8.1
Freq. (MHz)	46.5	225.0	219.5	225.0
Limit (dB)	15.3	8.5	8.6	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 20

Date / Time: 12/20/2020 09:31:31 PM
Headroom 5.9 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	26.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	127
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	8.9
Insertion Loss Margin (dB)	[Pair 1,2]	27.0
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	5.9	8.5	7.2	9.5
Freq. (MHz)	178.0	49.5	215.0	249.0
Limit (dB)	35.7	45.1	34.2	33.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.6	9.2	8.7	10.2
Freq. (MHz)	81.0	8.9	233.0	249.0
Limit (dB)	38.7	54.9	30.7	30.2


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.1	17.3	19.3	19.2
Freq. (MHz)	3.9	3.9	250.0	250.0
Limit (dB)	51.5	51.5	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.6	16.6	20.5	19.7
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
ACR-N (dB)	12.2	13.4	31.8	36.8
Freq. (MHz)	3.8	3.9	215.0	249.0
Limit (dB)	59.6	59.3	1.4	-2.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.3	12.8	34.8	37.4
Freq. (MHz)	3.8	4.3	233.0	249.0
Limit (dB)	57.1	56.0	-3.8	-5.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	4,5	4,5	4,5
RL (dB)	7.5	7.4	9.4	8.9
Freq. (MHz)	43.5	42.0	223.5	223.5
Limit (dB)	15.6	15.8	8.5	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 21


Date / Time: 12/20/2020 09:32:24 PM
Headroom 4.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	19.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	91
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	7.6
Insertion Loss Margin (dB)	[Pair 1,2]	29.1
Frequency (MHz)	[Pair 1,2]	248.5
Limit (dB)	[Pair 1,2]	35.8





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.1	4.9	4.8	5.5
Freq. (MHz)	179.5	186.5	247.0	240.5
Limit (dB)	35.6	35.3	33.2	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.6	6.0	6.4	6.5
Freq. (MHz)	66.0	46.0	233.0	233.5
Limit (dB)	40.2	42.9	30.7	30.7







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.5	17.6	18.6	18.6
Freq. (MHz)	3.9	4.1	238.0	244.5
Limit (dB)	51.5	50.9	15.7	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.9	15.9	19.4	18.9
Freq. (MHz)	1.0	1.0	250.0	245.0
Limit (dB)	60.3	60.3	12.3	12.5







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.7	10.0	33.9	34.7
Freq. (MHz)	6.1	6.3	247.0	247.5
Limit (dB)	55.1	54.9	-2.5	-2.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.4	10.5	36.1	36.2
Freq. (MHz)	6.1	6.1	247.0	247.5
Limit (dB)	52.6	52.6	-5.4	-5.5





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	6.9	7.8	8.1	7.8
Freq. (MHz)	49.3	187.0	241.5	187.0
Limit (dB)	15.1	9.3	8.2	9.3

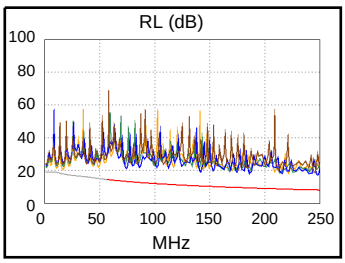

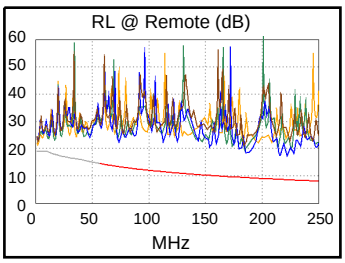

Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 22


Date / Time: 12/21/2020 05:27:54 PM
Headroom 3.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	16.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	80
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.1
Insertion Loss Margin (dB)	[Pair 3,6]	29.7
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	3.0	5.0	3.7	5.2
Freq. (MHz)	217.0	217.5	248.5	233.5
Limit (dB)	34.2	34.2	33.2	33.6
Worst Pair	3,6	4,5	4,5	4,5
PS NEXT (dB)	5.5	6.6	6.1	6.6
Freq. (MHz)	146.5	218.0	248.5	233.5
Limit (dB)	34.2	31.2	30.2	30.7







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	7,8-4,5	4,5-7,8	4,5-3,6
ACR-F (dB)	17.8	17.6	18.5	18.4
Freq. (MHz)	212.5	220.5	245.0	245.0
Limit (dB)	16.7	16.4	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.3	16.5	18.7	18.2
Freq. (MHz)	1.0	1.0	245.5	244.5
Limit (dB)	60.3	60.3	12.5	12.5







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	13.2	12.5	33.8	35.0
Freq. (MHz)	7.1	7.3	248.5	241.0
Limit (dB)	53.6	53.5	-2.7	-1.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.7	12.8	35.9	36.6
Freq. (MHz)	7.0	7.4	248.5	242.5
Limit (dB)	51.3	50.7	-5.6	-4.9





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.3	8.1	7.9	8.1
Freq. (MHz)	173.0	186.0	242.5	219.0
Limit (dB)	9.6	9.3	8.2	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 23

Date / Time: 12/21/2020 05:30:21 PM
Headroom 4.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	18.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	90
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.5
Insertion Loss Margin (dB)	[Pair 1,2]	29.6
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.0	4.8	5.3	6.1
Freq. (MHz)	68.0	40.8	239.0	232.5
Limit (dB)	42.8	46.5	33.5	33.7
Worst Pair	4,5	4,5	4,5	3,6
PS NEXT (dB)	6.1	6.6	7.8	7.5
Freq. (MHz)	68.0	47.3	239.0	232.5
Limit (dB)	40.0	42.7	30.5	30.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.2	17.2	18.2	18.2
Freq. (MHz)	3.8	3.8	250.0	250.0
Limit (dB)	51.8	51.8	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	17.1	17.5	19.4	18.8
Freq. (MHz)	1.0	1.0	250.0	249.5
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.0	9.4	35.0	34.7
Freq. (MHz)	6.3	6.3	246.0	232.5
Limit (dB)	54.9	54.9	-2.4	-0.8
Worst Pair	4,5	4,5	4,5	3,6
PS ACR-N (dB)	11.6	11.2	36.7	37.5
Freq. (MHz)	6.4	6.3	239.0	246.5
Limit (dB)	52.2	52.4	-4.5	-5.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	9.0	8.9	9.0	9.4
Freq. (MHz)	81.5	121.5	246.5	184.5
Limit (dB)	12.9	11.2	8.1	9.3


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

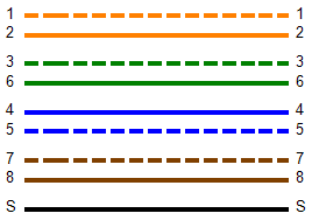
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 24

Date / Time: 12/20/2020 10:05:42 PM
Headroom 5.5 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	20.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	98
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.9
Insertion Loss Margin (dB)	[Pair 4,5]	28.7
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.3	5.5	7.2	6.1
Freq. (MHz)	145.0	102.5	236.5	225.0
Limit (dB)	37.2	39.7	33.5	33.9
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.9	6.8	8.0	7.6
Freq. (MHz)	145.0	157.5	237.0	237.0
Limit (dB)	34.3	33.7	30.6	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8-4,5	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.7	16.8	17.1	16.8
Freq. (MHz)	234.0	218.0	248.5	248.5
Limit (dB)	15.9	16.5	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.7	17.6	18.2	18.1
Freq. (MHz)	1.0	3.1	245.0	248.5
Limit (dB)	60.3	50.4	12.5	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	13.2	12.7	35.4	36.0
Freq. (MHz)	5.5	5.1	236.5	249.0
Limit (dB)	56.1	56.8	-1.3	-2.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.8	12.6	36.2	35.8
Freq. (MHz)	5.5	5.8	237.0	237.0
Limit (dB)	53.6	53.2	-4.3	-4.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.3	8.1	7.3	8.1
Freq. (MHz)	244.5	220.5	244.5	220.5
Limit (dB)	8.1	8.6	8.1	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 25

Date / Time: 12/21/2020 03:38:06 PM
Headroom 4.5 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	91
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.5
Insertion Loss Margin (dB)	[Pair 4,5]	28.8
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.5	5.2	5.1	5.6
Freq. (MHz)	220.5	214.0	247.5	241.0
Limit (dB)	34.1	34.3	33.2	33.4
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	6.9	6.8	7.7	7.2
Freq. (MHz)	186.0	187.0	247.5	241.0
Limit (dB)	32.4	32.4	30.2	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.7	17.4	18.9	18.4
Freq. (MHz)	145.5	145.5	245.0	245.0
Limit (dB)	20.0	20.0	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	16.6	18.7	19.0
Freq. (MHz)	1.0	1.0	245.0	244.5
Limit (dB)	60.3	60.3	12.5	12.5

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	12.2	11.6	33.9	34.0
Freq. (MHz)	6.0	6.4	247.5	241.0
Limit (dB)	55.3	54.7	-2.5	-1.8
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	13.1	12.4	36.5	36.0
Freq. (MHz)	6.1	6.4	247.5	241.0
Limit (dB)	52.6	52.2	-5.5	-4.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.0	8.3	8.1	8.8
Freq. (MHz)	74.3	108.0	242.0	222.0
Limit (dB)	13.3	11.7	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 26


Date / Time: 12/21/2020 03:39:03 PM
Headroom 5.2 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	17.2
Prop. Delay (ns), Limit 555	[Pair 1,2]	81
Delay Skew (ns), Limit 50	[Pair 1,2]	1
Resistance (ohms)	[Pair 7,8]	3.3
Insertion Loss Margin (dB)	[Pair 4,5]	29.5
Frequency (MHz)	[Pair 4,5]	247.0
Limit (dB)	[Pair 4,5]	35.7





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	5.6	5.2	5.6	5.8
Freq. (MHz)	220.5	213.5	220.5	244.0
Limit (dB)	34.1	34.3	34.1	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.7	6.3	7.7	6.7
Freq. (MHz)	220.5	213.5	220.5	244.0
Limit (dB)	31.1	31.4	31.1	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	17.0	18.3	18.0
Freq. (MHz)	3.6	3.6	248.0	248.0
Limit (dB)	52.1	52.1	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.1	16.2	19.3	18.1
Freq. (MHz)	1.0	1.0	247.0	247.5
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	13.0	12.5	35.9	35.1
Freq. (MHz)	6.9	7.1	244.0	244.0
Limit (dB)	54.0	53.6	-2.1	-2.1
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	14.2	13.5	38.2	36.3
Freq. (MHz)	7.0	7.1	244.0	244.0
Limit (dB)	51.3	51.1	-5.1	-5.1





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	6.7	8.6	6.7	8.6
Freq. (MHz)	244.5	183.0	244.5	183.0
Limit (dB)	8.1	9.4	8.1	9.4





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 27

Date / Time: 12/21/2020 03:49:31 PM
Headroom 3.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	105
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 1,2]	28.5
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	3.6	5.5	5.0	8.0
Freq. (MHz)	73.5	11.4	250.0	237.0
Limit (dB)	42.2	55.7	33.1	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	4.1	5.9	4.8	7.9
Freq. (MHz)	73.5	10.9	250.0	238.5
Limit (dB)	39.4	53.4	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.0	18.1	19.7	19.7
Freq. (MHz)	7.6	4.9	248.0	248.0
Limit (dB)	45.6	49.5	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.4	17.6	21.3	19.9
Freq. (MHz)	1.0	10.0	248.0	248.0
Limit (dB)	60.3	40.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	9.1	9.3	33.6	35.9
Freq. (MHz)	5.1	5.4	250.0	237.0
Limit (dB)	56.8	56.3	-2.8	-1.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	9.7	9.8	33.4	35.7
Freq. (MHz)	5.0	5.4	250.0	238.5
Limit (dB)	54.5	53.8	-5.8	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.5	7.8	7.5	8.6
Freq. (MHz)	240.5	46.0	240.5	222.5
Limit (dB)	8.2	15.4	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 28

Date / Time: 12/21/2020 03:40:10 PM
Headroom 7.8 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	19.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	93
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.6
Insertion Loss Margin (dB)	[Pair 4,5]	29.2
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-3,6	3,6-7,8
NEXT (dB)	9.0	7.8	10.6	7.9
Freq. (MHz)	19.1	237.0	248.0	243.5
Limit (dB)	52.0	33.5	33.2	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	9.2	9.1	10.6	9.5
Freq. (MHz)	25.5	57.8	239.0	243.0
Limit (dB)	47.2	41.2	30.5	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.9	17.7	17.9	17.8
Freq. (MHz)	245.0	245.5	250.0	250.0
Limit (dB)	15.5	15.5	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	16.7	19.0	18.1
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-3,6	3,6-7,8
ACR-N (dB)	14.7	13.7	39.9	37.4
Freq. (MHz)	5.9	5.9	248.0	250.0
Limit (dB)	55.5	55.5	-2.6	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	14.4	13.6	39.2	38.4
Freq. (MHz)	5.9	6.3	239.0	243.0
Limit (dB)	53.0	52.4	-4.5	-5.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.5	9.7	7.5	9.7
Freq. (MHz)	247.0	226.5	247.0	226.5
Limit (dB)	8.1	8.4	8.1	8.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 29

Date / Time: 12/21/2020 02:25:20 PM
Headroom 5.9 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	92
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	5.0
Insertion Loss Margin (dB)	[Pair 4,5]	29.1
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-4,5
NEXT (dB)	5.9	7.3	6.9	7.4
Freq. (MHz)	117.5	184.0	248.5	217.0
Limit (dB)	38.7	35.4	33.2	34.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.0	7.1	6.7	8.4
Freq. (MHz)	58.5	12.9	229.5	243.0
Limit (dB)	41.1	52.2	30.8	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.3	16.8	18.0	17.6
Freq. (MHz)	212.5	212.5	246.5	246.5
Limit (dB)	16.7	16.7	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.5	16.5	18.9	18.3
Freq. (MHz)	1.0	1.0	248.0	246.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-4,5
ACR-N (dB)	12.3	12.0	36.4	36.3
Freq. (MHz)	5.9	6.3	248.5	237.0
Limit (dB)	55.5	54.9	-2.7	-1.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.8	11.6	36.8	37.4
Freq. (MHz)	6.0	6.3	249.0	243.0
Limit (dB)	52.8	52.4	-5.7	-5.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.8	8.8	10.0	9.2
Freq. (MHz)	172.5	82.5	244.0	224.0
Limit (dB)	9.6	12.8	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

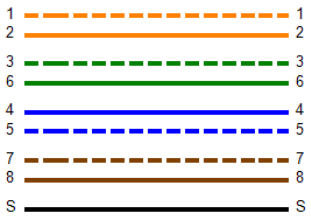
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 30

Date / Time: 12/21/2020 03:09:08 PM
Headroom 4.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	104
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 7,8]	4.0
Insertion Loss Margin (dB)	[Pair 1,2]	28.6
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.9	4.1	5.5	4.9
Freq. (MHz)	62.5	73.8	206.0	229.5
Limit (dB)	43.4	42.2	34.6	33.8
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.5	5.7	8.5	6.5
Freq. (MHz)	22.4	51.0	228.5	235.5
Limit (dB)	48.2	42.1	30.8	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.9	16.9	18.3	18.3
Freq. (MHz)	3.6	3.6	250.0	250.0
Limit (dB)	52.1	52.1	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.1	16.1	20.4	19.2
Freq. (MHz)	1.0	1.0	249.5	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	9.6	8.6	34.8	32.8
Freq. (MHz)	5.1	5.5	240.5	235.0
Limit (dB)	56.8	56.1	-1.7	-1.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.0	10.1	36.9	34.7
Freq. (MHz)	5.0	5.5	240.5	241.0
Limit (dB)	54.5	53.6	-4.7	-4.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	1,2	4,5	4,5
RL (dB)	7.8	9.2	8.9	9.5
Freq. (MHz)	47.0	46.5	247.0	223.5
Limit (dB)	15.3	15.3	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 31


Date / Time: 12/21/2020 03:10:09 PM
Headroom 2.6 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	24.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	115
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.3
Insertion Loss Margin (dB)	[Pair 3,6]	27.7
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	4.9	2.6	6.1	5.7
Freq. (MHz)	136.0	95.5	228.0	250.0
Limit (dB)	37.7	40.3	33.8	33.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.1	4.8	8.5	7.1
Freq. (MHz)	65.0	95.8	227.5	234.5
Limit (dB)	40.3	37.4	30.9	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.1	18.1	18.5	18.6
Freq. (MHz)	4.3	4.3	247.0	247.0
Limit (dB)	50.7	50.7	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.8	17.3	19.7	19.4
Freq. (MHz)	1.0	1.1	246.5	247.0
Limit (dB)	60.3	59.2	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
ACR-N (dB)	10.9	10.3	32.5	33.6
Freq. (MHz)	4.5	4.0	228.0	250.0
Limit (dB)	58.0	59.0	-0.2	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.0	10.3	36.5	35.4
Freq. (MHz)	4.9	4.6	242.5	250.0
Limit (dB)	54.7	55.2	-4.9	-5.8





PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	7.2	8.6	8.1	9.4
Freq. (MHz)	43.0	42.8	248.5	219.0
Limit (dB)	15.7	15.7	8.0	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 32

Date / Time: 12/21/2020 03:11:44 PM
Headroom 6.1 dB (NEXT 1,2-3,6)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	24.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	116
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	4.3
Insertion Loss Margin (dB)	[Pair 1,2]	27.8
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-3,6	3,6-7,8	1,2-3,6	3,6-7,8
NEXT (dB)	6.1	9.9	6.4	10.8
Freq. (MHz)	223.5	55.3	234.0	230.5
Limit (dB)	34.0	44.3	33.6	33.7
Worst Pair	3,6	3,6	3,6	7,8
PS NEXT (dB)	6.9	10.5	7.1	11.2
Freq. (MHz)	177.5	55.5	234.0	231.5
Limit (dB)	32.8	41.5	30.7	30.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	19.1	19.1	19.9	19.8
Freq. (MHz)	4.9	4.8	247.5	248.0
Limit (dB)	49.5	49.7	15.4	15.4
Worst Pair	3,6	3,6	3,6	4,5
PS ACR-F (dB)	17.9	17.7	20.8	19.9
Freq. (MHz)	1.0	1.0	248.0	247.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	1,2-3,6	3,6-7,8
ACR-N (dB)	13.6	14.4	34.9	39.1
Freq. (MHz)	4.3	4.8	249.0	246.0
Limit (dB)	58.5	57.5	-2.7	-2.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.5	14.4	35.8	39.6
Freq. (MHz)	4.6	4.6	249.5	245.5
Limit (dB)	55.2	55.2	-5.7	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	7.0	7.8	9.3	9.7
Freq. (MHz)	43.0	42.5	245.0	219.5
Limit (dB)	15.7	15.7	8.1	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 33

Date / Time: 12/21/2020 03:12:42 PM
Headroom 6.5 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	103
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.9
Insertion Loss Margin (dB)	[Pair 4,5]	28.5
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.5	7.4	7.3	8.9
Freq. (MHz)	34.3	57.0	239.0	233.5
Limit (dB)	47.8	44.1	33.5	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.1	7.9	8.8	10.0
Freq. (MHz)	34.0	11.4	245.5	239.5
Limit (dB)	45.1	53.1	30.3	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	3,6-4,5
ACR-F (dB)	16.6	16.6	18.6	18.3
Freq. (MHz)	3.5	3.5	250.0	245.5
Limit (dB)	52.4	52.4	15.3	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.1	16.9	18.9	18.5
Freq. (MHz)	1.0	1.0	222.0	250.0
Limit (dB)	60.3	60.3	13.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	11.6	12.2	35.9	38.1
Freq. (MHz)	5.1	5.1	245.0	250.0
Limit (dB)	56.8	56.8	-2.3	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.8	12.0	37.2	39.1
Freq. (MHz)	5.0	5.3	245.5	250.0
Limit (dB)	54.5	54.0	-5.3	-5.8


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	7,8	4,5	4,5
RL (dB)	7.7	7.8	8.1	9.6
Freq. (MHz)	86.5	87.0	242.0	224.5
Limit (dB)	12.6	12.6	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 34


Date / Time: 12/21/2020 04:33:52 PM
Headroom 7.4 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	19.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	92
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 7,8]	3.6
Insertion Loss Margin (dB)	[Pair 3,6]	29.3
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9





Wire Map (T568B)
PASS

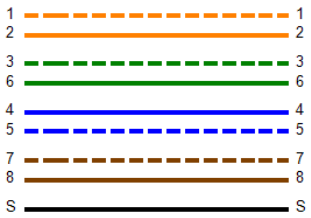





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-3,6	3,6-7,8
NEXT (dB)	7.4	7.4	8.2	9.2
Freq. (MHz)	64.8	58.5	237.5	229.0
Limit (dB)	43.1	43.9	33.5	33.8
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.1	8.5	8.4	9.0
Freq. (MHz)	64.8	217.0	242.0	236.5
Limit (dB)	40.3	31.2	30.4	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.9	16.9	19.1	19.1
Freq. (MHz)	3.9	3.8	246.5	246.5
Limit (dB)	51.5	51.8	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.2	17.4	19.7	18.8
Freq. (MHz)	1.0	1.0	246.5	246.5
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-3,6	3,6-7,8
ACR-N (dB)	14.0	13.3	36.8	39.2
Freq. (MHz)	6.1	6.1	237.5	248.0
Limit (dB)	55.1	55.1	-1.4	-2.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	14.1	13.8	37.3	37.5
Freq. (MHz)	6.1	5.9	242.0	236.5
Limit (dB)	52.6	53.0	-4.9	-4.2





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.4	7.9	8.4	8.1
Freq. (MHz)	243.5	152.0	243.5	183.5
Limit (dB)	8.1	10.2	8.1	9.4





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 35

Date / Time: 12/21/2020 02:08:34 PM
Headroom 6.7 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	19.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	94
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 1,2]	29.1
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	7.8	6.7	8.5	7.1
Freq. (MHz)	70.8	155.0	245.0	233.5
Limit (dB)	42.5	36.7	33.3	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.3	7.6	9.3	7.7
Freq. (MHz)	70.3	96.3	244.5	241.5
Limit (dB)	39.7	37.4	30.3	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.9	17.0	19.1	19.2
Freq. (MHz)	3.6	3.6	250.0	250.0
Limit (dB)	52.1	52.1	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.5	16.5	20.3	19.4
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	14.2	12.4	37.6	35.3
Freq. (MHz)	5.5	6.3	245.0	233.5
Limit (dB)	56.1	54.9	-2.3	-0.9
Worst Pair	4,5	3,6	3,6	3,6
PS ACR-N (dB)	13.9	12.4	38.2	37.1
Freq. (MHz)	5.5	6.3	244.5	248.0
Limit (dB)	53.6	52.4	-5.2	-5.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.9	8.5	7.9	8.5
Freq. (MHz)	241.0	221.5	241.0	221.5
Limit (dB)	8.2	8.5	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 36

Date / Time: 12/21/2020 02:07:08 PM
Headroom 6.2 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	105
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.9
Insertion Loss Margin (dB)	[Pair 4,5]	28.4
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.2	6.5	7.5	6.8
Freq. (MHz)	67.5	141.0	249.0	215.5
Limit (dB)	42.8	37.4	33.1	34.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.8	7.2	9.0	8.2
Freq. (MHz)	67.0	95.5	231.5	238.0
Limit (dB)	40.1	37.4	30.7	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.9	16.9	19.9	19.8
Freq. (MHz)	3.6	3.6	247.0	247.0
Limit (dB)	52.1	52.1	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.2	16.3	20.1	19.9
Freq. (MHz)	1.0	1.0	218.5	247.0
Limit (dB)	60.3	60.3	13.5	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	11.5	10.7	35.9	35.4
Freq. (MHz)	5.1	5.1	249.0	238.0
Limit (dB)	56.8	56.8	-2.7	-1.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.8	11.7	38.3	36.0
Freq. (MHz)	5.6	5.4	249.0	238.0
Limit (dB)	53.4	53.8	-5.7	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.6	8.4	8.6	8.4
Freq. (MHz)	43.8	221.5	244.5	221.5
Limit (dB)	15.6	8.5	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 37

Date / Time: 12/21/2020 02:05:44 PM
Headroom 4.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	26.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	126
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.6
Insertion Loss Margin (dB)	[Pair 4,5]	26.8
Frequency (MHz)	[Pair 4,5]	248.0
Limit (dB)	[Pair 4,5]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.0	5.3	6.0	7.8
Freq. (MHz)	73.0	13.4	243.5	234.5
Limit (dB)	42.2	54.5	33.3	33.6
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	5.9	6.6	8.1	8.5
Freq. (MHz)	72.8	13.4	248.0	238.5
Limit (dB)	39.5	51.9	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.8	17.8	18.3	17.9
Freq. (MHz)	4.3	4.3	247.5	247.5
Limit (dB)	50.7	50.7	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.8	16.9	19.8	19.6
Freq. (MHz)	1.0	1.0	247.5	247.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	9.4	8.6	33.0	34.2
Freq. (MHz)	4.1	4.3	248.0	238.5
Limit (dB)	58.7	58.5	-2.6	-1.5
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	10.6	10.1	34.9	35.0
Freq. (MHz)	4.3	4.3	248.0	238.5
Limit (dB)	56.0	56.0	-5.6	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.3	7.7	8.3	9.5
Freq. (MHz)	248.0	39.0	248.0	221.0
Limit (dB)	8.1	16.0	8.1	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 38


Date / Time: 12/21/2020 02:04:08 PM
Headroom 6.3 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	28.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	135
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.9
Insertion Loss Margin (dB)	[Pair 1,2]	26.5
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	7.5	6.3	10.2	7.4
Freq. (MHz)	20.8	59.0	240.5	248.5
Limit (dB)	51.4	43.8	33.4	33.2
Worst Pair	7,8	7,8	3,6	7,8
PS NEXT (dB)	7.8	6.6	11.3	8.0
Freq. (MHz)	16.8	54.8	249.5	246.0
Limit (dB)	50.3	41.6	30.2	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	16.8	16.8	19.0	18.8
Freq. (MHz)	3.8	3.8	248.0	248.5
Limit (dB)	51.8	51.8	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.4	16.5	19.3	18.4
Freq. (MHz)	1.0	1.0	249.5	250.0
Limit (dB)	60.3	60.3	12.3	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	12.2	11.3	36.3	34.1
Freq. (MHz)	3.9	3.6	240.5	248.5
Limit (dB)	59.3	59.9	-1.7	-2.7
Worst Pair	7,8	3,6	3,6	7,8
PS ACR-N (dB)	11.9	11.4	37.8	34.8
Freq. (MHz)	3.8	4.0	249.5	249.0
Limit (dB)	57.1	56.5	-5.7	-5.7





PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	7.7	8.0	9.1	9.5
Freq. (MHz)	40.5	40.0	243.0	217.5
Limit (dB)	15.9	16.0	8.1	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 39

Date / Time: 12/20/2020 09:41:55 PM
Headroom 6.8 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	30.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	143
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.2
Insertion Loss Margin (dB)	[Pair 1,2]	26.1
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	4,5-7,8	3,6-7,8	4,5-7,8
NEXT (dB)	6.8	7.5	10.1	8.4
Freq. (MHz)	70.8	51.8	242.0	239.0
Limit (dB)	42.5	44.8	33.4	33.5
Worst Pair	7,8	7,8	3,6	3,6
PS NEXT (dB)	7.7	7.7	10.5	9.3
Freq. (MHz)	19.5	51.3	238.5	249.5
Limit (dB)	49.2	42.1	30.5	30.2


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	15.6	15.5	15.7	15.7
Freq. (MHz)	37.0	76.8	250.0	250.0
Limit (dB)	31.9	25.6	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	14.9	15.1	17.1	16.5
Freq. (MHz)	1.0	1.0	247.5	250.0
Limit (dB)	60.3	60.3	12.4	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	4,5-7,8	4,5-7,8	3,6-7,8	4,5-7,8
ACR-N (dB)	12.6	12.1	36.3	34.5
Freq. (MHz)	3.9	3.4	245.5	243.0
Limit (dB)	59.3	60.5	-2.3	-2.0
Worst Pair	4,5	4,5	3,6	3,6
PS ACR-N (dB)	11.9	11.6	36.3	35.4
Freq. (MHz)	3.5	3.6	242.5	249.5
Limit (dB)	57.7	57.4	-4.9	-5.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	1,2	4,5	4,5
RL (dB)	8.5	8.5	8.6	10.1
Freq. (MHz)	44.8	44.0	236.5	216.5
Limit (dB)	15.5	15.6	8.3	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 40

Date / Time: 12/20/2020 09:42:30 PM
Headroom 6.4 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	28.2
Prop. Delay (ns), Limit 555	[Pair 1,2]	134
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.9
Insertion Loss Margin (dB)	[Pair 4,5]	26.3
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.4	6.6	7.8	7.7
Freq. (MHz)	141.0	145.5	219.0	214.5
Limit (dB)	37.4	37.2	34.1	34.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.1	7.7	9.7	8.6
Freq. (MHz)	141.0	106.5	219.0	214.5
Limit (dB)	34.5	36.6	31.2	31.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	17.0	17.5	17.1
Freq. (MHz)	3.8	3.8	249.0	249.0
Limit (dB)	51.8	51.8	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.7	15.7	18.4	18.3
Freq. (MHz)	1.0	1.0	244.5	248.5
Limit (dB)	60.3	60.3	12.5	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.8	11.4	32.0	31.6
Freq. (MHz)	3.9	4.1	219.0	214.5
Limit (dB)	59.3	58.7	0.9	1.4
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	11.7	11.9	34.4	34.9
Freq. (MHz)	3.9	4.0	219.5	232.0
Limit (dB)	56.8	56.5	-2.1	-3.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	4,5	4,5
RL (dB)	8.5	9.2	8.9	9.6
Freq. (MHz)	45.5	44.5	248.5	215.5
Limit (dB)	15.4	15.5	8.0	8.7


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 41


Date / Time: 12/20/2020 09:42:56 PM
Headroom 6.7 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	26.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	126
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.6
Insertion Loss Margin (dB)	[Pair 1,2]	27.2
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-4,5
NEXT (dB)	7.6	6.7	9.7	8.0
Freq. (MHz)	22.8	55.0	246.0	234.5
Limit (dB)	50.7	44.3	33.2	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	9.1	7.8	11.9	8.6
Freq. (MHz)	22.6	54.8	246.5	234.5
Limit (dB)	48.1	41.6	30.3	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.2	17.2	18.2	18.1
Freq. (MHz)	3.9	3.9	247.0	247.0
Limit (dB)	51.5	51.5	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.3	16.6	18.7	19.4
Freq. (MHz)	1.0	1.0	247.0	247.0
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-4,5
ACR-N (dB)	11.9	10.5	36.9	34.3
Freq. (MHz)	4.3	4.5	246.0	235.0
Limit (dB)	58.5	58.0	-2.4	-1.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.1	11.9	39.1	36.5
Freq. (MHz)	4.3	4.3	246.5	249.5
Limit (dB)	56.0	56.0	-5.4	-5.7





PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	1,2	3,6	4,5
RL (dB)	7.8	8.7	11.0	10.2
Freq. (MHz)	43.8	53.3	230.0	217.5
Limit (dB)	15.6	14.7	8.4	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 42


Date / Time: 12/21/2020 05:04:06 PM
Headroom 6.5 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	28.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	136
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.9
Insertion Loss Margin (dB)	[Pair 4,5]	26.3
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.8	6.5	9.0	7.5
Freq. (MHz)	20.8	58.5	243.5	239.5
Limit (dB)	51.4	43.9	33.3	33.4
Worst Pair	3,6	3,6	7,8	7,8
PS NEXT (dB)	7.9	7.9	11.1	9.0
Freq. (MHz)	71.0	50.0	243.5	239.5
Limit (dB)	39.6	42.2	30.4	30.5







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	16.4	16.4	18.8	19.1
Freq. (MHz)	3.5	3.5	248.5	248.5
Limit (dB)	52.4	52.4	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	17.1	19.5	20.0
Freq. (MHz)	1.0	1.0	248.5	249.0
Limit (dB)	60.3	60.3	12.4	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	11.9	11.6	35.4	34.4
Freq. (MHz)	3.8	3.8	243.5	248.0
Limit (dB)	59.6	59.6	-2.1	-2.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.7	12.0	37.9	36.0
Freq. (MHz)	3.9	3.8	247.5	248.0
Limit (dB)	56.8	57.1	-5.5	-5.6





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.6	8.2	8.6	10.8
Freq. (MHz)	245.5	47.3	245.5	224.5
Limit (dB)	8.1	15.3	8.1	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 43


Date / Time: 12/20/2020 09:44:32 PM
Headroom 6.6 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	36.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	173
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	6.1
Insertion Loss Margin (dB)	[Pair 1,2]	24.3
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS

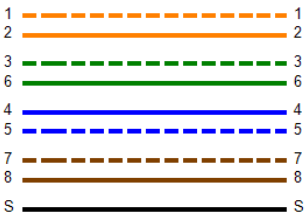





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.6	7.7	7.7	8.6
Freq. (MHz)	73.8	54.5	245.0	238.5
Limit (dB)	42.2	44.4	33.3	33.5
Worst Pair	3,6	7,8	7,8	7,8
PS NEXT (dB)	6.7	8.5	9.0	10.1
Freq. (MHz)	73.8	54.8	248.5	239.0
Limit (dB)	39.4	41.6	30.2	30.5

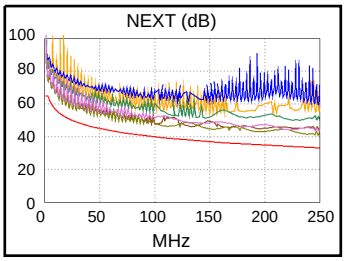





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-1,2	1,2-4,5
ACR-F (dB)	17.2	17.0	17.3	17.3
Freq. (MHz)	177.5	175.0	250.0	250.0
Limit (dB)	18.3	18.4	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.8	15.8	18.1	17.2
Freq. (MHz)	1.0	1.0	249.0	249.5
Limit (dB)	60.3	60.3	12.3	12.3

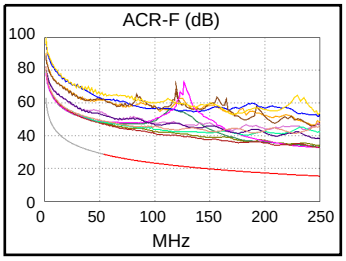





N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	10.8	12.0	32.2	33.0
Freq. (MHz)	3.0	6.3	248.5	245.5
Limit (dB)	61.5	54.9	-2.7	-2.3
Worst Pair	3,6	3,6	7,8	7,8
PS ACR-N (dB)	11.2	11.9	33.3	34.5
Freq. (MHz)	3.1	3.4	248.5	245.5
Limit (dB)	58.4	58.0	-5.6	-5.3

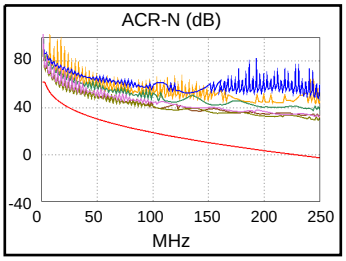



PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	1,2	4,5	3,6
RL (dB)	7.4	6.8	10.7	9.1
Freq. (MHz)	20.6	17.9	244.0	181.0
Limit (dB)	17.4	17.7	8.1	9.4

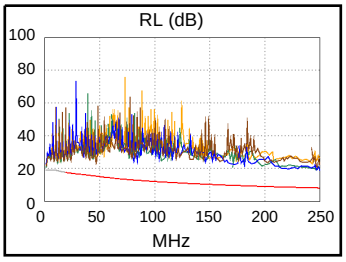



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 44


Date / Time: 12/20/2020 09:45:19 PM
Headroom 6.6 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	31.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	151
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	5.5
Insertion Loss Margin (dB)	[Pair 4,5]	25.5
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.6	8.0	8.4	8.7
Freq. (MHz)	66.8	48.3	242.5	235.0
Limit (dB)	42.9	45.3	33.3	33.6
Worst Pair	3,6	3,6	7,8	3,6
PS NEXT (dB)	7.1	7.8	9.7	9.7
Freq. (MHz)	29.6	11.0	239.0	246.0
Limit (dB)	46.1	53.3	30.5	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	17.3	17.3	17.3	17.5
Freq. (MHz)	5.1	4.3	250.0	250.0
Limit (dB)	49.1	50.7	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.2	16.3	18.8	18.5
Freq. (MHz)	1.0	1.0	248.5	247.5
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	11.3	11.0	34.4	34.6
Freq. (MHz)	3.3	3.6	250.0	246.5
Limit (dB)	60.9	59.9	-2.8	-2.4
Worst Pair	3,6	3,6	7,8	3,6
PS ACR-N (dB)	11.0	10.9	35.8	35.2
Freq. (MHz)	3.3	3.6	250.0	246.0
Limit (dB)	58.4	57.4	-5.8	-5.3





PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	4,5	4,5
RL (dB)	7.9	8.1	9.1	9.3
Freq. (MHz)	43.5	42.8	248.5	225.5
Limit (dB)	15.6	15.7	8.0	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 45

Date / Time: 12/20/2020 09:46:08 PM
Headroom 5.4 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	28.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	137
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.0
Insertion Loss Margin (dB)	[Pair 4,5]	26.3
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	5.4	9.1	5.4	10.8
Freq. (MHz)	249.5	52.0	249.5	247.5
Limit (dB)	33.1	44.7	33.1	33.2
Worst Pair	4,5	4,5	4,5	3,6
PS NEXT (dB)	6.9	10.0	7.0	10.2
Freq. (MHz)	223.5	56.8	249.5	239.5
Limit (dB)	31.0	41.3	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	16.0	16.0	17.7	18.0
Freq. (MHz)	3.5	3.4	249.5	249.0
Limit (dB)	52.4	52.7	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.1	16.4	18.2	18.5
Freq. (MHz)	1.0	2.5	249.5	249.5
Limit (dB)	60.3	52.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	14.5	13.8	31.7	37.2
Freq. (MHz)	3.5	6.3	249.5	247.5
Limit (dB)	60.2	54.9	-2.8	-2.5
Worst Pair	4,5	4,5	4,5	3,6
PS ACR-N (dB)	14.3	13.9	33.3	36.9
Freq. (MHz)	3.3	3.5	249.5	248.0
Limit (dB)	58.4	57.7	-5.7	-5.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.2	8.2	7.2	8.2
Freq. (MHz)	246.5	221.5	246.5	221.5
Limit (dB)	8.1	8.5	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 46


Date / Time: 12/21/2020 04:59:07 PM
Headroom 5.8 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	26.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	127
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.7
Insertion Loss Margin (dB)	[Pair 4,5]	27.0
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	5.8	7.2	9.1	8.2
Freq. (MHz)	71.8	53.8	244.0	239.5
Limit (dB)	42.4	44.5	33.3	33.4
Worst Pair	3,6	7,8	7,8	3,6
PS NEXT (dB)	7.6	8.7	10.7	9.7
Freq. (MHz)	71.8	49.3	244.0	244.0
Limit (dB)	39.6	42.4	30.3	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.3	18.3	19.4	19.2
Freq. (MHz)	5.0	5.0	250.0	250.0
Limit (dB)	49.3	49.3	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	18.0	18.0	20.2	20.2
Freq. (MHz)	2.9	2.8	248.5	250.0
Limit (dB)	51.1	51.5	12.4	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	11.8	11.8	36.5	35.6
Freq. (MHz)	4.3	4.3	248.5	248.5
Limit (dB)	58.5	58.5	-2.7	-2.7
Worst Pair	3,6	3,6	7,8	3,6
PS ACR-N (dB)	12.8	12.7	38.0	36.9
Freq. (MHz)	4.0	4.3	248.5	248.0
Limit (dB)	56.5	56.0	-5.6	-5.6





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	3,6	4,5	4,5
RL (dB)	8.0	8.7	8.0	10.0
Freq. (MHz)	46.5	38.5	242.0	223.0
Limit (dB)	15.3	16.1	8.2	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 47

Date / Time: 12/21/2020 04:43:45 PM
Headroom 4.8 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	28.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	136
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.0
Insertion Loss Margin (dB)	[Pair 1,2]	26.4
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.8	6.1	6.2	7.8
Freq. (MHz)	143.5	96.8	211.5	216.0
Limit (dB)	37.3	40.2	34.4	34.2
Worst Pair	3,6	4,5	3,6	3,6
PS NEXT (dB)	6.9	8.2	8.3	9.3
Freq. (MHz)	143.5	12.4	224.5	237.5
Limit (dB)	34.4	52.5	31.0	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	1,2-4,5	4,5-1,2
ACR-F (dB)	15.7	15.5	15.7	15.5
Freq. (MHz)	247.0	247.0	247.0	247.0
Limit (dB)	15.4	15.4	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.2	16.4	17.5	17.9
Freq. (MHz)	1.0	1.1	248.0	248.0
Limit (dB)	60.3	59.2	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	9.5	9.7	32.2	34.4
Freq. (MHz)	3.9	4.0	228.5	237.0
Limit (dB)	59.3	59.0	-0.3	-1.3
Worst Pair	4,5	4,5	3,6	3,6
PS ACR-N (dB)	10.7	11.0	33.4	36.0
Freq. (MHz)	3.8	4.0	224.5	246.0
Limit (dB)	57.1	56.5	-2.8	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.6	9.5	8.6	10.1
Freq. (MHz)	237.0	39.8	237.5	224.0
Limit (dB)	8.3	16.0	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 48

Date / Time: 12/21/2020 05:00:32 PM
Headroom 6.3 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	30.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	145
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	5.2
Insertion Loss Margin (dB)	[Pair 4,5]	25.8
Frequency (MHz)	[Pair 4,5]	248.5
Limit (dB)	[Pair 4,5]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.9	6.3	8.8	7.4
Freq. (MHz)	19.4	58.3	207.5	246.5
Limit (dB)	51.9	43.9	34.5	33.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.5	7.8	11.4	8.7
Freq. (MHz)	19.4	58.3	239.0	242.5
Limit (dB)	49.2	41.1	30.5	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	15.6	15.6	19.0	19.0
Freq. (MHz)	3.5	3.5	247.5	247.5
Limit (dB)	52.4	52.4	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.5	16.7	20.0	19.3
Freq. (MHz)	1.0	1.0	250.0	247.5
Limit (dB)	60.3	60.3	12.3	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	11.3	11.0	36.1	33.5
Freq. (MHz)	3.8	3.5	246.5	250.0
Limit (dB)	59.6	60.2	-2.4	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.9	11.6	36.8	35.1
Freq. (MHz)	3.6	3.6	239.0	250.0
Limit (dB)	57.4	57.4	-4.5	-5.8


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.4	8.4	8.4	8.9
Freq. (MHz)	248.0	41.0	248.0	181.5
Limit (dB)	8.1	15.9	8.1	9.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Seventh Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks