Cable ID	Summary	Test Limit	Length	Headroom	Date / Time
10	PASS	TIA Cat 6 Channel	27.3 m	7.9 dB (NEXT)	12/23/2020 11:26 AM
11	PASS	TIA Cat 6 Channel	24.7 m	5.7 dB (NEXT)	12/23/2020 11:24 AM
1	PASS	TIA Cat 6 Channel	16.3 m	6.0 dB (NEXT)	12/23/2020 12:15 AM
2	PASS	TIA Cat 6 Channel	19.8 m	4.1 dB (NEXT)	12/23/2020 12:12 AM
3	PASS	TIA Cat 6 Channel	21.7 m	3.6 dB (NEXT)	12/23/2020 12:13 AM
4	PASS	TIA Cat 6 Channel	23.2 m	7.3 dB (NEXT)	12/23/2020 12:11 AM
5	PASS	TIA Cat 6 Channel	12.7 m	3.1 dB (NEXT)	12/23/2020 12:15 AM
6	PASS	TIA Cat 6 Channel	11.6 m	3.1 dB (NEXT)	12/23/2020 12:09 AM
7	PASS	TIA Cat 6 Channel	14.8 m	5.5 dB (NEXT)	12/23/2020 12:08 AM
8	PASS	TIA Cat 6 Channel	29.4 m	3.3 dB (NEXT)	12/23/2020 12:05 AM
9	PASS	TIA Cat 6 Channel	27.3 m	6.4 dB (NEXT)	12/22/2020 10:49 PM
12	PASS	TIA Cat 6 Channel	24.9 m	7.4 dB (NEXT)	12/22/2020 09:31 PM
13	PASS	TIA Cat 6 Channel	32.0 m	5.7 dB (NEXT)	12/22/2020 09:33 PM
14	PASS	TIA Cat 6 Channel	31.2 m	6.9 dB (NEXT)	12/22/2020 09:59 PM
15	PASS	TIA Cat 6 Channel	30.3 m	7.4 dB (NEXT)	12/22/2020 10:04 PM
16	PASS	TIA Cat 6 Channel	28.8 m	7.1 dB (NEXT)	12/22/2020 09:50 PM
17	PASS	TIA Cat 6 Channel	29.9 m	6.6 dB (NEXT)	12/22/2020 09:51 PM
18	PASS	TIA Cat 6 Channel	30.7 m	4.0 dB (NEXT)	12/22/2020 09:43 PM
19	PASS	TIA Cat 6 Channel	23.9 m	7.0 dB (NEXT)	12/22/2020 09:37 PM
20	PASS	TIA Cat 6 Channel	22.8 m	7.4 dB (NEXT)	12/22/2020 09:57 PM
21	PASS	TIA Cat 6 Channel	22.1 m	5.3 dB (NEXT)	12/22/2020 09:37 PM
22	PASS	TIA Cat 6 Channel	21.3 m	4.4 dB (NEXT)	12/22/2020 09:38 PM
23	PASS	TIA Cat 6 Channel	19.6 m	7.1 dB (NEXT)	12/22/2020 09:39 PM
24	PASS	TIA Cat 6 Channel	20.0 m	3.3 dB (NEXT)	12/22/2020 09:39 PM
25	PASS	TIA Cat 6 Channel	20.6 m	3.7 dB (NEXT)	12/23/2020 12:37 AM

Total Length:	586.9 m
Number of Reports:	25
Number of Passing Reports:	25
Number of Failing Reports:	0
Number of Warning Reports:	0
Documentation Only:	0

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 10


Date / Time: 12/23/2020 11:26:36 AM
Headroom 7.9 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	27.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	129
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.8
Insertion Loss Margin (dB)	[Pair 4,5]	26.9
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS

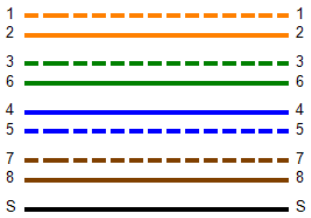





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	8.2	7.9	10.0	8.2
Freq. (MHz)	88.3	52.8	243.0	247.0
Limit (dB)	40.8	44.6	33.3	33.2
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	8.4	7.8	11.4	8.9
Freq. (MHz)	17.6	61.8	249.5	246.5
Limit (dB)	49.9	40.7	30.2	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.7	17.7	20.1	20.0
Freq. (MHz)	4.4	4.5	248.0	248.0
Limit (dB)	50.4	50.2	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	18.0	17.9	21.0	20.6
Freq. (MHz)	3.3	15.3	247.5	248.0
Limit (dB)	50.0	36.6	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	12.1	11.9	36.6	35.1
Freq. (MHz)	4.1	4.3	243.0	247.0
Limit (dB)	58.7	58.5	-2.0	-2.5
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	11.5	11.5	38.3	35.8
Freq. (MHz)	4.1	4.0	249.5	246.5
Limit (dB)	56.2	56.5	-5.7	-5.4





PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	3,6	4,5
RL (dB)	8.9	7.5	9.1	10.2
Freq. (MHz)	42.0	41.5	231.0	222.5
Limit (dB)	15.8	15.8	8.4	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 11

Date / Time: 12/23/2020 11:24:54 AM
Headroom 5.7 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	24.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	118
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.4
Insertion Loss Margin (dB)	[Pair 4,5]	27.3
Frequency (MHz)	[Pair 4,5]	248.0
Limit (dB)	[Pair 4,5]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.5	5.7	7.0	6.4
Freq. (MHz)	178.0	148.5	227.5	209.0
Limit (dB)	35.7	37.0	33.8	34.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.4	7.4	8.4	8.1
Freq. (MHz)	228.0	153.5	228.0	234.5
Limit (dB)	30.9	33.9	30.9	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	15.7	15.7	18.1	18.4
Freq. (MHz)	3.4	3.4	246.5	246.5
Limit (dB)	52.7	52.7	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.5	15.6	18.5	18.9
Freq. (MHz)	1.0	1.0	247.5	247.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	14.1	14.1	33.0	35.0
Freq. (MHz)	4.6	4.8	227.5	244.0
Limit (dB)	57.7	57.5	-0.2	-2.1
Worst Pair	4,5	4,5	4,5	3,6
PS ACR-N (dB)	13.0	13.1	36.8	35.3
Freq. (MHz)	4.6	4.6	247.5	239.5
Limit (dB)	55.2	55.2	-5.5	-4.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	4,5	4,5
RL (dB)	8.2	9.0	9.7	10.7
Freq. (MHz)	42.8	37.3	239.5	223.5
Limit (dB)	15.7	16.1	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 1


Date / Time: 12/23/2020 12:15:50 AM
Headroom 6.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	16.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	77
Delay Skew (ns), Limit 50	[Pair 1,2]	1
Resistance (ohms)	[Pair 7,8]	3.1
Insertion Loss Margin (dB)	[Pair 4,5]	30.0
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS

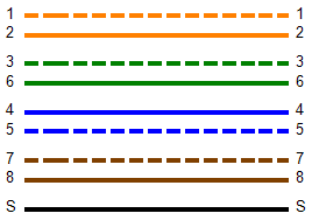





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.0	7.3	6.4	7.8
Freq. (MHz)	71.8	218.0	250.0	242.5
Limit (dB)	42.4	34.1	33.1	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.6	7.5	7.1	7.9
Freq. (MHz)	71.8	47.8	250.0	242.0
Limit (dB)	39.6	42.6	30.2	30.4







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	17.3	17.3	18.3	18.0
Freq. (MHz)	3.8	143.0	245.5	245.5
Limit (dB)	51.8	20.2	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.0	17.3	18.1	17.8
Freq. (MHz)	1.0	1.1	247.0	247.0
Limit (dB)	60.3	59.2	12.4	12.4

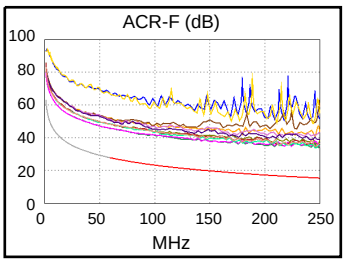





N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	12.7	12.6	36.4	37.4
Freq. (MHz)	7.6	7.8	250.0	242.5
Limit (dB)	53.0	52.8	-2.8	-2.0
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.1	12.7	37.5	37.8
Freq. (MHz)	7.5	7.8	250.0	242.0
Limit (dB)	50.6	50.3	-5.8	-4.9

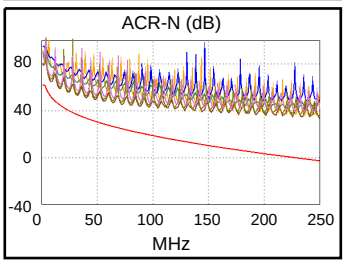

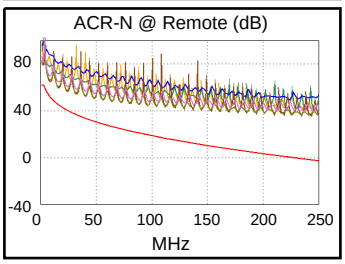

PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.0	9.0	9.3	9.0
Freq. (MHz)	80.8	219.5	250.0	219.5
Limit (dB)	12.9	8.6	8.0	8.6

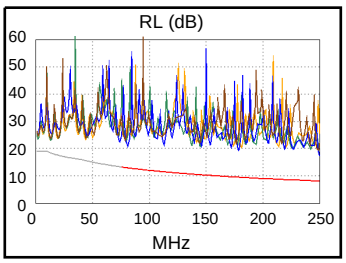

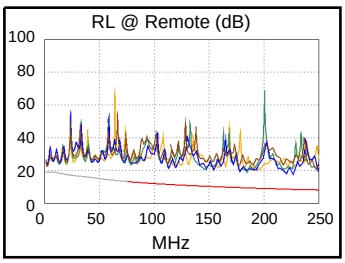

Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 2


Date / Time: 12/23/2020 12:12:47 AM
Headroom 4.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	19.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	94
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.6
Insertion Loss Margin (dB)	[Pair 1,2]	29.1
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.1	5.2	5.5	8.0
Freq. (MHz)	70.0	44.5	230.5	237.5
Limit (dB)	42.5	45.9	33.7	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.5	6.1	7.7	7.8
Freq. (MHz)	38.0	12.5	249.0	237.0
Limit (dB)	44.3	52.4	30.2	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.3	17.3	18.7	18.7
Freq. (MHz)	3.8	3.8	248.5	248.0
Limit (dB)	51.8	51.8	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.8	17.1	19.6	18.5
Freq. (MHz)	1.0	1.0	248.0	248.5
Limit (dB)	60.3	60.3	12.4	12.4

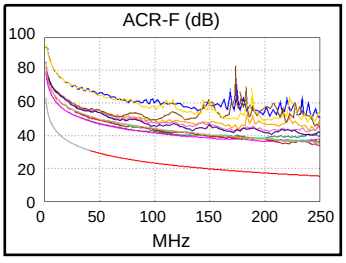

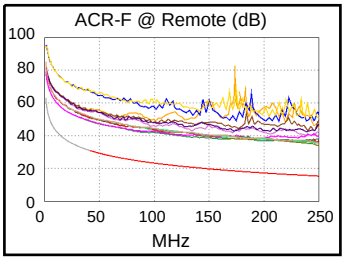



N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	9.7	9.4	35.4	36.5
Freq. (MHz)	6.1	6.1	249.5	237.5
Limit (dB)	55.1	55.1	-2.8	-1.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.8	10.4	37.0	36.4
Freq. (MHz)	6.3	6.1	249.0	238.0
Limit (dB)	52.4	52.6	-5.7	-4.4

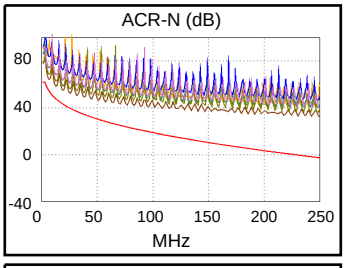

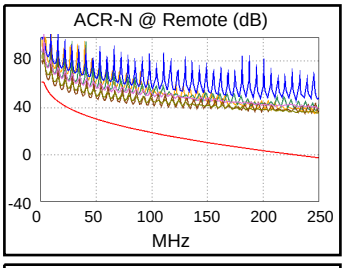

PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.3	8.6	8.1	9.5
Freq. (MHz)	77.0	115.0	244.5	224.5
Limit (dB)	13.1	11.4	8.1	8.5

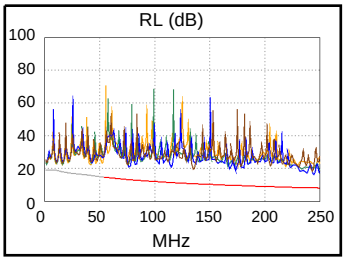

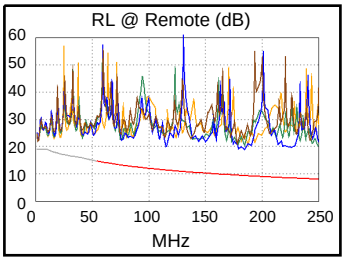

Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 3


Date / Time: 12/23/2020 12:13:14 AM
Headroom 3.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	104
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.3
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	3.6	5.7	3.9	6.4
Freq. (MHz)	177.5	194.5	223.5	241.0
Limit (dB)	35.7	35.0	34.0	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.7	6.8	6.4	7.2
Freq. (MHz)	177.5	16.8	235.0	241.0
Limit (dB)	32.8	50.3	30.6	30.4







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.7	16.7	17.7	17.5
Freq. (MHz)	3.6	3.6	250.0	250.0
Limit (dB)	52.1	52.1	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.5	16.9	19.6	19.1
Freq. (MHz)	1.0	1.9	250.0	250.0
Limit (dB)	60.3	54.8	12.3	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.3	10.5	30.6	34.7
Freq. (MHz)	5.1	5.4	223.5	246.5
Limit (dB)	56.8	56.3	0.3	-2.4
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.2	11.0	34.0	35.1
Freq. (MHz)	5.4	5.4	235.0	241.0
Limit (dB)	53.8	53.8	-4.0	-4.7





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	8.4	9.1	8.8	10.2
Freq. (MHz)	47.3	74.0	242.0	219.0
Limit (dB)	15.3	13.3	8.2	8.6

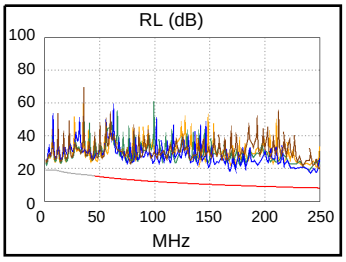



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 4


Date / Time: 12/23/2020 12:11:13 AM
Headroom 7.3 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	23.2
Prop. Delay (ns), Limit 555	[Pair 1,2]	111
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.2
Insertion Loss Margin (dB)	[Pair 1,2]	28.2
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
NEXT (dB)	7.8	7.3	10.1	9.3
Freq. (MHz)	73.8	47.5	241.0	245.5
Limit (dB)	42.2	45.4	33.4	33.3
Worst Pair	4,5	3,6	3,6	3,6
PS NEXT (dB)	9.2	8.4	11.9	9.8
Freq. (MHz)	20.9	52.5	246.5	245.0
Limit (dB)	48.7	41.9	30.3	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.9	17.9	20.0	20.0
Freq. (MHz)	5.3	4.3	247.5	247.5
Limit (dB)	48.9	50.7	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	17.5	17.8	21.6	20.4
Freq. (MHz)	1.4	1.3	244.0	247.5
Limit (dB)	57.5	58.3	12.5	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	12.3	11.7	37.8	37.3
Freq. (MHz)	5.0	5.1	241.0	245.5
Limit (dB)	57.0	56.8	-1.8	-2.3
Worst Pair	4,5	4,5	4,5	3,6
PS ACR-N (dB)	13.4	13.1	40.2	37.8
Freq. (MHz)	5.0	4.9	249.0	245.0
Limit (dB)	54.5	54.7	-5.7	-5.2





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	7.2	6.9	9.0	8.9
Freq. (MHz)	44.0	48.3	244.5	180.5
Limit (dB)	15.6	15.2	8.1	9.4





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 5

Date / Time: 12/23/2020 12:15:08 AM
Headroom 3.1 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	12.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	60
Delay Skew (ns), Limit 50	[Pair 1,2]	1
Resistance (ohms)	[Pair 3,6]	2.5
Insertion Loss Margin (dB)	[Pair 3,6]	31.2
Frequency (MHz)	[Pair 3,6]	248.5
Limit (dB)	[Pair 3,6]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	4.0	3.1	4.0	3.5
Freq. (MHz)	243.0	209.0	243.0	232.5
Limit (dB)	33.3	34.5	33.3	33.7
Worst Pair	3,6	7,8	3,6	3,6
PS NEXT (dB)	4.7	5.0	4.8	5.7
Freq. (MHz)	210.0	209.5	244.0	244.0
Limit (dB)	31.5	31.5	30.3	30.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	17.0	17.7	17.7
Freq. (MHz)	219.5	219.5	244.5	245.5
Limit (dB)	16.4	16.4	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.0	16.4	17.2	16.6
Freq. (MHz)	88.0	209.0	244.5	245.5
Limit (dB)	21.4	13.9	12.5	12.5

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	13.4	13.2	34.8	33.7
Freq. (MHz)	10.3	10.4	243.0	232.5
Limit (dB)	50.0	49.9	-2.0	-0.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	14.7	13.9	35.7	36.6
Freq. (MHz)	10.0	10.4	244.0	244.5
Limit (dB)	47.7	47.3	-5.1	-5.2


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	6.1	8.1	6.1	8.1
Freq. (MHz)	245.5	222.5	245.5	222.5
Limit (dB)	8.1	8.5	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

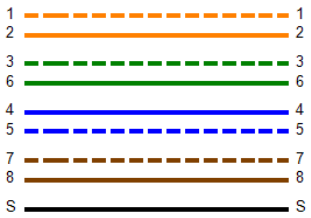
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 6

Date / Time: 12/23/2020 12:09:23 AM
Headroom 3.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	11.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	55
Delay Skew (ns), Limit 50	[Pair 1,2]	1
Resistance (ohms)	[Pair 1,2]	2.4
Insertion Loss Margin (dB)	[Pair 4,5]	31.3
Frequency (MHz)	[Pair 4,5]	247.0
Limit (dB)	[Pair 4,5]	35.7

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	3.1	3.9	4.0	4.9
Freq. (MHz)	73.5	48.8	234.0	234.5
Limit (dB)	42.2	45.2	33.6	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	4.4	5.0	5.7	5.5
Freq. (MHz)	73.5	60.8	234.0	234.5
Limit (dB)	39.4	40.8	30.7	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	1,2-4,5	4,5-1,2
ACR-F (dB)	16.5	16.5	16.7	17.0
Freq. (MHz)	121.5	194.5	245.0	245.0
Limit (dB)	21.6	17.5	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.0	17.2	17.1	17.5
Freq. (MHz)	1.0	220.5	250.0	249.0
Limit (dB)	60.3	13.4	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.9	10.6	35.8	36.6
Freq. (MHz)	11.5	11.8	246.0	246.0
Limit (dB)	48.8	48.6	-2.4	-2.4
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	12.1	11.5	37.4	37.3
Freq. (MHz)	12.0	11.8	246.0	246.5
Limit (dB)	45.7	46.0	-5.3	-5.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.0	8.5	7.6	8.5
Freq. (MHz)	175.0	223.5	247.5	223.5
Limit (dB)	9.6	8.5	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

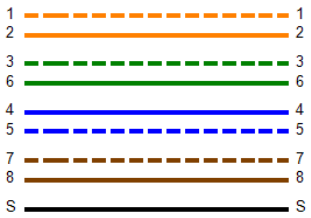
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 7


Date / Time: 12/23/2020 12:08:25 AM
Headroom 5.5 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	14.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	70
Delay Skew (ns), Limit 50	[Pair 1,2]	1
Resistance (ohms)	[Pair 1,2]	2.8
Insertion Loss Margin (dB)	[Pair 1,2]	30.8
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS

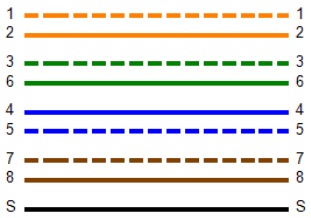





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	5.6	5.5	7.3	6.5
Freq. (MHz)	63.5	63.5	245.0	237.0
Limit (dB)	43.3	43.3	33.3	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.0	6.5	7.6	7.4
Freq. (MHz)	72.3	54.0	245.0	237.0
Limit (dB)	39.5	41.7	30.3	30.6







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	3,6-4,5
ACR-F (dB)	16.3	16.3	17.4	17.4
Freq. (MHz)	3.4	3.4	250.0	250.0
Limit (dB)	52.7	52.7	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.3	16.4	17.7	16.8
Freq. (MHz)	1.0	217.5	243.5	246.0
Limit (dB)	60.3	13.5	12.5	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-4,5	3,6-7,8
ACR-N (dB)	12.7	11.7	37.9	36.4
Freq. (MHz)	8.9	8.3	245.0	237.0
Limit (dB)	51.5	52.2	-2.3	-1.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.8	12.0	38.1	37.4
Freq. (MHz)	8.4	8.4	245.0	237.0
Limit (dB)	49.5	49.5	-5.2	-4.3





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.0	7.6	8.0	7.6
Freq. (MHz)	247.0	220.5	247.0	220.5
Limit (dB)	8.1	8.6	8.1	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 8

Date / Time: 12/23/2020 12:05:22 AM
Headroom 3.3 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	29.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	141
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	5.2
Insertion Loss Margin (dB)	[Pair 4,5]	26.2
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	4.5	3.3	5.9	6.5
Freq. (MHz)	138.0	56.0	179.5	238.0
Limit (dB)	37.5	44.2	35.6	33.5
Worst Pair	3,6	7,8	4,5	3,6
PS NEXT (dB)	6.6	4.1	8.5	7.5
Freq. (MHz)	97.0	52.0	183.5	237.5
Limit (dB)	37.3	42.0	32.5	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-7,8	7,8-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	16.6	16.4	17.9	18.0
Freq. (MHz)	106.0	106.0	250.0	250.0
Limit (dB)	22.8	22.8	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.3	16.5	18.9	19.5
Freq. (MHz)	1.0	1.0	247.0	250.0
Limit (dB)	60.3	60.3	12.4	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	9.8	10.2	27.5	33.3
Freq. (MHz)	3.6	4.0	183.5	250.0
Limit (dB)	59.9	59.0	5.4	-2.8
Worst Pair	4,5	3,6	4,5	3,6
PS ACR-N (dB)	10.8	10.3	29.9	33.0
Freq. (MHz)	3.6	3.6	183.5	237.5
Limit (dB)	57.4	57.4	2.5	-4.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	3,6	4,5
RL (dB)	7.0	6.2	8.8	9.1
Freq. (MHz)	39.3	38.8	232.5	220.5
Limit (dB)	16.0	16.1	8.3	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 9

Date / Time: 12/22/2020 10:49:54 PM
Headroom 6.4 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	27.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	130
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.7
Insertion Loss Margin (dB)	[Pair 4,5]	26.6
Frequency (MHz)	[Pair 4,5]	248.5
Limit (dB)	[Pair 4,5]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-4,5
NEXT (dB)	6.4	6.6	7.0	7.3
Freq. (MHz)	21.6	154.5	246.5	217.0
Limit (dB)	51.1	36.7	33.2	34.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.6	6.8	7.6	8.1
Freq. (MHz)	87.8	52.5	221.0	238.5
Limit (dB)	38.1	41.9	31.1	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	1,2-4,5	3,6-4,5
ACR-F (dB)	16.5	16.5	18.6	18.4
Freq. (MHz)	12.1	12.1	247.5	243.5
Limit (dB)	41.6	41.6	15.4	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.0	15.9	19.2	19.1
Freq. (MHz)	1.0	1.0	246.5	246.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-4,5
ACR-N (dB)	10.6	10.5	33.8	34.6
Freq. (MHz)	3.9	4.3	246.5	244.0
Limit (dB)	59.3	58.5	-2.4	-2.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.2	10.3	33.9	34.7
Freq. (MHz)	3.9	4.3	234.0	243.0
Limit (dB)	56.8	56.0	-3.9	-5.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	6.8	8.5	6.8	10.6
Freq. (MHz)	244.0	44.8	244.0	221.5
Limit (dB)	8.1	15.5	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 12

Date / Time: 12/22/2020 09:31:36 PM
Headroom 7.4 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	24.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	119
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.4
Insertion Loss Margin (dB)	[Pair 4,5]	27.4
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-4,5	3,6-7,8
NEXT (dB)	7.7	7.4	9.9	8.8
Freq. (MHz)	19.4	53.5	246.5	249.0
Limit (dB)	51.9	44.5	33.2	33.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.2	7.3	10.7	8.6
Freq. (MHz)	34.0	92.5	239.5	241.0
Limit (dB)	45.1	37.7	30.5	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.6	17.6	19.1	18.8
Freq. (MHz)	4.3	4.0	249.5	249.5
Limit (dB)	50.7	51.2	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.0	17.2	19.6	19.8
Freq. (MHz)	1.0	1.0	244.5	249.0
Limit (dB)	60.3	60.3	12.5	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-4,5	3,6-7,8
ACR-N (dB)	12.5	12.1	37.1	36.5
Freq. (MHz)	4.5	4.8	246.5	249.0
Limit (dB)	58.0	57.5	-2.4	-2.7
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	12.0	11.6	38.4	35.7
Freq. (MHz)	4.6	4.6	245.5	241.0
Limit (dB)	55.2	55.2	-5.3	-4.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	3,6	3,6
RL (dB)	8.6	8.6	8.9	11.5
Freq. (MHz)	42.5	45.0	245.0	245.0
Limit (dB)	15.7	15.5	8.1	8.1


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 13

Date / Time: 12/22/2020 09:33:09 PM
Headroom 5.7 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	32.0
Prop. Delay (ns), Limit 555	[Pair 1,2]	152
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.4
Insertion Loss Margin (dB)	[Pair 4,5]	25.4
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	1,2-3,6	3,6-4,5
NEXT (dB)	5.7	6.4	8.6	8.0
Freq. (MHz)	100.0	111.0	249.0	212.5
Limit (dB)	39.9	39.2	33.1	34.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.2	8.0	9.4	9.3
Freq. (MHz)	100.0	133.5	248.5	237.5
Limit (dB)	37.1	34.9	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.3	17.3	18.7	17.3
Freq. (MHz)	4.0	4.0	245.0	213.0
Limit (dB)	51.2	51.2	15.5	16.7
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.2	15.5	19.0	18.9
Freq. (MHz)	1.0	1.0	249.5	249.5
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	1,2-3,6	3,6-4,5
ACR-N (dB)	9.9	9.7	34.0	30.7
Freq. (MHz)	3.3	3.6	249.0	212.5
Limit (dB)	60.9	59.9	-2.7	1.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.2	11.3	34.8	35.2
Freq. (MHz)	3.3	3.8	248.5	248.5
Limit (dB)	58.4	57.1	-5.6	-5.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	1,2	3,6	4,5
RL (dB)	8.9	7.9	8.9	10.1
Freq. (MHz)	234.0	23.4	237.5	216.5
Limit (dB)	8.3	17.2	8.2	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 14

Date / Time: 12/22/2020 09:59:31 PM
Headroom 6.9 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	31.2
Prop. Delay (ns), Limit 555	[Pair 1,2]	148
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.4
Insertion Loss Margin (dB)	[Pair 1,2]	25.7
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	7.1	6.9	10.1	8.5
Freq. (MHz)	110.5	99.0	244.5	240.5
Limit (dB)	39.2	40.0	33.3	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.5	7.8	9.2	9.1
Freq. (MHz)	18.9	45.8	199.0	240.5
Limit (dB)	49.4	42.9	31.9	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	16.4	16.4	16.8	16.9
Freq. (MHz)	3.8	3.8	248.0	250.0
Limit (dB)	51.8	51.8	15.4	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.4	15.7	17.5	17.4
Freq. (MHz)	1.0	1.0	248.5	249.0
Limit (dB)	60.3	60.3	12.4	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	12.5	11.3	35.9	34.0
Freq. (MHz)	3.6	3.8	244.5	240.5
Limit (dB)	59.9	59.6	-2.2	-1.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.1	11.0	36.1	34.4
Freq. (MHz)	3.4	3.8	241.0	240.5
Limit (dB)	58.0	57.1	-4.7	-4.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	3,6
RL (dB)	7.9	8.8	8.4	8.9
Freq. (MHz)	44.0	40.0	250.0	187.0
Limit (dB)	15.6	16.0	8.0	9.3


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 15


Date / Time: 12/22/2020 10:04:37 PM
Headroom 7.4 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	30.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	144
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.2
Insertion Loss Margin (dB)	[Pair 4,5]	26.0
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS

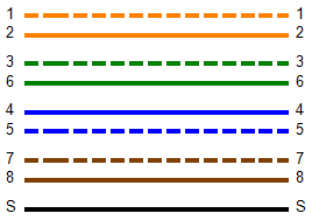





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
NEXT (dB)	8.5	7.4	12.5	7.8
Freq. (MHz)	47.0	51.0	247.0	243.0
Limit (dB)	45.5	44.9	33.2	33.3
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	8.8	7.2	12.4	8.0
Freq. (MHz)	19.3	58.5	209.5	243.0
Limit (dB)	49.2	41.1	31.5	30.4







PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.7	17.7	19.8	19.8
Freq. (MHz)	5.1	5.3	248.0	248.0
Limit (dB)	49.1	48.9	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.4	16.5	20.3	20.1
Freq. (MHz)	1.0	1.0	247.5	248.0
Limit (dB)	60.3	60.3	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	11.3	10.8	38.6	33.5
Freq. (MHz)	3.3	4.0	247.0	243.0
Limit (dB)	60.9	59.0	-2.5	-2.0
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	11.5	11.0	39.7	33.7
Freq. (MHz)	3.6	3.5	249.0	243.0
Limit (dB)	57.4	57.7	-5.7	-5.0





PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	4,5	4,5	4,5
RL (dB)	9.0	8.7	9.9	9.7
Freq. (MHz)	25.6	44.0	246.0	218.0
Limit (dB)	17.0	15.6	8.1	8.6

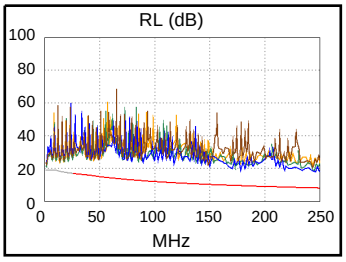



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 16


Date / Time: 12/22/2020 09:50:02 PM
Headroom 7.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	28.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	137
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.9
Insertion Loss Margin (dB)	[Pair 3,6]	26.5
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	1,2-3,6
NEXT (dB)	7.1	8.5	8.5	11.6
Freq. (MHz)	74.8	8.1	209.0	249.0
Limit (dB)	42.1	58.0	34.5	33.1
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	8.9	9.4	10.9	11.4
Freq. (MHz)	37.3	12.4	230.0	245.0
Limit (dB)	44.4	52.5	30.8	30.3







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.3	17.2	18.3	18.3
Freq. (MHz)	213.0	213.5	250.0	247.0
Limit (dB)	16.7	16.7	15.3	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.7	16.0	20.0	19.4
Freq. (MHz)	1.0	1.0	249.5	250.0
Limit (dB)	60.3	60.3	12.3	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	1,2-3,6
ACR-N (dB)	12.3	11.4	34.7	38.1
Freq. (MHz)	3.8	4.3	230.0	249.0
Limit (dB)	59.6	58.5	-0.5	-2.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.3	12.6	37.3	37.6
Freq. (MHz)	3.8	4.0	241.0	245.0
Limit (dB)	57.1	56.5	-4.7	-5.2





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.8	8.5	7.9	8.5
Freq. (MHz)	40.8	218.5	248.0	218.5
Limit (dB)	15.9	8.6	8.1	8.6

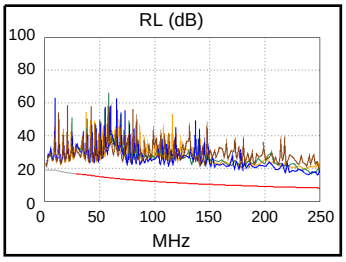



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 17

Date / Time: 12/22/2020 09:51:13 PM
Headroom 6.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	29.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	142
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.2
Insertion Loss Margin (dB)	[Pair 4,5]	25.9
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
NEXT (dB)	6.6	6.9	9.2	9.9
Freq. (MHz)	139.5	103.5	246.5	242.5
Limit (dB)	37.5	39.7	33.2	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.7	7.8	8.4	9.7
Freq. (MHz)	139.5	99.5	184.0	242.0
Limit (dB)	34.6	37.1	32.5	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.6	17.8	20.1	18.6
Freq. (MHz)	54.3	4.3	248.5	215.5
Limit (dB)	28.6	50.7	15.4	16.6
Worst Pair	4,5	3,6	3,6	4,5
PS ACR-F (dB)	17.6	17.8	20.8	20.3
Freq. (MHz)	1.0	1.0	244.5	248.5
Limit (dB)	60.3	60.3	12.5	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	11.6	12.1	35.3	35.8
Freq. (MHz)	3.6	3.9	246.5	242.5
Limit (dB)	59.9	59.3	-2.4	-2.0
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.1	11.5	36.0	35.3
Freq. (MHz)	3.4	3.8	239.0	242.0
Limit (dB)	58.0	57.1	-4.5	-4.9


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	7.9	8.3	7.9	10.2
Freq. (MHz)	248.5	38.0	248.5	217.0
Limit (dB)	8.0	16.1	8.0	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 18

Date / Time: 12/22/2020 09:43:25 PM
Headroom 4.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	30.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	147
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	5.2
Insertion Loss Margin (dB)	[Pair 1,2]	25.9
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	4.0	6.0	5.6	8.7
Freq. (MHz)	100.5	104.5	179.0	239.0
Limit (dB)	39.9	39.6	35.6	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.5	7.6	7.9	9.2
Freq. (MHz)	92.8	96.8	183.0	239.5
Limit (dB)	37.6	37.3	32.5	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	1,2-4,5	4,5-1,2
ACR-F (dB)	16.9	16.8	16.9	16.9
Freq. (MHz)	248.5	3.8	249.0	249.0
Limit (dB)	15.4	51.8	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.2	15.4	18.4	17.9
Freq. (MHz)	1.0	1.0	248.5	248.0
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	9.5	9.9	28.4	34.2
Freq. (MHz)	3.4	3.9	194.5	239.0
Limit (dB)	60.5	59.3	4.0	-1.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.9	11.1	34.4	34.6
Freq. (MHz)	3.4	3.9	230.0	239.5
Limit (dB)	58.0	56.8	-3.4	-4.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	7.7	8.2	8.2	10.7
Freq. (MHz)	44.5	44.0	238.5	218.5
Limit (dB)	15.5	15.6	8.2	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 19


Date / Time: 12/22/2020 09:37:04 PM
Headroom 7.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	23.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	113
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.2
Insertion Loss Margin (dB)	[Pair 3,6]	28.0
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	7.0	8.0	8.7	9.7
Freq. (MHz)	72.0	9.9	222.5	246.5
Limit (dB)	42.3	56.7	34.0	33.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.8	7.9	9.6	9.2
Freq. (MHz)	46.0	15.0	222.5	238.0
Limit (dB)	42.9	51.1	31.0	30.5







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.4	16.3	16.9	16.8
Freq. (MHz)	218.0	217.5	247.0	247.5
Limit (dB)	16.5	16.5	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.8	16.1	19.0	18.4
Freq. (MHz)	1.1	1.1	247.5	247.0
Limit (dB)	59.2	59.2	12.4	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	12.3	11.6	34.9	37.6
Freq. (MHz)	4.8	5.1	222.5	246.5
Limit (dB)	57.5	56.8	0.4	-2.4
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	12.3	11.9	38.3	36.9
Freq. (MHz)	4.6	4.9	248.0	243.0
Limit (dB)	55.2	54.7	-5.6	-5.0





PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	7.6	8.9	8.4	9.6
Freq. (MHz)	39.5	43.3	240.0	218.5
Limit (dB)	16.0	15.6	8.2	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 20

Date / Time: 12/22/2020 09:57:08 PM
Headroom 7.4 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	22.8
Prop. Delay (ns), Limit 555	[Pair 1,2]	108
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 1,2]	28.4
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
NEXT (dB)	7.4	7.7	10.0	9.3
Freq. (MHz)	48.8	10.8	247.0	247.5
Limit (dB)	45.2	56.1	33.2	33.2
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.0	8.1	10.7	9.8
Freq. (MHz)	32.3	10.6	249.0	246.5
Limit (dB)	45.5	53.6	30.2	30.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.1	17.1	18.1	18.2
Freq. (MHz)	3.8	3.8	248.0	249.0
Limit (dB)	51.8	51.8	15.4	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.7	15.8	19.3	19.3
Freq. (MHz)	1.0	1.0	247.0	248.0
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	12.7	11.6	38.2	37.5
Freq. (MHz)	4.8	5.4	247.0	247.5
Limit (dB)	57.5	56.3	-2.5	-2.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.6	12.0	39.1	38.0
Freq. (MHz)	5.0	5.4	249.0	246.5
Limit (dB)	54.5	53.8	-5.7	-5.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	6.2	7.7	9.5	8.9
Freq. (MHz)	42.0	41.5	245.5	184.5
Limit (dB)	15.8	15.8	8.1	9.3


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

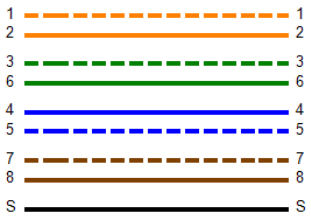
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 21

Date / Time: 12/22/2020 09:37:49 PM
Headroom 5.3 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	22.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	106
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 4,5]	28.1
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	5.3	5.8	7.0	7.0
Freq. (MHz)	72.5	78.0	241.0	236.0
Limit (dB)	42.3	41.8	33.4	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.6	6.8	8.8	7.9
Freq. (MHz)	72.3	55.5	241.0	235.5
Limit (dB)	39.5	41.5	30.4	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.1	16.1	18.6	18.3
Freq. (MHz)	3.4	3.4	245.0	245.0
Limit (dB)	52.7	52.7	15.5	15.5
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.3	15.5	20.3	20.1
Freq. (MHz)	1.0	1.0	245.0	245.5
Limit (dB)	60.3	60.3	12.5	12.5

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	11.0	10.1	34.7	34.7
Freq. (MHz)	5.1	5.5	241.0	241.5
Limit (dB)	56.8	56.1	-1.8	-1.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.8	11.0	36.7	36.1
Freq. (MHz)	5.0	5.5	241.0	241.5
Limit (dB)	54.5	53.6	-4.7	-4.8


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	3,6	4,5
RL (dB)	7.3	8.1	8.3	8.1
Freq. (MHz)	78.3	180.5	246.0	180.5
Limit (dB)	13.1	9.4	8.1	9.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 22

Date / Time: 12/22/2020 09:38:28 PM
Headroom 4.4 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	102
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.3
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	4.4	7.0	5.3	7.8
Freq. (MHz)	175.0	175.5	246.0	234.5
Limit (dB)	35.8	35.8	33.2	33.6
Worst Pair	4,5	3,6	4,5	3,6
PS NEXT (dB)	5.9	8.1	6.3	8.3
Freq. (MHz)	199.0	187.0	246.0	234.5
Limit (dB)	31.9	32.4	30.3	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	16.6	17.0	16.6
Freq. (MHz)	250.0	250.0	250.0	250.0
Limit (dB)	15.3	15.3	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.8	15.9	19.0	18.4
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	12.1	11.6	33.4	35.2
Freq. (MHz)	5.0	5.8	246.0	234.5
Limit (dB)	57.0	55.7	-2.4	-1.0
Worst Pair	4,5	3,6	4,5	3,6
PS ACR-N (dB)	12.5	12.5	34.4	37.4
Freq. (MHz)	5.0	5.5	246.0	246.5
Limit (dB)	54.5	53.6	-5.3	-5.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	3,6	4,5
RL (dB)	6.6	8.5	7.5	8.5
Freq. (MHz)	176.5	176.5	250.0	176.5
Limit (dB)	9.5	9.5	8.0	9.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 23

Date / Time: 12/22/2020 09:39:10 PM
Headroom 7.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	19.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	92
Delay Skew (ns), Limit 50	[Pair 1,2]	1
Resistance (ohms)	[Pair 7,8]	3.6
Insertion Loss Margin (dB)	[Pair 4,5]	29.2
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-4,5
NEXT (dB)	8.2	7.1	9.9	8.8
Freq. (MHz)	58.0	77.5	238.5	234.5
Limit (dB)	43.9	41.8	33.5	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.1	7.3	11.1	8.6
Freq. (MHz)	19.1	58.3	245.0	239.5
Limit (dB)	49.3	41.1	30.3	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.8	17.8	19.9	19.7
Freq. (MHz)	4.0	4.0	247.0	247.0
Limit (dB)	51.2	51.2	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.6	16.8	19.8	18.9
Freq. (MHz)	1.0	1.1	247.0	248.5
Limit (dB)	60.3	59.2	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-4,5
ACR-N (dB)	13.6	12.1	38.6	37.0
Freq. (MHz)	6.0	6.3	238.5	234.5
Limit (dB)	55.3	54.9	-1.5	-1.0
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.3	12.1	40.2	37.3
Freq. (MHz)	6.0	6.3	245.0	239.5
Limit (dB)	52.8	52.4	-5.2	-4.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.4	8.4	7.5	9.6
Freq. (MHz)	83.8	111.5	242.5	221.5
Limit (dB)	12.8	11.5	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 24

Date / Time: 12/22/2020 09:39:38 PM
Headroom 3.3 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	20.0
Prop. Delay (ns), Limit 555	[Pair 1,2]	96
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	3.6
Insertion Loss Margin (dB)	[Pair 1,2]	29.1
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	3.3	4.6	3.9	5.9
Freq. (MHz)	106.5	50.0	245.0	233.5
Limit (dB)	39.5	45.0	33.3	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	3.7	5.0	4.5	5.9
Freq. (MHz)	100.0	75.3	245.0	233.5
Limit (dB)	37.1	39.2	30.3	30.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-7,8	7,8-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	15.5	15.5	16.4	16.4
Freq. (MHz)	178.5	178.0	249.0	249.0
Limit (dB)	18.2	18.2	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	14.9	15.1	18.7	16.7
Freq. (MHz)	1.0	1.0	249.5	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	9.6	9.8	33.0	35.3
Freq. (MHz)	6.1	5.9	245.0	245.5
Limit (dB)	55.1	55.5	-2.3	-2.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	9.6	9.3	33.4	34.7
Freq. (MHz)	6.1	6.1	245.0	240.0
Limit (dB)	52.6	52.6	-5.2	-4.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	8.0	8.7	9.3	10.4
Freq. (MHz)	81.5	79.8	241.5	222.0
Limit (dB)	12.9	13.0	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 25

Date / Time: 12/23/2020 12:37:19 AM
Headroom 3.7 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	20.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	98
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 7,8]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.7
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	3.7	4.8	4.7	6.7
Freq. (MHz)	30.3	48.8	244.0	232.5
Limit (dB)	48.7	45.2	33.3	33.7
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.0	6.1	6.4	8.1
Freq. (MHz)	67.0	11.9	244.5	239.5
Limit (dB)	40.1	52.8	30.3	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	3,6-4,5
ACR-F (dB)	16.6	16.6	19.6	19.3
Freq. (MHz)	3.5	3.5	249.0	249.0
Limit (dB)	52.4	52.4	15.3	15.3
Worst Pair	4,5	1,2	4,5	4,5
PS ACR-F (dB)	16.6	17.1	21.1	20.0
Freq. (MHz)	1.0	1.0	249.5	249.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	9.5	9.8	33.4	36.1
Freq. (MHz)	5.9	5.9	244.0	245.0
Limit (dB)	55.5	55.5	-2.1	-2.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.6	10.5	35.1	37.1
Freq. (MHz)	5.5	6.0	244.5	245.5
Limit (dB)	53.6	52.8	-5.2	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.2	9.6	8.2	9.6
Freq. (MHz)	241.0	184.0	246.0	222.0
Limit (dB)	8.2	9.4	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 1

FLUKE networks