LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID	Summary	Test Limit	Length	Headroom	Date / Time
1	PASS	TIA Cat 6 Channel	22.4 m	5.8 dB (NEXT)	12/23/2020 10:22 AM
2	PASS	TIA Cat 6 Channel	29.7 m	5.6 dB (NEXT)	12/23/2020 10:21 AM
3	PASS	TIA Cat 6 Channel	23.6 m	6.0 dB (NEXT)	12/23/2020 10:52 AM
4	PASS	TIA Cat 6 Channel	25.4 m	7.2 dB (NEXT)	12/22/2020 06:43 PM
5	PASS	TIA Cat 6 Channel	32.0 m	4.4 dB (NEXT)	12/22/2020 07:10 PM
6	PASS	TIA Cat 6 Channel	27.9 m	8.8 dB (NEXT)	12/22/2020 07:11 PM
7	PASS	TIA Cat 6 Channel	27.9 m	6.7 dB (NEXT)	12/22/2020 07:12 PM
8	PASS	TIA Cat 6 Channel	27.7 m	8.2 dB (NEXT)	12/22/2020 07:13 PM
9	PASS	TIA Cat 6 Channel	26.9 m	6.7 dB (NEXT)	12/22/2020 07:13 PM
10	PASS	TIA Cat 6 Channel	30.3 m	7.5 dB (NEXT)	12/22/2020 07:15 PM
11	PASS	TIA Cat 6 Channel	27.1 m	6.5 dB (NEXT)	12/22/2020 07:16 PM
12	PASS	TIA Cat 6 Channel	20.9 m	5.2 dB (NEXT)	12/22/2020 07:17 PM
13	PASS	TIA Cat 6 Channel	21.5 m	5.5 dB (NEXT)	12/22/2020 07:27 PM
14	PASS	TIA Cat 6 Channel	20.6 m	5.8 dB (NEXT)	12/22/2020 07:26 PM
15	PASS	TIA Cat 6 Channel	22.1 m	6.4 dB (NEXT)	12/22/2020 07:24 PM
16	PASS	TIA Cat 6 Channel	23.6 m	7.4 dB (NEXT)	12/22/2020 07:37 PM
17	PASS	TIA Cat 6 Channel	21.3 m	6.0 dB (NEXT)	12/22/2020 07:39 PM
18	PASS	TIA Cat 6 Channel	21.5 m	5.6 dB (NEXT)	12/22/2020 07:40 PM
19	PASS	TIA Cat 6 Channel	22.4 m	7.1 dB (NEXT)	12/22/2020 07:41 PM
20	PASS	TIA Cat 6 Channel	23.4 m	7.0 dB (NEXT)	12/22/2020 07:42 PM
21	PASS	TIA Cat 6 Channel	23.6 m	6.2 dB (NEXT)	12/22/2020 08:53 PM

FLUKE networks

Total Length:	521.8 m
Number of Reports:	21
Number of Passing Reports:	21
Number of Failing Reports:	0
Number of Warning Reports:	0
Documentation Only:	0

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 1


Date / Time: 12/23/2020 10:22:52 AM
Headroom 5.8 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	22.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	106
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 1,2]	28.4
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	5.8	6.5	7.5	7.9
Freq. (MHz)	71.8	49.5	248.5	233.0
Limit (dB)	42.4	45.1	33.2	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.8	6.2	7.7	8.0
Freq. (MHz)	33.0	10.9	249.5	238.5
Limit (dB)	45.3	53.4	30.2	30.5







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.2	17.1	18.8	18.8
Freq. (MHz)	3.8	3.8	248.5	247.5
Limit (dB)	51.8	51.8	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.4	16.5	20.8	19.4
Freq. (MHz)	1.0	1.0	249.0	246.5
Limit (dB)	60.3	60.3	12.3	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	11.1	10.7	36.0	37.0
Freq. (MHz)	5.1	5.4	248.5	250.0
Limit (dB)	56.8	56.3	-2.7	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.7	10.3	36.3	35.7
Freq. (MHz)	4.9	5.4	249.5	238.5
Limit (dB)	54.7	53.8	-5.7	-4.4





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	8.2	8.7	8.2	8.7
Freq. (MHz)	46.0	217.5	245.0	217.5
Limit (dB)	15.4	8.6	8.1	8.6





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 2

Date / Time: 12/23/2020 10:21:30 AM
Headroom 5.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	29.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	141
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	5.1
Insertion Loss Margin (dB)	[Pair 3,6]	26.2
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	5.6	7.7	7.3	8.9
Freq. (MHz)	96.5	11.9	241.5	249.0
Limit (dB)	40.2	55.4	33.4	33.1
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.2	7.2	8.3	9.3
Freq. (MHz)	36.0	11.9	241.5	246.0
Limit (dB)	44.7	52.8	30.4	30.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.7	17.7	20.5	20.6
Freq. (MHz)	5.0	4.3	245.5	246.0
Limit (dB)	49.3	50.7	15.5	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.8	17.5	21.3	20.9
Freq. (MHz)	1.0	1.0	250.0	249.5
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	10.1	11.1	33.1	35.1
Freq. (MHz)	3.8	4.0	241.5	249.0
Limit (dB)	59.6	59.0	-1.8	-2.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	9.7	10.3	33.9	35.3
Freq. (MHz)	3.6	3.9	241.5	246.0
Limit (dB)	57.4	56.8	-4.8	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.2	8.4	9.7	8.4
Freq. (MHz)	43.3	182.0	243.5	182.0
Limit (dB)	15.6	9.4	8.1	9.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 3


Date / Time: 12/23/2020 10:52:59 AM
Headroom 6.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	23.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	112
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.2
Insertion Loss Margin (dB)	[Pair 1,2]	28.0
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.0	6.8	8.2	8.5
Freq. (MHz)	57.0	62.3	245.0	235.0
Limit (dB)	44.1	43.4	33.3	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.4	7.2	9.4	8.4
Freq. (MHz)	57.0	61.8	239.0	239.5
Limit (dB)	41.3	40.7	30.5	30.5

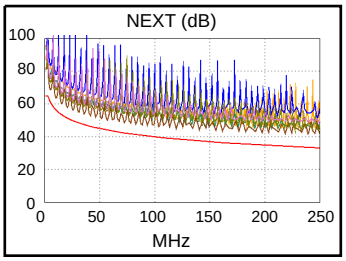





PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	3,6-4,5
ACR-F (dB)	17.6	17.6	18.3	18.1
Freq. (MHz)	4.0	4.3	249.0	249.0
Limit (dB)	51.2	50.7	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.3	17.3	20.0	19.2
Freq. (MHz)	2.6	4.3	249.0	249.0
Limit (dB)	51.9	47.7	12.3	12.3

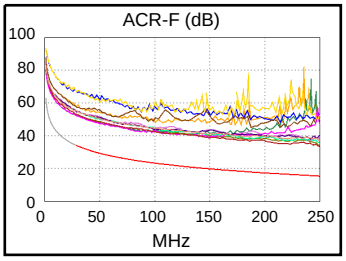





N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.8	10.8	36.0	36.2
Freq. (MHz)	4.8	4.9	245.0	240.0
Limit (dB)	57.5	57.2	-2.3	-1.7
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	11.9	11.5	37.4	36.0
Freq. (MHz)	4.9	4.9	244.5	239.5
Limit (dB)	54.7	54.7	-5.2	-4.6

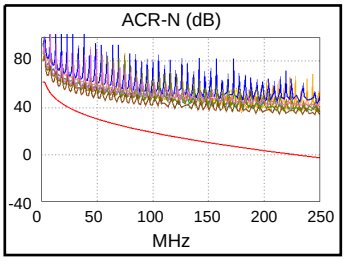



PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	6.9	8.3	8.1	10.2
Freq. (MHz)	39.8	43.5	250.0	220.0
Limit (dB)	16.0	15.6	8.0	8.6

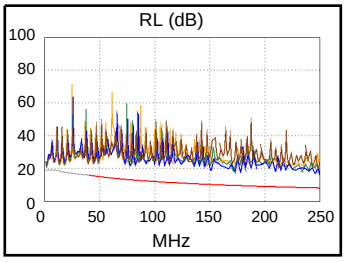



Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 4

Date / Time: 12/22/2020 06:43:01 PM
Headroom 7.2 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	25.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	121
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.5
Insertion Loss Margin (dB)	[Pair 1,2]	27.4
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	7.5	7.2	10.7	7.3
Freq. (MHz)	52.5	228.5	239.0	243.0
Limit (dB)	44.7	33.8	33.5	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.4	6.9	10.9	7.8
Freq. (MHz)	23.6	14.1	249.0	243.0
Limit (dB)	47.8	51.5	30.2	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.8	17.8	19.3	19.3
Freq. (MHz)	4.3	4.1	250.0	250.0
Limit (dB)	50.7	50.9	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.4	17.6	19.9	19.9
Freq. (MHz)	1.0	1.0	248.0	250.0
Limit (dB)	60.3	60.3	12.4	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	11.3	10.8	38.6	34.4
Freq. (MHz)	4.5	4.8	248.5	243.0
Limit (dB)	58.0	57.5	-2.7	-2.0
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.0	10.6	38.4	34.9
Freq. (MHz)	4.3	4.6	249.0	243.0
Limit (dB)	56.0	55.2	-5.7	-5.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	7.8	8.3	8.3	10.0
Freq. (MHz)	41.3	36.3	241.5	178.0
Limit (dB)	15.8	16.2	8.2	9.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 5

Date / Time: 12/22/2020 07:10:34 PM
Headroom 4.4 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	32.0
Prop. Delay (ns), Limit 555	[Pair 1,2]	153
Delay Skew (ns), Limit 50	[Pair 1,2]	4
Resistance (ohms)	[Pair 1,2]	6.0
Insertion Loss Margin (dB)	[Pair 4,5]	25.4
Frequency (MHz)	[Pair 4,5]	249.5
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	4.4	6.9	4.6	9.5
Freq. (MHz)	232.0	7.3	243.0	240.0
Limit (dB)	33.7	58.9	33.3	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	5.3	6.8	6.4	9.8
Freq. (MHz)	44.0	10.8	243.5	240.5
Limit (dB)	43.2	53.5	30.4	30.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.8	16.8	18.7	18.7
Freq. (MHz)	4.6	3.8	247.5	247.5
Limit (dB)	50.0	51.8	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.1	16.3	19.9	18.8
Freq. (MHz)	1.0	1.0	247.0	247.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	8.4	10.0	29.7	34.5
Freq. (MHz)	3.3	3.6	243.0	240.0
Limit (dB)	60.9	59.9	-2.0	-1.7
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	8.8	9.5	31.5	34.7
Freq. (MHz)	3.4	3.6	243.5	240.5
Limit (dB)	58.0	57.4	-5.0	-4.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	1,2	4,5	4,5
RL (dB)	8.1	8.4	8.8	10.0
Freq. (MHz)	178.0	23.4	248.5	219.0
Limit (dB)	9.5	17.2	8.0	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 6

Date / Time: 12/22/2020 07:11:46 PM
Headroom 8.8 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	27.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	132
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 7,8]	4.9
Insertion Loss Margin (dB)	[Pair 3,6]	26.7
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
NEXT (dB)	9.8	8.8	11.0	8.9
Freq. (MHz)	34.3	8.5	241.5	245.5
Limit (dB)	47.8	57.7	33.4	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	9.5	8.6	11.9	9.2
Freq. (MHz)	21.4	12.5	242.0	245.5
Limit (dB)	48.5	52.4	30.4	30.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.6	16.6	18.4	18.5
Freq. (MHz)	3.6	3.6	250.0	250.0
Limit (dB)	52.1	52.1	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.2	16.4	20.0	19.8
Freq. (MHz)	1.0	1.3	250.0	250.0
Limit (dB)	60.3	58.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	13.0	12.0	37.3	35.5
Freq. (MHz)	3.9	4.3	241.5	245.5
Limit (dB)	59.3	58.5	-1.8	-2.3
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.6	12.2	38.2	35.7
Freq. (MHz)	3.9	4.3	242.0	245.5
Limit (dB)	56.8	56.0	-4.9	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	3,6	4,5	4,5
RL (dB)	7.7	9.0	8.5	9.1
Freq. (MHz)	45.0	37.0	243.5	217.5
Limit (dB)	15.5	16.2	8.1	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 7

Date / Time: 12/22/2020 07:12:23 PM
Headroom 6.7 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	27.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	133
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.8
Insertion Loss Margin (dB)	[Pair 4,5]	26.5
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	6.7	6.7	7.3	6.8
Freq. (MHz)	64.3	98.3	224.0	235.0
Limit (dB)	43.2	40.1	33.9	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.4	6.6	8.6	8.0
Freq. (MHz)	17.0	51.0	215.0	238.5
Limit (dB)	50.2	42.1	31.3	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.8	17.8	18.5	18.3
Freq. (MHz)	4.1	4.1	249.0	249.0
Limit (dB)	50.9	50.9	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.6	15.9	19.6	19.5
Freq. (MHz)	1.0	1.0	249.0	249.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	11.6	10.2	34.6	33.1
Freq. (MHz)	3.9	4.3	246.0	239.5
Limit (dB)	59.3	58.5	-2.4	-1.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.2	10.2	36.3	33.9
Freq. (MHz)	3.9	4.3	245.5	238.5
Limit (dB)	56.8	56.0	-5.3	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6	3,6	4,5	4,5
RL (dB)	8.5	8.4	9.7	10.4
Freq. (MHz)	41.5	40.5	250.0	220.5
Limit (dB)	15.8	15.9	8.0	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 8


Date / Time: 12/22/2020 07:13:10 PM
Headroom 8.2 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	27.7
Prop. Delay (ns), Limit 555	[Pair 1,2]	131
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.9
Insertion Loss Margin (dB)	[Pair 4,5]	26.7
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9





Wire Map (T568B)
PASS







	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	8.2	8.8	9.6	9.1
Freq. (MHz)	56.5	8.8	218.5	243.5
Limit (dB)	44.1	57.5	34.1	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.5	8.3	10.5	9.6
Freq. (MHz)	56.3	12.8	219.0	238.5
Limit (dB)	41.4	52.2	31.2	30.5







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.1	17.9	18.4	18.3
Freq. (MHz)	221.0	221.0	244.5	248.5
Limit (dB)	16.4	16.4	15.5	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.9	16.2	19.7	19.5
Freq. (MHz)	1.0	1.0	249.0	248.5
Limit (dB)	60.3	60.3	12.3	12.4







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	13.1	11.8	35.3	35.7
Freq. (MHz)	3.9	4.3	227.5	243.5
Limit (dB)	59.3	58.5	-0.2	-2.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.5	11.7	37.9	36.2
Freq. (MHz)	3.9	4.4	244.5	243.5
Limit (dB)	56.8	55.7	-5.2	-5.0





PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	3,6	4,5	4,5
RL (dB)	6.9	8.5	9.1	9.9
Freq. (MHz)	42.0	41.3	246.0	223.5
Limit (dB)	15.8	15.8	8.1	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 9

Date / Time: 12/22/2020 07:13:55 PM
Headroom 6.7 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	26.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	127
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 3,6]	21.7
Insertion Loss Margin (dB)	[Pair 3,6]	26.4
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-4,5	3,6-7,8
NEXT (dB)	6.7	6.9	9.6	7.4
Freq. (MHz)	31.5	13.3	246.5	238.5
Limit (dB)	48.4	54.6	33.2	33.5
Worst Pair	3,6	3,6	4,5	3,6
PS NEXT (dB)	7.7	7.3	10.4	8.0
Freq. (MHz)	36.0	8.9	239.0	238.5
Limit (dB)	44.7	54.9	30.5	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	3,6-4,5	4,5-3,6
ACR-F (dB)	15.8	15.8	17.7	17.0
Freq. (MHz)	3.4	3.3	248.0	248.5
Limit (dB)	52.7	53.0	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.4	15.5	19.1	19.6
Freq. (MHz)	1.0	1.0	248.0	248.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	1,2-4,5	3,6-7,8
ACR-N (dB)	11.5	11.4	36.5	33.8
Freq. (MHz)	4.0	4.3	246.5	238.5
Limit (dB)	59.0	58.5	-2.4	-1.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.0	10.4	37.2	33.7
Freq. (MHz)	4.0	4.3	248.5	238.5
Limit (dB)	56.5	56.0	-5.6	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	3,6	4,5	4,5
RL (dB)	7.0	2.4	8.2	8.7
Freq. (MHz)	38.5	21.0	241.0	222.5
Limit (dB)	16.1	17.4	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 10

Date / Time: 12/22/2020 07:15:08 PM
Headroom 7.5 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	30.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	144
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 7,8]	5.4
Insertion Loss Margin (dB)	[Pair 4,5]	25.9
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
NEXT (dB)	7.5	7.7	12.0	8.0
Freq. (MHz)	51.0	7.8	247.0	239.5
Limit (dB)	44.9	58.4	33.2	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.2	7.7	11.7	8.1
Freq. (MHz)	19.5	11.5	248.0	239.5
Limit (dB)	49.2	53.0	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.7	17.5	17.9	17.8
Freq. (MHz)	211.0	213.0	247.5	247.5
Limit (dB)	16.8	16.7	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.0	17.0	18.7	19.0
Freq. (MHz)	1.0	1.0	249.0	247.5
Limit (dB)	60.3	60.3	12.3	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	10.6	10.5	37.9	33.4
Freq. (MHz)	3.8	3.8	247.0	239.5
Limit (dB)	59.6	59.6	-2.5	-1.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.0	10.9	37.7	34.4
Freq. (MHz)	3.8	3.8	248.0	248.0
Limit (dB)	57.1	57.1	-5.6	-5.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	7,8	4,5	4,5	4,5
RL (dB)	8.1	8.4	8.5	9.9
Freq. (MHz)	45.3	118.0	238.5	221.5
Limit (dB)	15.4	11.3	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

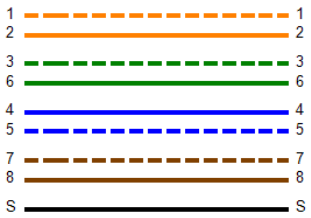
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 11


Date / Time: 12/22/2020 07:16:17 PM
Headroom 6.5 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010


Test Summary: PASS


Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	27.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	129
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.7
Insertion Loss Margin (dB)	[Pair 1,2]	27.0
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9





Wire Map (T568B)
PASS

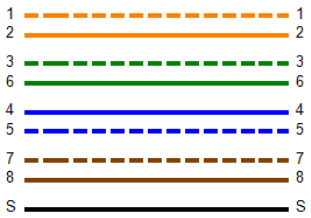





	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	6.9	6.5	9.0	8.0
Freq. (MHz)	22.3	44.5	210.5	239.5
Limit (dB)	50.9	45.9	34.4	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.8	7.1	11.0	8.1
Freq. (MHz)	22.3	13.0	250.0	239.5
Limit (dB)	48.2	52.1	30.2	30.5







PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-1,2	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.9	17.9	19.0	19.0
Freq. (MHz)	4.6	4.5	245.5	245.5
Limit (dB)	50.0	50.2	15.5	15.5
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.4	17.5	20.3	19.8
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3







N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	10.4	9.9	36.7	34.4
Freq. (MHz)	4.3	4.5	242.0	239.5
Limit (dB)	58.5	58.0	-1.9	-1.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.9	10.7	38.1	35.6
Freq. (MHz)	4.3	4.6	250.0	249.0
Limit (dB)	56.0	55.2	-5.8	-5.7





PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	1,2	4,5	4,5
RL (dB)	7.1	8.1	7.1	9.2
Freq. (MHz)	247.0	45.3	247.0	224.5
Limit (dB)	8.1	15.4	8.1	8.5





Compliant Network Standards:

10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		

LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 12

Date / Time: 12/22/2020 07:17:09 PM
Headroom 5.2 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	20.9
Prop. Delay (ns), Limit 555	[Pair 1,2]	99
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 1,2]	28.6
Frequency (MHz)	[Pair 1,2]	248.5
Limit (dB)	[Pair 1,2]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	5.2	5.3	7.8	7.8
Freq. (MHz)	41.8	60.0	240.0	235.0
Limit (dB)	46.3	43.7	33.4	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.9	6.9	8.8	8.6
Freq. (MHz)	29.8	11.9	227.5	238.0
Limit (dB)	46.1	52.8	30.9	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.4	16.3	16.4	16.3
Freq. (MHz)	221.0	221.0	221.5	221.5
Limit (dB)	16.4	16.4	16.3	16.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.0	17.0	19.2	18.2
Freq. (MHz)	1.1	2.6	250.0	249.5
Limit (dB)	59.2	51.9	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.0	9.8	36.2	35.8
Freq. (MHz)	5.5	5.5	240.0	235.0
Limit (dB)	56.1	56.1	-1.7	-1.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.6	11.1	37.6	37.9
Freq. (MHz)	5.6	5.6	240.0	250.0
Limit (dB)	53.4	53.4	-4.6	-5.8


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	8.1	8.9	8.1	10.1
Freq. (MHz)	247.0	48.3	247.0	222.5
Limit (dB)	8.1	15.2	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 13

Date / Time: 12/22/2020 07:27:34 PM
Headroom 5.5 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.5
Prop. Delay (ns), Limit 555	[Pair 1,2]	102
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.9
Insertion Loss Margin (dB)	[Pair 4,5]	28.4
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-4,5	3,6-7,8
NEXT (dB)	5.5	5.9	6.7	6.4
Freq. (MHz)	74.8	97.5	250.0	237.0
Limit (dB)	42.1	40.1	33.1	33.5
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.0	6.1	9.0	6.8
Freq. (MHz)	74.5	74.8	249.5	238.0
Limit (dB)	39.3	39.3	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-7,8	7,8-4,5
ACR-F (dB)	17.8	17.8	19.5	19.1
Freq. (MHz)	4.0	4.0	247.5	247.5
Limit (dB)	51.2	51.2	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.7	17.0	20.3	18.9
Freq. (MHz)	1.0	1.0	247.5	218.0
Limit (dB)	60.3	60.3	12.4	13.5

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	11.0	10.8	35.1	34.9
Freq. (MHz)	5.4	5.5	250.0	242.5
Limit (dB)	56.3	56.1	-2.8	-2.0
Worst Pair	3,6	3,6	4,5	3,6
PS ACR-N (dB)	11.8	11.0	37.6	34.6
Freq. (MHz)	5.5	5.4	250.0	238.0
Limit (dB)	53.6	53.8	-5.8	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.7	9.0	7.7	9.1
Freq. (MHz)	239.5	47.0	239.5	221.5
Limit (dB)	8.2	15.3	8.2	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS

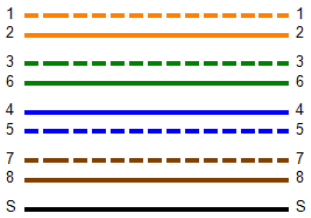
























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 14

Date / Time: 12/22/2020 07:26:25 PM
Headroom 5.8 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	20.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	98
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.7
Insertion Loss Margin (dB)	[Pair 1,2]	28.9
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	5.8	6.6	8.8	8.8
Freq. (MHz)	60.5	11.9	243.0	244.0
Limit (dB)	43.6	55.4	33.3	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.4	6.8	9.5	8.6
Freq. (MHz)	36.0	11.9	242.5	238.0
Limit (dB)	44.7	52.8	30.4	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	3,6-4,5
ACR-F (dB)	17.5	17.5	18.1	18.1
Freq. (MHz)	3.9	3.9	248.5	248.0
Limit (dB)	51.5	51.5	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.9	16.5	20.1	19.5
Freq. (MHz)	1.0	1.0	248.5	248.5
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	11.2	10.6	37.3	37.4
Freq. (MHz)	5.5	5.8	243.0	244.0
Limit (dB)	56.1	55.7	-2.0	-2.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.5	11.0	38.1	36.9
Freq. (MHz)	5.6	5.8	243.0	238.0
Limit (dB)	53.4	53.2	-5.0	-4.4


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	6.9	8.0	7.4	9.5
Freq. (MHz)	177.5	153.5	245.0	225.5
Limit (dB)	9.5	10.1	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 15

Date / Time: 12/22/2020 07:24:58 PM
Headroom 6.4 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	22.1
Prop. Delay (ns), Limit 555	[Pair 1,2]	105
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 3,6]	28.4
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	6.4	7.9	8.0	7.9
Freq. (MHz)	106.5	11.0	242.0	239.5
Limit (dB)	39.5	55.9	33.4	33.4
Worst Pair	4,5	3,6	3,6	3,6
PS NEXT (dB)	8.1	8.4	10.1	8.7
Freq. (MHz)	50.3	10.9	249.5	239.5
Limit (dB)	42.2	53.4	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-3,6	3,6-4,5
ACR-F (dB)	17.0	17.0	17.7	17.8
Freq. (MHz)	3.8	3.8	246.0	247.5
Limit (dB)	51.8	51.8	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	16.3	16.7	19.4	18.8
Freq. (MHz)	1.0	1.0	245.5	247.5
Limit (dB)	60.3	60.3	12.5	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	11.7	11.7	36.1	35.7
Freq. (MHz)	5.0	5.5	242.0	239.5
Limit (dB)	57.0	56.1	-1.9	-1.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.8	12.4	38.5	37.1
Freq. (MHz)	5.3	5.3	249.5	245.5
Limit (dB)	54.0	54.0	-5.7	-5.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	7.1	8.0	7.2	8.7
Freq. (MHz)	47.3	118.0	244.0	221.0
Limit (dB)	15.3	11.3	8.1	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 16

Date / Time: 12/22/2020 07:37:53 PM
Headroom 7.4 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	23.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	112
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.2
Insertion Loss Margin (dB)	[Pair 4,5]	27.9
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	8.2	7.4	10.4	8.6
Freq. (MHz)	119.5	51.5	239.5	239.5
Limit (dB)	38.6	44.8	33.4	33.4
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.8	8.0	9.7	8.8
Freq. (MHz)	82.8	98.8	230.0	235.5
Limit (dB)	38.5	37.2	30.8	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	3,6-4,5	3,6-4,5
ACR-F (dB)	17.4	17.4	19.8	19.7
Freq. (MHz)	3.9	3.9	250.0	250.0
Limit (dB)	51.5	51.5	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	16.9	17.1	20.3	20.0
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-4,5	3,6-7,8
ACR-N (dB)	14.2	13.1	38.7	36.1
Freq. (MHz)	4.9	5.0	246.0	239.5
Limit (dB)	57.2	57.0	-2.4	-1.6
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	13.7	13.0	38.2	35.9
Freq. (MHz)	4.9	5.0	245.5	235.5
Limit (dB)	54.7	54.5	-5.3	-4.1


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	3,6	3,6
RL (dB)	8.6	8.3	9.8	9.2
Freq. (MHz)	43.8	47.3	235.5	182.5
Limit (dB)	15.6	15.3	8.3	9.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 17

Date / Time: 12/22/2020 07:39:16 PM
Headroom 6.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.3
Prop. Delay (ns), Limit 555	[Pair 1,2]	101
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 7,8]	3.9
Insertion Loss Margin (dB)	[Pair 3,6]	28.7
Frequency (MHz)	[Pair 3,6]	250.0
Limit (dB)	[Pair 3,6]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	6.0	6.2	7.4	7.3
Freq. (MHz)	58.3	81.8	247.0	235.5
Limit (dB)	43.9	41.4	33.2	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.2	6.2	8.5	7.6
Freq. (MHz)	29.0	52.5	247.5	235.5
Limit (dB)	46.3	41.9	30.2	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5-3,6	3,6-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	18.5	18.5	19.1	19.2
Freq. (MHz)	215.0	214.5	250.0	250.0
Limit (dB)	16.6	16.6	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	17.6	17.8	20.6	20.0
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.9	10.6	36.0	35.8
Freq. (MHz)	5.5	5.8	247.0	241.5
Limit (dB)	56.1	55.7	-2.5	-1.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.9	10.5	37.1	35.4
Freq. (MHz)	5.5	5.8	247.5	235.5
Limit (dB)	53.6	53.2	-5.5	-4.1


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	4,5	4,5	4,5
RL (dB)	7.2	8.2	8.2	8.8
Freq. (MHz)	182.5	117.0	242.5	219.0
Limit (dB)	9.4	11.3	8.2	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 18

Date / Time: 12/22/2020 07:40:16 PM
Headroom 5.6 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	21.5
Prop. Delay (ns), Limit 555	[Pair 1,2]	102
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	3.8
Insertion Loss Margin (dB)	[Pair 4,5]	28.5
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
NEXT (dB)	5.6	6.4	6.9	7.7
Freq. (MHz)	98.0	45.8	231.5	244.0
Limit (dB)	40.1	45.7	33.7	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	6.0	6.4	7.5	7.9
Freq. (MHz)	57.0	46.0	231.5	237.5
Limit (dB)	41.3	42.9	30.7	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.2	16.2	18.3	18.1
Freq. (MHz)	3.4	3.4	248.0	248.0
Limit (dB)	52.7	52.7	15.4	15.4
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.6	15.6	20.3	19.3
Freq. (MHz)	1.0	1.0	247.5	248.0
Limit (dB)	60.3	60.3	12.4	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-4,5
ACR-N (dB)	10.9	10.6	36.3	35.8
Freq. (MHz)	5.0	5.5	249.5	244.0
Limit (dB)	57.0	56.1	-2.8	-2.1
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	10.8	10.6	35.5	36.9
Freq. (MHz)	5.0	5.5	237.0	249.0
Limit (dB)	54.5	53.6	-4.3	-5.7


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	7.6	8.5	7.9	8.7
Freq. (MHz)	180.5	47.3	245.0	180.5
Limit (dB)	9.4	15.3	8.1	9.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 19

Date / Time: 12/22/2020 07:41:01 PM
Headroom 7.1 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 3,6]	22.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	106
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.0
Insertion Loss Margin (dB)	[Pair 1,2]	28.4
Frequency (MHz)	[Pair 1,2]	250.0
Limit (dB)	[Pair 1,2]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	7.1	7.1	8.3	8.4
Freq. (MHz)	60.8	55.3	249.0	234.0
Limit (dB)	43.6	44.3	33.1	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.0	6.7	9.2	8.2
Freq. (MHz)	21.8	55.3	249.5	239.0
Limit (dB)	48.4	41.5	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	17.4	17.3	18.5	18.4
Freq. (MHz)	3.9	4.3	248.5	248.0
Limit (dB)	51.5	50.7	15.4	15.4
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	15.5	15.4	19.7	19.1
Freq. (MHz)	1.0	1.0	249.0	248.5
Limit (dB)	60.3	60.3	12.3	12.4

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-7,8	3,6-7,8
ACR-N (dB)	12.2	11.4	36.7	36.2
Freq. (MHz)	5.0	5.4	249.0	239.0
Limit (dB)	57.0	56.3	-2.7	-1.5
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	11.6	11.1	37.7	36.0
Freq. (MHz)	5.0	5.4	249.5	239.0
Limit (dB)	54.5	53.8	-5.7	-4.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	3,6	3,6	3,6
RL (dB)	7.7	8.4	8.0	8.4
Freq. (MHz)	46.5	183.0	238.5	183.0
Limit (dB)	15.3	9.4	8.2	9.4


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 20

Date / Time: 12/22/2020 07:42:04 PM
Headroom 7.0 dB (NEXT 3,6-4,5)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	23.4
Prop. Delay (ns), Limit 555	[Pair 1,2]	111
Delay Skew (ns), Limit 50	[Pair 1,2]	2
Resistance (ohms)	[Pair 1,2]	4.2
Insertion Loss Margin (dB)	[Pair 1,2]	27.9
Frequency (MHz)	[Pair 1,2]	248.5
Limit (dB)	[Pair 1,2]	35.8

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
NEXT (dB)	7.0	7.7	9.4	8.3
Freq. (MHz)	68.0	10.4	210.5	235.0
Limit (dB)	42.8	56.3	34.4	33.6
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	8.0	7.8	11.6	8.8
Freq. (MHz)	68.0	15.4	247.0	237.0
Limit (dB)	40.0	50.9	30.2	30.6


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	1,2-4,5	4,5-3,6	3,6-4,5
ACR-F (dB)	16.9	16.8	19.4	19.4
Freq. (MHz)	3.8	3.6	250.0	250.0
Limit (dB)	51.8	52.1	15.3	15.3
Worst Pair	4,5	4,5	3,6	4,5
PS ACR-F (dB)	15.1	15.3	21.4	20.1
Freq. (MHz)	1.0	1.0	250.0	250.0
Limit (dB)	60.3	60.3	12.3	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-4,5	3,6-4,5	3,6-4,5	3,6-7,8
ACR-N (dB)	12.5	11.4	38.6	37.0
Freq. (MHz)	4.6	5.1	247.5	250.0
Limit (dB)	57.7	56.8	-2.5	-2.8
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.8	11.9	39.5	36.2
Freq. (MHz)	4.6	5.0	247.0	237.0
Limit (dB)	55.2	54.5	-5.4	-4.3


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2	4,5	4,5	4,5
RL (dB)	8.0	9.0	8.4	9.5
Freq. (MHz)	44.0	120.0	238.5	217.0
Limit (dB)	15.6	11.2	8.2	8.6


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks

LINKWARE™PC
CABLE TEST MANAGEMENT SOFTWARE

Cable ID: 21

Date / Time: 12/22/2020 08:53:09 PM
Headroom 6.2 dB (NEXT 3,6-7,8)
Test Limit: TIA Cat 6 Channel
Cable Type: Cat 6 FTP
NVP: 71.7%

Operator: STS
Software Version: 2.7400
Limits Version: 1.9300
Calibration Date:
Main (Tester): 03/04/2010
Remote (Tester): 03/04/2010

Test Summary: PASS

Model: DTX-1800
Main S/N: 1246007
Remote S/N: 1246008
Main Adapter: DTX-PLA002
Remote Adapter: DTX-CHA002

Length (m), Limit 100.0	[Pair 4,5]	23.6
Prop. Delay (ns), Limit 555	[Pair 1,2]	113
Delay Skew (ns), Limit 50	[Pair 1,2]	3
Resistance (ohms)	[Pair 1,2]	4.2
Insertion Loss Margin (dB)	[Pair 4,5]	27.7
Frequency (MHz)	[Pair 4,5]	250.0
Limit (dB)	[Pair 4,5]	35.9

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
NEXT (dB)	6.2	7.4	8.4	9.4
Freq. (MHz)	71.8	46.3	248.5	243.0
Limit (dB)	42.4	45.6	33.2	33.3
Worst Pair	3,6	3,6	3,6	3,6
PS NEXT (dB)	7.3	8.2	10.5	9.7
Freq. (MHz)	67.0	46.0	249.0	238.5
Limit (dB)	40.1	42.9	30.2	30.5


PASS	MAIN	SR	MAIN	SR
Worst Pair	1,2-4,5	4,5-1,2	4,5-7,8	7,8-4,5
ACR-F (dB)	18.4	18.5	22.3	21.9
Freq. (MHz)	92.0	92.0	249.0	249.0
Limit (dB)	24.0	24.0	15.3	15.3
Worst Pair	4,5	4,5	4,5	4,5
PS ACR-F (dB)	18.7	18.9	23.6	22.2
Freq. (MHz)	1.0	2.6	248.5	249.0
Limit (dB)	60.3	51.9	12.4	12.3

N/A	MAIN	SR	MAIN	SR
Worst Pair	3,6-7,8	3,6-7,8	3,6-7,8	3,6-7,8
ACR-N (dB)	11.6	11.8	36.5	37.0
Freq. (MHz)	4.5	4.9	248.5	243.0
Limit (dB)	58.0	57.2	-2.7	-2.0
Worst Pair	3,6	3,6	3,6	3,6
PS ACR-N (dB)	12.3	12.1	38.6	37.5
Freq. (MHz)	4.6	4.9	249.0	243.5
Limit (dB)	55.2	54.7	-5.7	-5.0


PASS	MAIN	SR	MAIN	SR
Worst Pair	4,5	3,6	4,5	4,5
RL (dB)	7.4	8.5	8.0	10.8
Freq. (MHz)	78.0	43.5	245.0	223.5
Limit (dB)	13.1	15.6	8.1	8.5


Compliant Network Standards:


10BASE-T	100BASE-TX	100BASE-T4
1000BASE-T	2.5GBASE-T	5GBASE-T
ATM-25	ATM-51	ATM-155
100VG-AnyLan	TR-4	TR-16 Active
TR-16 Passive		





Wire Map (T568B)
PASS


























LinkWare™ PC Version 10.4

Project: MOI
Floor: Sixth Floor
Patch: Cupper

MOI.flw
Rack: Cabinet 2

FLUKE networks