


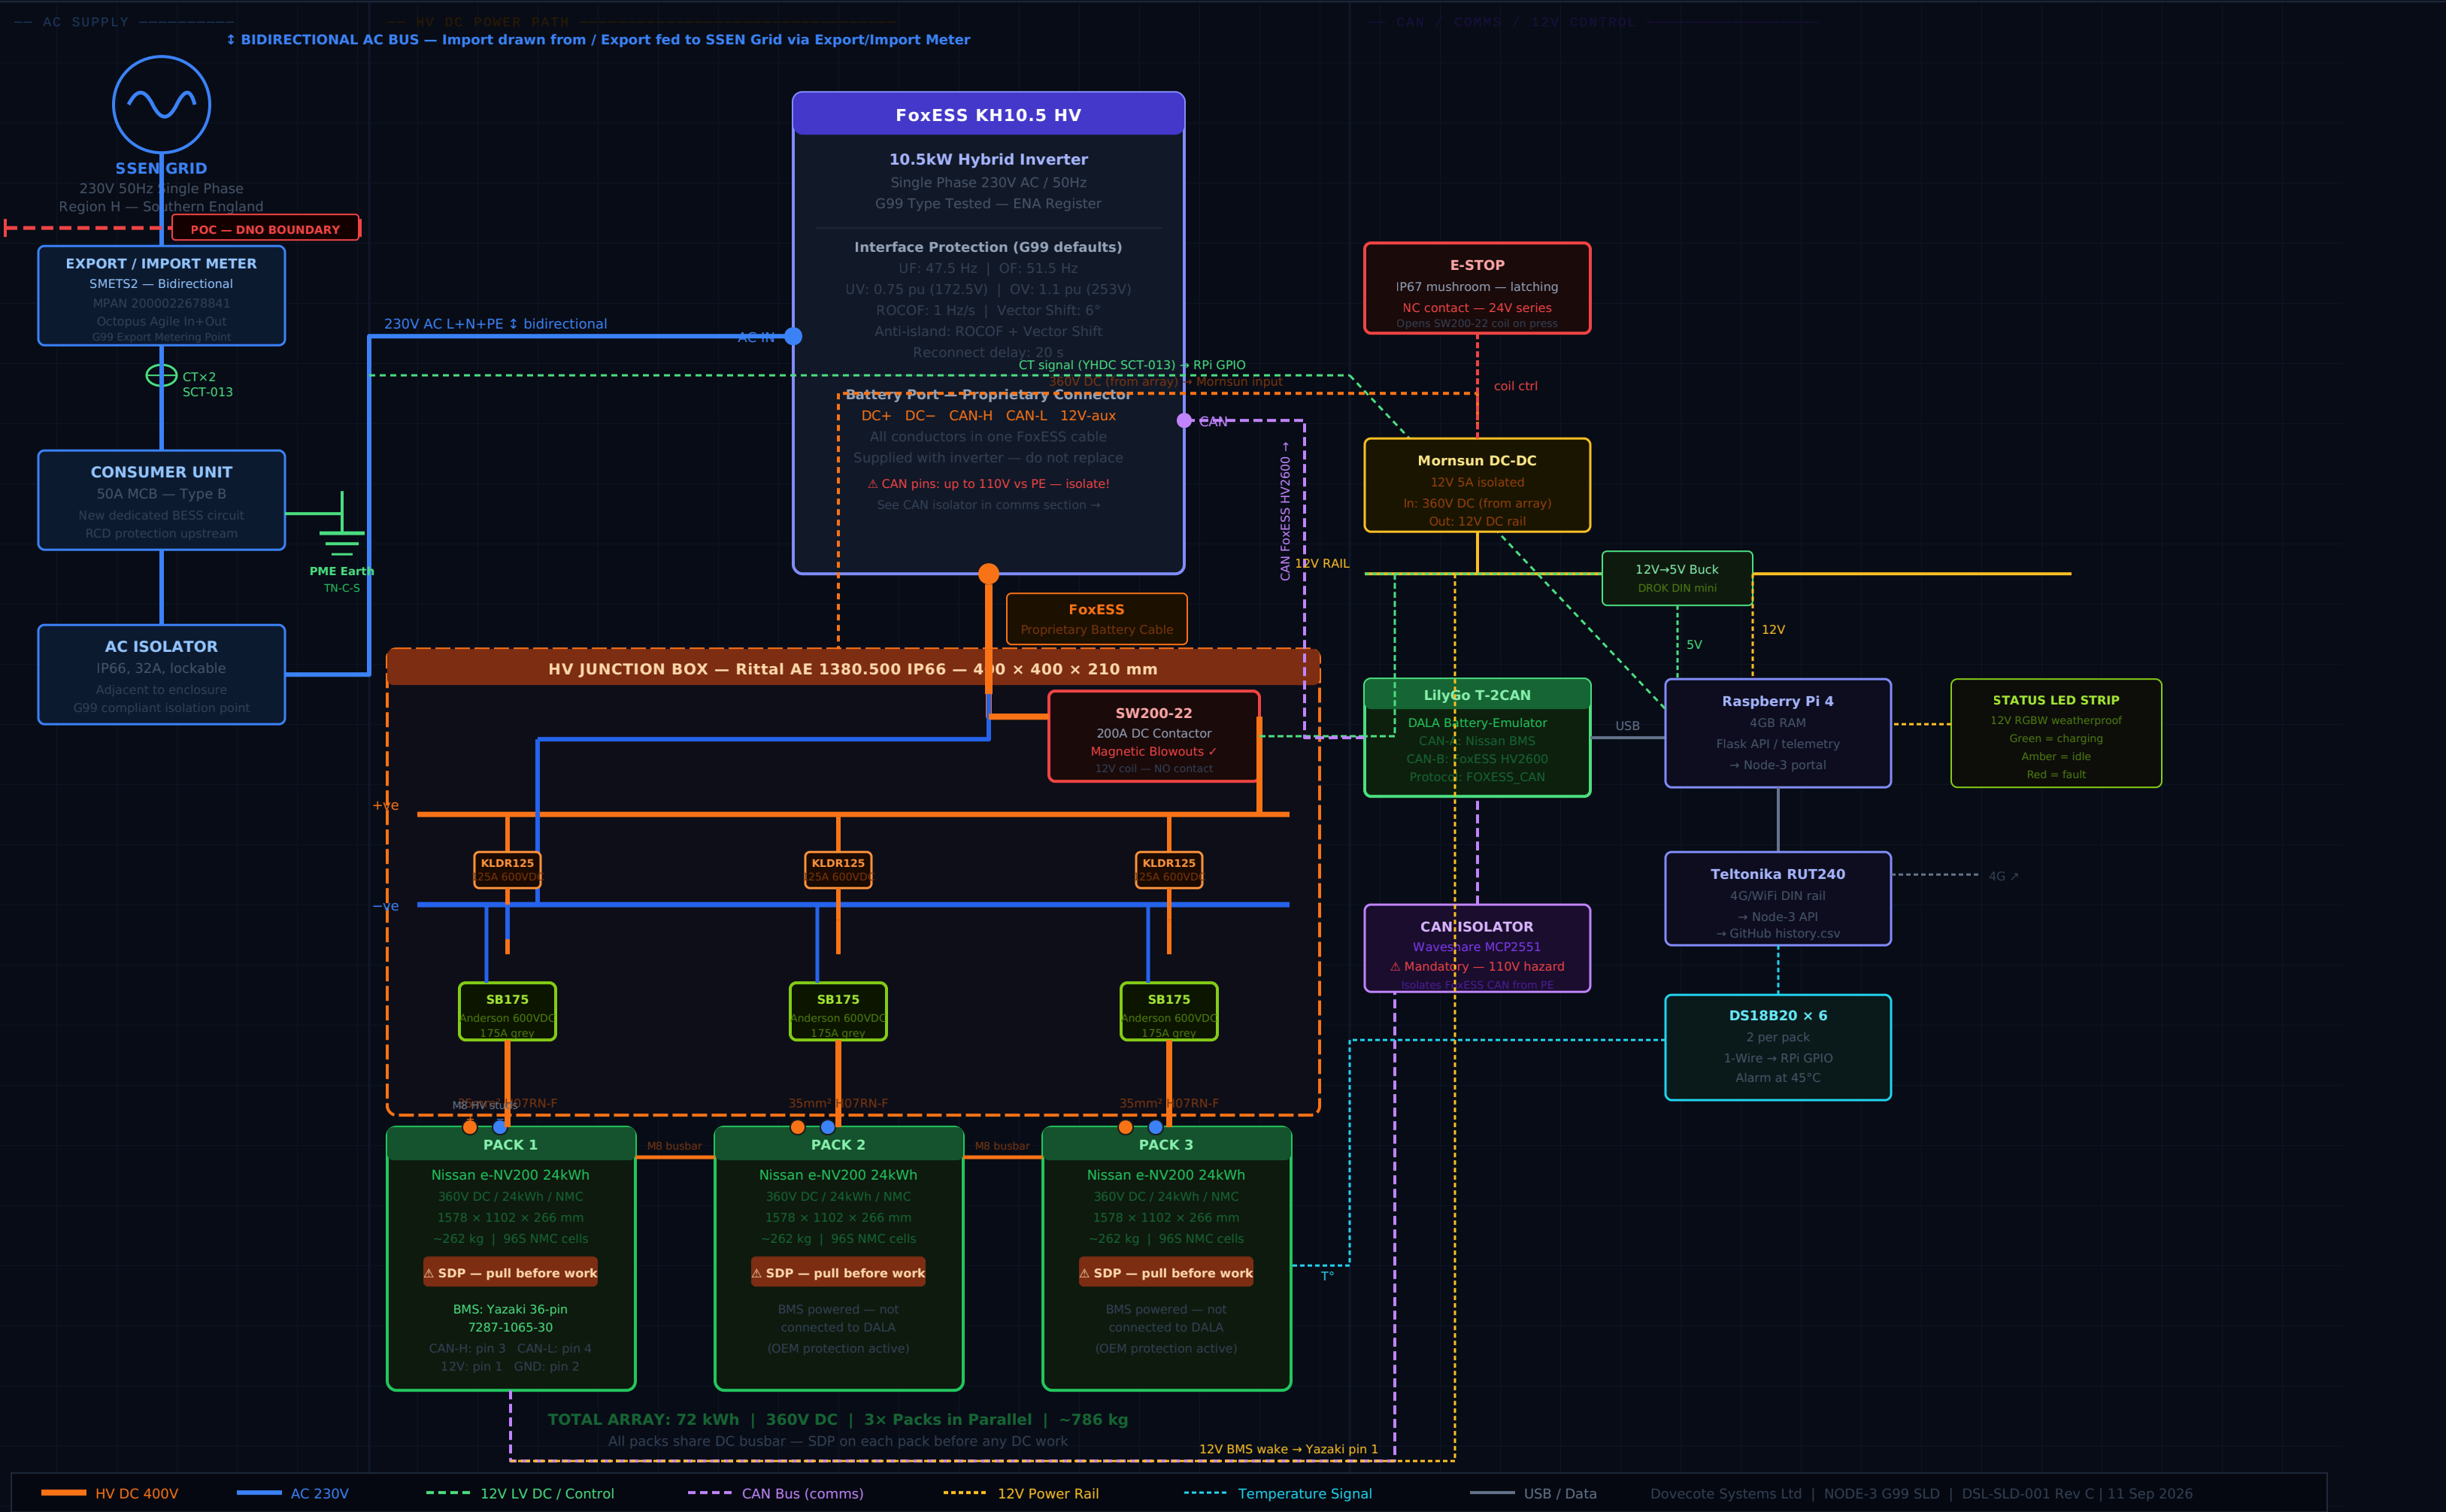

SINGLE LINE DIAGRAM — G99 APPLICATION | ENA EREC G99 Issue 1 | Battery Energy Storage System (BESS)

PROJECT / SITE ADDRESS 179 King Georges Avenue Southampton, SO15 4LD Hampshire, England	MPAN 2000022678841 NETWORK OPERATOR / REGION SSEN — Southern England (Region H)	DRAWING NUMBER DSL-SLD-001 REVISION Rev C	DATE OF ISSUE 11 Sept 2026 SCALE Not to scale	GENERATING PLANT FoxESS KH10.5 HV Inverter Export limited: 5.5 kW single-phase G99 type-tested — ENA Register Storage: 3 × 24 kWh = 72 kWh BESS
PREPARED BY Solent Renewables Sonny — G99 Competent Person sonny@solentrenewables.co.uk NAPIT / MCS Reg No: _____ Signature: _____ Date: _____	CHECKED BY / CLIENT Matthew Brander Director, Dovecote Systems Ltd matt.brander@gmail.com Signature: _____	APPLICANT / COMPANY Dovecote Systems Ltd Company No. 17160178 Incorporated 15 April 2026 G99 Application — BESS 5.5 kW export Single Phase 230V Prepared for submission to SSEN (Southern Electric Power Distribution plc)		

All connections shown are verified against component datasheets. REMA connectors (96V-rated) removed and replaced with Anderson SB175 (600VDC). Batrium WatchMon removed — replaced with DALA Battery-Emulator on LilyGo T-2CAN (confirmed FoxESS KH CAN protocol). CAN isolator is mandatory due to up to 110V potential on FoxESS CAN pins relative to PE. SW200-22 magnetic blowout contactor required — plain SW200 unsuitable at 400V DC.

Rev C (11 Sep 2026): Export figure corrected from 10.5 kW to 5.5 kW to match accepted SSEN connection offer FJJ907/1 (5.5 kW export, £0.00, accepted 2 Jun 2026). Inverter plant rating is unchanged at 10.5 kW; export is to be limited to 5.5 kW. Revision block, issue date and competent-person email corrected. Awaiting SSEN confirmation of export-limitation method and whether Form A3-3 is required.