




— HV DC 400V — AC 230V — 12V LV DC / Control — CAN Bus (comms) — 12V Power Rail — Temperature Signal — USB / Data Dovecote Systems Ltd | NODE-3 G99 SLD | DSL-SLD-001 Rev A | 29 Apr 2026

SINGLE LINE DIAGRAM — G99 APPLICATION ENA EREC G99 Issue 1 Battery Energy Storage System (BESS)				
PROJECT / SITE ADDRESS 179 King Georges Avenue Southampton, SO15 4LD Hampshire, England		MPAN 2000022678841 NETWORK OPERATOR / REGION SSEN — Southern England (Region H)	DRAWING NUMBER DSL-SLD-001 REVISION Rev A	DATE OF ISSUE 29 April 2026 SCALE Not to scale
GENERATING PLANT FoxESS KH10.5 HV Inverter Export capacity: 10.5 kW single-phase G99 type-tested — ENA Register Storage: 3 × 24 kWh = 72 kWh BESS		APPLICANT / COMPANY Dovecote Systems Ltd Company No. 17160178 Incorporated 15 April 2026 G99 Application — BESS 10.5 kW export Single Phase 230V Prepared for submission to SSEN (Southern Electric Power Distribution plc)		
PREPARED BY Solent Renewables Sonny — G99 Competent Person sonny@solentrenewables.com NAPIT / MCS Reg No: _____ Signature: _____ Date: _____		CHECKED BY / CLIENT Matthew Brander Director, Dovecote Systems Ltd matt.brander@gmail.com Signature: _____		

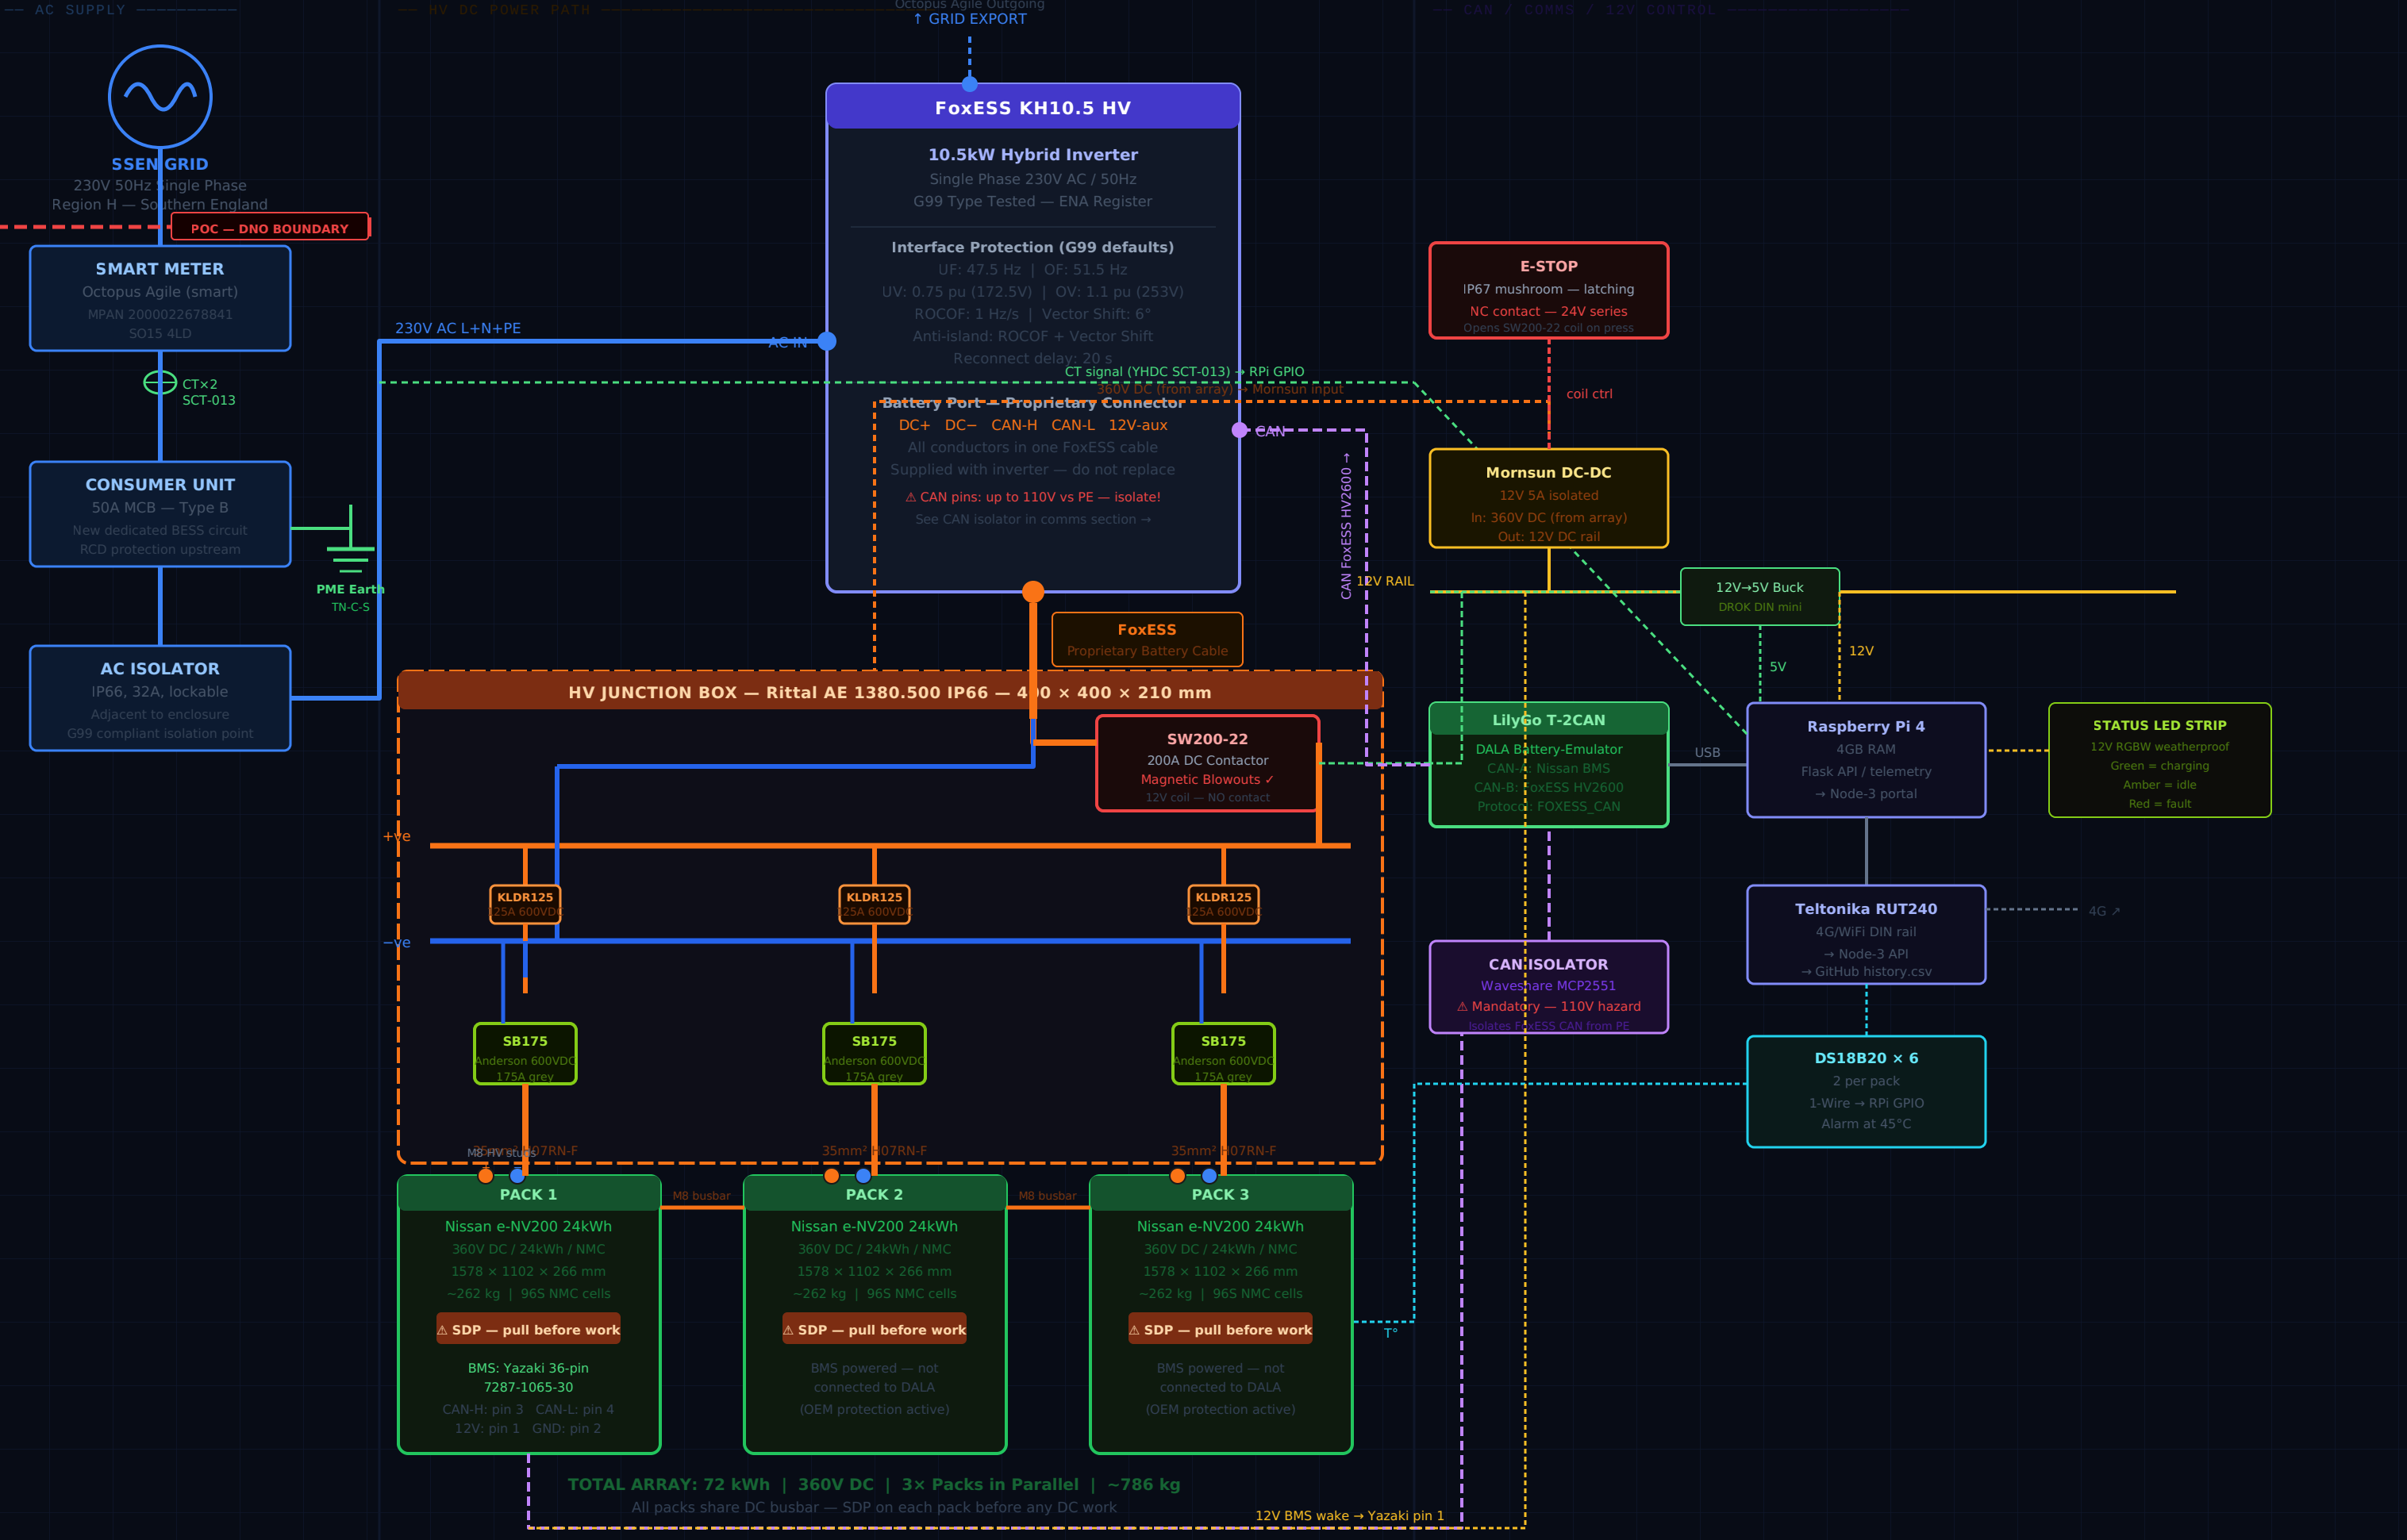