


Complete validation set
cough=463, non-cough=1246



FSD50K validation subset
cough=33, non-cough=1235

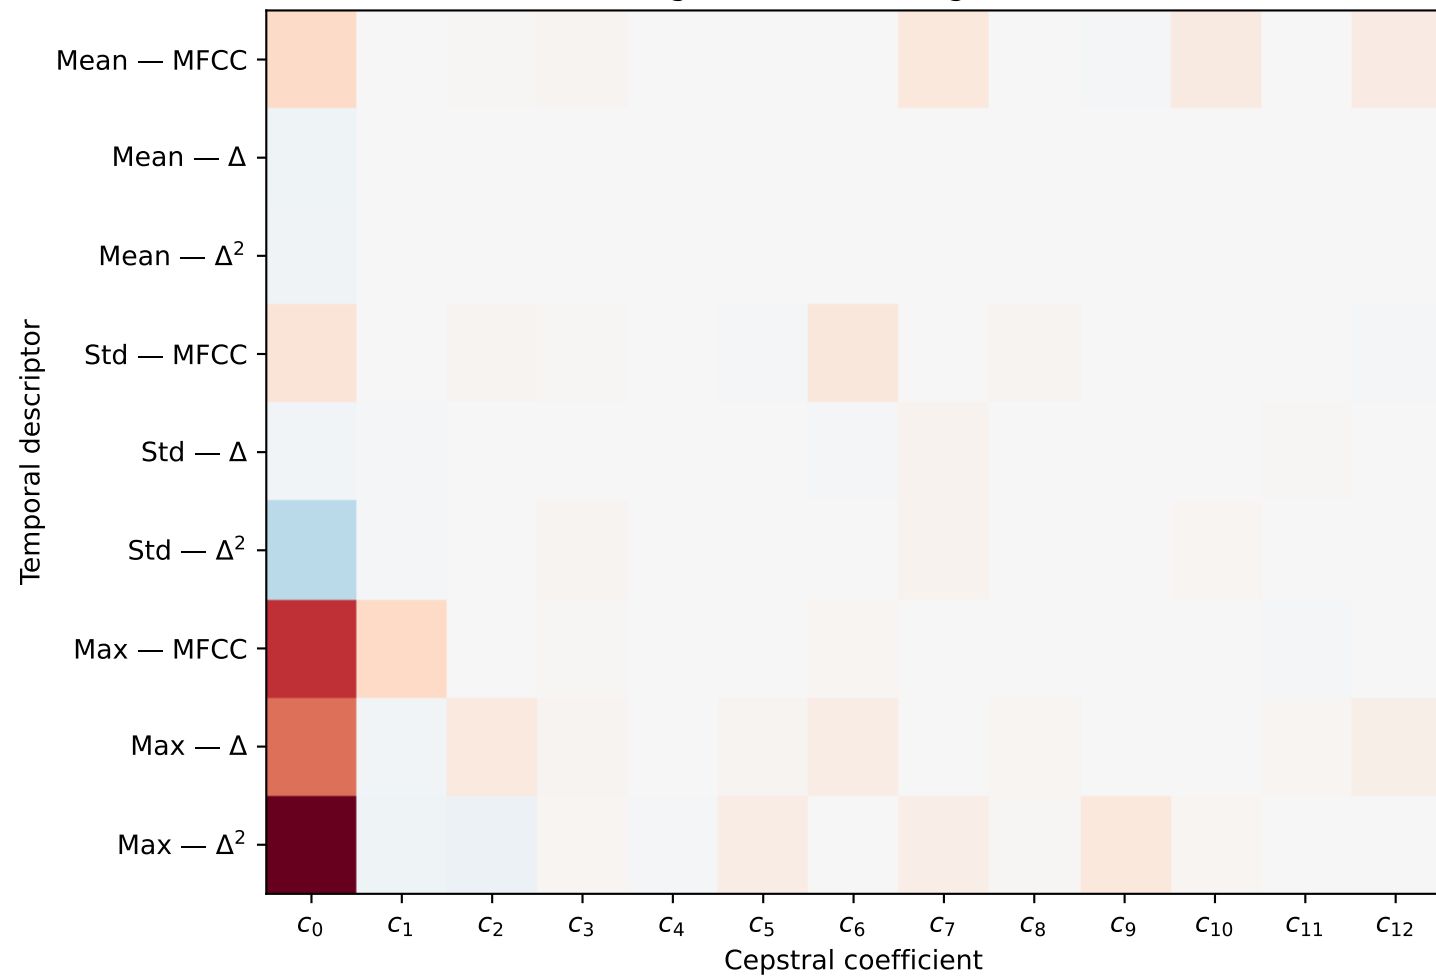