




Validation — complete
cough=463, non-cough=1246

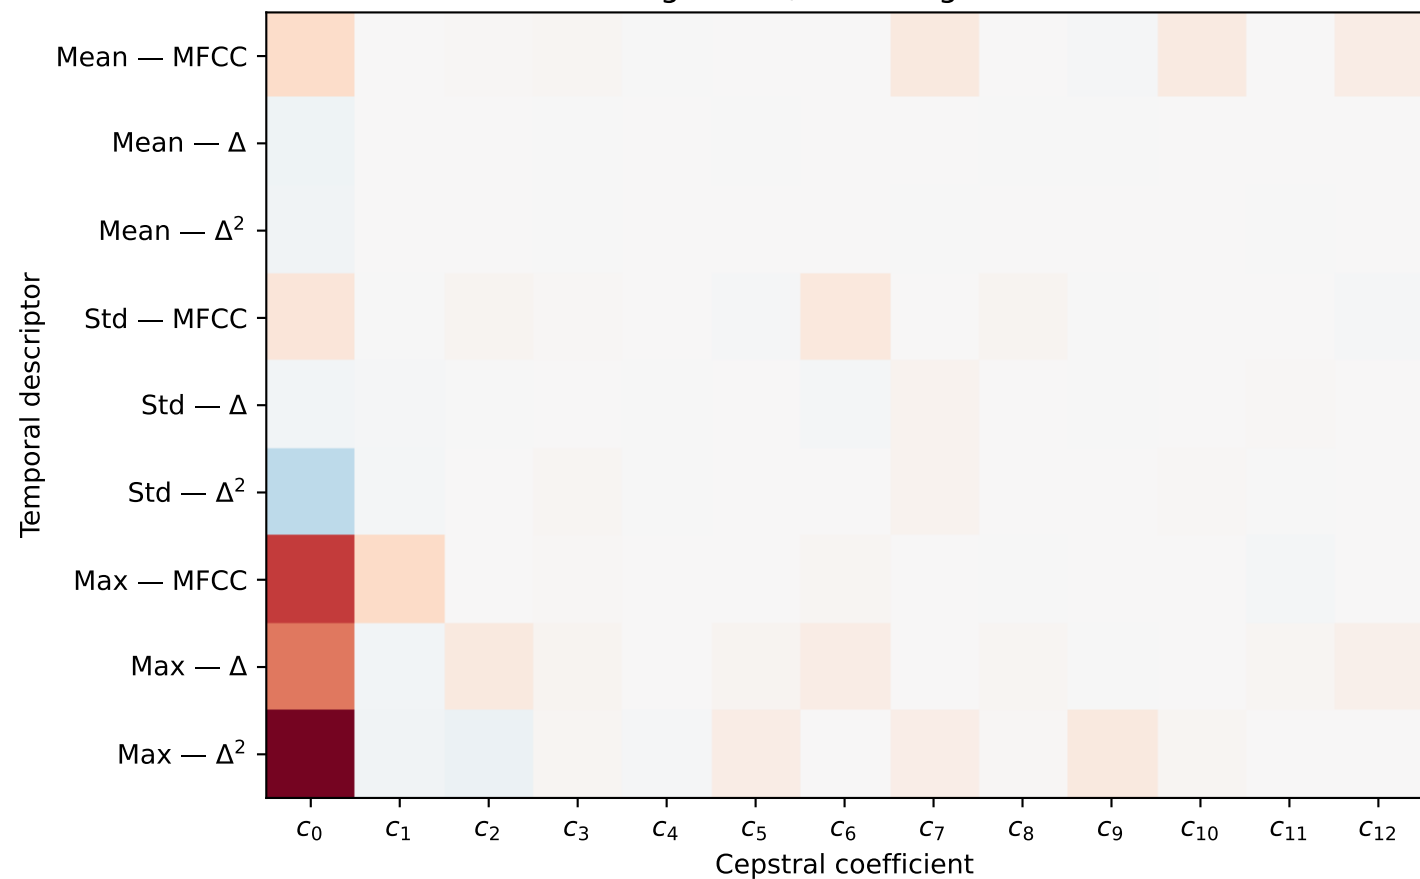

Test — complete
cough=428, non-cough=1261

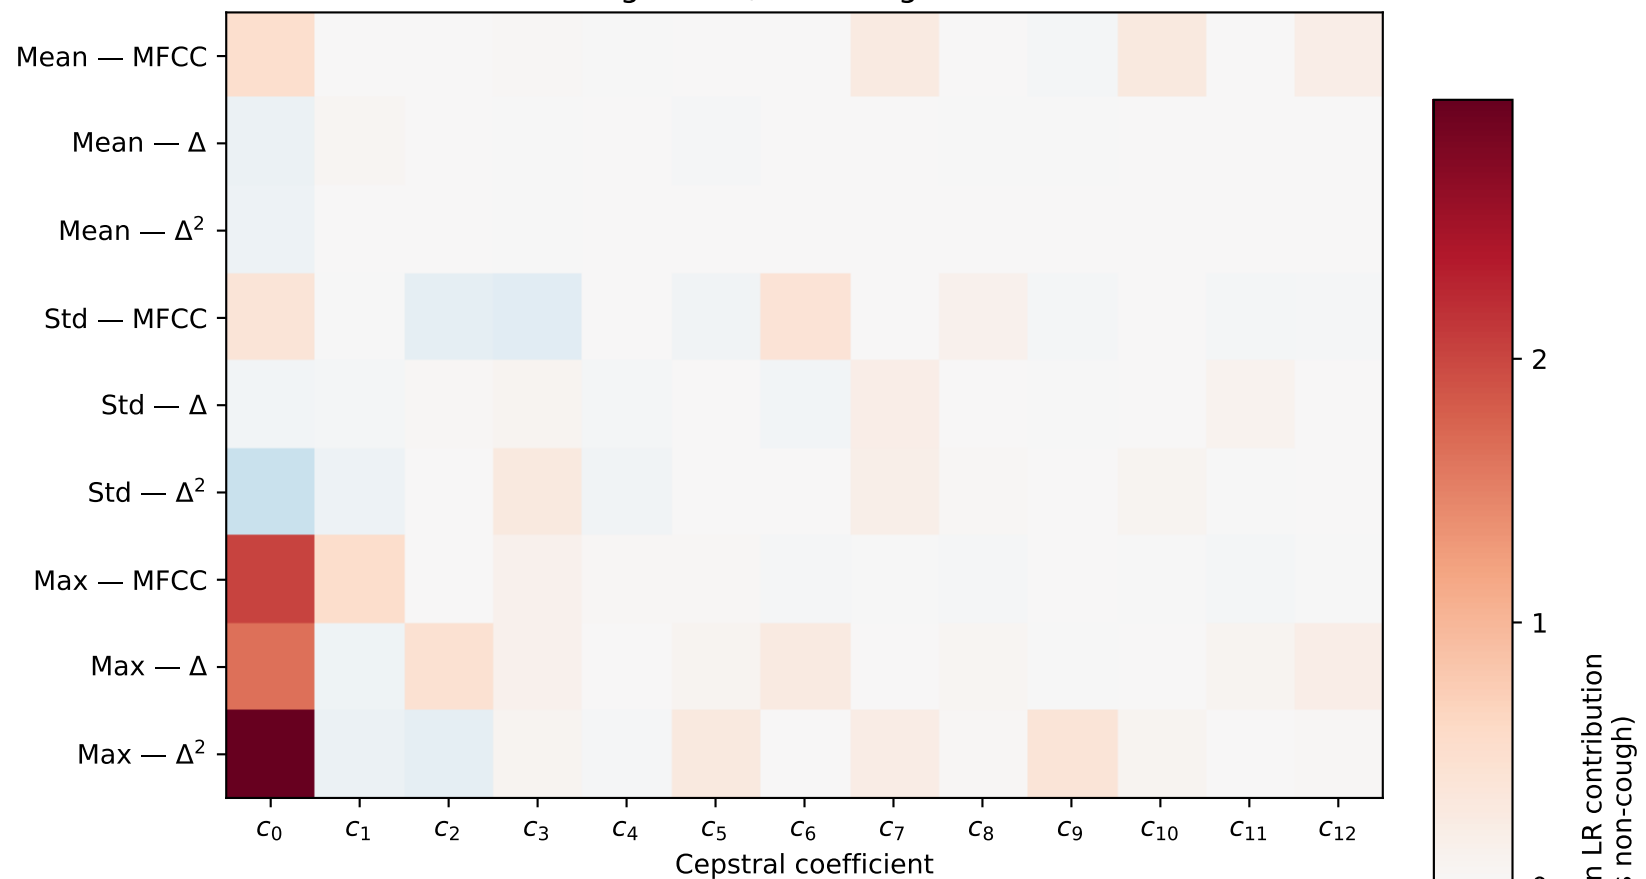

Validation — FSD50K
cough=33, non-cough=1235

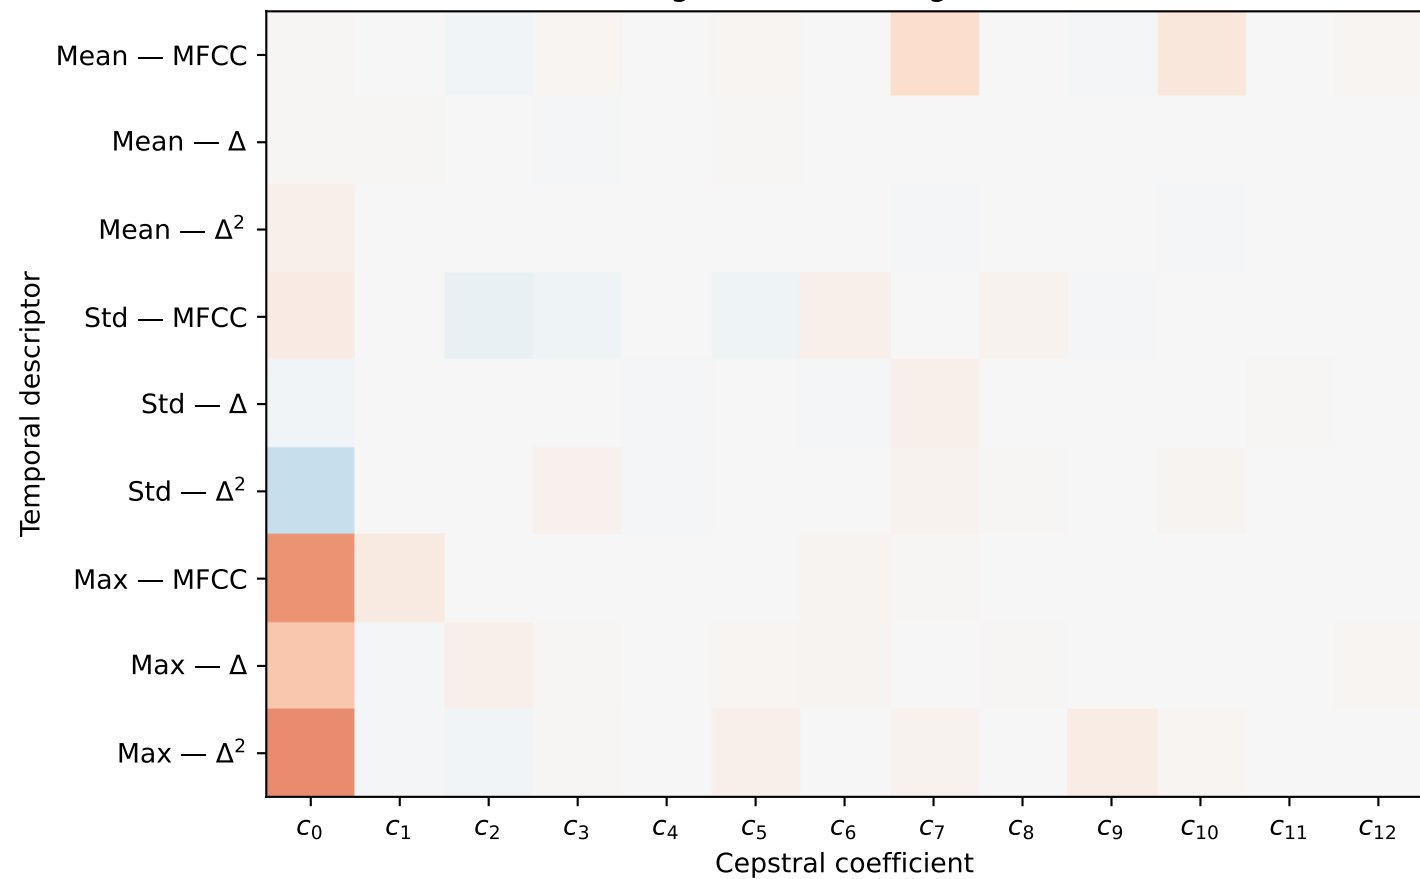

Test — FSD50K
cough=25, non-cough=1250

