

glasstech, inc.

Service Bulletin

Customer Service Department

TELEPHONE: 419-661-9000 FAX: 419-661-9639

Modification to Honeywell UDC100 Micro-Pro Universal Limit Controller Reference 015

Glasstech requires a change in the output wiring for those gas fired heating systems that use the Honeywell UDC100 Micro-Pro Limit Controller for high temperature safety shutdown.

As originally wired and configured, the controller will safely shut down a burner that exceeds the high temperature limit setpoint. Once the high temperature cools to a point below the high temperature setpoint the system will initiate a re-ignition sequence and re-light the burner.

The Factory Mutual (FM) listing of this device as a safety shut down control requires manual operator intervention to reset the controller latching relay before re-starting the burner.

The wiring for the high temperature limit shutdown interlock needs to be removed from the Output 2 Relay (non-latching) to the Limit Relay (latching manually reset).

See figure 1 below for description of the required changes.

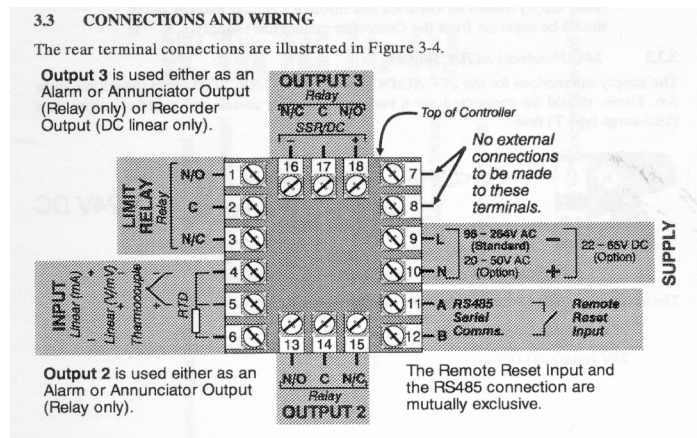


Figure 1

- Step 1 – De-energize the combustion system panels.
- Step 2 – Remove wires from terminals 14, 15.
- Step 3 – Re-install wires on terminals 1, 2.
- Step 4 – Return combustion panels to normal service.

See attached drawings for complete details of changes for your system.