



WESTCONNECT REGIONAL TRANSMISSION PLANNING

2026-27 PLANNING CYCLE

REGIONAL STUDY PLAN

FINAL APPROVED BY WESTCONNECT PMC ON MARCH 18, 2026

INTENTIONALLY LEFT BLANK

Contents

1. Introduction	5
2. Overview of 2026-27 Regional Transmission Planning	7
2.1 Schedule.....	7
2.2 Regional Needs Assessment Background.....	8
2.3 Planning Region.....	9
2.4 Local versus Regional Transmission Issues.....	10
2.5 Opportunities for Stakeholder Involvement	10
2.6 Interregional Transmission Project Submittals	11
3. Base Transmission Plan.....	12
4. Regional Reliability Assessment.....	13
4.1 Model Development Process.....	14
4.2 Key Assumptions	14
4.3 Study Methodology and Criteria.....	15
4.4 Regional Reliability Needs	16
5. Regional Economic Assessment	18
5.1 Model Development Process.....	19
5.2 Key Assumptions	19
5.3 Study Methodology and Criteria.....	19
5.4 Regional Economic Needs	20
6. Public Policy Assessment	21
6.1 Public Policy Requirements.....	21
6.2 Study Methodology and Criteria.....	25
6.3 Regional Public Policy-driven Transmission Needs.....	26
7. Solutions to Regional Needs	26
8. Scenario Studies.....	27
8.1 Scenario Proposals Received for the 2026-27 Study Plan.....	28
Appendix A – Base Transmission Plan.....	29

1. Introduction

The first step of the WestConnect Regional Transmission Planning Process (“Planning Process”) is the development of a Regional Study Plan which identifies the scope and schedule of the study work to be performed during the two-year planning cycle (“planning cycle”). This document reflects the WestConnect Regional Study Plan (“Study Plan”) for the 2026-27 planning cycle. **Table 1** below lists the acronyms used in the document.

Table 1. List of Acronyms

Acronym	Meaning
AQCC	Air Quality Control Commission
BPM	WestConnect Regional Business Practice Manual
CAS	WestConnect Cost Allocation Subcommittee
CFE	Carbon Pollution-Free Electricity
DR	Demand Response
ETO	Enrolled Transmission Owner
EE	Energy Efficiency
FERC	Federal Energy Regulatory Commission
GHG	Greenhouse Gas
GSU	Generator step-up (in context of generator step-up transformers)
IRP	Integrated Resource Plan
ITD	Independent Transmission Developer
ITP	Interregional Transmission Project
NERC	North American Electric Reliability Corporation
NTA	Non-transmission alternative
OWM	Organized Wholesale Market
PMC	WestConnect Planning Management Committee
PPA	Planning Participation Agreement
PS	WestConnect Planning Subcommittee
RES	Renewable Energy Standard
RCT	Reasonable Cost Threshold
RPS	Renewable Portfolio Standard
TO	Transmission Owner
TPPL	Transmission Plan Project List
WECC	Western Electricity Coordinating Council
ZEV	Zero-Emission Vehicle


The WestConnect Planning Management Committee (“PMC”) has overall responsibility for all WestConnect regional planning activities. The Planning Process activities described within this Study Plan will be conducted under the direction of the PMC by the WestConnect Planning Subcommittee (“PS”) and WestConnect Cost Allocation Subcommittee (“CAS”), with input from PMC members and stakeholders, as described in greater detail in subsequent sections of this document.

Process Background

The Planning Process was developed for compliance with Federal Energy Regulatory Commission (“FERC”) Order Number 1000, Transmission Planning and Cost Allocation by Transmission Owning and Operating Public Utilities, (“Order 1000”).¹ The Planning Process is performed biennially and consists of seven primary steps as outlined in **Figure 1**.

The Planning Process is in conformance with Order 1000 as supplemented by numerous Compliance Filings and resulting FERC Orders. Readers can access the text of the compliance documentation on the WestConnect website,² and are encouraged to consult the compliance documentation and the WestConnect Regional Business Practice Manual (“BPM”) for additional process information, which is posted to the WestConnect website.³ Also, for Enrolled Transmission Owner (“ETO”) members with load serving obligation that are jurisdictional to the FERC, their FERC-approved tariff may preside over this document.

Figure 1: WestConnect Regional Transmission Planning Process

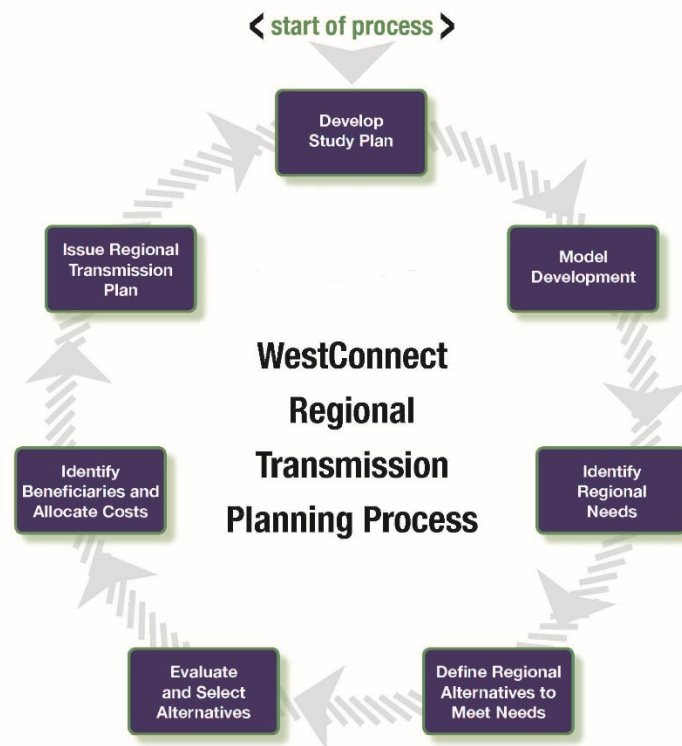

The Planning Process commences in even-numbered years, resulting in the development of a Regional Transmission Plan (“Regional Plan”) every other year. During the first year of the planning cycle, WestConnect performs system assessments to determine if there are any regional reliability, economic, or public policy-driven transmission needs, collectively referred to as “regional needs”. If regional needs are identified, WestConnect will solicit alternatives (transmission or non-transmission alternatives (NTAs)) from WestConnect members and stakeholders to determine if they have the potential to meet any identified regional needs. WestConnect will then evaluate those alternatives to determine whether

¹ All references to Order 1000 include any subsequent orders

² www.westconnect.com

³ WestConnect BPM: [WestConnect Regional Business Practice Manual](#)

any alternatives meet the identified regional needs, and which alternatives provide the more efficient or cost-effective solution. The more efficient or cost-effective solutions will be identified in the Regional Plan. Any alternatives that were submitted for the purposes of regional cost allocation and selected into the Regional Plan may go through the cost allocation process if they are deemed to be eligible for regional cost allocation. During the last quarter of the process WestConnect will develop and finalize the Regional Transmission Plan Report (“Regional Plan Report”) which will describe the process used to identify regional needs, identify transmission facilities or NTAs selected as the more efficient or cost-effective solutions to identified regional needs, and document why projects were included or not included in the Regional Plan.

2. Overview of 2026-27 Regional Transmission Planning

2.1 Schedule

Table 2 below provides an overview of the expected schedule of activities to be conducted as part of the 2026-27 planning cycle. This schedule is subject to change. Changes to the schedule of activities outlined below will be noticed on the WestConnect website, emailed to stakeholder lists, and discussed at committee meetings.


Table 2: Tentative Schedule for 2026-27 Regional Planning Cycle

<i>Due Date</i>	<i>Quarter</i>	<i>Activity</i>
February 18, 2026	Q1	Stakeholder Meeting to present draft Regional Study Plan
February 20, 2026	Q1	Draft Regional Study Plan posted to WestConnect website
March 18, 2026	Q1	Final Regional Study Plan approved by PMC
March 26, 2026	Q1	Interregional Coordination Meeting
March 31, 2026	Q1	Interregional Transmission Project (“ITP”) submittal deadline ⁴
September 2026	Q3	Regional models finalized
November 18, 2026	Q4	Stakeholder meeting to discuss identified regional needs
December 2026	Q4	Regional needs determination posted to WestConnect website
January 2027	Q5	Submittal window opens for projects to meet the posted regional needs. Submittal window lasts for no less than 30 days
September 2027	Q7	WestConnect posts listing of projects meeting an identified regional need selected for the purposes of cost allocation
November 2027	Q8	Draft Regional Plan Report posted to WestConnect website
November 2027	Q8	Stakeholder meeting to discuss the draft Regional Plan Report
December 2027	Q8	Final 2026-27 Regional Plan Report posted

⁴ The timing of this ITP submittal deadline being early in 2026, as opposed to after the PMC's identification of regional transmission needs, is driven by the fact that the Western Planning Regions' coordination activities require, no later than March 31st, an identification of ITPs submitted into the regional processes of all relevant planning regions. For the WestConnect region, the PMC will not begin evaluating whether an ITP may satisfy an identified regional transmission need in the WestConnect region until after the PMC identifies regional transmission needs at year-end 2026.

The 2026-27 regional planning cycle timeline is shown in **Figure 2**.

Figure 2: 2026-27 Planning Cycle Timeline

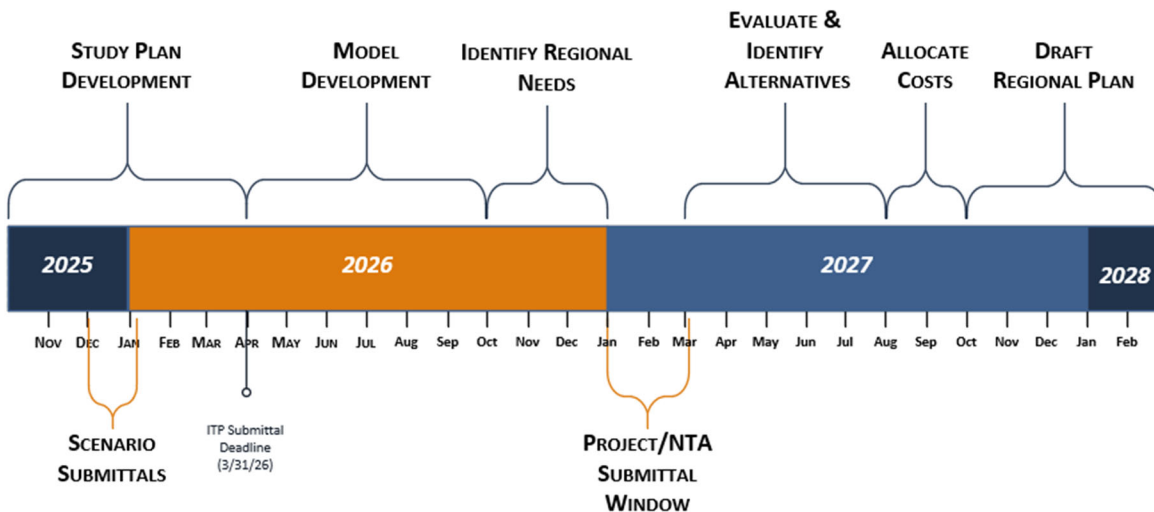

2.2 Regional Needs Assessment Background

During Quarters 2 and 3 of the 2026-27 planning cycle, the models that are needed to perform the regional transmission assessments will be developed as described in this document. The PMC will conduct an assessment of the regional transmission needs using models representing a 10-year timeframe, developed for year 2036. Three types of assessments will be performed during the Planning Process: reliability (steady state and/or transient), economic (production cost), and public policy. The public policy assessment will utilize the reliability and economic planning tools and models.⁵ Models from the Western Electricity Coordinating Council (“WECC”) will be used as starting cases, and they will include the systems of all WECC transmission owner (“TO”) members. These cases are used as the foundation for the models that WestConnect will develop and use for the regional transmission need assessments.

ETO members and other participants will update the WECC models, as described in more detail below, to ensure the WestConnect footprint is properly represented.⁶ To promote interregional coordination, WestConnect may utilize modeling data from TOs outside the WestConnect planning region. To the extent WestConnect receives updated modeling data from those TOs during the development of the regional models, it will be considered and, if appropriate, incorporated into the regional models. The PMC will approve the WestConnect models prior to their use in the regional needs assessment. The PMC will not evaluate regional transmission needs for systems outside of the WestConnect planning region.

After the PS completes the regional transmission assessments (as described in Sections 4.0, 5.0, and 6.0) for the studies included in the scope of this Study Plan, the PS will identify a list of transmission issues resulting from the studies, and make a recommendation to the PMC as to which, if any, regional issues

⁵ Other public policy assessment methodologies may be used at the discretion of the PMC.

⁶ All parties participating in the model development process, and several other stages of the WestConnect planning process that involve handling of non-public data, are required to execute a non-disclosure agreement (NDA) with WestConnect. The agreement is located here: [WestConnect Confidentiality Agreement](#)

should constitute economic, reliability, or public policy-driven transmission needs. The process for identifying those regional transmission needs for which a regional transmission (or NTA) solution or solutions is sought and evaluated shall utilize various communication channels with stakeholders, including open PMC and PS meetings, stakeholder meetings, and the development of a Regional Transmission Needs Assessment Report (which will allow for stakeholder comment and input). The Transmission Needs Assessment Report will be delivered to the PMC for review and approval, and it will contain the PS recommendations on regional transmission needs for the planning cycle. The regional transmission needs identification will be finalized pending the PMC approval of that report.

2.3 Planning Region

The Planning Process evaluates the regional transmission needs of the WestConnect planning region, which is defined as the combined footprints of signatories to the Planning Participation Agreement (PPA) from within the ETO member sector. ETO members participating in the WestConnect 2026-27 Planning Process and the systems considered in the regional transmission needs assessment include:

- Arizona Public Service
- Black Hills Energy
- Deseret Generation and Transmission Cooperative
- El Paso Electric
- Public Service Company of New Mexico
- Tucson Electric Power Company / UNS Electric
- Tri-State Generation and Transmission
- Public Service Company of Colorado (Xcel Energy)

The following PMC members in the Independent Transmission Developer or Owner (ITDO) member sector participate in the planning effort:

- Black Forest Partners
- Southwestern Power Group
- TransCanyon
- Western Energy Connection, LLC
- Xcel Energy West Transmission Company, LLC
- GridLiance Southwest, LLC

WestConnect has two members in the State Regulatory Commission (SRC) sector:

- The Colorado Public Utilities Commission
- The New Mexico Public Regulation Commission


WestConnect has one participant in the Key Interest Group (KIG) sector:

- Interwest Energy Alliance

WestConnect does not conduct Order 1000 regional transmission needs assessments for non-member TOs.⁷ The approximate footprint of ETOs participating in WestConnect is shown in **Figure 3**.

⁷ Non-member TOs within the geographic overlay of the WestConnect footprint are invited to provide updated modeling information, subject to confidentiality provisions, for use in the regional planning models and to participate in the regional planning process as stakeholders.

Figure 3: Approximate Footprint of WestConnect Members

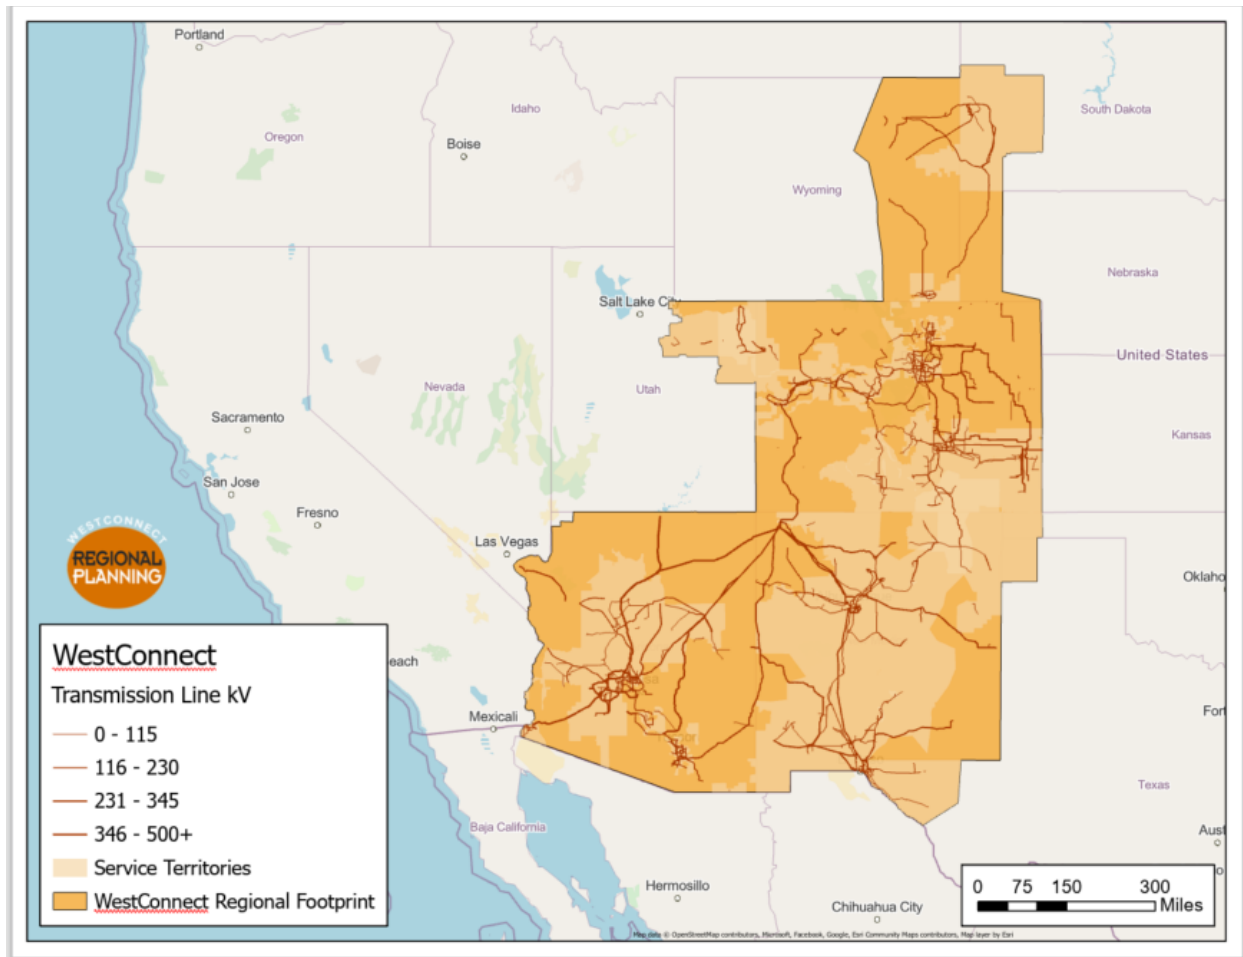

2.4 Local versus Regional Transmission Issues

For the purposes of the regional transmission needs assessment, a single-system need impacts only the ETO-footprint in which it resides. Single ETO transmission issues and non-member issues are not within the scope of the Planning Process and are not considered regional transmission needs. However, for the sake of completeness and study transparency, the Planning Process will include a review of all single-system transmission issues to ensure that in combination, none of the issues are regional in nature and/or co-dependent. Any single-system issues are the responsibility of the affected ETO to resolve, if necessary.

Regional needs are generally defined by impacts to more than one ETO. However, the PMC may determine that in some instances, the multi-ETO impacts are local, rather than regional, in nature. In such cases, WestConnect will provide an explanation as to how impacts are classified.

2.5 Opportunities for Stakeholder Involvement

The Planning Process is performed in an open and transparent manner to attain objective analysis and results. WestConnect invites and encourages interested parties or entities to participate in and provide input to the Planning Process at all levels. Stakeholders also have opportunities to participate in and

provide input to local transmission plans as provided for in each ETO member's Open Access Transmission Tariff.

WestConnect planning meetings are open to stakeholders.⁸ Stakeholders' opportunities for timely input and meaningful participation are available throughout the Planning Process. More specifically, WestConnect will accept and consider stakeholder comments on the following reports planned for the 2026-27 planning cycle:

- Study Plan
- Model Development Report
- Regional Needs Assessment
- Alternative Evaluation (if applicable)⁹
- Cost Allocation (if applicable)¹⁰
- Regional Transmission Plan.

In addition, WestConnect will conduct at least two stakeholder meetings per year to update stakeholders on the Planning Process and collect input. Additional meetings may be scheduled as needed. Notice of all stakeholder meetings and stakeholder comment periods will be posted to the WestConnect website.

2.5.1 Interregional Coordination

WestConnect will coordinate planning data and information with the two other established Planning Regions in the Western Interconnection (California ISO and NorthernGrid) by:

- Participating in annual interregional coordination meetings
- Distributing regional planning data or information such as:
 - Draft and Final Regional Study Plan
 - Regional Transmission Needs Assessment Report
 - List of Interregional Transmission Projects ("ITPs") submitted to WestConnect
 - Assessments and selection of ITPs into Regional Plan
 - Draft and Final Regional Plan
- Sharing planning assumptions if and when requested and subject to applicable confidentiality requirements; and
- Participating in a coordinated ITP evaluation process, as necessary, when an ITP is submitted to WestConnect as an alternative to meet an identified regional need.

The process that WestConnect utilizes to conduct its interregional coordination activities is described in the WestConnect Regional Planning Process BPM.

2.6 Interregional Transmission Project Submittals

An ITP is defined in the common tariff language developed for the Order 1000 interregional compliance filings as a proposed new transmission project that would directly interconnect electrically to existing or planned transmission facilities in two or more planning regions and that is submitted into the regional transmission planning processes of all such planning regions. If an ITP proponent desires to have their project evaluated to meet an identified regional need, they must submit their project to WestConnect via

⁸ Administrative, legal, and/or contractual matters (and from time to time, matters involving the handling and protection of non-public information) are non-public in nature and are discussed outside of public planning meetings.

⁹ The Alternative Evaluation will only occur if a regional need is identified.

¹⁰ Cost Allocation will only occur if a project seeking cost allocation is identified and chosen as the more efficient or cost-effective alternative to meet an identified regional need.

the WestConnect Regional Project Submittal Form no later than March 31, 2026, at which time they need not identify which regional transmission need the project proposes to address. ITP proponents can also have their project evaluated for inclusion in the Base Transmission Plan by participating in the process described in Appendix A.¹¹

3. Base Transmission Plan

WestConnect creates the regional base transmission plan at the beginning of each planning cycle to establish the transmission network topology that is reflected in the regional planning models for the 10-year timeframe and evaluated in the regional needs assessments. The base transmission plan consists of the “planned” incremental transmission facilities included by ETOs in local transmission plans,¹² , planned incremental transmission facilities submitted to WestConnect by non-member TOs, as well as regional transmission facilities identified in previous regional transmission plans that are not subject to reevaluation.¹³ It also includes any assumptions ETO members may have made with regard to other incremental regional transmission facilities in the development of their local transmission plans. As defined by WestConnect, planned facilities include projects that are expected to be in-service during the approaching 10 years and meet one of the following criteria: (1) are required to meet public policy requirements, (2) have a sponsor and are incorporated in an entity’s regulatory filings or capital budget, or (3) have an agreement committing entities to participate and construct. “Conceptual” transmission projects are not included in the base transmission plan.

The base transmission plan may also include transmission projects under development by Independent Transmission Developers (“ITDs”) in the WestConnect planning region, to the extent there is sufficient likelihood associated with these projects to warrant their inclusion in the base transmission plan. A description of the criteria used to identify projects for inclusion can be found in the WestConnect BPM.

The base transmission plan is developed using project information collected via the WestConnect Transmission Plan Project List (“TPPL”), which serves as a project repository for ETO and non-member TO participant transmission plans as well as ITD projects. The TPPL data used for the 2026-27 planning cycle was based on updates submitted as of February 6, 2026, with subsequent updates to the data made by members in the following weeks.

To identify transmission projects for inclusion in the 2026-27 Base Transmission Plan, the PS reviewed the transmission project lists submitted to WestConnect by the ETO members and participants via the TPPL. All ETO member projects designated with a “planned” project status will be included in the base transmission plan. As defined by WestConnect, planned facilities include projects that are expected to be in-service during the approaching 10 years, have a sponsor and are incorporated in an entity’s regulatory filings or capital budget, or have an agreement committing entities to participate and construct. Individual members and participants reviewed the TPPL data and provided any necessary updates with regard to the project status.

The PS also reviewed the list of ITD projects submitted to determine if any of those projects met the threshold identified by the PMC for inclusion in the base transmission plan. Upon reviewing the project information submitted by the project sponsors, WestConnect there were no ITDO projects identified for inclusion in the 2026-27 Base Transmission Plan.

¹¹ Additional details regarding the ITP submittal and evaluation process can be found in the WestConnect Business Practice Manual

¹² Developed in accordance with Order No. 890 local planning processes.

¹³ There were no regional transmission projects identified to meet regional need(s) in the 2024-25 Planning Cycle

As stated in the BPM, WestConnect coordinates planning data and information with the two other Planning Regions in the Western Interconnection, the California ISO, and NorthernGrid. This includes the coordination of planning data to the extent practical and subject to the confidentiality requirements of the regions. WestConnect will seek the regional planning data and information from the other Western Planning Regions during the times within its regional planning cycle that such data can be usefully incorporated together with its own regional planning information in order to conduct its regional planning activities. The list of base transmission plan projects in the 2026-27 Base Transmission Plan is summarized in Appendix A.

As part of the planned activities for 2026, WestConnect intends to create summary information regarding the base transmission plan. The summary information will be developed using both data in the TPPL and other information, such as:

- Cost information
- Line mileage information
- Voltage information
- State-level summaries
- Information on how the 2026-27 Base Transmission Plan has changed as compared with the 2024-25 Regional Transmission Plan, including a list of projects that have gone into service, new projects added to the Base Transmission Plan, and other summary statistics.

The 2026-27 Base Transmission Plan summary information will be included in the 2026-27 Model Development Report, which is scheduled to be completed by the end of Q3, 2026. When the 2026-27 Regional Plan Report describes the planned projects in the region, this summary information will be used and, if necessary, updated to include any additional regional projects selected into the plan as the more efficient or cost-effective solution to a regional need.

4. Regional Reliability Assessment

The regional reliability assessment will be performed on power flow models developed by WestConnect. The study cases to be used for the regional reliability assessment are summarized in **Table 3**.

Table 3: Power Flow Cases for Regional Reliability Assessment

WestConnect Case	Case Description	Seed Case
2036 Heavy Summer	10-Year heavy summer model	WECC 36HS
2036 Light Spring	10-Year, light load with significant, but reasonable renewable resources	WECC 34LSP1 or WestConnect 36HS

The process and scope for regional model development and the regional reliability assessment is described further in this section. The models will be developed during Quarters 2 and 3 of the planning cycle. The PMC will approve the regional power flow models and the contingency list used to assess regional reliability transmission needs. The regional reliability assessment will take place in Quarter 4.

4.1 Model Development Process

WestConnect will review and modify the WECC seed cases identified in this Study Plan through coordination with ETO members.

After collecting initial updates through the process described above, WestConnect will compile the regional power flow models through a phased approach:

1. Review and update the power flow base case topology, including transmission lines, transformers, connectivity, reactive devices, and corresponding power flow data. These changes do not include load magnitudes and resource levels or status.
2. Review and revise interchange flows and schedules, iterating between any loads and resources revisions. Importantly, WECC will have ten-year seed cases for both the heavy summer and light spring conditions.
3. Provide remedial action schemes (RAS) and contingency definitions based on modeled topology.

The process utilized for model development, including coordinating with the ETO members, Independent Transmission Developers, and other stakeholders in the development of these cases, will be conducted and managed by the PS. Once the cases have been vetted through review and preliminary assessments, the models will be approved by the PMC. The final regional reliability assessment will take place during Q4 of 2026.

4.2 Key Assumptions

In developing the models for use in the regional reliability assessment, WestConnect must make a number of assumptions as it relates to generation, transmission, and load modeling. Descriptions of the assumptions that will be used in developing the study cases are provided below:

- **Transmission Assumptions** – Existing transmission system plus 2026-27 Base Transmission Plan, with ETO members confirming the inclusion/exclusion of projects through the process described above.
- **Demand Forecasts** – Provided by ETO members and embedded in WECC seed cases, specific to season and condition of study case. May be updated as necessary by TO members.
- **Generation Projects** – Existing and planned generation facilities. Specifically, generation consistent with ETO resource plans as of March 2026¹⁴, developed through an integrated resource planning (IRP) or similar process. The governance for these resource plans varies by the type of utility, but in all cases should be open, rigorous, and prescriptive.
- **Public Policy Requirements** – Public Policy Requirements are reflected in the study cases through local planning assumptions (e.g., load, generation, demand response, etc.), to the extent a plan for compliance with the Public Policy Requirements has been completed by the ETO member.
- **Major Path Flows and Interchange** – Path flows and interchange will be established based on the generation, load, and system condition being modeled in the study case.

¹⁴ Modifications to modeling assumptions may be updated during the model development phase of the planning cycle, subject to PMC approval.

- **Operating Procedures** – Any special operating procedures required for compliance with NERC reliability standards will be considered and included in the power flow cases.
- **Protection Systems** – The impact of protection systems including RAS required for compliance with NERC reliability standards will be included in the power flow cases.
- **Control Devices and Reactive Resources** – Any special control devices or reactive resources will be included in the power flow cases, including shunt capacitors/reactors, static var compensators, synchronous condensers and other voltage control devices.
- **Contingency List** – Participants will provide the contingency list in the WECC RAS and Contingency Format (available in GE PSLF and PowerWorld Simulator). A list of contingencies to be studied will be developed by the ETO members and provided to the PMC concurrent with the final review of the base cases. The PS along with the PMC can add to the list if needed. Contingencies will be limited to N-1 (TPL Category P1 and P2) contingencies for elements 230-kV and above, generator step-up (“GSU”) transformers for generation with at least 200 MW capacity, and member-requested N-2 (TPL Category P4, P5 and P7) contingencies. If a participant provides justification as to why lower voltage contingencies might impact the system in a regional manner, the PS may decide to include those contingencies.
- **Facilities with Multiple Owners** – the ETO members will verify which buses, lines, and transformers have multiple owners. This data will be maintained either directly in the power flow models (when possible) and/or in a spreadsheet, and will be used when processing the results of the reliability and economic assessments described in Sections 4.3 and 5.3, and to help the PS focus on issues with the highest potential for being a regional reliability-driven transmission need.

4.3 Study Methodology and Criteria

An assessment of the WestConnect regional power flow cases will be conducted to ensure the WestConnect planning region as a whole is in compliance with applicable North American Electric Reliability Corporation (NERC) standards and WECC regional criteria for the 2036 planning horizon. The assessment will include steady state contingency analysis and transient stability analysis. The following standards and criteria are applicable for the assessment:

- Table 1 Planning Events from NERC [TPL-001-5.1 Table 1](#) (P0 and P1) Transmission System Planning Performance Requirements; and
- WECC [TPL-001-WECC-CRT-4](#) Transmission System Planning Performance.

Monitoring and violation reporting will be performed for transmission elements above 100-kV outside of the WestConnect footprint and member-identified elements within or bordering the WestConnect footprint.

4.3.1 Steady State Contingency Analysis

Power flow contingency analyses will be performed for all power flow areas within the WestConnect planning footprint. More specifically, the assessment will evaluate performance of the regional system under system intact conditions (TPL Category P0), using normal facility ratings and voltage ranges, and under certain emergency system conditions and planning event contingencies (TPL Categories P1, P2, P4, P5, and P7)¹⁵. In all cases, applicable facility ratings and voltage criteria shall not be exceeded. The power flow solution options will only enable control systems reasonably able to intervene within 20

¹⁵ P4, P5 and P7 contingencies are optional and must be volunteered by TO members

seconds, meaning that SVC Control will be enabled while the other control options (Switched Shunt Control, LTC Transformer Control, and Phase Shifter Control) will be disabled.

4.3.2 Transient Stability Analysis

The transient stability performance of the regional system will be studied consistent with the standards and criteria provided above to identify any occurrences of under frequency load shedding, sufficient frequency recovery (e.g., undamped oscillations), and general instability (e.g., cascading trips). WECC criterion will be used to define acceptable voltage recovery and system performance within the first 30 seconds post-disturbance.

WestConnect members will determine the specific contingencies for inclusion in the transient stability analysis. These contingencies will be limited to those that may have a regional impact, including but not limited to major generator and transmission trips with and without faults.

4.4 Regional Reliability Needs

When conducting the regional reliability assessment, violations of standards or criterion creating reliability issues that the PMC determines to be regional in nature will be identified as a regional reliability need. By definition, regional reliability needs are identified by reliability issues that impact more than one ETO member system. Specifically, in the event a simulated outage produces one or more NERC TPL violations in more than one ETO member system, those violations may result in the identification of a regional reliability-driven transmission need.

If a single-system reliability violation is identified, the violation will be referred back to the appropriate ETO for resolution. The affected ETO will have an opportunity to identify mitigation for the violation, and will submit the modeling data associated with the mitigation to the PS. The PS will review the mitigation and make a recommendation to the PMC regarding whether or not to include the mitigation in the study. Upon approval by the PMC, the modeling for the mitigation will then be incorporated back into the regional power flow model. Single-system reliability violations typically do not cause a regional reliability-driven transmission need.¹⁶ In the event a simulated outage produces NERC TPL violations in more than one ETO member system, that violation will first be referred to the affected ETO members and discussed with the PS to determine if the violation is local in nature. However, issues that impact more than one ETO member may result in the identification of a regional reliability-driven transmission need. Once finalized, regional reliability needs will be posted to the WestConnect website and described in the Regional Needs Assessment documentation. The PMC approves both the base models and the Regional Needs Assessment.

Table 4 provides examples of the ownership of affected elements involved with various examples of reliability issues that may be caused by a contingency and whether they are (1) likely a single-system reliability violation (“Local” in the table); (2) potentially a regional reliability-driven transmission need (“Regional Potential” in the table); or (3) in need of further review before a determination can be made (“Flag for Further Review” in the table).

¹⁶ There may be certain exceptions, such as when a jointly owned contingency causes reliability issues in a single area

Table 4. Reliability Assessment Regional vs Local Needs Matrix

Ownership¹⁷ of the Element(s)¹⁸ with Reliability Issue(s)	Example of Reliability Issue(s) and Affected Element(s)	Regional or Local?
Single-ETO bus	Bus with voltage issue has only one ETO	Local
Single-ETO line	Overloaded line has only one ETO	Local
Single-ETO transformer	Overloaded transformer has only one ETO	Local
Multiple single-ETO buses	Multiple buses have voltage issues and are each owned by different ETOs	Regional Potential
Multiple single-ETO lines	Multiple overloaded lines are owned by different ETOs	Regional Potential
Multiple single-ETO transformers	Multiple overloaded transformers are owned by different ETOs	Regional Potential
Multi-ETO bus	Bus with voltage issue is owned by multiple ETOs	Regional Potential
Multi-ETO line	Overloaded line is owned by multiple ETOs	Regional Potential
Multi-ETO transformer	Overloaded transformer is owned by multiple ETOs	Regional Potential
Single-ETO bus & different Single-ETO line	Bus with voltage issue has one ETO & an overloaded line has a different ETO	Regional Potential
Single-ETO line with one or both terminal buses having a different single-ETO	- Overloaded line and one of its terminal buses have one ETO while the other terminal bus has a different ETO, or - Overloaded line has one ETO while its terminal buses have a different ETO - Overloaded line has one ETO, one of its terminal buses has a different ETO, and the other terminal bus has a separate ETO (different than the ETOs of the line or other terminal bus)	Flag for Further Review
Single-ETO line with both terminal buses having multiple, different ETOs	Overloaded line has one ETO and both terminal buses have multiple ETOs which are different from the line's ETO	Flag for Further Review
Single-ETO line & multi-ETO terminal bus or buses	Overloaded line has one ETO; one of its terminal buses has multiple, different ETOs; and the other terminal bus multiple, different ETOs.	Flag for Further Review
Single-ETO bus & different single-ETO transformer	Bus with voltage issue has one ETO & an overloaded transformer has a different ETO	Regional Potential

¹⁷ "Ownership" refers to the entity or entities whose permission is needed to replace, update, or remove the affected element(s)

¹⁸ "Line" and "Transformer" are inclusive of adjacent facilities not explicitly modeled in the power flow case (e.g., breakers, bus-ties, wave traps)

Ownership ¹⁷ of the Element(s) ¹⁸ with Reliability Issue(s)	Example of Reliability Issue(s) and Affected Element(s)	Regional or Local?
Single-ETO transformer with one or both terminal buses having a different single-ETO	- Overloaded transformer and one of its terminal buses have one ETO while the other terminal bus has a different ETO, or - Overloaded transformer has one ETO while its terminal buses have a different ETO - Overloaded transformer has one ETO, one of its terminal buses has a different ETO, and the other terminal bus has a separate ETO (different than the ETOs of the transformer or other terminal bus)	Flag for Further Review
Single-ETO transformer with both terminal buses having multiple, different ETOs	Overloaded transformer has one ETO and both terminal buses have multiple, ETOs which are difference from the transformer's ETO	Flag for Further Review
Single-ETO transformer & one or more multi-ETO terminal buses	Overloaded line has one ETO; one of its terminal buses has multiple, different ETOs; and the other terminal bus multiple, different ETOs.	Regional Potential

5. Regional Economic Assessment

The regional economic needs assessment will be performed using a production cost model (PCM) developed by WestConnect. The cases to be used for the regional economic assessment is summarized in **Table 5**.

Table 5: Production Cost Model Case Summary

WestConnect Case	Case Description	Seed Case
2036 PCM	10-Year PCM with updated regional data	2036 WECC ADS PCM or 2034 WestConnect PCM

The process used by WestConnect to develop the regional PCM is described in the following section. The analysis used to perform the regional economic assessment is also included. The model will be developed during Quarters 2 and 3 of the 2026-27 planning cycle along with some preliminary assessments. The PMC will approve the final regional economic model used to assess regional economic transmission needs. The final regional economic assessment will take place in Quarter 4.

5.1 Model Development Process

Either the WestConnect 2034 PCM, or a WECC 2036 ADS model will be used as the seed case to develop the WestConnect 2036 PCM model. The model will be reviewed and updated by WestConnect during Quarters 2 and 3 of the 2026-27 planning cycle consistent with the process described below in order to create the WestConnect 2036 PCM Base Case.

If the 2034 WestConnect PCM is used as a seed case, then the PS will initiate and coordinate a review of the data and assumptions contained within the WestConnect 2034 PCM by the WestConnect members, participants, and stakeholders. The case may be updated with select assumptions from available WECC 2036 ADS interconnection-wide PCM.

If a WECC ADS PCM is used as a seed case, then that model will be reconciled with the WestConnect 2034 PCM.

The model will then be reviewed and updated by WestConnect members during Quarters 2 and 3 of the 2026-27 planning cycle consistent with the process described below in order to create the WestConnect 2036 PCM Base Case. Once the data and assumptions have been reviewed by the ETO members, WestConnect will compile any changes submitted by the ETO members to create the 2036 PCM Base Case. Once compiled, the PS will perform a series of initial testing and benchmarking studies with the goal of validating the output of the WestConnect 2036 PCM Base Case. Comparisons with historical path flows, typical wind/solar operation, historical generator dispatch, and other study results/models will be performed at the discretion of the PS to help vet the PCM results. Comparisons with the WestConnect 2036 power flow cases will be used to keep assumptions synced between the reliability and economic models. Once the WestConnect 2036 PCM Base Case has been vetted, the PS will initiate the regional economic assessment. The PS will also develop and conduct sensitivities, as discussed in more detail in Section 5.3.

5.2 Key Assumptions

Specific data and assumptions to be reviewed by the ETO members will include, but are not limited to:

- Changes needed to make data and assumptions consistent with the 2036 Heavy Summer and 2036 Light Spring power flow cases described earlier in the Study Plan
- Consistent with the key assumptions of the reliability models (Section 4.2), the load, generation, and transmission are reflected in the model based on local planning assumptions (e.g., load, generation, demand response (DR), energy efficiency (EE), etc.), based on the planning information provided by Members. PS may choose to perform spreadsheet-based analyses to verify the assumptions included in the model (e.g., accounting of renewable generation);
- Branch switching throughout the year
- Fuel price assumptions and related assumptions (e.g., carbon pricing or other environmental impact costs)
- Unit operating characteristics
- Load, resource, and transmission bus assignments to balancing authorities; and
- Wheeling charge approach to appropriately represent inter-Balancing Authority interactions.

5.3 Study Methodology and Criteria

To evaluate the potential for regional economic needs in the WestConnect planning footprint, WestConnect identifies congested elements through forward-looking production cost modeling. Using

results from base case model runs and sensitivities,¹⁹ the PS will review metrics such as congested hours and congestion cost for regional transmission elements greater than 100-kV and WECC transfer paths (or other defined interfaces in the WestConnect footprint) along with any ETO member-specified lower voltage BES elements.

Regional transmission facilities or paths/interfaces with significant congestion are identified and verified through PS review, historical benchmarking, and follow-up study. Given the regional focus of the Planning Process, the PS will limit their analysis to:

- Transmission (or paths/interfaces) between multiple ETO member systems;
- Transmission (or paths/interfaces) owned by multiple ETO members; and
- Congestion occurring within the footprint of multiple ETO members (congestion in one ETO Member footprint reasonably related or tied to congestion in another ETO Member footprint) that has potential to be addressed by a regional transmission project or NTA.²⁰

5.3.1 Sensitivities

WestConnect will also conduct sensitivity studies on the 2036 PCM Base Case economic model to better understand whether regional transmission congestion may be impacted by adjusting certain input assumptions subject to significant uncertainty. The sensitivity analysis is intended to make relatively minor adjustments that would still remain within the expected future framework of the base models. This sensitivity analysis may include variables such as:

- Load forecast
- Hydro conditions (e.g., wet vs. dry)
- Natural gas prices
- Emissions cost (e.g., CO₂)
- Weather & Forecast Uncertainty
- Other modeling parameters

By adjusting individual input assumptions subject to uncertainty, the sensitivity assessment will help WestConnect understand how sensitive the economic performance of the Base Transmission Plan is to key variables. The PS will make recommendations to the PMC regarding how sensitivity analysis will be incorporated into the study process.

5.4 Regional Economic Needs

The process to assess congestion will include a vetting of any congested elements to allow the PS to determine whether congestion issues are regional in nature. After this vetting process, the PS will produce a list of the congested elements that were identified in the base case. The PMC may further evaluate that list of congested elements and determine which should constitute regional economic needs. The objective is to arrive at a set of congested transmission elements that warrant being tested for the economic potential for a regional project solution, recognizing that the presence of congestion does not always equate to a regional need for congestion relief at a particular location. The PMC will approve the base models and the results of the regional economic assessment. When finalized, regional economic needs will be posted to the WestConnect website and described in the Regional Needs Assessment documentation.

¹⁹ In this document, the term “sensitivity” has the same meaning as “scenario” in the common tariff under the section that describes cost allocation for economic projects.

²⁰ Congestion within a single ETO Member’s footprint (and not reasonably related or tied to other ETO Member footprints) is out of scope of the regional planning effort and is alternatively subject to Order 890 economic planning requirements.

6. Public Policy Assessment

WestConnect will first solicit members to identify Public Policy Requirements in the region and identify if any of the Public Policy Requirements are driving local projects in the ETOs' local transmission plans that are incorporated in the base case models used in the WestConnect planning process. An initial list of Public Policy Requirements is provided in this section and will be further refined in public WestConnect meetings.

In an effort to engage stakeholders, the list of Public Policy Requirements in the region and local projects in the ETOs' local transmission plans that are driven by Public Policy Requirements will be provided to stakeholders. Stakeholders will be asked to review the information and suggest to WestConnect possible regional public policy-driven transmission needs. An open stakeholder comment window will be announced via posting on the WestConnect website and through an email to the WestConnect stakeholder distribution list for the purpose of collecting suggestions of possible regional public policy-driven transmission needs.

6.1 Public Policy Requirements

Public Policy Requirements means those requirements enacted by state or federal laws or regulations, including those enacted by local governmental entities, such as a municipality or county. **Table 6** lists the Public Policy Requirements that have been identified and will be considered in the WestConnect 2026-27 planning cycle. To the extent a plan for compliance with the Public Policy Requirements was completed prior to the model development phase of the WestConnect 2026-27 planning cycle, the WestConnect 2036 economic and reliability models will reflect these public policies' conditions for the study year 2036. Each ETO member will provide confirmation in this regard as part of the model development phase of the WestConnect 2026-27 planning cycle. Company goals, although not Public Policy Requirements, may also be considered in the development of the base models but will not be used in the evaluation of public policy-driven transmission needs.

Table 6: Public Policy Requirements for Consideration in the WestConnect 2026-27 Planning Process

Public Policy Requirement	Description
Arizona Renewable Energy Standard	Requires IOUs and retail suppliers to supply 15% of electricity from renewable resources by 2025, with a minimum of 30% of the renewable resources provided by distributed generation
California SB100	Requires Investor-owned utilities (IOUs) and municipal utilities to meet a 60% renewable portfolio standard ("RPS") by 2030
Colorado HB 18-1270 ("Energy Storage Procurement Act")	Directs the Commission to develop a framework to incorporate energy storage systems in utility procurement and planning processes. See C.R.S. § 40-2-201, et seq. The legislation broadly addresses resource acquisition and resource planning, and transmission and distribution system planning functions of electric utilities. Energy storage systems may be owned by an electric utility or any other person. Benefits include increased integration of energy into the grid; improved reliability of the grid; a reduction in the need for increased generation during periods of peak demand; and, the avoidance, reduction, or deferral of investment by the electric utility

Public Policy Requirement	Description
Colorado HB 19-1261 and SB 1261 (“GHG Reduction Bills”)	HB 19-1261 requires the Air Quality Control Commission (“AQCC”) to promulgate rules and regulations for statewide greenhouse gas (“GHG”) pollution abatement. Section 1 of SB 1261 states that Colorado shall have statewide goals to reduce 2025 greenhouse gas emissions by at least 26%, 2030 greenhouse gas emissions by at least 50%, and 2050 greenhouse gas emissions by at least 90% of the levels of statewide greenhouse gas emissions that existed in 2005. A clean energy plan filed by a utility is deemed approved if the plan demonstrates an 80% reduction by 2030.
Colorado HB10-1001	Established Colorado Renewable Energy Standard (“RES”) to 30% by 2020 for IOUs (Xcel & Black Hills)
Colorado SB 07-100	Requires IOUs to identify Energy Resource Zones, plan transmission to alleviate constraints from those zones, and pursue projects according to the timing of resource development in those zones
Colorado SB 18-009 (“Energy Storage Rights Bill”)	Protects the rights of Colorado electricity consumers to install, interconnect, and use energy storage systems on their property without the burden of unnecessary restrictions or regulations and without unfair or discriminatory rates or fees.
Colorado SB 19-077 (“Electric Vehicles Bill”)	The bill enables a regulatory approval process for electric utilities to invest in charging facilities and provide incentive rebates; thus, the investments and rebates may earn a return at the utility’s authorized weighted-average cost of capital. Where approved, the costs for the investments and rebates may be recovered from all customers of the electric utility similar to recovery of distribution system investments. Natural gas public utilities may provide fueling stations for alternative fuel vehicles as non-regulated services only.
Colorado SB 19-236 (“PUC Sunset Bill”)	The primary purpose of this bill is to reauthorize the CPUC, by appropriations, for a seven-year period to September 1, 2026. Reauthorization is required by the sunset process. Additionally, the bill carries numerous requirements for utilities and the CPUC to achieve an affordable, reliable, clean electric system. Included in the bill are requirements to reduce the qualifying retail utility’s carbon dioxide emissions associated with electricity sales to the qualifying retail utility’s electricity customers by eighty percent from 2005 levels by 2030, and that seeks to achieve providing its customers with energy generated from one-hundred-percent clean energy resources by 2050. The bill also subjects co-ops to Colorado Public Utility Commission rulemaking.
Colorado SB13-252	Requires cooperative utilities to generate 20% of their electricity from renewables by 2020
Colorado SB21-072	This bill requires electric transmission utilities in Colorado to join an organized wholesale market (“OWM”) by January 1, 2030, provided that the OWM meets certain criteria set forth in the statute. This bill also creates the Colorado Electric Transmission Authority, a governmental entity that is authorized to independently develop and finance transmission projects.
Colorado HB21-1266	This bill is a broad policy measure to promote environmental justice in disproportionately impacted communities through the creation of an Environmental Justice Task Force. The bill requires wholesale generation and transmission cooperatives to file with the Public Utilities Commission a Clean Energy Plan to achieve 80% emissions reductions by 2030.

Public Policy Requirement	Description
Colorado SB 21-246	The primary purpose of this bill is to direct the approval of plans for the electrification of buildings that use fossil fuel-based systems through existing demand side management programs.
Colorado HB21-1238	The primary purpose of this bill is to update the PUC's rules and decision-making process with respect to natural gas demand-side management programs including the use of the Social Cost of Carbon and Social Cost of Methane.
Colorado SB21-272	The primary purpose of this bill is to update the PUC's rules and decision-making process to better incorporate the impacts and benefits to underserved or disproportionately impacted communities and groups including workforces impacted by generation acquisition and retirement. Other requirements include how utilities finance resources or investments, the retirement of renewable energy credits, and the inclusion of the Social Cost of Carbon in resource planning decisions.
Colorado SB23-016	This legislation updates the State of Colorado's statutory greenhouse gas emissions goals (HB19-1261) to add a 65% reduction goal for 2035, an 80% reduction goal for 2040, and a 90% reduction goal for 2045, as well as amending the state's 2050 goal from a 90% reduction goal to 100%.
Colorado HB25-1292 (Transmission Lines in State Highway ROW)	HB25-1292 allows a transmission developer to longitudinally co-locate high voltage transmission lines within a state highway right-of-way, according to a process developed by rule by the Colorado Department of Transportation. The bill also requires the Colorado Electric Transmission Authority to study state highway corridors to identify potential corridors that may be suitable for high voltage transmission line development and to publish and share with specified state agencies a report on the findings of the study
Colorado HB25-1040 (Adding Nuclear Energy as a Clean Energy Resource)	HB25-1040 adds nuclear energy to the definition of a "clean energy resource" under Colorado law, which allows nuclear energy projects to qualify for the state's 2050 clean energy targets and clean energy project financing.
Colorado SB24-218 (Modernize Energy Distribution Systems)	SB24-218 requires large investor-owned utilities to upgrade distribution systems as necessary to (1) support the transportation, affordable housing, new infill housing, and building electrification policies of state and local law, including state rules related to transportation electrification and building performance standards; (2) implement federal, state, regional, and local air quality and decarbonization targets, standards, plans, and regulations; and (3) support state agency, local agency, and local government plans and requirements related to housing, economic development, critical facilities, transportation, and building electrification.
New Mexico Efficient Use of Energy Act	The objective of this rule is to implement the Efficient Use of Energy Act's requirements for public utilities to acquire a portfolio of cost-effective energy efficiency and load management and to establish criteria to evaluate and implement a portfolio of cost-effective energy efficiency and load management that reduces energy demand and energy consumption.

Public Policy Requirement	Description
New Mexico Energy Transition Act (2019 SB 489)	Subject to the Reasonable Cost Threshold (“RCT”), the Energy Transition Act defines renewable energy requirements that are a percentage of a utility’s retail energy sales and the type of utility: • By 2020, 20% for public utilities and 10% for cooperatives • By 2025, 40% for public utilities and cooperatives • By 2030, 50% for public utilities and cooperatives • By 2040, 80% for public utilities with provisions associated with carbon free generation • 100% carbon-free by 2045 for public utilities and by 2050 for cooperatives
Texas RPS	Texas RPS requires a total renewable capacity of 5,880 MW (which has already been achieved) by 2025 be installed in the state which is in turn converted into a renewable energy requirement. The renewable energy requirements are allocated to load serving entities based on their amount of retail energy sales as a percent of the total Texas energy served
Texas Substantive Rule 25.181 (Energy Efficiency Rule)	The purpose is to ensure electric utilities administer energy efficiency incentive programs in a market-neutral, nondiscriminatory manner and do not offer competitive services except as permitted. All customers have access to programs that help reduce energy use, peak demand, or costs and utilities provide annual incentives through standard offers, market-transformation, or self-delivered programs to support cost-effective energy efficiency, within EECRF limits (relating to Energy Efficiency Cost Recovery Factor), to meet established goals.
New Mexico Title 17- Public Utilities and Utility Services Part 574 Applications to Expand Transportation Electrification	"The purpose of this rule is to implement Section 62-8-12 NMSA 1978, applications to expand transportation electrification, and to bring to New Mexico the economic development and environmental benefits of expanded electrification of the State’s transportation modalities and transportation infrastructure. Three-year plan with a planning outlook for two-years beyond the proposed three-year plan"

Public Policy Requirement	Description
New Mexico Title 17- Public Utilities and Utility Services Part 588 Grid Modernization Grant Program	Grid modernization roadmap and grant program is focused on improvements to electric distribution or transmission infrastructure, including related data analytics equipment, that are designed to accommodate or facilitate the integration of renewable electric generation resources with the electric distribution grid or to otherwise enhance electric distribution or transmission grid reliability, grid security, demand response capability, customer service or energy efficiency or conservation and includes:(a) advanced metering infrastructure that facilitates metering and providing related price signals to users to incentivize shifting demand;(b) intelligent grid devices for real time system and asset information at key substations and large industrial customers;(c) automated control systems for electric distribution circuits and substations;(d) communications networks for service meters;(e) distribution system hardening projects for circuits and substations designed to reduce service outages or service restoration times;(f) physical security measures at key distribution substations; (g) cybersecurity measures;(h) energy storage systems and microgrids that support circuit-level grid stability, power quality, reliability or resiliency or provide temporary backup energy supply;(i) electrical facilities and infrastructure necessary to support electric vehicle charging systems;(j) new customer information platforms designed to provide improved customer access, greater service options and expanded access to energy usage information; and (k) other new technologies that may be developed regarding the electric grid.
New Mexico Advanced Clean Car Rule	Starting in calendar year 2026, 43% of all new passenger cars and light-duty trucks shipped to New Mexico auto dealerships by national auto manufacturers must be zero emission vehicles. Similarly, beginning in calendar year 2026, 15% of all new commercial heavy-duty trucks shipped to New Mexico auto dealerships by national auto manufacturers must be zero emission vehicles. These percentages gradually increase over time.
New Mexico Transportation Clean Fuel Standard	It is expected to be approved in Q1 2026 for effectiveness in Q2 2026. EPE will provide a notification upon its effectiveness so that the study plan (if not yet finalized) can capture it. For now, a placeholder row would be appropriate.

6.2 Study Methodology and Criteria

Regional public policy-driven needs are evaluated in the following ways:

1. New regional economic or reliability needs identified during the regional economic and reliability needs assessments are further evaluated to determine if they were driven by Public Policy Requirements; and
2. Stakeholders are given an opportunity to review a list of Public Policy Requirements impacting the WestConnect region and a map representation of the local projects driven by those Public Policy Requirements. Stakeholders can then suggest to WestConnect which Public Policy Requirements may result in possible regional public policy-driven transmission needs.

For the second component above, the WestConnect regional public policy needs assessment leverages WestConnect and stakeholders in determining if a Public Policy Requirement (or set of Public Policy Requirements) may drive a regional public policy-driven transmission need that is appropriate to address in that planning cycle. WestConnect will provide stakeholders with (1) the list of Public Policy Requirements impacting the WestConnect region and (2) a list of local public policy-driven transmission projects and a map representation of the projects. Stakeholders review the information and make suggestions as to whether a regional need may be driven by Public Policy Requirements

The PMC will then select which, if any, of the proposed regional needs driven by Public Policy Requirements will be evaluated in the 2026-27 planning cycle. The PMC will make this selection by considering factors, including, but not limited to:

1. whether the Public Policy Requirement is driving a regional transmission need that can be reasonably identified in the current planning cycle;
2. the feasibility of addressing the regional transmission need driven by the Public Policy Requirement in the current planning cycle;
3. the factual basis supporting the regional transmission need driven by the Public Policy Requirement; and
4. whether a Public Policy Requirement has been identified for which a regional transmission need has not yet materialized, or for which there may exist a regional transmission need but the development of a solution to that need is premature

6.3 Regional Public Policy-driven Transmission Needs

If any regional public policy needs are identified, the needs will be identified and described in the Regional Need Assessment report and posted to the WestConnect website. It is possible that a specific model will be developed to evaluate the specific public policy need and associated solutions.

7. Solutions to Regional Needs

After the Regional Need Assessment Report is finalized, regional needs will be posted to the WestConnect website, and a project solution submittal window will open. Upon closure of the submittal window, WestConnect will initiate an evaluation of the benefits and costs of the proposed solutions to identify if any is a more efficient or cost-effective regional solution.

If no project solutions are submitted, WestConnect will seek to develop solutions to the regional needs.

In the event that no regional transmission needs are identified, the PMC will not collect transmission or non-transmission alternatives for evaluation (as there will be no regional transmission needs to evaluate the alternatives against).

8. Scenario Studies

In addition to the regional needs assessment, WestConnect also conducts information-only scenario studies that look at alternate but plausible futures. They represent futures with resource, load, and public policy assumptions that are different in one or more ways than what is assumed in the Base model and sensitivity assessments. The studies required under the tariffs that implement Order 1000 in the WestConnect region shall be given priority. However, as time permits, the PS may evaluate scenario proposals and make recommendations to the PMC on any scenario proposals for the PMC's consideration.

Proposals for scenarios generally enter into the Planning Process through a 30-day open submittal window, which opens during Quarter 8 of the previous planning cycle. During the open window, stakeholders may provide proposals for specific scenarios for WestConnect to consider in the upcoming planning cycle. The PMC and PS can also develop scenarios for consideration. The PS may work with individual requestors to clarify the intent of the scenarios. The PS may also recommend combining scenarios that appear to have common goals, themes, or modeling assumptions.

Since the assessment of a scenario is different than an "expected future" base case such assessments may provide useful information for future planning cycles, especially if the scenario appears likely to become an expected future for the region. Also, results from the scenario assessments may help the region identify emerging opportunities for infrastructure (generation, transmission, or otherwise). Any transmission issues that might come to light as a result of the WestConnect scenario assessments are not to be confused with the WestConnect task under Order 1000 to identify regional transmission needs and to solicit for proposals to more cost effectively or efficiently satisfy such needs. In other words, the WestConnect scenario assessments do not obligate ETO members to any responsibility under or outside the scope of Order 1000.

WestConnect also provides the opportunity for stakeholders to provide suggestions that might allow for more efficient or cost-effective alternatives to the regional plans. These types of suggestions may be different from the scenarios mentioned above. They may also be different than proposals to meet identified regional needs. These types of suggestions may be submitted at any time, but would be most beneficial to the Planning Process if they are presented through the scenario submission window. The PMC will consider such suggestions on a case-by-case basis to determine if any such suggestions warrant analyses, and how to incorporate any analyses into the Planning Process. Stakeholders submitting such suggestions are expected to provide evidence as to how their proposals might result in a more efficient or cost-effective regional plan. As with scenarios, the PMC will determine whether the PS should assess any suggestions.

8.1 Scenario Proposals Received for the 2026-27 Study Plan

WestConnect held an open window from December 1, 2025, through January 7, 2026. Two proposals for scenario studies were submitted during the open window, shown in Table 7.

Table 7 Scenarios Received During the Open Window

Requestor	Description/Name
Ron Belval, Rob Kondziolka	20-Year High Load & Renewable Resource Scenario
Ben Fitch-Fleischmann Interwest Energy Alliance	Full Accounting of Production Cost Benefits

The two scenario proposals were reviewed by the PS on January 20, 2026. A representative for each scenario request provided a presentation to the PS to summarize the request and answer questions.

On January 29, 2026, Interwest withdrew their scenario request and stated support for the 20-Year scenario.

During an interim PS meeting on February 11, 2026, the scenario proposals were revisited. The discussion at that meeting led to the conclusion that there was no consensus support for evaluating the 20-Year scenario in the planning cycle. However, the PS agreed that it will revisit the 20-year scenario proposal and other scenario ideas, as time permits, following completion of the Order 1000 Regional Needs Assessment in December 2026.

Appendix A – Base Transmission Plan

The tables below include the planned projects that are slated for inclusion in the Base Transmission Plan.

ETO Transmission Plan Projects

Sponsor	Project Name	Voltage	In 2024-25 RTP?	ISD
Arizona Public Service	Bagdad 230kV Transmission Line	230 kV	Yes	2028
Arizona Public Service	Bianco 230kV Lines	230 kV	Yes	2028
Arizona Public Service	Four Corners to Cholla to Pinnacle Peak 345kV Line Rebuilds	345 kV	Yes	2038
Arizona Public Service	Hashknife Energy Center Generation Tie Line Project	500 kV AC	Yes	2026
Arizona Public Service	Jojoba to Rudd 500kV line	500 kV AC	Yes	2031
Arizona Public Service	Panda - Freedom 230kV Line Rebuild	230 kV	Yes	2030
Arizona Public Service	Sundance - TS33 - Milligan 230kV Line	230 kV	Yes	2027
Arizona Public Service	Pinnacle Peak to Ocotillo 230kV Line Rebuilds	230 kV	Yes	2030
Arizona Public Service	Proving Ground Solar and Storage 500kV Interconnection	500 kV AC	Yes	2026
Arizona Public Service	Runway - Stratus 230kV Cut-In to TS21	230 kV	Yes	2030
Arizona Public Service	Sun Valley to Outer Circle 230kV line	230 kV	Yes	2027
Arizona Public Service	TS21 500/230kV Substation	500 kV AC	Yes	2031
Arizona Public Service	TS21 to Broadway 230kV Line	230 kV	Yes	2030
Arizona Public Service	TS22 Project	500 kV AC	Yes	2028
Arizona Public Service	Morgan to Outer Circle 230kV line	230 kV	No	2030
Arizona Public Service	North Gila – Orchard 230kV Line Circuit #2	230 kV	No	2029
Black Hills Energy	BHCT-G29 Substation	115 kV	Yes	2027
Black Hills Energy	West Station - Portland 115 kV Rebuild	115 kV	Yes	2026
Black Hills Energy	La Junta 115/69 kV Transformer Replacement (50 MVA)	115 kV	No	2028
Black Hills Energy	Pueblo Plant 115 kV Substation Rebuild	115 kV	No	2029
Black Hills Power	BHBE G25 115 MW RICE	230 kV	No	2026
Cheyenne Light Fuel and Power	Happy Jack - North Range #2 115 kV Line	115 kV	Yes	2026
Cheyenne Light Fuel and Power	Sweetgrass - Bison 115 kV #3 & #4	115 kV	Yes	2027
Cheyenne Light Fuel and Power	CLPT G20 365 MW Solar/BESS	230 kV	No	2027
Cheyenne Light Fuel and Power	CLPT G16 300 MW Solar/Wind/BESS	230 kV	No	2028
Cheyenne Light Fuel and Power	CLPT G18 255 MW Solar/BESS	230 kV	No	2028
Cheyenne Light Fuel and Power	CLPT G11 150 MW Wind	115 kV	No	2028

Cheyenne Light Fuel and Power	CLPT G17 300 MW Solar/Wind/Bess	115 kV	No	2028
Cheyenne Light Fuel and Power	CLPT G21 400 MW Solar/BESS	230 kV	No	2028
Cheyenne Light Fuel and Power	Sweetgrass – CPGS 230 kV Voltage Conversion	230 kV	No	2028
El Paso Electric Company	Verde 115 kV Substation (Load Serving Station Portion Added), 115/24kV 50 MVA Transformer Addition	115 kV	Yes	2030
El Paso Electric Company	Afton-Newman 345kV Line Reconfiguration, In and Out in Vado 345 kV Substation	345 kV	Yes	2028
El Paso Electric Company	McCombs Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2028
El Paso Electric Company	Jornada-Arroyo 115 kV Line (Reconductor/Rebuild)	115 kV	Yes	2028
El Paso Electric Company	Apollo-Cox Line 69 kV to 115 kV (Moongate-Apollo Portion - Rebuild)	115 kV	Yes	2027
El Paso Electric Company	Afton North 345 kV Substation (New)	345 kV	Yes	2028
El Paso Electric Company	Afton-Afton North 345 kV Double Bundled Line (New)	345 kV	Yes	2028
El Paso Electric Company	Vado Substation 345/115 kV (New)	345 kV	Yes	2028
El Paso Electric Company	Seabeck Switching Station 115 kV (New)	115 kV	Yes	2027
El Paso Electric Company	Seabeck-Horizon 115 kV Line (Rebuild, Upgrade)	115 kV	Yes	2027
El Paso Electric Company	Seabeck-Wicked-San Felipe 115 kV Line (Reconfiguration)	115 kV	Yes	2029
El Paso Electric Company	Sparks-San Felipe Line (Voltage Conversion, Rebuild, Reconductor) 69 kV to 115 kV	115 kV	Yes	2026
El Paso Electric Company	San Felipe (New) 115 kV Capacitors (2 x 15.9 MVAR)	115 kV	Yes	2026
El Paso Electric Company	Pine Switching Station 345/115 kV (New)	115 kV	Yes	2031
El Paso Electric Company	Pine-Seabeck 115 kV Line (New)	115 kV	Yes	2031
El Paso Electric Company	Marvin-Pine 115kV Line (Reconductor)	115 kV	Yes	2031
El Paso Electric Company	Rio Grande-Sunset 69 kV Lines (5500/5600) (Rebuild, Reconductor)	Below 115 kV	Yes	2026
El Paso Electric Company	Vado-Salopek 115 kV Line (Rebuild, Reconductor)	115 kV	Yes	2029
El Paso Electric Company	Anthony-Vado 115 kV Line (Rebuild, Reconductor)	115 kV	Yes	2029
El Paso Electric Company	Vado 2 x 224 MVA Vado 345/115 kV Autotransformers (New)	345 kV	Yes	2029
El Paso Electric Company	Leasburg Substation 115 kV (New)	115 kV	Yes	2028
El Paso Electric Company	Arroyo-Moongate 115 kV line - Reconductor, Reconfiguration	115 kV	Yes	2027
El Paso Electric Company	Lane-Americas 69 kV Line (Reconductor)	Below 115 kV	Yes	2026
El Paso Electric Company	Rio Bosque-Ascarate 69 kV Line (Reconductor)	Below 115 kV	Yes	2027
El Paso Electric Company	Sparks-Felipe 69 kV Line (Rebuild, Reconductor)	Below 115 kV	Yes	2026
El Paso Electric Company	Ascarate-Trowbridge 115 kV Line (Reconductor)	115 kV	Yes	2027

El Paso Electric Company	Hawkins Substation 69 kV (New) and Line Reconfiguration	Below 115 kV	Yes	2026
El Paso Electric Company	Pellicano-Montwood 115 kV Line (Reconductor)	115 kV	Yes	2026
El Paso Electric Company	WS2 Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2034
El Paso Electric Company	Eastlake Substation (New) and Related 115 kV Line Reconductor and Reconfiguration	115 kV	Yes	2026
El Paso Electric Company	Passmore Bovee Substation (New) and Related 69 kV Line; Reconductor and Reconfiguration	Below 115 kV	Yes	2026
El Paso Electric Company	Wrangler-Eastlake 115 kV Line (Rebuild, Reconductor)	115 kV	Yes	2027
El Paso Electric Company	Arroyo Variable Line Shunt Reactor (50-100 MVAR) on the Arroyo end of the West Mesa-Arroyo 345 kV Line	345 kV	Yes	2028
El Paso Electric Company	Afton North-Airport 345 kV Line (New)	345 kV	Yes	2028
El Paso Electric Company	Afton-Newman 345kV Line Reconfiguration	345 kV	Yes	2028
El Paso Electric Company	Airport 345/115/24 kV Substation	345 kV	Yes	2028
El Paso Electric Company	Marvin (FE6) 115 kV Switching Substation and Related 115 kV Line Reconfiguration	115 kV	Yes	2027
El Paso Electric Company	Artesia/Eddy HVDC Tie Replacement (New)	345 kV	Yes	2031
El Paso Electric Company	WS1 Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2030
El Paso Electric Company	McNutt Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2028
El Paso Electric Company	EA1 Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2027
El Paso Electric Company	FE7 115 kV Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2027
El Paso Electric Company	Marlow-Trowbridge 115 kV Line (Rebuild, Reconductor)	115 kV	Yes	2032
El Paso Electric Company	Newman-McCombs 115 kV Line Circuit 1 (Reconductor)	115 kV	Yes	2032
El Paso Electric Company	Newman-McCombs 115 kV Line Circuit 2 (Reconductor)	115 kV	Yes	2032
El Paso Electric Company	NE3 Substation (New) and Related 115 kV Line Reconfiguration	115 kV	Yes	2031
El Paso Electric Company	Newman-Roberts 115 kV Line Circuit 1 (Reconductor)	115 kV	Yes	2032
El Paso Electric Company	McCloud East Substation & Related 115 kV Line Reconfigurations	115 kV	No	2026
El Paso Electric Company	Eastlake Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2026
El Paso Electric Company	Eastwind 115 Substation (New) & Related 115 kV Line Reconfiguration	115 kV	No	2026
El Paso Electric Company	Bovee Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2026

El Paso Electric Company	Eastwind Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2026
El Paso Electric Company	Chaparral-Escondido 115 kV Line (Reconductor)	115 kV	No	2027
El Paso Electric Company	Marvin-Seabeck 115 kV Line (New)	115 kV	No	2027
El Paso Electric Company	Thorn-Ripley 115 kV Line (Reconductor)	115 kV	No	2027
El Paso Electric Company	Americas-Bovee 69 kV Line (Reconductor)	115 kV	No	2027
El Paso Electric Company	EA-1 Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2027
El Paso Electric Company	EA-2 Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2027
El Paso Electric Company	FE-7 Substation 115 kV Capacitor Bank Addition (New)	115 kV	No	2027
El Paso Electric Company	Rio Bosque 69 kV 1x15.9 MVAR Capacitor Bank (New)	Below 115 kV	No	2027
El Paso Electric Company	WS-3 Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2027
El Paso Electric Company	Dyer Substation (Voltage Conversion) 69 kV to 115 kV	115 kV	No	2028
El Paso Electric Company	Afton North-Vado 345 kV Line (New, New Line)	345 kV	No	2028
El Paso Electric Company	Eastwind-Seabeck 115 kV Line (New)	115 kV	No	2028
El Paso Electric Company	Leasburg Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2028
El Paso Electric Company	Marvin Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2028
El Paso Electric Company	WS-4 Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2028
El Paso Electric Company	Bovee-Eastlake 115 kV Line (New)	115 kV	No	2029
El Paso Electric Company	Bovee-Northloop 115 kV Line (Reconductor)	115 kV	No	2029
El Paso Electric Company	Eastlake-Sparks 115 kV Line (Reconductor)	115 kV	No	2029
El Paso Electric Company	Thorn Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2029
El Paso Electric Company	Alamo 345/115/69 kV Switching Station (New)	345 kV	No	2030
El Paso Electric Company	T_W1 345/115 kV Switching Station (New) & Related 345 kV Line Reconfiguration	345 kV	No	2030
El Paso Electric Company	Luna-Diablo 345 kV Line Reconfiguration (In-and-Out at Afton 345 kV Substation)	345 kV	No	2030
El Paso Electric Company	Alamo-Bovee 115 kV Line (New)	115 kV	No	2030
El Paso Electric Company	Alamo-Wicked 115 kV Line (New)	115 kV	No	2030
El Paso Electric Company	Alamo-San Felipe (Voltage Conversion, Rebuild, Reconductor) 69 kV to 115 kV	115 kV	No	2030
El Paso Electric Company	T_W1-WS-3 115 kV Line (New)	115 kV	No	2030
El Paso Electric Company	Alamo 115/69 kV Autotransformer (New)	115 kV	No	2030
El Paso Electric Company	T_W1 345/115 kV Autotransformer (New)	345 kV	No	2030
El Paso Electric Company	McCombs Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2030

El Paso Electric Company	WS-1 Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2030
El Paso Electric Company	Americas Substation (Voltage Conversion) 69 kV to 115 kV	115 kV	No	2031
El Paso Electric Company	Caliente-Pine 345 kV Line (New)	345 kV	No	2031
El Paso Electric Company	Americas-Lane (Voltage Conversion, Rebuild, Reconductor) 69 kV to 115 kV	115 kV	No	2031
El Paso Electric Company	Airport-Arroyo 115 kV Line (New)	115 kV	No	2031
El Paso Electric Company	Apollo-Moongate 115 kV Line (Reconfiguration, Reconductor)	115 kV	No	2031
El Paso Electric Company	Escondido-Oro Grande 115 kV Line (Reconductor)	115 kV	No	2031
El Paso Electric Company	Oro Grande-Amrad 115 kV Line (Reconductor)	115 kV	No	2031
El Paso Electric Company	Amrad 345/115 kV Autotransformer (New, Additional)	345 kV	No	2031
El Paso Electric Company	Pine 345/115 kV Autotransformer (New)	345 kV	No	2031
El Paso Electric Company	WS-2 Substation 115 kV 2x15.9 MVAR Capacitor Bank (New)	115 kV	No	2034
El Paso Electric Company	Alamo – Pine 345 kV Line (New)	345 kV	No	2035
El Paso Electric Company	Alamo 345/115 kV Autotransformer (New)	345 kV	No	2035
Public Service Company of Colorado/ Xcel Energy	Gilman-Avon 115 kV Transmission Line	115 kV	Yes	2029
Public Service Company of Colorado/ Xcel Energy	Colorado's Power Pathway	345 kV	Yes	2027
Public Service Company of Colorado/ Xcel Energy	Daniels Park to Prairie Reconductor 230kV	230 kV	Yes	2026
Public Service Company of Colorado/ Xcel Energy	Kestrel Substation	230 kV	Yes	2026
Public Service Company of Colorado/ Xcel Energy	Poder (Formerly Stock Show) Distribution Substation	115 kV	Yes	2026
Public Service Company of Colorado/ Xcel Energy	Sandstone Switching Station	345 kV	Yes	2027
Public Service Company of Colorado/ Xcel Energy	Colorado's Power Pathway – Segment 1	345 kV	Yes	2026
Public Service Company of Colorado/ Xcel Energy	Colorado's Power Pathway – Segments 4 and 5	345 kV	Yes	2027
Public Service Company of Colorado/ Xcel Energy	Colorado's Power Pathway - Voltage Control / Reactive Support	345 kV	Yes	2027
Public Service Company of Colorado/ Xcel Energy	Colorado's Power Pathway - Voltage Control / Reactive Support	345 kV	Yes	2027
Public Service Company of Colorado/ Xcel Energy	Barker Distribution Substation	230 kV	No	2027
Public Service Company of Colorado/ Xcel Energy	Circuit 5707 & 5111: Daniels Park - Prairie - Greenwood Uprate	230 kV	No	2027
Public Service Company of Colorado/ Xcel Energy	Circuit 5283: Leetsdale – Elati 230 kV Underground Transmission Line Upgrade	230 kV	No	2027

Public Service Company of Colorado/ Xcel Energy	Arapahoe Substation Upgrades (230/115kV Transformer)	115 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Greenwood Substation Upgrades	230 kV	No	2028
Public Service Company of Colorado/ Xcel Energy	Circuits 9055, 9558, and 9464: Cherokee - Federal Heights - Semper – Broomfield Uprate	115 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Daniels Park Substation Upgrades (345/230kV Transformer)	345 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Smoky Hill Substation (345/230kV Transformer)	345 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Circuit 9955: Leetsdale to Harrison 115 kV Uprate	115 kV	No	2031
Public Service Company of Colorado/ Xcel Energy	Circuit 5709: Greenwood – Arapahoe 230kV Uprate	230 kV	No	2027
Public Service Company of Colorado/ Xcel Energy	PI-2024-06 Generation Interconnection Substation	345 kV	No	2028
Public Service Company of Colorado/ Xcel Energy	Circuit 9335: Arapahoe – South Tap – Bancroft Uprate	115 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Circuit 5107: Daniels Park – Santa Fe Uprate	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 5717: Greenwood – Monaco Series Reactor	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 9332: Arapahoe - Air Liquide Tap - South - Gray Street Uprate	115 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	New Substation A	115 kV	No	2031
Public Service Company of Colorado/ Xcel Energy	Circuit 9542: Cherokee - New Substation A	115 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 9546: Cherokee -Mapleton - New Substation A Uprate	115 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 9549: Cherokee - Conoco - New Substation A Uprate	115 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	New 115 kV Transmission Line: Cherokee - New Substation A	115 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuits 5167 and 5285: Smoky Hill - Buckley - Tollgate - Jewell – Leetsdale Uprate	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	South Substation Upgrade (230/115kV Transformer)	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 5625: Denver Terminal – Elati Uprate	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 6584: Mitchell Creek – Ute (Rifle)	Below 115 kV	No	2026
Public Service Company of Colorado/ Xcel Energy	Circuit 6671: Vineland – Ute Grand Junction	Below 115 kV	No	2028
Public Service Company of Colorado/ Xcel Energy	Climax – Robinson Rack – Gilman 115 kV	115 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Circuit 9812: Smeltertown to Poncha 115kV	115 kV	No	2027

Public Service Company of Colorado/ Xcel Energy	Circuit 5207: Hopkins to Rifle 230kV	230 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Circuit 5205: Parachute to Rifle 230kV	230 kV	No	2028
Public Service Company of Colorado/ Xcel Energy	Circuit 5509: Bluestone Valley to Parachute 230kV	230 kV	No	2029
Public Service Company of Colorado/ Xcel Energy	Circuit 55123: Bluestone Valley to Cameo 230kV	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 5245: Hopkins to Hagerman Pass 230kV	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 5245: Hagerman Pass to Malta 230kV	230 kV	No	2030
Public Service Company of Colorado/ Xcel Energy	Circuit 5785: Cooley Mesa to Wolcott 230kV	230 kV	No	2031
Public Service Company of Colorado/ Xcel Energy	Circuit 5787: Cooley Mesa to Basalt 230kV	230 kV	No	2031
Public Service Company of Colorado/ Xcel Energy	Circuit 9188: Climax to Summit 115kV	115 kV	No	2027
Public Service Company of Colorado/ Xcel Energy	Circuits 9046, 9054, & 9688: Eldorado to Valmont, Valmont to Ralston, Ralston to Eldorado 115kV	115 kV	No	2028
Public Service Company of New Mexico	New 115 kV Switching Station (Albuquerque)	115 kV	No	2027
Public Service Company of New Mexico	Pajarito 345 kV Station Expansion	345 kV	No	2027
Public Service Company of New Mexico	Sun Ranch 115 kV Station Expansion	115 kV	No	2026
Public Service Company of New Mexico	Hidden Mountain 345 kV Expansion	345 kV	No	2028
Public Service Company of New Mexico	Rio Puerco-Pajarito-Prosperity 345 kV Line	345 kV	No	2029
Tri-State Generation and Transmission Association	Frontier Reactor Addition	115 kV	Yes	2036
Tri-State Generation and Transmission Association	Rolling Meadows Substation	115 kV	Yes	2027
Tri-State Generation and Transmission Association	Badger Creek - Big Sandy 230 kV	230 kV	Yes	2028
Tri-State Generation and Transmission Association	Big Sandy - Burlington 230 kV Uprate	230 kV	Yes	2028
Tri-State Generation and Transmission Association	Crosspoint Substation	230 kV	Yes	2027
Tri-State Generation and Transmission Association	Sulfur Creek Tap	138 kV	Yes	2027
Tri-State Generation and Transmission Association	Breaker Addition at Sidney Substation	115 kV	Yes	2027
Tri-State Generation and Transmission Association	Breaker Addition at Hesperus Substation	115 kV	Yes	2026
Tri-State Generation and Transmission Association	Mora Project	115 kV	No	2027

Tri-State Generation and Transmission Association	Kinnan DP	115 kV	No	2026
Tri-State Generation and Transmission Association	Iron Muontain DP	115 kV	No	2026
Tri-State Generation and Transmission Association	Breaker addition at Montrose Substation	115 kV	No	2026
Tri-State Generation and Transmission Association	Sunrise DP	115 kV	No	2029
Tri-State Generation and Transmission Association	Richie Gulch	115 kV	No	2027
Tri-State Generation and Transmission Association	Thoreau DP	115 kV	No	2029
Tucson Electric Power	Grier 138/13.8 kV Substation	138 kV	Yes	2028
Tucson Electric Power	Lago Del Oro 138/13.8 kV Substation	138 kV	Yes	2032
Tucson Electric Power	Corona 138/13.8 kV Substation	138 kV	Yes	2032
Tucson Electric Power	Craycroft-Barril 138/13.8 kV Substation	138 kV	Yes	2032
Tucson Electric Power	Golden Valley 230kV Transmission Line	230 kV	Yes	2031
Tucson Electric Power	Santa Rita (formerly Hartt) 138/13.8 kV Substation	138 kV	Yes	2028
Tucson Electric Power	Grier 138-kV Transmission Line	138 kV	Yes	2028
Tucson Electric Power	Rancho Vistoso - Lago Del Oro 138kV Line	138 kV	Yes	2032
Tucson Electric Power	Naranja 138/13.8 kV Substation	138 kV	Yes	2029
Tucson Electric Power	Vine 138/13.8 kV Substation (was UA North)	138 kV	Yes	2027
Tucson Electric Power	New 138kV line North Loop to Naranja to La Canada	138 kV	Yes	2029
Tucson Electric Power	Re-Conductor Vail to Kantor 138-kV Transmission Line, south of Nogales Tap	138 kV	Yes	2029
Tucson Electric Power	Wilmot Park (formerly Sears Wilmot) 138/13.8 kV Substation	138 kV	Yes	2033
Tucson Electric Power	Rio Rico 138kV Switchyard	138 kV	Yes	2027
Tucson Electric Power	Greenlee Capacitor Additions	345 kV	Yes	2026
Tucson Electric Power	Rio Rico Capacitor Bank Addition	138 kV	Yes	2027
Tucson Electric Power	Rillito 138kV Conversion to breaker-and-a-half substation	138 kV	Yes	2027
Tucson Electric Power	New 230kV Yard at Tortolita Substation	230 kV	Yes	2026
Tucson Electric Power	New 230kV Yard at DMP Substation	230 kV	Yes	2026
Tucson Electric Power	New 230kV Yard at Vail Substation	230 kV	Yes	2027
Tucson Electric Power	Tortolita to DMP 230kV line	230 kV	Yes	2026
Tucson Electric Power	DMP to Vail 230kV line	230 kV	Yes	2027
Tucson Electric Power	Tortolita 500/230kV Transformers	500 kV AC	Yes	2026
Tucson Electric Power	DMP 230/138kV Transformers	230 kV	Yes	2026
Tucson Electric Power	Vail 345/230kV Transformers	345 kV	Yes	2027
Tucson Electric Power	Tucson Estates (formerly Bopp-Donald) 138/13.8 kV Substation	138 kV	Yes	2029

Tucson Electric Power	Midvale to Tucson Estates 138 kV line	138 kV	Yes	2029
Tucson Electric Power	Tucson Estates to South 138 kV line	138 kV	Yes	2030
Tucson Electric Power	TEPTDA 138kV Substation	138 kV	Yes	2030
Tucson Electric Power	Harshaw 138kV Substation	138 kV	Yes	2027
Tucson Electric Power	Rio Rico - Harshaw 138kV Transmission Line	138 kV	Yes	2027
Tucson Electric Power	Kipper 138kV Substation	138 kV	Yes	2026
Tucson Electric Power	Canoa Ranch to Kantor 138kV Transmission Line	138 kV	Yes	2028
Tucson Electric Power	UNSTDB 138 kV Substation	138 kV	Yes	2031
Tucson Electric Power	Kantor to UNSTDB 138 kV Line	138 kV	Yes	2031
Tucson Electric Power	Port 138kV Substation	138 kV	Yes	2028
Tucson Electric Power	Aerospace Research Campus Transmission Project	138 kV	Yes	2026
Tucson Electric Power	Irvington to Sonoran 138 kV circuits 1, 2, & 3 reconductor	138 kV	No	2026
Tucson Electric Power	Owl Head Ranch Switchyard. Loop-in of Tortolita - North Loop 138 kV Line # 118	138 kV	No	2028
Tucson Electric Power	Owl Head Ranch to Grier 2nd 138 kV Circuit	138 kV	No	2028
Tucson Electric Power	South Houghton 138 kV Switchyard	138 kV	No	2027
Tucson Electric Power	Loop-in of existing Greenlee - Vail 345 kV line into Winchester 345 kV Substation	345 kV	No	2027
Tucson Electric Power	500/345 kV Transformer addition at Pinal West	500 kV AC	No	2035
Tucson Electric Power	Rancho Vistoso Capacitor Bank Addition	138 kV	No	2027
Tucson Electric Power	DeMoss Petrie Capacitor Bank Addition	138 kV	No	2031
Tucson Electric Power	Owl Head Ranch to Grier 1st 138 kV circuit	138 kV	No	2028
Tucson Electric Power	Midvale - TEPTDA 2nd 138 kV circuit	138 kV	No	2030
Tucson Electric Power	Vail to South Houghton 4th 138 kV circuit	138 kV	No	2027
Tucson Electric Power	Robert Bills to Vail 138 kV reconductor	138 kV	No	2026
Tucson Electric Power	Robert Bills to Sonoran 138 kV reconductor	138 kV	No	2026

Non-member TO Transmission Plan Projects

Sponsor	Project Name	Voltage	In 2024-25 RTP?	ISD
Arizona Electric Power Cooperative	Adonis to Marana 115 kV Connection	115 kV	No	2025
Arizona Electric Power Cooperative	Apache 115/69 kV Second Transformer	115 kV	No	2029
Arizona Electric Power Cooperative	Apache Generation 230 kV Ring Bus	230 kV	No	2026
Arizona Electric Power Cooperative	Apache/Hayden to San Manuel 115 kV Line	115 kV	No	2027
Arizona Electric Power Cooperative	Cochise 230 kV Substation	230 kV	No	2026
Arizona Electric Power Cooperative	Greenlee Transformer Upgrade	345 kV	Yes	2025
Arizona Electric Power Cooperative	Marana Substation Rebuild	115 kV	Yes	2026
Arizona Electric Power Cooperative	Pantano Transformer Upgrade	230 kV	Yes	2025
Arizona Electric Power Cooperative	Saguaro to Adonis 115 kV Connection	115 kV	No	2024
Arizona Electric Power Cooperative	Schieffelin Project	230 kV	No	2022
Salt River Project	Anderson - Kyrene 230 kV #2	230 kV	Yes	2028
Salt River Project	Duke - Pinal Central 500 kV #2	500 kV	No	2033
Salt River Project	Duke - Pinal West 500 kV #2	500 kV	No	2031
Salt River Project	Duke 500/230 kV Transformer #2	500 kV	Yes	2028
Salt River Project	Hassayampa - Jojoba 500 kV #3	500 kV	No	2031
Salt River Project	Jojoba - Pinal West 500 kV #2 Line	500 kV	No	2028
Salt River Project	Laveen 230 kV	230 kV	No	2028
Salt River Project	Randolph 500 kV	500 kV	No	2026
Salt River Project	Reconductor Browning - Prickly Pear 230 kV	230 kV	No	2027
Salt River Project	Reconductor Miami - Pinto Valley 115 kV	115 kV	Yes	2027
Salt River Project	Reconductor Scott - Prickly Pear 230 kV	230 kV	No	2028
Salt River Project	Rudd 500/230 Transformer #5	500 kV	Yes	2026
Salt River Project	Rudd 500/230 Transformer #6	500 kV	Yes	2032
Salt River Project	Upgrade Kyrene - Papago Buttes 230 kV	230 kV	No	2026
Salt River Project	10 Ohm Series Reactors on Henshaw – Knox 230 kV Lines #1&2	230 kV	No	2028
Salt River Project	10 Ohm Series Reactors on Kyrene East – Kyrene West 230 kV Line	230 kV	No	2028
Salt River Project	5 Ohm Series Reactors on Liberty – Rudd 230 kV Line	230 kV	No	2027
Salt River Project	5 Ohm Series Reactors on Pinnacle Peak SRP – WAPA 230 kV Tie-line	230 kV	No	2026
Salt River Project	Abel Second 230/69 kV Transformer Addition	230 kV	No	2034

Salt River Project	Anderson 230/69 kV Transformer #1 Upgrade	230 kV	No	2028
Salt River Project	Anderson 230/69 kV Transformer #2 Upgrade	230 kV	No	2027
Salt River Project	Anderson 230/69 kV Transformer #3 Upgrade	230 kV	No	2026
Salt River Project	Browning Fourth 230/69 kV Transformer Addition	230 kV	No	2026
Salt River Project	Browning Fourth 500/230 kV Transformer Addition	500 kV	Yes	2025
Salt River Project	Browning Third 230/69 kV Transformer Addition	230 kV	No	2026
Salt River Project	Coodlige - Hayden 115 kV Reroute	115 kV	No	TBD
Salt River Project	Coolidge Expansion Project		No	2026
Salt River Project	Dinosaur Third 230/69 kV Transformer Addition	230 kV	No	2028
Salt River Project	Kyrene – Papago Buttes 230 kV Transmission Line Drop Upgrade	230 kV	No	2026
Salt River Project	Laveen First 230/69 kV Transformer Addition	230 kV	No	2027
Salt River Project	Laveen Second 230/69 kV Transformer Addition	230 kV	No	2027
Salt River Project	Orme 230/69 kV Transformer #2 Upgrade	230 kV	No	2026
Salt River Project	Papago Buttes 230/69 kV Transformer #3 Upgrade	230 kV	No	2025
Salt River Project	Papago Buttes 230/69 kV Transformer #4 Upgrade	230 kV	No	2025
Salt River Project	Prickly Pear Third 230/69 kV Transformer Addition	230 kV	No	2027
Salt River Project	Reconductor Anderson – Kyrene 230 kV Transmission Line	230 kV	Yes	2028
Salt River Project	Redhawk 230 kV	230 kV	No	2026
Salt River Project	Rudd Fifth 500/230 kV Transformer Addition	500 kV	Yes	2027
Salt River Project	Rudd Second 230/69 kV Transformer Addition	230 kV	No	2026
Salt River Project	Rudd Sixth 500/230 kV Transformer Addition	500 kV	Yes	2032
Salt River Project	Rudd Third 230/69 kV Transformer Addition	230 kV	No	2028
Salt River Project	Santan 230/69 kV Transformer #5 Upgrade	230 kV	No	2033
Salt River Project	Schrader Fourth 230/69 kV Transformer Addition	230 kV	No	2025
Salt River Project	Scott Third 230/69 kV Transformer Addition	230 kV	No	2026
Salt River Project	Silver King - East Plant - West Plant 230kV	230 kV	No	TBD
Salt River Project	Silver King - Tailings - Oak Flat 115 kV	115 kV	No	TBD
Salt River Project	South Mountain Transmission (Laveen 500/230 kV)	500 kV	No	2027-TBD
Salt River Project	Superior - Silver King 115 kV Reroute	115 kV	No	TBD
Salt River Project	Thunderstone 230/69 kV Transformers #2&4 Upgrade	230 kV	No	2033
Salt River Project	White Tanks Third 230/69 kV Transformer Addition	230 kV	No	2033