101-E-102A/B/C/D
CRUDE/CRUDE COLUMN OVERHEAD EXCHANGER

(TYPE-C, NOTE-1)
S/S DT - 175° C
DP - 36.7 kg/cm²g
T/S DT - 161.5° C 4
DP - 28.2 kg/cm²g
DESIGN DUTY - 26.74 MMkcal/hr

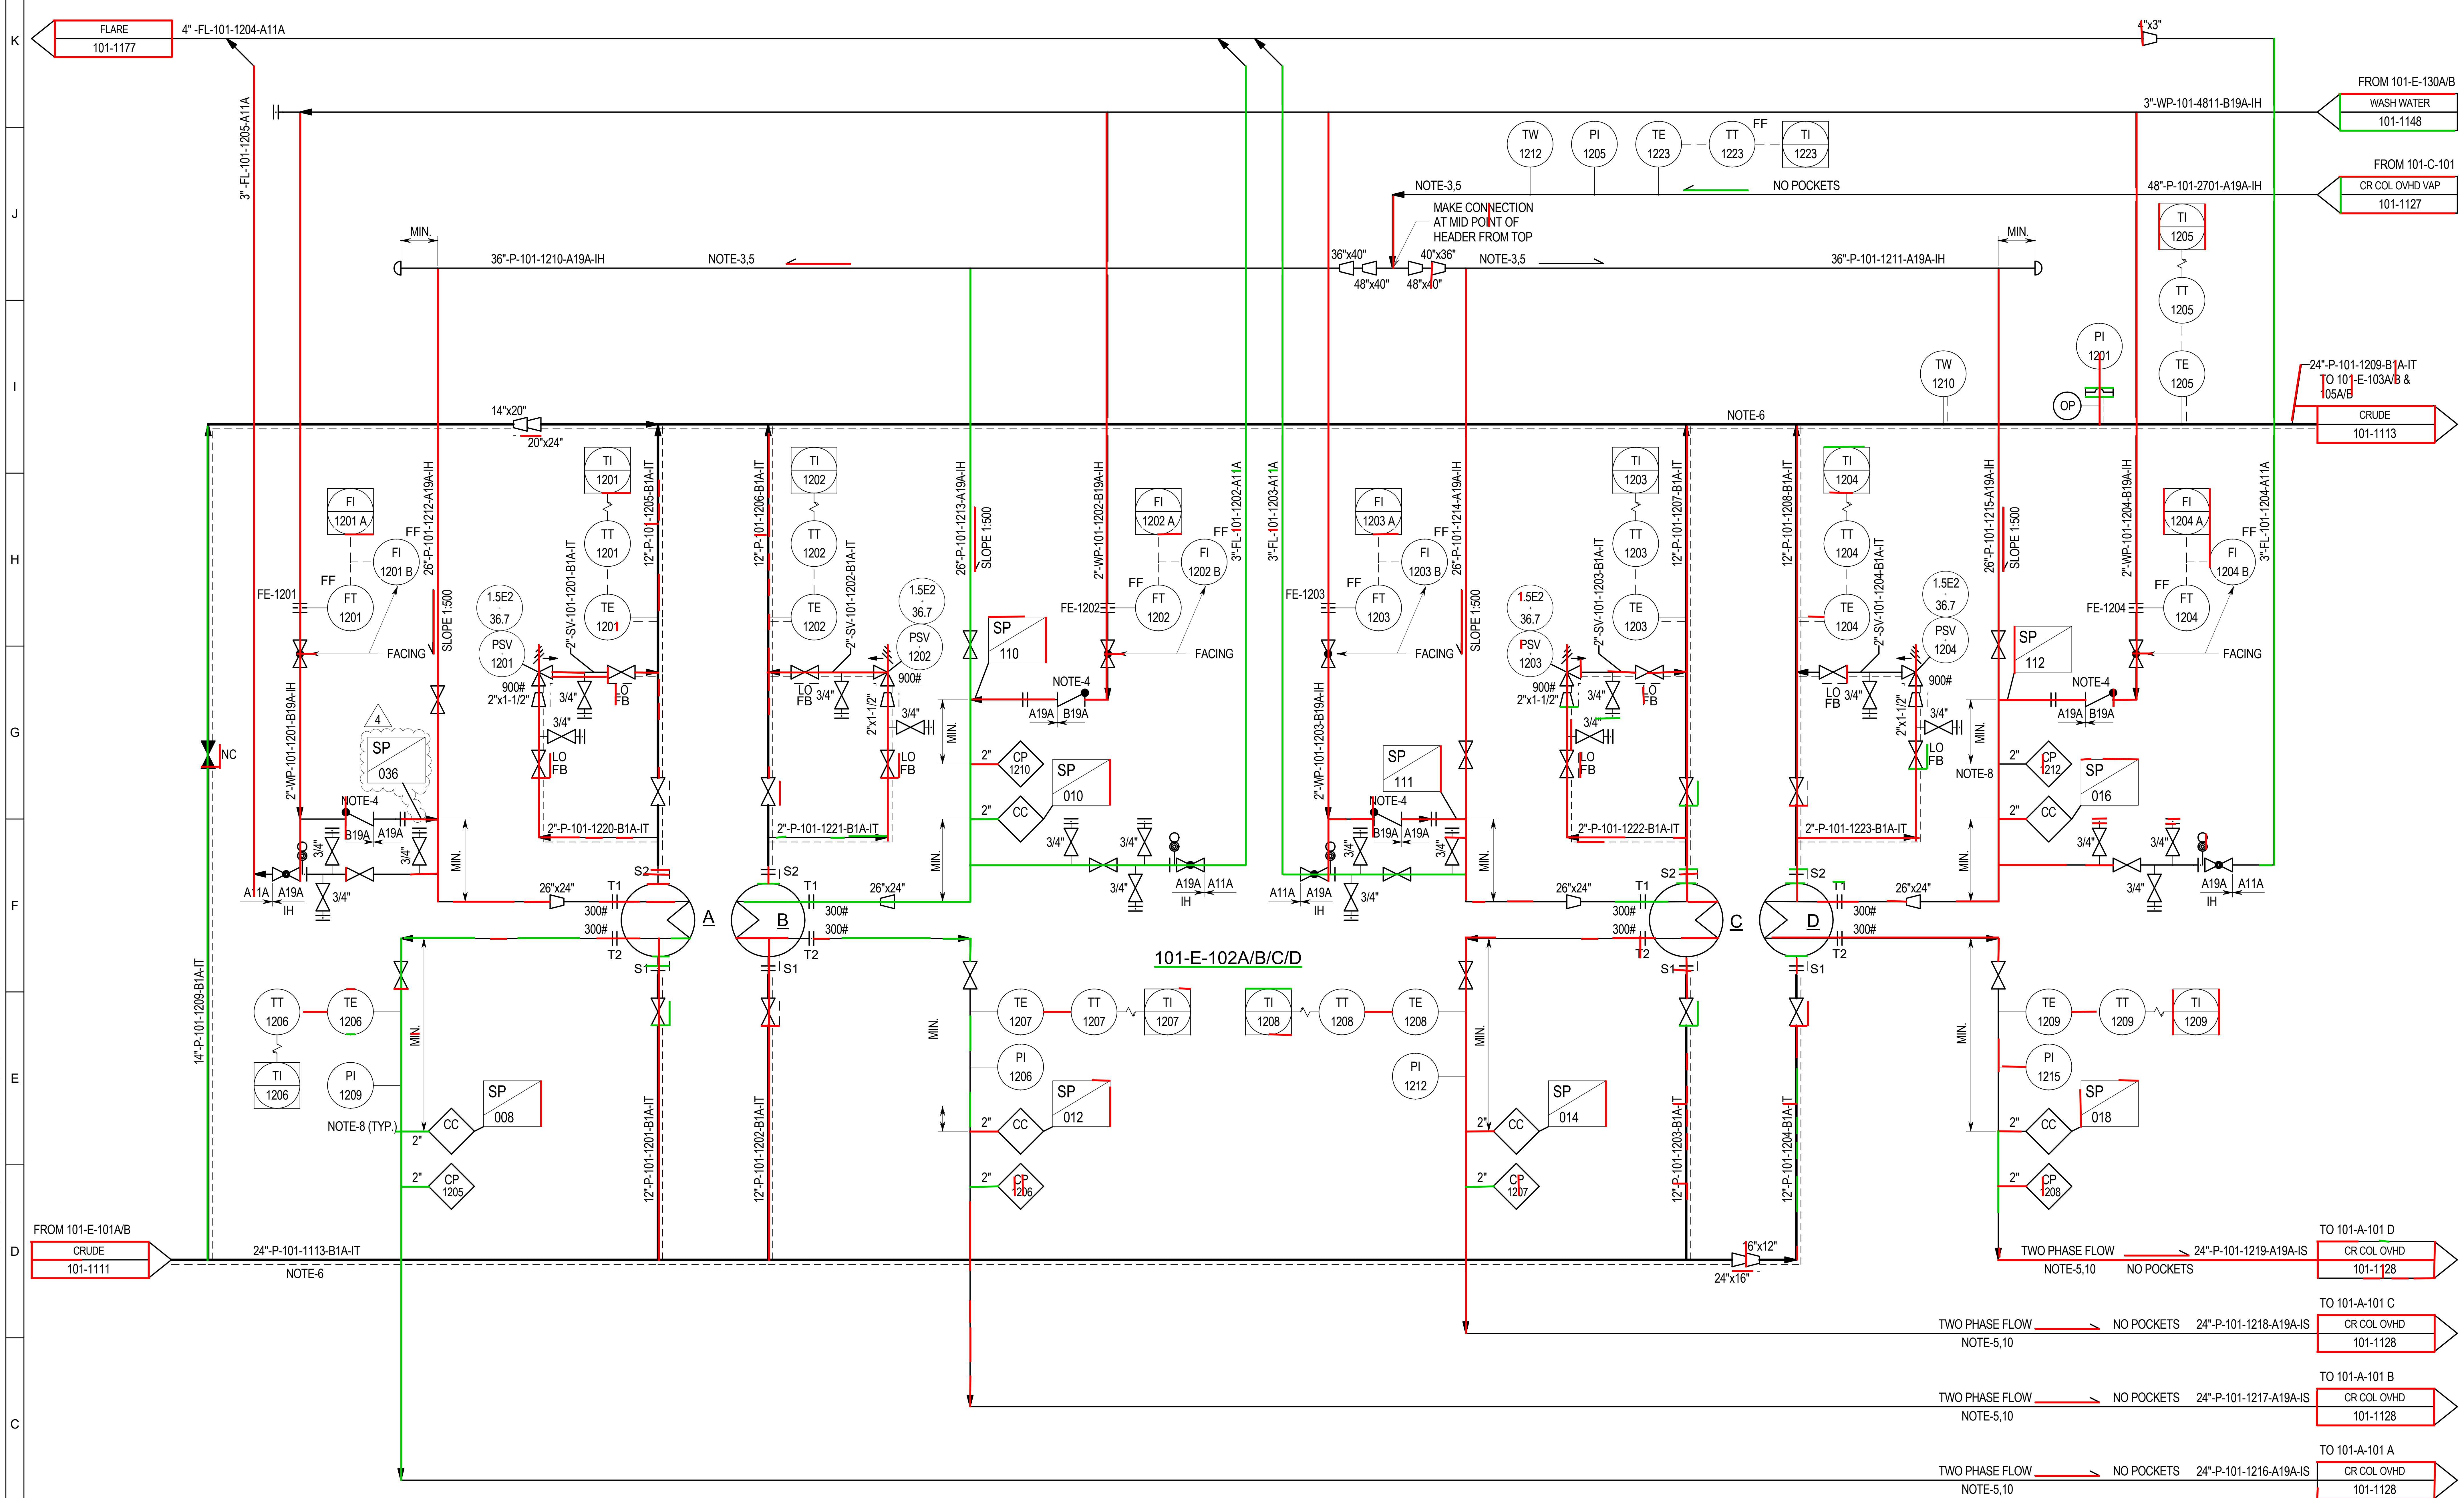

NOTES: -

1. FOR LEGEND SYMBOL AND GENERAL DETAILS, REFER P&ID NO. B068-79-41-00-1191/1192. (TPL DWG. NO. B224-CDU-TPL-000-1191/1192-SHT01/1192-SHT02).
   - FOR EXCHANGER DRAIN DETAILS REFER P&ID NO. B224-CDU-TPL-101-1246-SHT01 & B224-CDU-TPL-101-1246-SHT02.
   - FOR AIR COOLER DRAIN CONNECTION DETAILS REFER P&ID NO. B224-CDU-TPL-101-1247.
   - FOR PUMP DRAIN/VENT REFER P&ID NO.B224-CDU-TPL-101-1245-SHT01 & B224-CDU-TPL-101-1245-SHT02.
   - FOR FILTER DRAIN VENT DETAILS REFER P&ID NO. B224-CDU-TPL-101-1248.
   - FOR PUMP SEAL PLAN DETAIL REFER P&ID NO. B224-CDU-TPL-101-1184-SHT01, B224-CDU-TPL-101-1184-SHT02 & B224-CDU-TPL-101-1184-SHT03.
   - FOR CONTROL VALVE DRAIN VENT DETAILS REFER P&ID NO. B224-CDU-TPL-101-1243-SHT01 & B224-CDU-TPL-101-1243-SHT02.
   - FOR LEVEL INSTRUMENT DRAIN VENT DETAILS REFER P&ID NO. B224-CDU-TPL-101-1244-SHT01 & B224-CDU-TPL-101-1244-SHT02.
   - ALL INSTRUMENT TAG NUMBERS TO HAVE THE UNIT DESIGNATION PREFIX 101.
2. ALL DCS OPEN AND CLOSED LOOP INSTRUMENTS SHOWN IN P&ID WITH `FF' ARE FOUNDATION FIELD BUS DEVICES. FOR INSTRUMENTS FOR WHICH FIELD BUS DEVICES ARE NOT SHOWN/AVAILABLE, SMART TRANSMITTERS/SMART POSITIONERS SHALL BE USED.
3. SYMMETRICAL PIPING.
4. WASH WATER TO BE INJECTED WITH REVERSE FLOW, CONE SPRAY INJECTION NOZZLE, AS PER DETAIL SHOWN BELOW.

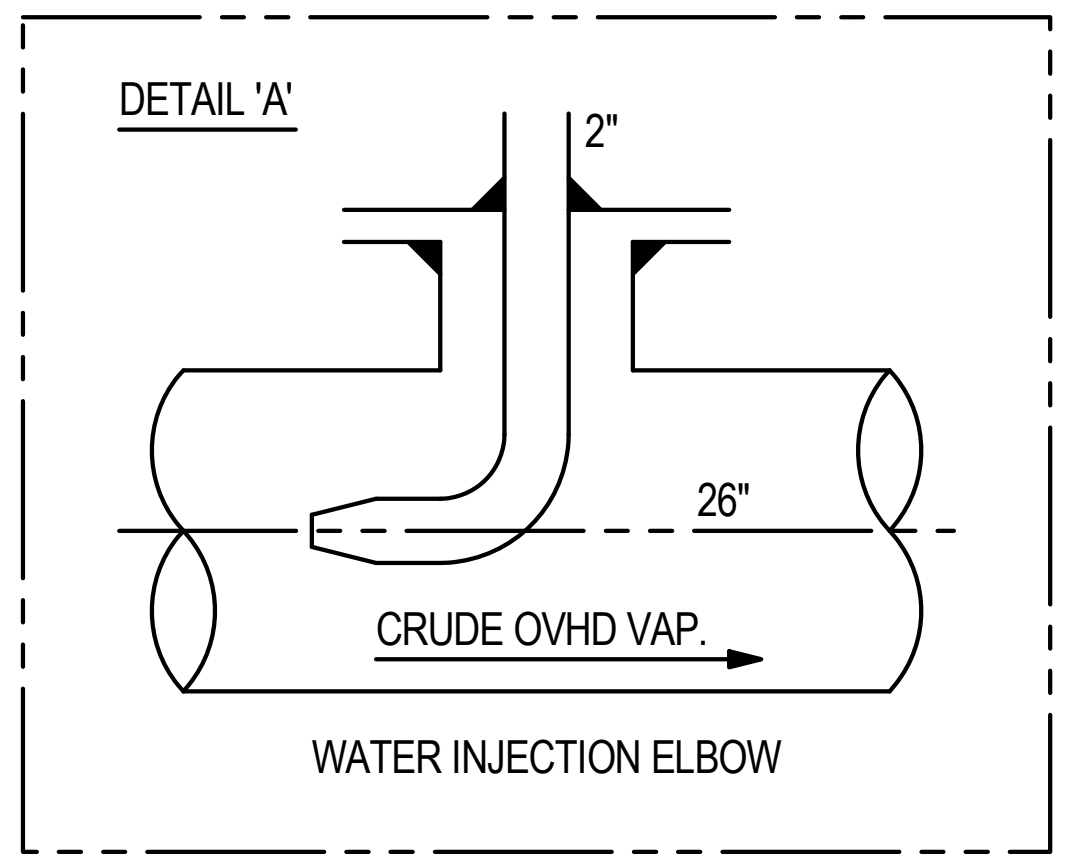

THE INJECTION NOZZLE TO BE INSERTED IN HORIZONTAL PORTION FOR PROPER MIXING

5. MAXIMUM ALLOWABLE PRESSURE DROP IN THE LINES IN THE CRUDE COLUMN OVHD CIRCUIT (I.E. FROM 101-C-101 TO 101-V-101 VIA 101-E-102A/B/C/D AND 101-A-101) IS 0.1 KG/CM2. ALL LINE SIZES IN THE CIRCUIT ARE CONFIRMED BASED ON FINAL ISOMETRICS.
6. CRUDE INLET AND OUTLET LINES TO BE ORIENTED SUCH THAT THE INLET AND OUTLET ARE DIAGONALLY OPPOSITE TO EACH OTHER AS SHOWN ON P&ID.
7. CORROSION MONITORING SYSTEM (CMS) SHALL BE DONE WITH CORROSION PROBE & CORROSION COUPON.
8. A MIN. OF 1 TO 1.5 M DISTANCE SHOULD BE KEPT BETWEEN CP AND CC. FOR MAINTENANCE PURPOSE.
9. CHEMICAL INJECTION SHALL BE DOSED THROUGH INJECTION TUBE WITH T-TYPE ACCESS FITTINGS.
10. LINE TO BE PROPERLY SUPPORTED.

संख्या No.	संशोधन REVISIONS	तिथि DATE	ड्रॉन DRN	द्वारा BY	जॉच CKD	अनुमोदित APPD
4	ISSUED FOR CONSTRUCTION	10.03.22	SC	MW	VD	PV
3	ISSUED FOR CONSTRUCTION	30.09.21	SC	MW	VD	PV
2	ISSUED FOR ENGG/ DESIGN WITH HAZOP RECOMMENDATION	02.09.20	RMB	KG	RS	SG
1	ISSUED FOR ENGINEERING/DESIGN	11.08.20	JO	KG	RS	SG
0	ISSUED FOR REVIEW	13.03.20	LC	KG	RS	SG

MW

DETAILED ENGINEERING CONTRACTOR: FLUOR®
FLUOR DANIEL INTERNATIONAL
(MALAYSIA) SDN BHD

LSTK CONTRACTOR: TATA
TATA PROJECTS LIMITED
MUMBAI

संख्या No.	तिथि DATE	संशोधन REVISIONS	ड्रॉन DRN	द्वारा BY	जॉच CKD	अनुमोदित APPD
1	14.12.18	REVISED AS MARKED	PP	UA/AT	GN	AM
0	15.11.18	ISSUED FOR PACKAGE	S.K.L	UA/AT	GN	AM

PMC :
इंजिनियर्स इंडिया लिमिटेड
(भारत सरकार का उपक्रम)
ENGINEERS
INDIA LIMITED
(A Govt. of India Undertaking)

OWNER
एचपीसीएल राजस्थान रिफाइनरी लिमिटेड
HPCL Rajasthan Refinery Limited
एच पी सी एल राजस्थान रिफाइनरी लिमिटेड
HPCL RAJASTHAN REFINERY LTD
RAJASTHAN REFINERY PROJECT

पाइपिंग एण्ड इंस्ट्रूमैन्टेशन डायाग्राम
PIPING AND INSTRUMENTATION DIAGRAM
CRUDE/VACUUM DISTILLATION UNIT
CRUDE PREHEAT TRAIN-1B

अनुमाप SCALE	कार्य संख्या JOB NO.	विभाग DEPT.	अनुभाग SECTN.	इकाई UNIT	आरेख संख्या DWG. No.	संशो REV.
	B068	79	41	101	1112	1

TPL DRAWING NO. टी पी एल आरेख संख्या: B224-CDU-TPL-101-1112 संशो REV 4

NOTICE: THIS DRAWING AND THE DESIGN IT COVERS ARE THE PROPERTY OF ENGINEERS INDIA LIMITED. THEY ARE MERELY LOANED AND ON THE BORROWER'S EXPRESS AGREEMENT THAT THEY WILL NOT BE REPRODUCED, COPIED, LOANED, EXHIBITED, NOR USED EXCEPT IN THE LIMITED WAY AND PRIVATE USE PERMITTED BY ANY WRITTEN CONSENT GIVEN BY LENDER TO THE BORROWER.

SIZE A1 (594X841)

DOCUMENT REVIEW DETAILS

☑ 1 No Comments. **Doc. B224-CDU-TPL-101-1112 Rev. 4**
☐ 2 Proceed with manufacture / fabrication as per the commented document. Revised document required.
☐ 3 Document does not conform to basic requirements as marked. Resubmit for review.
☐ R Retained for Records. ☐ V Void.

Signature with Date **24-AUG-2022**
Name of Reviewer **UMER AFZAL (C889)**
Page No. **1 of 2**

Refer file provided against B224-CDU-TPL-101-1111

DOCUMENT REVIEW DETAILS

☑ 1 No Comments. **Doc. B224-CDU-TPL-101-1112 Rev. 4**

☐ 2 Proceed with manufacture / fabrication as per the commented document. Revised document required.

☐ 3 Document does not conform to basic requirements as marked. Resubmit for review.

☐ R Retained for Records. ☐ V Void.

Signature with Date **24-AUG-2022**

Name of Reviewer **UMER AFZAL (C889)**

Page No. **2 of 2**