


Lab17 - Session 01

Δ_{47} repeatability = 29.2 ppm

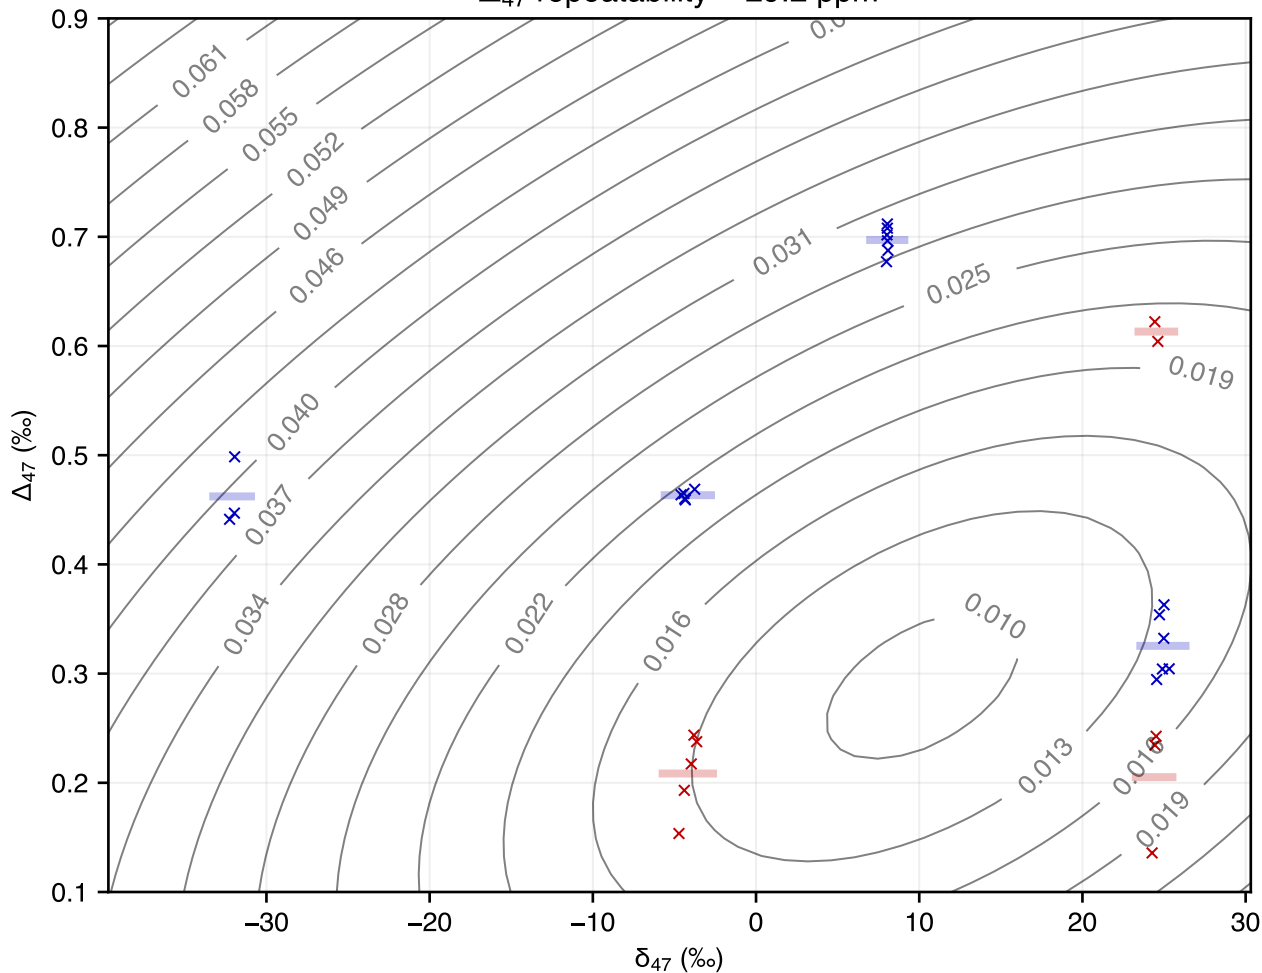

All analyses (cross markers) in Session 01 of Lab 17.
 Anchors are plotted in red and unknown in blue.
 Average Δ_{47} values for each sample are plotted as thick blue and red lines.
 Standardization errors are mapped as gray contours.