


Lab24 - Session 01
 Δ_{47} repeatability = 9.9 ppm

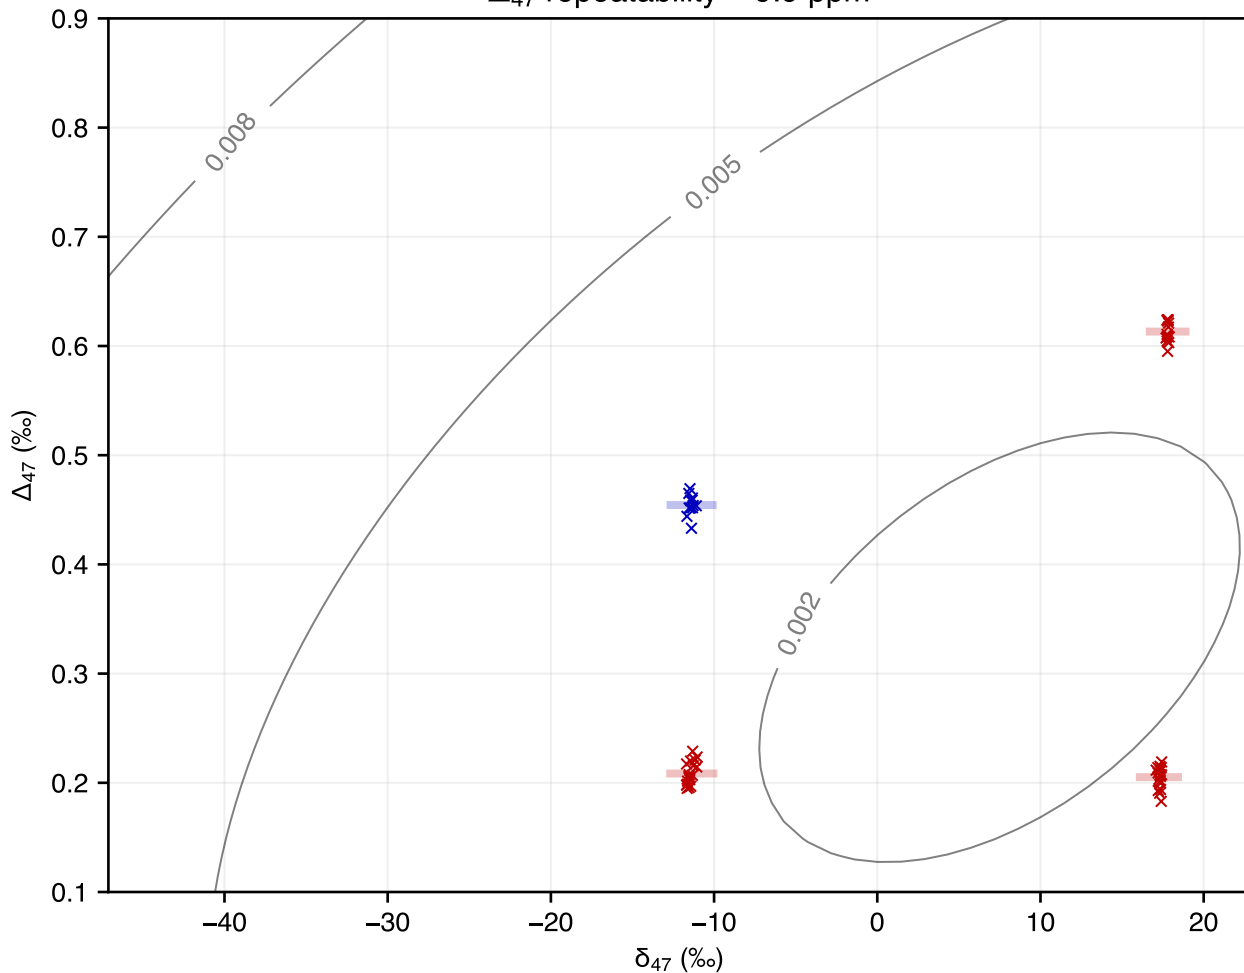

All analyses (cross markers) in Session 01 of Lab 24.
 Anchors are plotted in red and unknown in blue.
 Average Δ_{47} values for each sample are plotted as thick blue and red lines.
 Standardization errors are mapped as gray contours.