


Lab14 (RMSWD = 1.245)

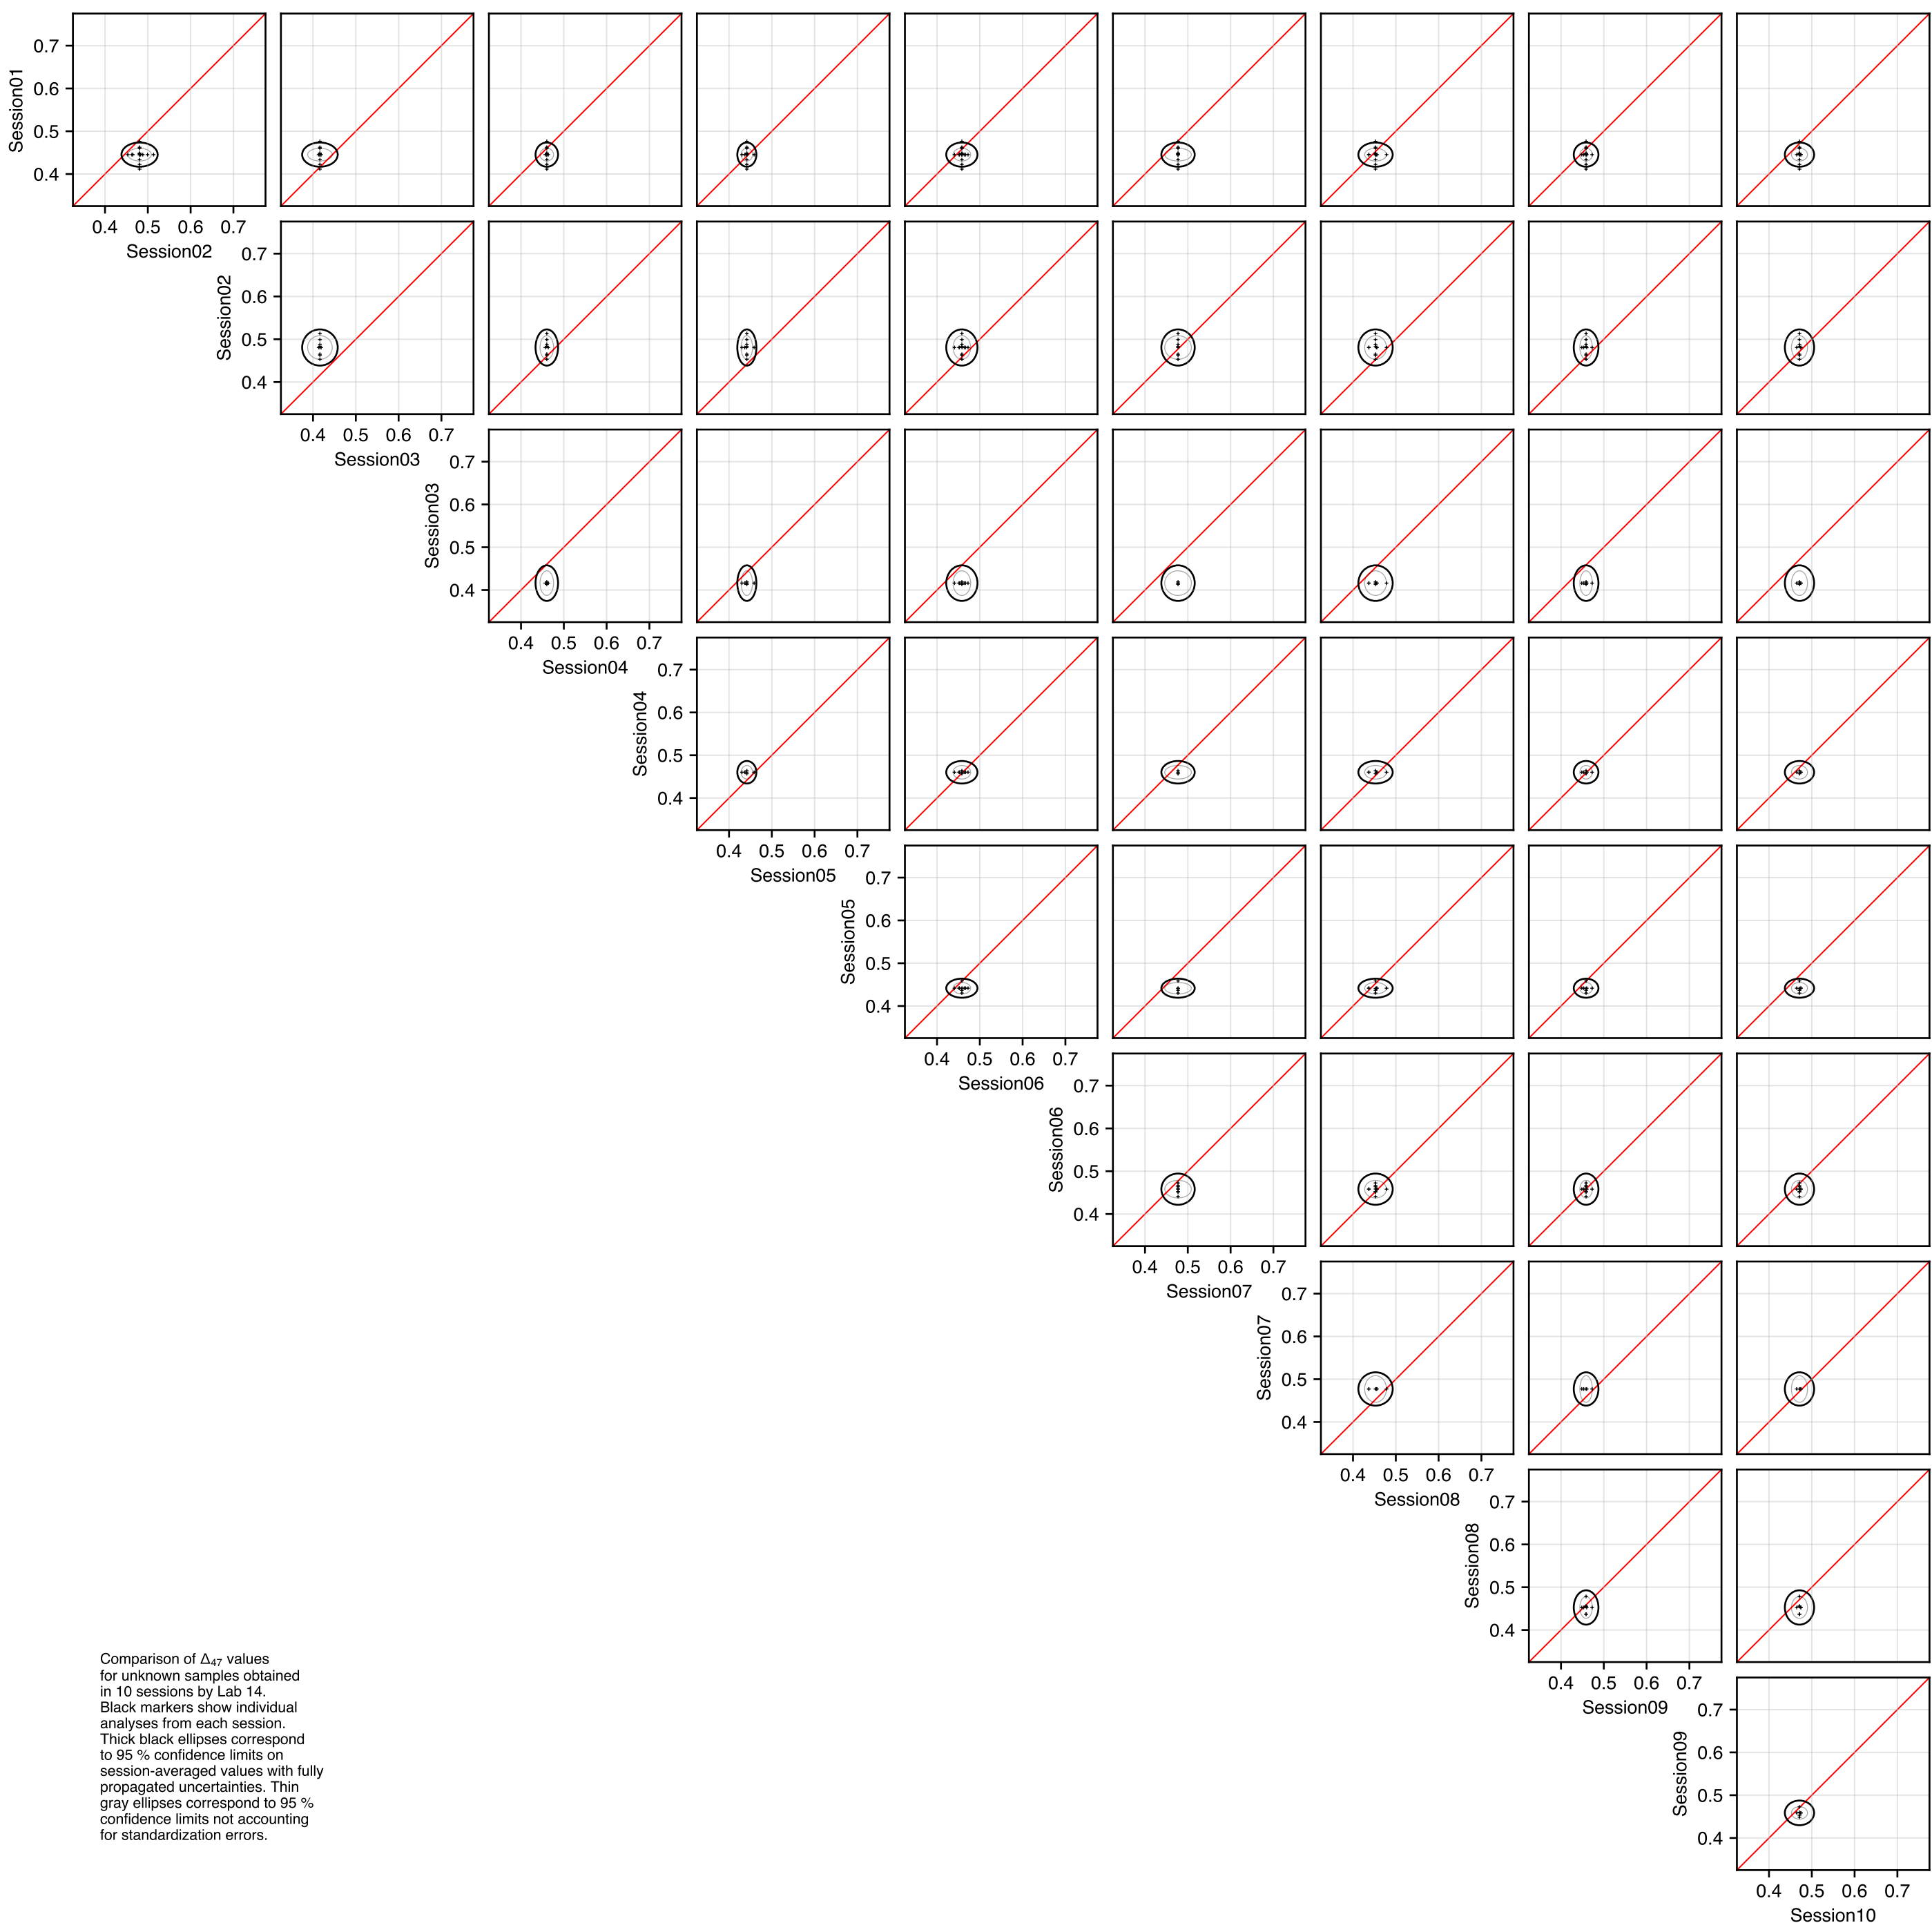

Comparison of  $\Delta_{47}$  values  
for unknown samples obtained  
in 10 sessions by Lab 14.  
Black markers show individual  
analyses from each session.  
Thick black ellipses correspond  
to 95 % confidence limits on  
session-averaged values with fully  
propagated uncertainties. Thin  
gray ellipses correspond to 95 %  
confidence limits not accounting  
for standardization errors.