

Powered by Esri

Note: All dashboards and maps presented on this page are provisional and subject to revision.

If viewing on a mobile device, scroll down on each dashboard to view the full list of parameters.


The figure displays eight water quality gauges arranged in a 2x4 grid. Each gauge features a blue needle, a scale, a central value, a status (NORMAL), and a timestamp.

Parameter	Value	Status	Timestamp
CO2	116.73	NORMAL	2025-11-12 06:50:16
Temperature	58.613 F	NORMAL	2026-01-06 06:46:04
Turbidity	69.25 NTU	NORMAL	2026-01-06 06:46:04
Specific Conductivity	1298.98	NORMAL	2026-01-06 06:46:04
Salinity	0.65 ppt	NORMAL	2026-01-06 06:46:04
DO Concentration	11.01 mg/L	NORMAL	2026-01-06 06:46:04
DO Concentration (% Sat)	109.06 %	NORMAL	2026-01-06 06:46:04
pH	8.35	NORMAL	2026-01-06 06:46:04

The figure displays eight water quality parameters in a 2x4 grid. Each parameter is represented by a semi-circular gauge chart with a white needle, a scale, a central value, a status label, and a timestamp.

Parameter	Value	Status	Timestamp
CO2	564.37	NORMAL	2025-11-12 07:20:38
Temperature	60.105 F	NORMAL	2026-01-06 06:45:20
Turbidity	13 NTU	NORMAL	2026-01-06 06:45:20
Specific Conductivity	1321.6	NORMAL	2026-01-06 06:45:20
Salinity	0.66 ppt	NORMAL	2026-01-06 06:45:20
DO Concentration	11.05 mg/L	NORMAL	2026-01-06 06:45:20
DO Concentration (% Sat)	111.59 %	NORMAL	2026-01-06 06:45:20
pH	6.96	NORMAL	2026-01-06 06:45:20

## Blind Buoy Weather Station Data

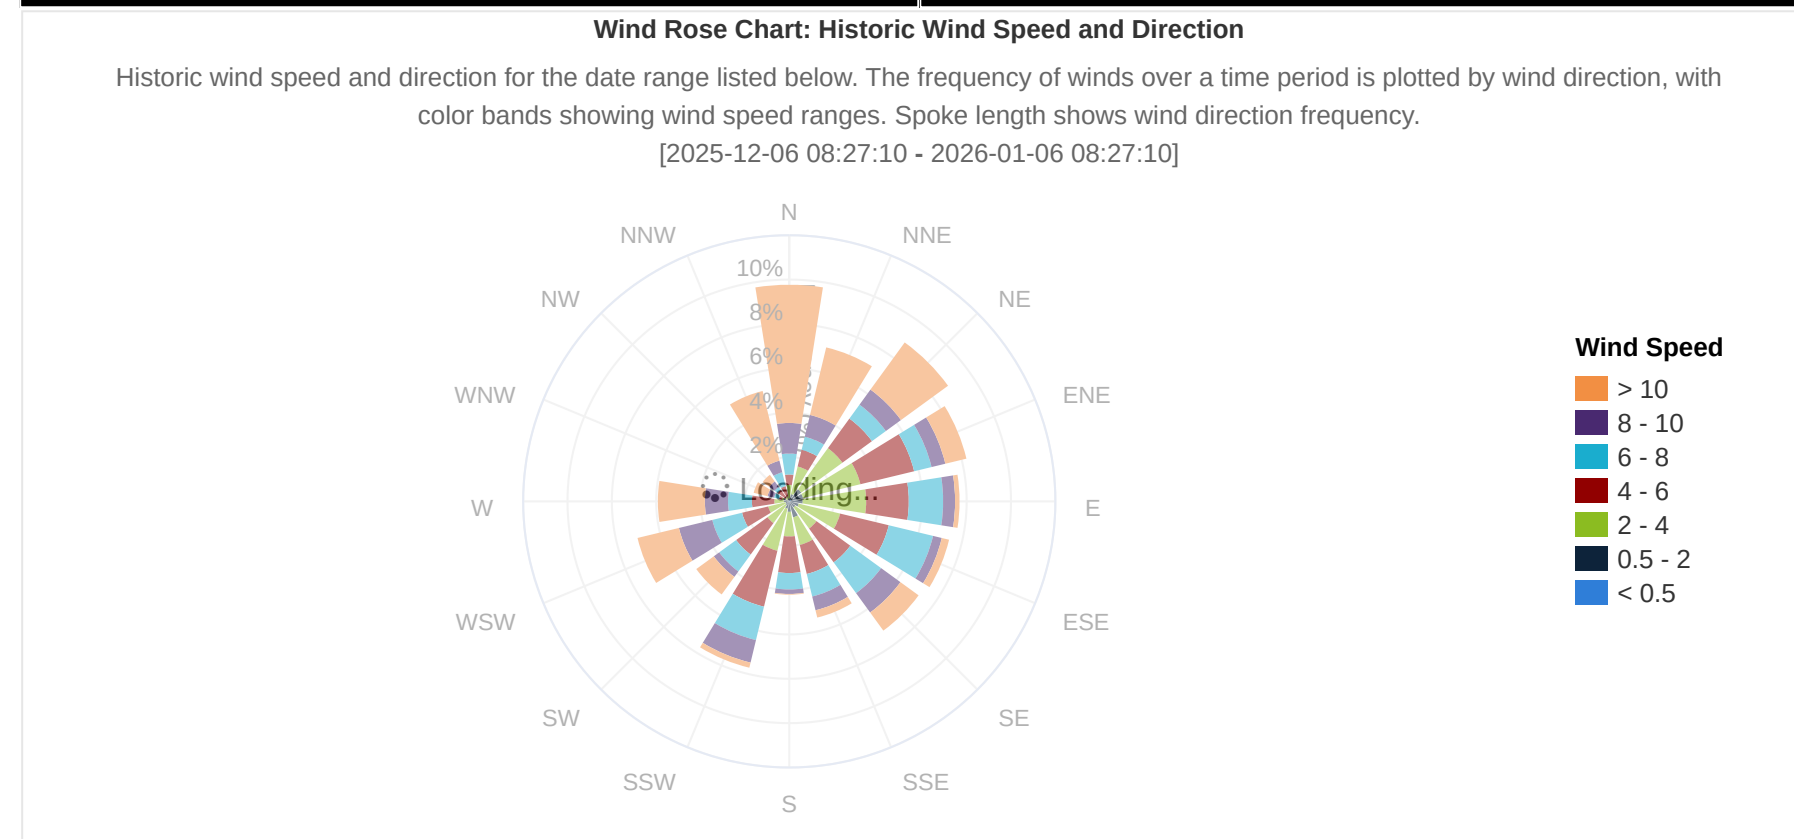

**eagle.io**

Parameter	Value	Status	Timestamp
CO2	0	NORMAL	2025-10-03 19:50:14
Temperature	-1767.82 F	ERROR	2026-01-06 07:15:00
Turbidity	-999.9 NTU	NORMAL	2026-01-06 07:15:00
Specific Conductivity	-999.9	NORMAL	2026-01-06 07:15:00
Salinity	-999.9 ppt	ERROR	2026-01-06 07:15:00
DO Concentration	-999.9 mg/L	NORMAL	2026-01-06 07:15:00
DO Concentration (% Sat)	-999.9 %	NORMAL	2026-01-06 07:15:00
pH	-999.9	NORMAL	2026-01-06 07:15:00

## Tickfaw Buoy Water Quality Data




CO2



2025-11-12 01:20:18

Temperature

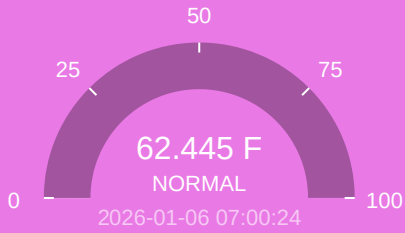


2026-01-06 07:00:24

Turbidity



2026-01-06 07:00:24

Specific Conductivity

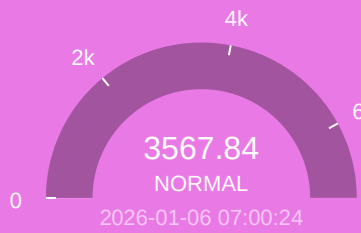

2026-01-06 07:00:24

Salinity




2026-01-06 07:00:24

DO Concentration




2026-01-06 07:00:24

DO Concentration (% Sat)

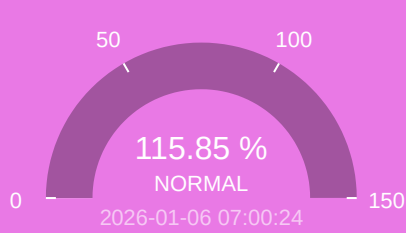

2026-01-06 07:00:24

pH

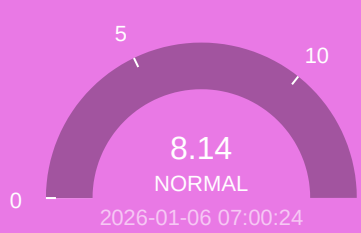

2026-01-06 07:00:24