

Grid-Aware Placement of Datacenters and Wind Farms

Abstract—Due to the growing concern for huge energy consumption, Internet service providers tend to build data centers with renewable energy support to reduce cost and the carbon footprint. Prior work about “green” data center placement issues didn’t consider the potential impact on the electricity grid by penetrating large loads and intermittent power generations from renewable resources. In this paper, we propose a holistic framework which incorporates together the cost of data centers, renewable energy power plants and the utility grid. By considering various factors such as land, building, hardware costs as well as the losses on the grid network, we try to solve an optimization problem to minimize the overall cost for both service providers and utility grid operators. **XW: As discussed, we are assuming that the IT service provider want to build data centers and also renewable power plants to support these datacenters.** Our results show that losses of the regional grid would have remarkable effect on the decision of selecting locations for data centers and renewable energy power plants. Furthermore, co-location choices for distribution load generation sources and loads as datacenters are not always better, even comparing only the losses on the grid, which is quite not intuitive. Our work gives a way to seek for optimal locations in the capacity planning stage and also shows the importance for cloud service companies and grid operators to collaborate for reduction of overall cost.

I. INTRODUCTION

As reported recently, the energy consumption of datacenters keeps growing while more and more enterprises and organizations are building their own datacenters [1], [2]. The increasing speed of the datacenter energy consumption is approximately 10-12% per year recently [3]. The carbon emission and environment pollution issues attract insights of seeking for clean energy resources. Many IT companies such as Google [4], Apple [5], and McGrawHill [6] are trying to build their datacenters together with renewable energy power plants.

Usually, generation of sustainable energy like solar and wind will be closely related to the weather condition at certain locations. As far as we know, there might be different choices for building the datacenter and the power plants. Both on-site and off-site generation are possible approaches [7]. By grid-centric approaches, the renewable energy will be generated at locations with sufficient renewable sources and pumped into the grid. On the other hand, co-location and self-generation approaches sit the datacenter and the power plant at the same location to facilitate management and avoid long-distance losses. Since it seems no approach is perfect, we argue that companies essentially expect benefits from the investments by building up datacenters and green power plants. However, since the renewable energy generation is mostly intermittent and sometimes might bring great penetration current into the electricity grid, the capacity should be carefully planned and will be limited from the perspective of grid operators. For

example, some tiny failures may make an area of grid system completely out of power [8].

Since datacenters are becoming quite large loads for the electricity grid, they are supposed to have a significant impact on the operation of power grid [9]. Large datacenter loads might increase the grid load and also lead to significant load variability of the electricity system. Especially, the emergence of the renewable energy sources with intermittent nature brings fluctuations onto the electricity networks. Furthermore, grid losses are one of the largest expenses for the power system operators [10]. EIA (U.S. Energy Information Administration) [11] has estimated that the electricity transmission and distribution losses all over the U.S. is about 6% of the electricity that is transmitted and distributed each year (averaged from 1990 to 2012). Thus, reduction of these losses for the grid can greatly affect the total operational costs.

In this case, companies who want to build datacenters with either on-site or off-site renewable energy plants have to get the permission from the grid operators first in order to reduce the unexpected influence to the grid operation. Since the grid losses will also finally turn into expenses for end-users, service providers may want to collaborate with grid operators to minimize the overall cost when planning locations and capacity for the datacenters. In the current literature, datacenter placement issues have been mentioned in some prior work [12]–[15], and there are also some research focused on the capacity planning of green datacenters [16], [17]. Nevertheless, these work hasn’t considered the impact of datacenter placement on the grid itself, which might also lead to comparable costs as other costs for datacenters.

In this paper, we attempt to set up a different point of view, by combining the consideration for cloud service providers and energy companies together and aiming at the minimization of the overall cost for both. First, we investigate the impact of datacenter placement and its importance to the grid by studying a region of grid network. We pay special attention to the datacenter size, datacenter locations and the variation of renewable power generations. Second, we formulate the optimization framework, which incorporates the costs of datacenters, renewable power plants and power grid into one objective. We also try to solve it under necessary constraints by using several different approaches. Then we conduct a case study in the New England area of the United States, by sitting and provisioning datacenters and power plants at different locations, with the purpose of minimizing the overall cost. Results show that grid losses can have remarkable impact on the decision of selecting best locations for green datacenters. Furthermore, the co-location choices by sitting the datacenter and green plants together don’t show advantages despite of the reduced line cost and distribution cost, which is not that

intuitive as prior work thought.

Contributions of this paper. The main contributions of this paper includes: (i) it quantifies the potential impact of data-center placement on the bus network of power grid, and (ii) it proposes a framework for smart placement of both datacenters and renewable energy plants in the power grid network. (iii) it formulates an optimization problem and gives a solution approach to find out good choices for siting and provisioning datacenters when considering grid costs.

To the extent of our knowledge, there is no previous work considering the jointly placement issues of datacenters and green power plants while caring about the grid operational costs together. The remainder of the paper is organized as follows. Section II first quantifies the potential of datacenters together with wind farms by placing them into different buses of the grid network system. In Section III, we describe the optimization framework in detail, showing the integration of various parameters of the entire problem. Section IV evaluates the costs and illustrates breakdown of the total cost by different kinds of strategies. In Section V, we present some prior work related to this paper. Finally, the conclusion is given in Section VI.

II. METRIC CHOICE: DATACENTER PLACEMENTS IN RENEWABLE POWER GRID

Planning optimal datacenter location, requires comprehensive metric definition. Most of the studies carried out so far neglect the impact of renewable powered datacenters on the transmission grid. When the penetration of renewable powered datacenters was small, the impact of these on the transmission grid was insignificant. However, with several large datacenter companies opting for renewable energy source it becomes imperative to study their impact on the transmission grid.

A. Impact of datacenter on renewable power grid

We will show that choosing optimal datacenter location within the renewable power grid could be beneficial to both the grid operators and the datacenter owners. Specifically datacenters located at strategic places in the grid could help minimize i) overloading of transmission lines; ii) grid voltage variations outside the acceptable range iii) system losses. We will demonstrate this by considering a real world system, i.e., the New England Independent System Operator (ISO) spanning most of North Eastern region of United States and some parts of Canada.

1) *Overloading of transmission lines:* The transmission lines (referred as branch hereafter in the paper) are used to transport power from the large generators to the load. The power carrying capacity is limited to protect the line from over heating, mainly due to the line resistive losses i.e., $I^2 R$, where I is the current flowing through the branch and R is the resistance of the branch.

A transmission line has typically two ratings: short term and long term capacity rating. During certain wind and system load (including datacenter load) conditions, some of the transmission lines could get overloaded. If this happens during the normal operation of the electric grid then one of the following will be done: i) if an electronic power flow controller

is available then it is used to control the power flow through the overloaded line; or ii) in extreme situations, the overloaded line is disconnected which may result in power supply interruption to the loads.

If major transmission lines are getting overloaded quite often annually then new lines are planned and built. This solution is very expensive and takes a long time (typically 7 to 10 years). The need for such expensive grid retrofits may be minimized by planning the location of the datacenter.

2) *Voltage variation in electric grid:* The voltage magnitude varies in the electric grid and needs to be maintained within a narrow range (for example $\pm 5\%$ of nominal) so that there is no damage caused to the sensitive electronic loads. However, sometimes/days the change in renewable power output could cause the voltage to vary beyond the acceptable limits. Such over/under voltage problems can be mitigated by appropriately locating the datacenter load.

3) *System losses:* Historically, the electric grid was designed to have large central generating stations that are located far away from the load centers. The power from these central sources would be transmitted to the datacenter over transmission lines. While designing such a grid, the generator location and the transmission line voltage level as well as the path would be optimized to minimize the line losses. However, today with renewable power being distributed the scenario has changed, the generation sources are distributed and they may be located near the load centers. In order to transfer power from these renewable source we still use the existing transmission lines that were planned and built about 50 years ago or earlier. This may result in higher line losses and sub-optimal power transmission between generation sources and loads. Since we cannot re-design the entire electric grid to minimize line losses, we need to leverage the flexibility we have in locating new loads i.e., datacenters in our specific case.

B. Simulation study

In order to study the impact of datacenter location in a renewable power grid we consider the New England ISO transmission network. We choose this system due to the following reasons:

- **Wind power expansion in New England:** The system studies carried by the New England ISO state that in this region there is a potential of integrating up to 12 Giga-Watts of wind power. Given this enormous interest to install new wind farms, this region may have a great potential in future to accommodate datacenters powered by wind farms.
- **Transmission network upgrades:** A study carried out by the New England ISO showed that they could potentially integrate wind resources to meet up to 24% of the region's total annual electric energy needs in 2020 if the system includes transmission upgrades. If these transmission upgrades can be limited then the development of new wind farms becomes more economical.
- **Positive impacts of wind power in New England ISO:** Introducing large amounts of low-marginal-cost wind generation tended to depress the spot price and reduce

the price differential for bulk power between day and night. Also the study results demonstrated that there was only a relatively small increase in the use of existing pumped-storage hydro power for large wind penetrations, largely because the flexible natural-gas-fired generation fleet provided most of the system balancing.

We will show in our study, that within the New England ISO, the wind power penetration can be increased much more cost effectively by strategically locating the datacenter. Intuitively, it may appear that co-locating datacenter loads and wind farms would solve the problem of building new transmission lines, limit the voltage variation and also minimize losses. However, our study shows that this is not indeed true and co-locating wind farm and datacenter may not be the optimal solution always.

1) Model of the New England renewable power datacenter:

Before we carry out the case studies, we will describe the approximations we made and the models we used for each sub-system we considered in our study.

- New England transmission system model:

For our study we considered a widely used [18] model of the New England transmission network. A single line diagram of this test system is shown in Figure 1. As shown in the figure, the model lumps all the generators, loads and transmission lines in the New England ISO region to 10 generators, 19 loads and 46 lines and transformers. The 10 generator buses are numbered from 30-39 in Figure 1. Specifically, bus 39 represents the aggregation of a large number of generators interconnected to rest of US/Canada.

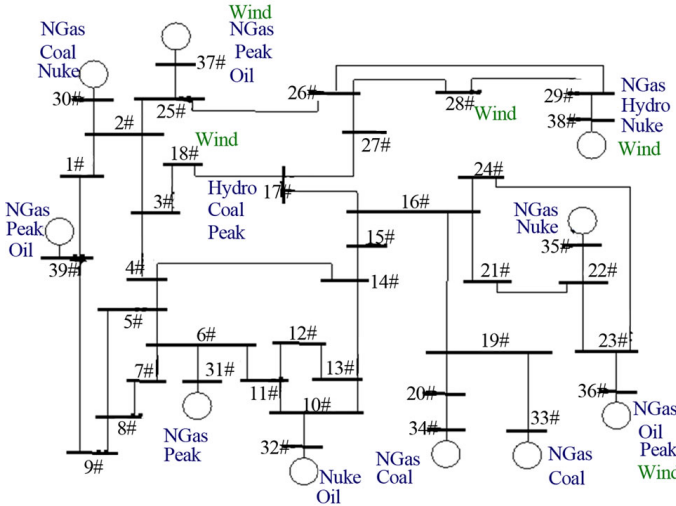


Fig. 1: New England 39 bus test system

- Datacenter model:

Based on the geographical mapping we aggregate all the datacenters in the New England ISO region into six datacenters, each datacenter for one state. In order to estimate the size of an "aggregated" datacenter in a certain state, we use the following equation:

$$L_i = \frac{n_i * 9.8GW}{1278} \quad (1)$$

where L_i is the aggregated load of the i th state, n_i is the number of datacenters reported in that state, 9.8GW is the upper bound of total electricity used by US datacenters in 2010, according to the report [2], and 1278 is the number of datacenters in US collected and reported in [19]. However, according to [2], for the summarized load of datacenters, there is an increase of 56% from 2005-2010. Hence, we are assuming the increasing percentage from 2010-2014 is $56\% * 0.8 = 45\%$, and after adjustment we are using $L'_i = 1.45L_i$ as the datacenter load for the target grid system.

The state wise aggregated datacenters are mapped to different buses according to their geographical locations, as seen from Table I. Note that the load size given in the table represents the total load of datacenters in the entire state.

TABLE I: Background datacenter load and location settings

DC No.	State	Number of DCs	Estimated size(MW)	Mapped Bus No.
DC1	Connecticut	12	133.43	6
DC2	Maine	3	33.36	29
DC3	Vermont	4	44.48	25
DC4	Rhode Island	3	33.36	20
DC5	New Hampshire	4	44.48	16
DC6	Massachusetts	27	300.21	4

- Wind farm model:

The wind farms connected to bus 18, 28, 36, 37 and 38 (Figure 1) are lumped models of several wind farms within a geographical region. The locations and capacity settings of the five wind farms are presented in Table II. We assume that each farm can be represented by 'n' identical wind turbines, where $n = \text{total farm rated capacity} / \text{individual wind turbine rating}$. This approximation does not change any of our results because we are interested in studying the global impact of wind farm powered datacenters on the electric grid. Also, since most of the wind turbines in this region are the GE 1.5MW machines, we consider the GE machine wind speed versus power characteristics [20]. The wind speed versus turbine output characteristics is commonly referred to as the power curve (Figure 2). From Figure 2 we can see that the cut-in wind speed, i.e., the wind speed at which the turbine starts producing power, is 5m/s and the cut-off wind speed is 25m/s, beyond this the turbine will be shut down for safety reasons. The wind turbine produces rated output (1.5MW) between wind speeds of 13-25m/s.

C. Case study

We have used the above described model and carried out the following case studies to assess the impact of datacenter location on the renewable power grid.

- Case 1: Existing New England system

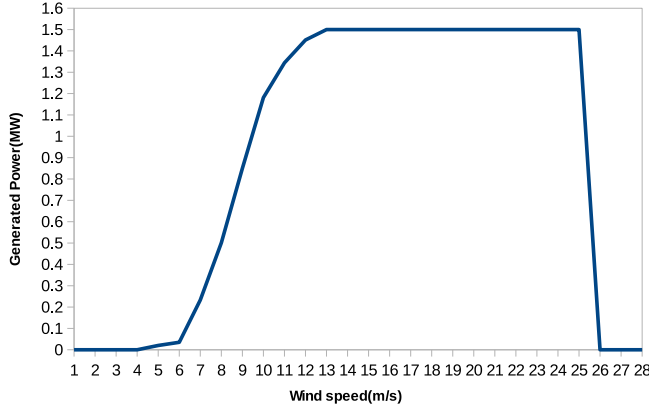


Fig. 2: Power curve of the GE 1.5MW wind turbine

TABLE II: Wind farm settings

WF No.	Bus No.	State	Capacity(MW)
WF1	18	XW: ?	100
WF2	28	XW: ?	90
WF3	36	Vermont	90
WF4	37	Maine	90
WF5	30	Massachusetts(XW: ?)	90

- Case 2: New England system with one additional datacenter (co-located with a wind farm)
- Case 3: New England system with one additional datacenter (located away from the wind farm)

For assessing the impact, we use the three metrics described earlier (section II-A) and calculate the system losses, power flows through the transmission lines and the bus voltages. The system losses, line flows and the bus voltages are calculated by solving the power flow or loadflow equations. The loadflow equations mathematically model the power balance (i.e., net load + losses = total generation in the electric grid). Within an electric grid the power can be easily measured at the loads and at generators. Also, some generators have the capability to regulate the voltage at a bus at a constant preset reference value. The power flow equations are used to calculate the bus voltages (magnitude and angle), for a given network and a set of load and generation powers. The loadflow equation for a generic n bus network with k branches is given below.

$$P_i = \sum_{j=1}^n (|Y_{ij}| |V_i| |V_j| \cos(\theta_{ij} + \delta_j - \delta_i)) \quad (2)$$

$$Q_i = -\sum_{j=1}^n (|Y_{ij}| |V_i| |V_j| \sin(\theta_{ij} + \delta_j - \delta_i)) \quad (3)$$

where P_i and Q_i are real and reactive powers at the i^{th} bus; $|V_i| \angle \delta_i$ is the voltage magnitude and angle at the i^{th} bus; $|Y_{ij}| \angle \theta_{ij}$ is the admittance of the branch between i^{th} and j^{th} bus. For a given power P_i and Q_i at the i^{th} load bus, the above powerflow equations are used to solve for the voltage magnitude and angle at the i^{th} bus. Since the above equations, i.e., real and reactive powers are non-linear function of voltage they are solved iteratively using Newton Raphson method. Once the bus voltages are calculated the line flows and system losses are computed.

D. Results and discussion

Here, we show the simulation results of the three cases and give some discussion about them. First, the total system losses are compared over the three cases under the condition of three wind speed settings, as shown in Figure 3. The background load of the electricity grid is set to normal (6254MW in total, summarized over all the buses), as described previously. Three categories of wind speed settings are: LOW (4-6m/s), MEDIUM (7-11m/s), and HIGH (>11m/s). The size of the additional datacenter in Case 2&3 is set to 200MW. Specifically, for Case 2 the datacenter is located at bus 18 (co-located with wind farm 1) and for Case 3 the datacenter is located at bus 10 (away from all wind farms).

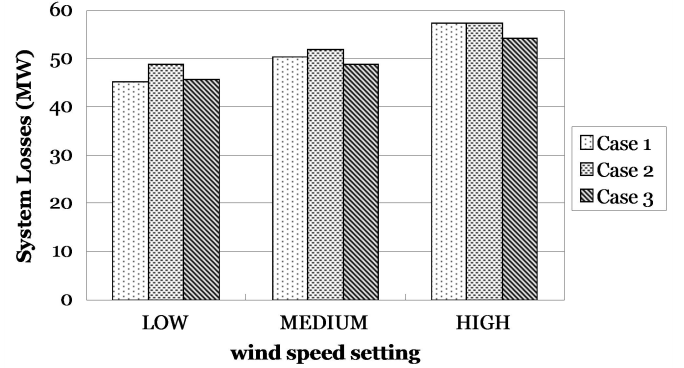


Fig. 3: Results of system losses

By comparing the values of system losses from Figure 3, it can be observed that the co-location case (Case 2) could lead to more losses than Case 1 and Case 3. Take MEDIUM setting for example, the system losses of Case 3 is about 6% less than Case 2, which illustrates system loss can be reduced by placing the datacenter correctly and co-location is not necessarily the best choice.

Next, in order to investigate the impact of datacenter placement on line capacity violations and voltage violations, we change the scenario to peak system load (6885MW in total) and conduct the experiments again. Wind speed setting here is LOW. Evaluation results are illustrated in Table III, which shows that there is one overloaded branch from bus 4 to bus 5 in Case 2. This highlights that different placement choice of the additional datacenter can make some particular lines overloaded. During our experiments, although there are only a few cases where lines are overloaded, annually the number of times and how long these overloads could occur depends on the frequency and duration of occurrence of a particular wind speed and load condition. If it is too frequent or more persistent then the overloads could be a serious problem and might require building new transmission lines. According to [21], the estimated cost of building new transmission lines of 345kV voltage level is about \$2.5 Million/mile, which is very expensive with total costs in the billions of dollars. Hence, it's important to choose the right place for datacenters in order to mitigate line over-loading occurrences.

Furthermore, we investigate cases where voltage violations occur, as shown in Table IV. Here, the wind speed setting

TABLE III: Results of overloaded lines

Case No.	# of overloaded lines	List of overloaded lines
1	0	None
2	1	bus 4 - bus 5
3	0	None

is MEDIUM. For Case 2 the datacenter is located at bus 38 (co-located with wind farm 5), and for Case 3 the datacenter is located at bus 25 (away from wind farms). The acceptable voltage range of a bus is set to $[0.95p.u., 1.05p.u.]$. It can be observed under this condition, there is already voltage violation occurring with the original New England grid system. Co-locating the datacenter with a wind farm as Case 2 increases the number of violated buses. This result highlights that by placing the datacenter in an appropriate bus carefully might also mitigate voltage violations.

TABLE IV: Results of voltage violations

Case No.	# of violated buses	List of violated buses
1	1	bus25
2	4	bus25 bus26 bus28 bus29
3	0	None

Even though we have provided one set of results for a particular set of condition, we have simulated different wind speed and load conditions. We found that in general the system loss magnitude could change. However, in most cases we saw that co-location is not the optimal choice for minimum system loss. In Section III we will describe a method for determining the datacenter location that will correspond to minimal system loss annually and will cover all the wind speed and system load conditions.

III. FRAMEWORK FOR SMART PLACEMENT

Thu: I have not yet worked on these introductory paragraphs. Will change next to reflect Divya's comments. The previous section highlights that placing datacenters and wind farms has obvious impact on the grid transmission network system. Thus, when a service provider is looking for best locations to establish a network of green datacenters, the grid operational cost should also be included as one of the most important factors into consideration. Another observation is that co-location of the green datacenter and the green energy plant seems not always be the best choice. In this case, we try to study how to seek the best locations for both the datacenter and the green energy plant, which are designed to be connected to the same grid network.

By grid-aware placement, we attempt to efficiently select a set of locations for one or more datacenters to support a given amount of computational power, as well as one or more green power plants (e.g. solar, wind or others) to provide a given power capacity. The main goal is to minimize the overall cost for datacenters, green power plants and also the grid network operation. The next subsections defines some important parameters in the selection procedure. Then, the cost

model and the entire optimization problem will be formulated and described.

TABLE V: Framework parameters. l is a location, and t is a time period.

Symbol	Meaning	Unit
$dcCapacity$	desired power capacity for computing in DC	kW
$wfCapacity$	desired power production capacity of wind farm	kW
$pLand(l)$	land price at l	\$/m ²
$PUE(l, t)$	PUE at l during t	
$maxPUE(l)$	maximum PUE at l	
$dcArea$	land needed per kW of DC compute capacity	m ² /kW
$cLinePow(l)$	cost to layout power line from l to the closest power plant	\$
$cLineNet(l)$	cost to layout optical fiber from l to closest network backbone	\$
$pBuildDC(c)$	per kW price of building a datacenter with c power capacity	\$/kW
$serverPow$	server peak power demand	kW/serv
$switchPow$	switch peak power demand	kW/switch
$servsSwitch$	number of servers per switch	servs/switch
$pServer$	price of a server	\$/serv
$pSwitch$	price of a network switch	\$/switch
$pNBWServ$	cost of external network bandwidth per server	\$/serv-month
$pEnergy(l)$	grid electricity price at l	\$/kWh
$powNeed(t)$	avg computing power demand of DC during t	kW
$\beta(l, t)$	avg generation efficiency of wind energy at l during t	%
$wfArea$	land needed per kW wind power	\$/m ²
$pBuildWF$	per kW price of building a wind power plant	\$/kW
$revEnergy(l)$	revenue for selling wind energy to grid at l	\$/kWh
$transLoss(t)$	avg system transmission loss in grid during t	kW
$pTransLoss$	the price for system transmission losses per kWh	\$/kWh

A. Optimization Framework

Thu: Need to integrate this thought below. The problem is set up from the perspective of both IT company and the grid operator, who want to collaborate for building up green datacenters, with the purpose of minimizing the summarized cost including datacenter cost, green power plant cost and the grid cost.

Table V lists the set of parameters in our framework. Using these parameters, we define the optimization problem shown in Figure 4. The objective of this optimization problem is to minimize the total cost ($totalCost$) of building and operating a datacenter of a given size ($dcCapacity$) and a wind farm of a given size ($wfCapacity$). **XW:** In the program, wind farm size is not given but calculated based on the datacenter size and other location-dependent parameters. The datacenter and wind farm can each be placed at any location within a set of given locations. The total cost has three components, the cost of the datacenter ($dcCost$), the cost of the wind farm ($wfCost$), and the cost of losses in the transmission system ($transCost$).

1) *Datacenter:* The cost of the datacenter can be broken down into capital ($dcCAPEX$) and operational ($dcOPEX$) components. The capital costs are those investments made upfront and depreciated over the lifetime of the datacenter. These costs include the cost for buying land ($dcLandCost$), building the datacenter ($dcBuildCost$), and buying IT equipment ($dcITCost$). The cost of building the datacenter include datacenter construction cost as well as the costs of laying power and network lines to the datacenter. IT equipment includes servers and switches. Land price varies according to location ($pLand(d)$ for location d), whereas the other prices do

$$\begin{aligned}
totalCost &= dcCost + wfCost + transCost & (4) \\
dcCost &= dcCAPEX + dcOPEX & (5) \\
dcCAPEX &= dcLandCost + dcBuildCost + dcITCost & (6) \\
dcOPEX &= dcNetCost + dcEnergyCost & (7) \\
dcLandCost &= pLand(d) \cdot dcArea \cdot dcCapacity & (8) \\
dcBuildCost &= dcTotalPow \cdot pBuildDC(dcTotalPow) + cLinePow(d) + cLineNet(d) & (9) \\
dcTotalPow &= dcCapacity \cdot maxPUE(d) & (10) \\
dcITCost &= nServers \cdot pServer + nSwitches \cdot pSwitch & (11) \\
nServers &= dcCapacity / (serverPow + switchPow / servsSwitch) & (12) \\
nSwitches &= nServers / servsSwitch & (13) \\
dcNetCost &= nServers \cdot pNBWServ & (14) \\
dcEnergyCost &= \sum_{t \in T} |t| \cdot powNeed(t) \cdot PUE(d, t) \cdot pEnergy(d) & (15) \\
wfCost &= wfCAPEX - wfRev & (16) \\
wfCAPEX &= wfLandCost + wfBuildCost & (17) \\
wfLandCost &= pLand(w) \cdot wfArea \cdot wfCapacity & (18) \\
wfBuildCost &= pBuildWF \cdot wfCapacity + cLinePow(w) & (19) \\
wfRev &= revEnergy(w) \cdot \sum_{t \in T} |t| \cdot \beta(w, t) \cdot wfCapacity & (20) \\
transCost &= pTransLoss \cdot \sum_{t \in T} |t| \cdot transLoss(t) & (21) \\
& & (22)
\end{aligned}$$

Fig. 4: Optimization framework. The datacenter is placed at location d and the windfarm is placed at location w . The objective is to minimize $totalCost$ for a given time period T (divided into epochs denoted by t) and a set of possible locations for d and w . $|t|$ denotes the length of epoch t .

not to a first approximation. Of course, the total cost of laying the power ($cLinePow(d)$) and network ($cLineNet(d)$) lines depends on location, as the distances to the closest power plant and network backbone are location-dependent. The datacenter construction cost is typically estimated as a function of the maximum power to be consumed by the datacenter. This maximum power is that required by the maximum number of servers and network switches when running at 100% utilization times the maximum expected PUE of the datacenter. The PUE is computed by dividing the overall power consumption by the power consumption of the computational equipment. The PUE is higher when temperature and/or humidity are high, since cooling consumes more energy under those conditions.

The operational costs are those incurred during the operation of the datacenter, and include costs for external network bandwidth use ($dcNetCost$) and the grid electricity ($dcEnergyCost$) required to run the datacenter. (There is also a cost for water, which is currently not considered by can be easily added.) The electricity cost is computed based on the IT equipment's power demand over time ($powerNeed(t)$), the PUE, and the electricity price. Both the electricity price and the PUE vary with location.

Finally, lower taxes and one-time incentives are another important component of the cost of a datacenter. For example, some states in the US lower taxes on datacenters, as they generate employment and wealth around them. This component

depends on the nature of the savings and applies to each cost in a different way. Although we do not consider this component further, it is easy to add it to our framework.

2) *Wind farm*: The cost of the wind farm is modeled as the capital cost ($wfCAPEX$) minus the revenue earned by selling the wind energy to the grid ($wfRev$). We assume that the operational cost of operating the wind farm is low, and so do not consider it here; of course, this cost can be easily added to the framework. The capital costs include the cost for buying land ($wfLandCost$) and building the wind farm ($wfBuildCost$), which in turn includes the construction cost and the cost of laying the power line from the wind farm to the closest power plant. The construction cost is assumed to be a linear function of the desired power generation capacity. Note that if the datacenter and wind farm are co-located, then the cost for laying power lines is incurred only once.

The revenue earned by the wind farm is computed over the time period T , where the energy generated within any time epoch t in T at location w depends on the efficiency of the wind turbines and the wind speed. The efficiency of today's wind turbine is close to 50%. We capture the efficiency and impact of wind speed in epoch t using the parameter $\beta(w, t)$, which gives the fraction of the wind farm's maximum capacity actually produced during t .

3) *Transmission system*: As discussed above, adding a datacenter and wind farm to an existing transmission system

will alter the power flow of the network, thus affecting the system transmission loss. We model this loss across the entire time period T , and assume that each unit of loss has a corresponding cost.

4) Constraints: Thu: Still need to finish the section.

The outputs of the problem is the lowest cost found and the corresponding locations for datacenters and renewable power plant, as well as the capacity provisioned at each location for datacenters or green power plants (if any).

Equation 1 in Figure 4 shows the optimization objective of our defined problem, i.e. $TotalCost$, where $DC(l)$ and $RE(l, r)$ are booleans indicating whether to place a datacenter or power plant of type r at location l . $DC_Cost(l)$, $RE_Cost(l, r)$ and $Grid_Cost$ represent the cost for datacenters, renewable plants and the power grid system respectively.

The overall cost should be optimized under the constraints, which are listed in Figure 5. Equation 21-23 show the constraints of the provisioned capacity for datacenters. Equation 24 means that the provisioned capacity for renewable energy plants are determined by the total power demand from the datacenters. This constraint is added indicating that the power generation and consumption added to the grid should be balanced from the perspective of the grid system. Furthermore, Equation 26 is a strict limitation for keeping the grid out of any violations at any given time t , since we assume the grid reliability is crucial and must be guaranteed.

B. Optimizing approaches

1) *Semi Brute force*: A time-consuming approach is to generate all of the possible combinations for datacenters and renewable energy plants. However, it is not possible to generate all kinds of capacity provisioning amounts since it's not discrete. Thus, we generate combinations of locations first, and then evenly distribute the total capacity to all of the candidate locations selected. By testing these generated configurations, the approach returns the best one with the lowest total cost. This approach still could be very exhaustive, which needs extremely long time for execution.

2) Heuristic searching: XW: TO DO SOME WORK...

IV. EVALUATION EXPERIMENT

Now in this section, we study the overall cost for placing datacenters and renewable energy power plants into the same grid network. By considering the grid loss or not, we can get different results of placement decisions.

A. Input data

The target area here is New England in United States, and we select 56 locations as candidates inside this area, as shown in Figure 6. We obtained the Typical Meteorological Year (TMY) information for 56 locations from US Department of Energy (2), which includes a one-year dataset of hourly weather values for a location. We simplify the problem by only considering one type of renewable energy - wind. We computed the average wind power generation using $\beta(l, t)$ derived from the specifications for the 1.5MW Series wind

turbine from General Electric Company [22], TMY wind speed, TMY air pressures, and conversion losses.

Besides, we collected various data of PUEs, datacenter construction costs, wind farm construction costs, land costs, transmission lines and network connection costs and grid energy costs in the same way as stated in [17]. Specifically, for grid costs, we use $priceLoss$ the same as the maximum electricity price in the whole area. The input data for the grid is derived from the New England grid system, which is shown as in Section II, including all of the settings for buses, branches and generators in it. Thus, the transmission loss, $transLoss(t)$, could be computed by simulating the power flow process for time epoch t .

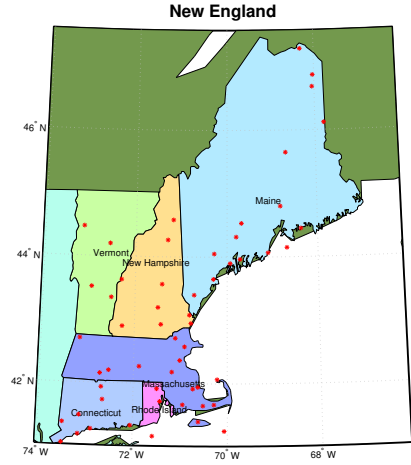


Fig. 6: Candidate locations in New England

B. Building one datacenter with one wind farm

Here, we are trying to solve a simplest case of the defined problem by placing only one datacenter and only one wind farm onto the grid system. The added generation (wind power) and consumption (datacenter load) should be balanced for the grid to keep reliability to the best extent. In this case, we can brute force all of the combinations of locations for the datacenter and the wind farm. Figure 7 shows the results of the total cost by using five different strategies when seeking the best locations when we are building a 100MW datacenter and a wind farm which can supply green energy for it.

The five different strategies are explained as follows:

(1) **DC_WF_OPT**. This strategy tries to seek for the best location for the datacenter where its total cost could be minimized, and the best location for the wind farm where its total cost could be minimized. XW: According to Divya, today there are standard methods used to determine the best location for wind farms. So are you suggesting us to focus on the placement of datacenters only? Grid costs are not considered here.

(2) **DC+G_WF+G**. Since only putting datacenter or wind farm into the grid will change the power flow, this strategy tries to add the transmission loss costs into consideration when

$$\forall l \in \mathcal{L}, capDC(l) \leq DC(l) \cdot CapacityDC \Rightarrow \text{capacity of datacenter at } l \text{ should be zero when } DC(l) \text{ is } 0 \quad (23)$$

$$\sum_{l \in \mathcal{L}} DC(l) \cdot capDC(l) = CapacityDC \Rightarrow \text{total capacity of built datacenters should meet the requirement} \quad (24)$$

$$\forall t \in T, demand(l, t) \leq capDC(l) \Rightarrow \text{power demand of the datacenter should not exceed its capacity} \quad (25)$$

$$\sum_{l \in \mathcal{L}, r \in \mathcal{R}} RE(l, r) \cdot capRE(l, r) \cdot avgEff(l, r) = \sum_{t \in T, l \in \mathcal{L}} DC(l) \cdot demand(l, t) \cdot PUE(l, t) \Rightarrow \text{the generated green energy should be balanced with consumption} \quad (26)$$

$$\forall t \in T, 0 \leq effRE(r, l, t) < 1 \Rightarrow \text{efficiency of power plant should be between } [0, 1) \quad (27)$$

$$\forall t \in T, numLineVio(t) = 0, numVolVio(t) = 0 \Rightarrow \text{No violations in each time epoch} \quad (28)$$

Fig. 5: Optimization constraints.

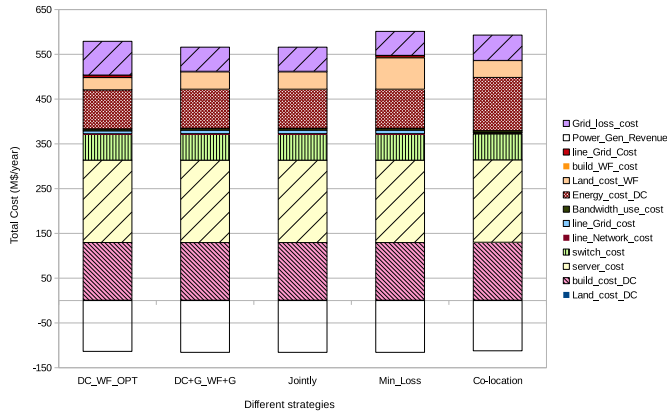


Fig. 7: Costs of building one datacenter (100MW) with one wind farm

seeking for best locations separately for the datacenter and the wind farm.

(3)**Jointly.** All of the combinations of locations are exploited by using this strategy to seek for the jointly placement choice for both the datacenter and the wind farm, considering the total cost as calculated by Equation 2.

(4)**Min_Loss.** Here, this strategy seeks for the locations for datacenter and wind farm which can lead to the minimal grid losses cost.

(5)**Co-location.** Assuming the the datacenter should be build together with an on-site wind farm, this strategy seeks for one location to place both the datacenter and the wind farm towards minimizing the total cost.

From the figure, we can see that by considering grid costs, the total cost will be further saved compared to best choices for the datacenter and the wind farm separately. Also, *Min_Loss* can achieve minimal losses of all possible choices, but the total cost is large mainly because it selects an expensive place for purchasing land for the wind farm. The best choice of co-location options is also nearly 7% higher than the *Jointly* choice, and it's easy to understand since the best location for datacenter is not necessarily the best for wind farm and vice versa.

We calculate all of the combinations for wind farm and datacenter locations and use the average total cost of these combinations (which is \$667.1M per year) as the baseline for comparison. Then, the locations found and the corresponding cost savings of the five strategies are listed in Table VI.

TABLE VI: Detailed results of cost savings by different strategies.

Strategy	Datacenter location	Wind farm location	Total cost (M\$/year)	Cost saving (%)
DC_WF_OPT	Burlington, NH	Mount Washington, NH	465.6	30.2
DC+G_WF+G	Springfield Hartnes, VT	Nash Island, CO	450.3	32.5
Jointly	Springfield Hartnes, VT	Nash Island, CO	450.3	32.5
Min_Loss	Springfield Hartnes, VT	Marthas Vineyard, RI	485.6	27.2
Co-location	Nash Island, CO	Nash Island, CO	480.7	27.9

C. Multiple datacenters and wind farms

XW: NEED MORE MORE WORK....

V. RELATED WORK

This section reviews relevant work to this paper in the recent literature, which are classified into two categories.

A. Effect of datacenters to the grid

In the smart grid era, datacenters began to show the advantages for demand response and facilitate ancillary services due to its great and controllable flexibility. Researchers studied the effect of datacenter demand response on power consumption reduction [23], [24]. They found that 25% of the demand savings can be done with minimal or no impact on datacenter performance. Also, 10% of the load can be shed with short response time with no operational impact. They did not consider dynamic load migration of the workload which can result in further reduction in power demand.

Mohsenian *et al.* in [25] proposed a request distribution policy among datacenters to ensure power load balancing. They tried to minimize the maximum power on any transmission line by distributing the computing requests to suitable

datacenter. Their work assumes that a fairly large number of datacenters (e.g. 6) are connected to the same power distribution network. In practice, it is very rare for some company to build several datacenters connected to the same power distribution network. Aikema *et al.* in [26] studied the energy cost savings that can be achieved when datacenter participates in ancillary services. Their simulation shows that 12% cost savings can be done at the cost of 2% performance loss (i.e. increased latency).

Recently, Wierman *et al.* [27] surveyed the opportunities and challenges for datacenters to ease the incorporation of renewable energy source into the grid and shaving the peak load. Further, Liu *et al.* in [28] focused on the impact of datacenter demand response on grid. They concluded that datacenter demand response can reduce the storage requirement of a grid with renewable energy source. The other key finding of their work is voltage violation frequency is lower when datacenter is placed on the same power bus with the PV solar source.

Different from these work, we quantify the datacenter impact on the grid by focusing on the losses brought because of penetrating additional load and generations to the grid network in a regional area. By incorporating such effects into a holistic framework, we convert such losses to grid operational costs and regard it as part of the total cost when building and planning the capacity of datacenters and also the renewable energy power plants.

B. Datacenter placement and capacity planning

Some prior work has discussed about the placement issues of datacenters. Alger [13] explained how to choose an optimal location for the datacenter several years ago, by considering hazards, accessibility and scalability factors. Stansberr [29] ranked some cities by estimating the annual operation costs of the datacenter. Oley [14] considered looking for a proper location for the datacenter establishment only by investigating the power rates of different states. Goiri *et al.* [12] focused on intelligently finding the best places for building multiple datacenters to form a network for interactive Internet services. This work is to some extent close to ours, but they didn't consider the provisioning issues of renewable energy plants and the relevant costs.

Larumbe *et al.* [15] presented a mathematical problem aiming at solving the location and routing of cloud service components. Gao *et al.* [30] studied how to sit datacenters near existing wind farms, and distributing load using a greedy online algorithm. Berral *et al.* [17] considered to select sites for datacenters and on-site power plants aiming at follow-the renewable cloud services. Unlike our work, they didn't put insights the possible impact of datacenters and distributed energy generations on the utility grid system.

Different from these work, we quantify and incorporate the impact of the site selection on the grid operation, and regard the summarized cost as the objective, which shows the importance of collaborating service providers and grid operators together to do the site and capacity planning.

VI. CONCLUSION

In this paper, we studied the problem of smartly placing green datacenters in proper locations with considering the impact on electricity grid. Since connecting datacenters and renewable energy plants to the utility grid will change the power flow of the whole grid network, and thus the grid losses should be incorporated when trying to minimize the total cost. In this context, we proposed an optimization framework with the purpose of optimizing the total cost including datacenter, renewable energy plant and also the grid cost. The problem is formulated with several necessary constraints according to the reliability issues for the grid. By solving the problem, we tried to seek for best locations for sitting and provisioning the capacity of both datacenters and renewable energy plants. Our optimization results show that considering the grid cost will have different impact on the placement choice for sitting datacenters and renewable power plants. This means grid-aware placement strategies could further help saving the overall cost from the perspective of both IT companies and grid operators.

REFERENCES

- [1] R. Urgaonkar, B. Urgaonkar, M. J. Neely, and A. Sivasubramaniam, "Optimal power cost management using stored energy in data centers," in *SIGMETRICS*, 2011. 1
- [2] J. Koomey, *Growth In Data Center Electricity Use 2005 To 2010*. Oakland, CA: Analytics Press, 2011. 1, 3
- [3] G. Ghatikar, "Demand response opportunities and enabling technologies for data centers: Findings from field studies," 2014. 1
- [4] Google, "Renewable energy Data Centers Google," 2014, <http://www.google.com/about/datacenters/renewable/>. 1
- [5] Apple, "Apple and the Environment," 2013, <http://www.apple.com/environment/renewable-energy/>. 1
- [6] R. Miller, "Data Centers Scale Up Their Solar Power," 2012, <http://www.datacenterknowledge.com/archives/2012/05/14/data-centers-scale-up-their-solar-power/>. 1
- [7] I. Goiri, W. Katsak, K. Le, T. D. Nguyen, and R. Bianchini, "Parasol and GreenSwitch: Managing Datacenters Powered by Renewable Energy," in *ASPLOS*, 2013. 1
- [8] Julfikar Ali Manik and Nida Najar, "Electricity Returns to Bangladesh After Power Failure," 2014, <http://www.nytimes.com/2014/11/02/world/asia/power-grid-failure-puts-bangladesh-in-the-dark.html>. 1
- [9] H. Wang, J. Huang, X. Lin, and H. Mohsenian-Rad, "Exploring smart grid and data center interactions for electric power load balancing," *SIGMETRICS Perform. Eval. Rev.*, vol. 41, no. 3, pp. 89–94, Jan. 2014. [Online]. Available: <http://doi.acm.org/10.1145/2567529.2567556> 1
- [10] R. de Groot, J. Morren, and J. Slootweg, "Investigation of grid loss reduction under closed-ring operation of mv distribution grids," in *PES General Meeting—Conference & Exposition, 2014 IEEE*. IEEE, 2014, pp. 1–5. 1
- [11] U.S. Energy Information Administration, "How much electricity is lost in transmission and distribution in the United States?" 2014, <http://www.eia.gov/tools/faqs/faq.cfm?id=105&t=3>. 1
- [12] I. Goiri, K. Le, J. Guitart, J. Torres, and R. Bianchini, "Intelligent Placement of Datacenters for Internet Services," in *ICDCS*, 2011. 1, 9
- [13] D. Alger, "Choosing an Optimal Location for Your Data Center," in *InformIT*, 2006. 1, 9
- [14] B. Oley, "Power & Approaching the Best Place to Build a Data Center," pp. 32–33, 2009. 1, 9
- [15] F. Larumbe and B. Sansò, "Optimal Location of Data Centers and Software Components in Cloud Computing Network Design," in *CCGrid*, 2012. 1, 9
- [16] K. Le *et al.*, "Capping the Brown Energy Consumption of Internet Services at Low Cost," in *IGCC*, 2010. 1

- [17] J. L. Berral, I. Goiri, T. D. Nguyen, R. Gavalda, J. Torres, and R. Bianchini, "Building green cloud services at low cost," in *Distributed Computing Systems (ICDCS), 2014 IEEE 34th International Conference on*. IEEE, 2014, pp. 449–460. 1, 7, 9
- [18] G. Bills *et al.*, "On-line stability analysis study," *Report for the Edison Electric Institute RP90-I*, 1970. 3
- [19] Data Center Research, "Data Center Map," 2014, <http://www.datacentermap.com/datacenters.html>. 3
- [20] Y. Lei, A. Mullane, G. Lightbody, and R. Yacamini, "Modeling of the wind turbine with a doubly fed induction generator for grid integration studies," *Energy Conversion, IEEE Transactions on*, vol. 21, no. 1, pp. 257–264, 2006. 3
- [21] P. Interconnection, "A survey of transmission cost allocation issues, methods and practices," *Valley Forge*, 2010. 4
- [22] General Electric Company, "1.5 MW Wind Turbine Technical Specifications," 2013, http://site.ge-energy.com/prod_serv/products/wind_turbines/en/15mw/specs.htm. 7
- [23] V. Ganti and G. Ghatikar, "Smart Grid as a Driver for Energy-Intensive Industries: A Data Center Case Study," 2012, IBNL. 8
- [24] G. Ghatikar, V. Ganti, N. Matson, and M. A. Piette, "Demand Response Opportunities and Enabling Technologies for Data Centers: Findings from Field Studies," 2012, IBNL. 8
- [25] A.-H. Mohsenian-Rad and A. Leon-Garcia, "Coordination of Cloud Computing and Smart Power Grids," in *2010 First IEEE International Conference on Smart Grid Communications (SmartGridComm)*, 2010, pp. 368–372. 8
- [26] D. Aikema, R. Simmonds, and H. Zareipour, "Data centres in the ancillary services market," in *IGCC*, 2012, pp. 1–10. 9
- [27] I. L. Adam Wierman, Zhenhua Liu and H. Mohsenian-Rad, "Opportunities and Challenges for Data Center Demand Response," in *Proceedings of IEEE IGCC, 2014.*, 2014. [Online]. Available: <http://users.cms.caltech.edu/~adamw/papers/dcdrsurvey.pdf> 9
- [28] Z. Liu, I. Liu, S. Low, and A. Wierman, "Pricing data center demand response," in *Proc. ACM Sigmetrics*, 2014. 9
- [29] M. Stansberr, "Data Center Locations Ranked by Operating Cost," in *SearchDatacenter.com*, 2006. 9
- [30] Y. Gao, Z. Zeng, X. Liu, and P. Kumar, "The Answer Is Blowing in the Wind: Analysis of Powering Internet Data Centers with Wind Energy," in *INFOCOM*, 2013. 9