ELECTRICAL LEGEND

DESCRIPTION

A — 2x4 RECESSED FLUORESCENT LIGHT FIXTURE SCHEDULE

NL --- NIGHT LIGHT FIXTURE, CONTINUOUSLY ENERGIZED

B—1x8 RECESSED FLUORESCENT LIGHT FIXTURE SCHEDULE

C -- RECESSED INCANDESCENT DOWN LIGHT FIXTURE SCHEDULE

D -- PENDANT MOUNTED INCANDESCENT DOWN LIGHT FIXTURE SCHEDULE

SEE LIGHT FIXTURE SCHEDULE

EGL —EMERGENCY EGRESS LIGHT FIXTURE SCHEDULE

X1 — UNIVERSAL EXIT LIGHT FIXTURE WITH BATTERY
BACK-UP-SEE LIGHT FIXTURE SCHEDULE

18"-TELEPHONE/DATA CONNECTION-MT 18" AFF

EXHAUST FAN

---- 20A,208V RECEPTACLE

----GFI RECEPTACLE-MT 18" AFF CIRCUIT, 20A,125VAC

- RECEPTACLE ON ISOLATED GROUND

INTERMATIC#FF312H, AUTO SHUT-OFF, THREE WAY 12 HR, 20A, 120/277V, SPRING WOUND TIMER/SWITCH, MT 48"

-ELECTRICAL SERVICE FOUR WAY SWITCH-MT 48" AFF

\$ \$ 8 _ P2 _ - OCCUPANCY LIGHT/MOTION SENSOR (MFGR-P&S#WSP200-W),120/277V

INTERMATIC #K4121
1800W,120V PHOTOCELL

- MOTOR

▲18"—TELEPHONE OUTLET CONNECTION—MT 18" AFF UNLESS NOTED

△18"—MODEM OUTLET CONNECTION—MT 18" AFF UNLESS NOTED


OTHERWISE

\$ ____COMBINATION OUTLET: MODEM, COMPUTER/DATA & TELEPHONE 18" AFF UNLESS NOTED OTHERWISE

18 COMPUTER/DATA OUTLET CONNECTION-MT 18 AFF UNLESS NOTED OTHERWISE

 $\bigtriangledown_{18}^{\text{TV}}$ —Cable TV outlet-MT 18" AFF UNLESS NOTED OTHERWISE

O_{SD}—SMOKE DETECTOR (120VAC) --- DUPLEX RECEPTACLE-MT 18" AFF-20A,125VAC — SINGLE POLE—120/277V—MT 48" AFF (INTERMATIC#FF12HC) -600W, 120V INCANDESCENT DIMMER - 1000W, 120V INCANDESCENT DIMMER 돢

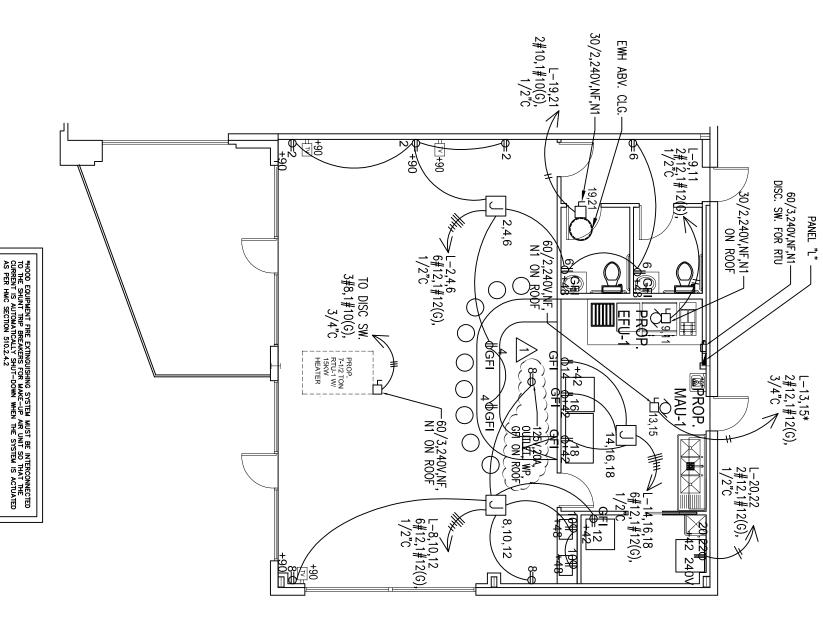

/4"=1'-0"

SHEET:

E1.2

M.A.
DRAWN BY
1/4"=1'-0"
SCALE M.A. 8 뫼

2/25/10 DATE

ELECTRICAL PLAN FOR A PROPOSED BUILD-OUT "LA BOTANA REGIA" LOCATED AT 7610 KEMPWOOD, STE A HOUSTON TX 77055





REVISION 1. 06/18/10 COH COMMENT