



Temperature Sensors Installation Instructions

Dimensions in mm

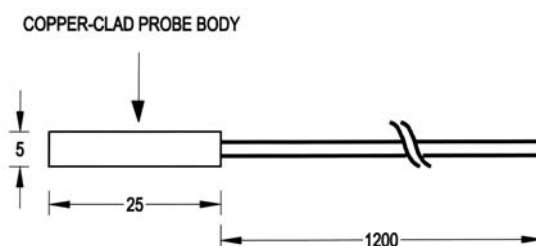

TE10-1 Probe Temperature Sensor

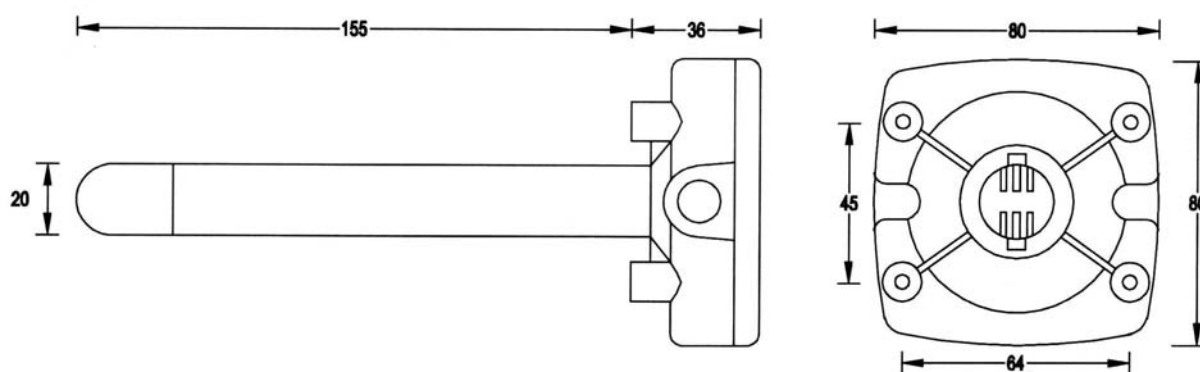

TE10-2 Duct Temperature Sensor

Wiring Notes

1. 22 or 24 AWG twisted shielded pair double-insulated cable is recommended as remote sensor wiring and its length must not exceed 50 m.
2. Do not bundle and run power wiring and remote sensor wiring in the same conduit.
3. Run the remote sensor wiring away from any electric motors or power wiring. Failure to do so may result in poor thermostat performance due to electrical noise.

WARNING

Incorrect wiring connection may cause permanent equipment damages to the sensor.