Digital Room Thermostats with LCD Installation and Operation Instructions


Model Number Selection Guide					
Default Model	Application	Standard Model	Remarks		
50-1	Single on-off output, cool only or heat only	50-1	Factory setting		
	Single on-off output, manual cool/heat changeover	50-1M	Select via setup menu		
50-1A	Single 0-10 VDC output, cool only or heat only	50-1A	Factory setting		
	Single 0-10 VDC output, manual cool/heat changeover	50-1AM	Select via setup menu		
50-1F	Single 3-wire floating output, cool only or heat only	50-1F	Factory setting		
50-2	Dual on-off outputs, manual/auto cool/heat changeover	50-2	Factory setting		
	Single 3-wire floating output, cool only or heat only	50-1F	Cut jumper JP2		
	Single 3-wire floating output, manual cool/heat changeover	50-1FM	Cut jumper JP2 and select via setup menu		
	Single on-off output, cool only or heat only	50-1	Cut jumpers JP2 and JP3		
	Single on-off output, manual cool/heat changeover	50-1M	Cut jumpers JP2 & JP3 & select via setup menu		
50-2A	Dual 0-10 VDC outputs, manual/auto cool/heat changeover	50-2A	Factory setting		
	Single 0-10 VDC output, cool only or heat only	50-1A	Cut jumpers JP2 and JP3		
	Single 0-10 VDC output, manual cool/heat changeover	50-1AM	Cut jumpers JP2 & JP3 & select via setup menu		

The default models 50-2 and 50-2A can be re-configured in the field to various standard models by a qualified servicing agent, if necessary, by changing the jumper positions of JP2 and JP3. The locations of these jumpers can be found after removing the thermostat cover from its mounting plate.

	1	- (ID0 I ID0	
Model Number	Jumper Settings of JP2 and JP3		
Model Number	JP2	JP3	
50-1	Cut	Cut	
50-1M	Cut	Cut	
50-2	Uncut	Uncut	
50-1F	Cut	Uncut	
50-1FM	Cut	Uncut	
50-1A	Cut	Cut	
50-1AM	Cut	Cut	
50-2A	Uncut	Uncut	


Jumper Settings of JP1 and JP4				
Jumper	Cut	Uncut		
JP1	With Exter- nal Sensor	With Built- in Sensor		
JP4	For 2-10 VDC Output	For 0-10 VDC Output		


Note: JP4 is available in 0-10 VDC/2-10 VDC output models only. Factory setting is 0-10 VDC.



Dimensions in mm

Mounting Details

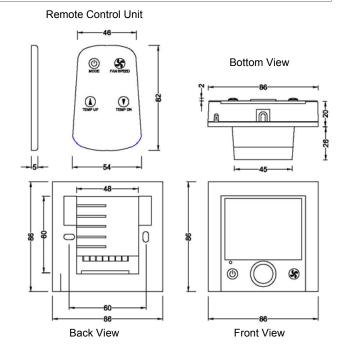



Mounting

The thermostat can be surface mounted or secured to a standard European $75 \times 75 \times 35$ mm electrical box. Two mounting screws are included.

Operation Notes

- LCD shows ambient temperature constantly except when set point adjustment is being made.
- \blacksquare Press the system key Φ to enter into the desired operating mode: Cool-Heat-Auto-Fan Only-Off, etc.
- Press the fan key ***** to change the fan speed mode: High-Med-Low-Auto.
- Increase or decrease temperature set point by rotating the adjustment dial clockwise or counter-clockwise. When the dial is rotated, the LCD shows the existing set point setting.
- In unoccupied mode, the factory temperature set points are 26 °C for cooling and 16 °C for heating and the fan speed is always set at "low".
- Unoccupied mode can be activated in the following manner when the unoccupied contact closes:
 - For Models "1", "1A" and "1F", the unoccupied cooling or heating mode is determined by the status of the SR2 seasonal changeover sensor and the valve output is activated according to the measured temperature.
 - For Models "1M", "1AM" and "1FM", while in unoccupied mode, the valve output is never activated.
 - For Model "2", the unoccupied cooling or heating mode is always determined by the measured temperature and valve output is also activated according to the measured temperature.
 - Unoccupied mode activation in operating mode only or in both standby and operating mode will be determined by activation setting in setup menu. Low fan will run according to fan action setting in setup menu.
 - When unoccupied mode is activated, all keys are locked out and no settings can be entered.
- The thermostat allows authorized service agent to change some operating parameters in the field. Refer to parameter setup manual for details.
- When "1F" or "1FM" is used for on-off control, its parameter settings must be set as 🖪 I, 🖽 and 🖾 and its effective operating temperature differential will be 1 K.

Wiring Diagrams and Application Notes

Wiring and Application Notes

- Cut jumper JP1 open if an external sensor is wired to SR1 and GND. Run the wiring away from any electrical motors or power wiring. Failure to do so may result in poor thermostat performance due to electrical noise.
- Cut jumper JP4 open if 2-10 VDC proportional output is required.
- 22 or 24 AWG twisted shielded pair double-insulated cable is recommended as remote sensor wiring and its length must not exceed 25 m.
- Do not bundle and run power wiring and remote sensor wiring in the same conduit.
- The seasonal changeover sensor should be wrapped around the supply water pipe when associated with a water system. When the changeover sensor temperature exceeds 30 °C, the thermostat enters into heating mode.
- External seasonal changeover sensor or switch is applicable to heat only or cool only 2-pipe models only.
- Unoccupied contact closure activates unoccupied mode.
- Hidden-line wiring for Terminal 7 of CN6 and Terminal V2+ of CN3 is applicable to dual-output models only.
- The thermostat on-off outputs are designed for controlling zone valves. If used for controlling electric heaters, external contactors must be used.
- For a 3-wire floating output model, in cooling mode, Terminal 6 of CN6 is wired to open valve on temperature rise and Terminal 7 of CN6 to close valve on temperature drop. The action in heating mode is reversed.


WARNING

Incorrect wiring connection may cause permanent equipment damages to the thermostat.

Piping Notes:


- On a single-output unit, V1 can be either a 2-wire spring-return cooling or heating valve.
- On a dual-output unit, V1 must be a 2-wire spring-return cooling valve and V2 a 2-wire spring-return heating valve.
- V3 must be a 3-wire floating valve. In cooling mode, Terminal 6 output opens valve on temperature rise and Terminal 7 output closes valve on temperature drop. The action in heating mode is reversed.
- On a single-output unit, V4 can be either a 0-10 VDC cooling or heating valve.
- On a dual-output unit, V4 must be a 0-10 VDC cooling valve and V5 a 0-10 VDC heating valve.

Wiring Diagram for Single and Dual 2-Wire On-Off Valve Outputs




V1 and V2 are 2-wire on-off spring-return valves

Connections of Sensors and Contacts





Wiring Diagram for Single 3-Wire Floating Valve Output



V3 is a 3-wire floating valve

Wiring Diagram for Single and Dual 0-10 VDC Valve Outputs





V4 and V5 are 0-10 VDC valves

TC50-Ins-0, 13-02