

VA-2003 Series

Intelligent Actuators for VB-2000/VB-2010 Brass Globe Valve Bodies

Features

- Bi-directional synchronous motor with Hall effect sensor switch
- Self stroke adjustment with memory
- Valve position indicator
- 0-10 VDC or 4-20 mA input models available
- Jumper selectable DA or RA setting
- Returns actuator to its fully up or fully down position when lack of input signal
- 0-10 VDC feedback signal
- Optional manual open/close positioner

General

The VA-2003 Series intelligent valve actuators are designed for 0-10 VDC or 4-20 mA control of VB-2000/VB-2010 Series 2-way or 3-way brass globe valve bodies.

The VA-2003 Series actuators feature a bi-directional synchronous motor with Hall effect sensor to eliminate the need for position switches. Position feedback from a 0-10 VDC potentiometer is a standard feature for all actuators. For ease of operation, factory-mount VA-2003 Series actuators onto the VB-2000/VB-2010 Series valve bodies are recommended. For best control results, the

thermostat or controller should be selected or adjusted to complement the stroke time of the VA-2003 actuator.

Direct Action (DA) and Reverse Action (RA) Switch Setting

DA is set to extend actuator stem when input signal increases and RA to retract actuator stem when input signal increases. The factory setting is DA. Can be changed in the field to RA by moving the switch 3 position at JP1.

Input Signal Interruption Protection

When there is no input signal or input signal is open-circuited, the actuator will return to its fully up or fully down position, depending on DA/RA (switch 2) setting at JP1. DA setting denotes fully up position and RA setting denotes fully down position.

Ordering

To order, specify complete model numbers. If 4-20 mA input signal actuators are required, it is highly recommended to specify this requirement for factory-mount valve/actuator set on ordering, as fine factory adjustments on the control board may be needed to accomplish best control results. Field change



of 4-20 mA input signal to 0-10 VDC is not recommended.

Replacement and Repair


Field repairs must not be made and no field replacement parts are available.

Specifications

Product model numbers	VA-2103	0-10 VDC (4-20 mA) model
	VA-2103M	0-10 VDC (4-20 mA) model with manual open/close positioner
Actuator type	Non-spring return	
Control action	Selectable DA or RA	
Power supply	24 V \pm 10% 50/60 Hz only	
Power rating	2.5 VA	
Input signal	Proportional: 0-10 VDC or 4-20 mA	
Input impedance	Proportional: 100,000 Ω of voltage input; 500 Ω of current input	
Feedback signal	0-10 VDC	
Motor type	Bi-directional synchronous motor with Hall effect sensor	
Close-off force	500 N	
Stroke	25 mm maximum	
Electrical connection	Non-removable terminal block, wire size 1mm ² or 18 AWG solid copper recommended	
Protection class	IP42	
Materials:	Gear	POM plastic
	Reducer plate	Zinc-plated steel
	Bracket	Die-cast aluminum alloy
	Casing	Fire-retardant molded ABS (UL94V-0)
Operating time	At 50 Hz: 12.4 s/mm At 60 Hz: 10.3 s/mm	
Ambient Conditions	Operating: 2 to 55°C (36 to 131°F); 0-90% RH, non-condensing Storage: -20 to 65°C (-4 to 149°F); 0-90% RH, non-condensing	
Accessories	U-type connector, locknut, indicator guide and valve connector	
Factory settings	Input signal: 0-10 VDC Stroke self-calibration: at 50 Hz Control action: DA Failure protection: Up At fully-closed position (upwards)	
Dimensions	See Figure 1: Dimensions in mm and Mounting Details	
Shipping Weights	1.1 kg (2.4 lb) for VA-2103 Series 1.15 kg (2.5 lb) for VA-2203 Series	

*The performance specifications above are nominal and subject to tolerances and application variables of generally acceptable industry standards.
The Manufacturer shall not be liable for damages resulting from misapplication or misuse of its products.*

Figure 1: Dimensions in mm and Mounting Details

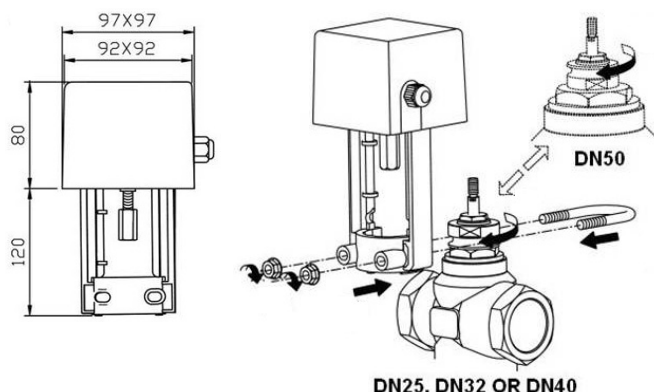


Mounting and Installation

1. Tighten the valve locknut to the valve.
2. Mount the actuator bracket to the valve, insert the U-type connector into the bracket and tighten the two connector nuts.
3. Lift the valve stem, place the locknut and indicator guide in it and couple the valve stem to the valve connector. Rotate the connector as far as it can go and tighten the locknut with a wrench. This is the fully-closed position of the valve set.
4. Allow enough headroom for removing the actuator from the valve body.

Figure 2: Wiring Diagrams

Proportional Actuators with Feedback

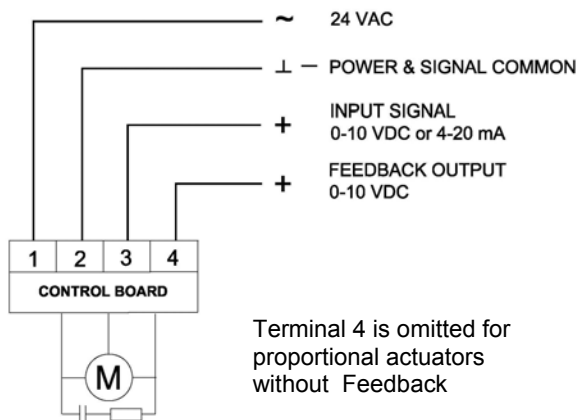


CAUTION: Equipment Damage Hazard

- Do not install the actuator in atmospheres where explosive or corrosive vapors or escaping gases are present. This could result in damage to the actuator.
- Protect the actuator against water dripping.

WARNING:


- All VA-2003 Series actuators are designed for use only in conjunction with operating controls. Where an operating control failure would result in personal injury and/or loss of property, it is the responsibility of the installer to add safety devices or alarm systems that protect against, and/or warn of, control failure.
- Electrical shock hazard! Disconnect power before installation to prevent electrical shock or equipment damage.

Manual Open/Close Positioner



NOTE: Disconnect power supply before operating manual open/close positioner. Push down and hold slider and rotate knob.

Figure 3: Jumper Settings

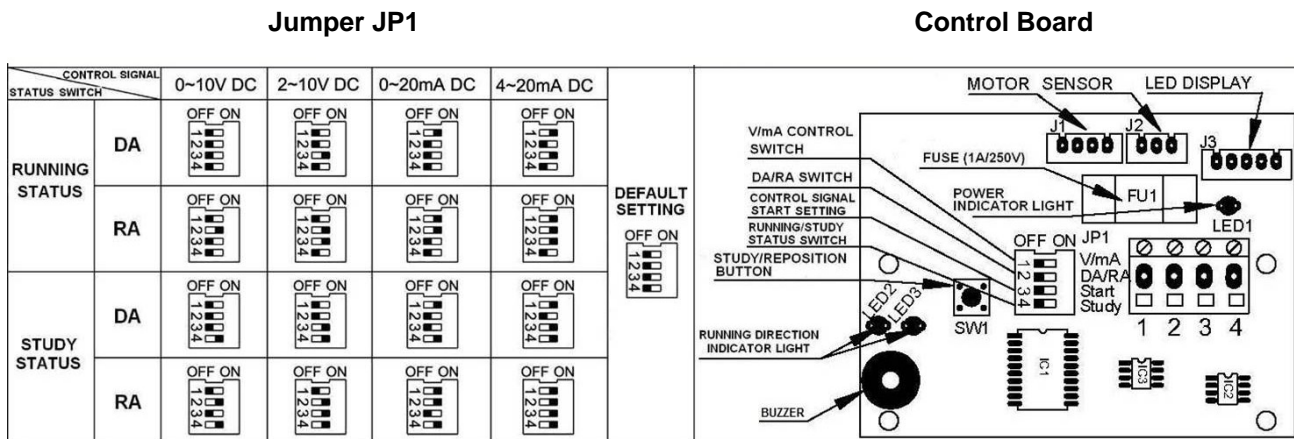

- Notes:** 1. It is highly recommended that JP1 be set in run mode when the valve is in normal service.
2. For 60 Hz power supply operation, specify this requirement on ordering or implement the study mode at least once in the field.

Valve Stroke Self Calibration

Study Mode

After power is turned on, set all dip switches of JP1 according to the above table. Firstly, set switch 4 of JP1 to "ON" position. Press STUDY/REPOSITION momentary switch SW1 once, power LED1 will start flickering and buzzer sounds every 5 seconds. Actuator stem starts moving downwards and opening the valve until reaching its maximum stroke. When the gear chain is blocked, the actuator stem starts moving upwards and closing the valve until the valve is fully closed and the gear train is blocked again. The power LED1 becomes steady and the buzzer sounds a long beep, indicating that the study mode is finished and over. The valve stroke calibration data will be kept in the actuator's micro-computer memory and no further recalibration is required when power is turned on again.

After the test, place switch 4 to "OFF" position to put the actuator into run mode. Note that if the switch 4

is not placed back to its "OFF" position after the study mode, the valve assembly will still operate normally but the actuator will have to go through the study mode every time when power is turned on.

Run Mode

Every time when power is turned on, the power LED1 lights up steadily and the actuator will retract to its fully-closed position. The buzzer will then sound a long beep, indicating that the actuator is now ready to act in accordance with the input signal.

Change of Operating Mode

If operating mode needs to be changed, change the dip switch positions of JP1 as desired and new settings will be confirmed after the STUDY/REPOSITION switch SW1 is pressed once. It is not necessary to turn the power off for this process to take place.

Mega Controls Limited

Room 2505, Trend Centre

29 Cheung Lee Street, Chai Wan, Hong Kong

Phone: +852 2896 7277 Fax: +852 2896 7234 E-mail: sales@megacontrols.com Website: www.megacontrols.com