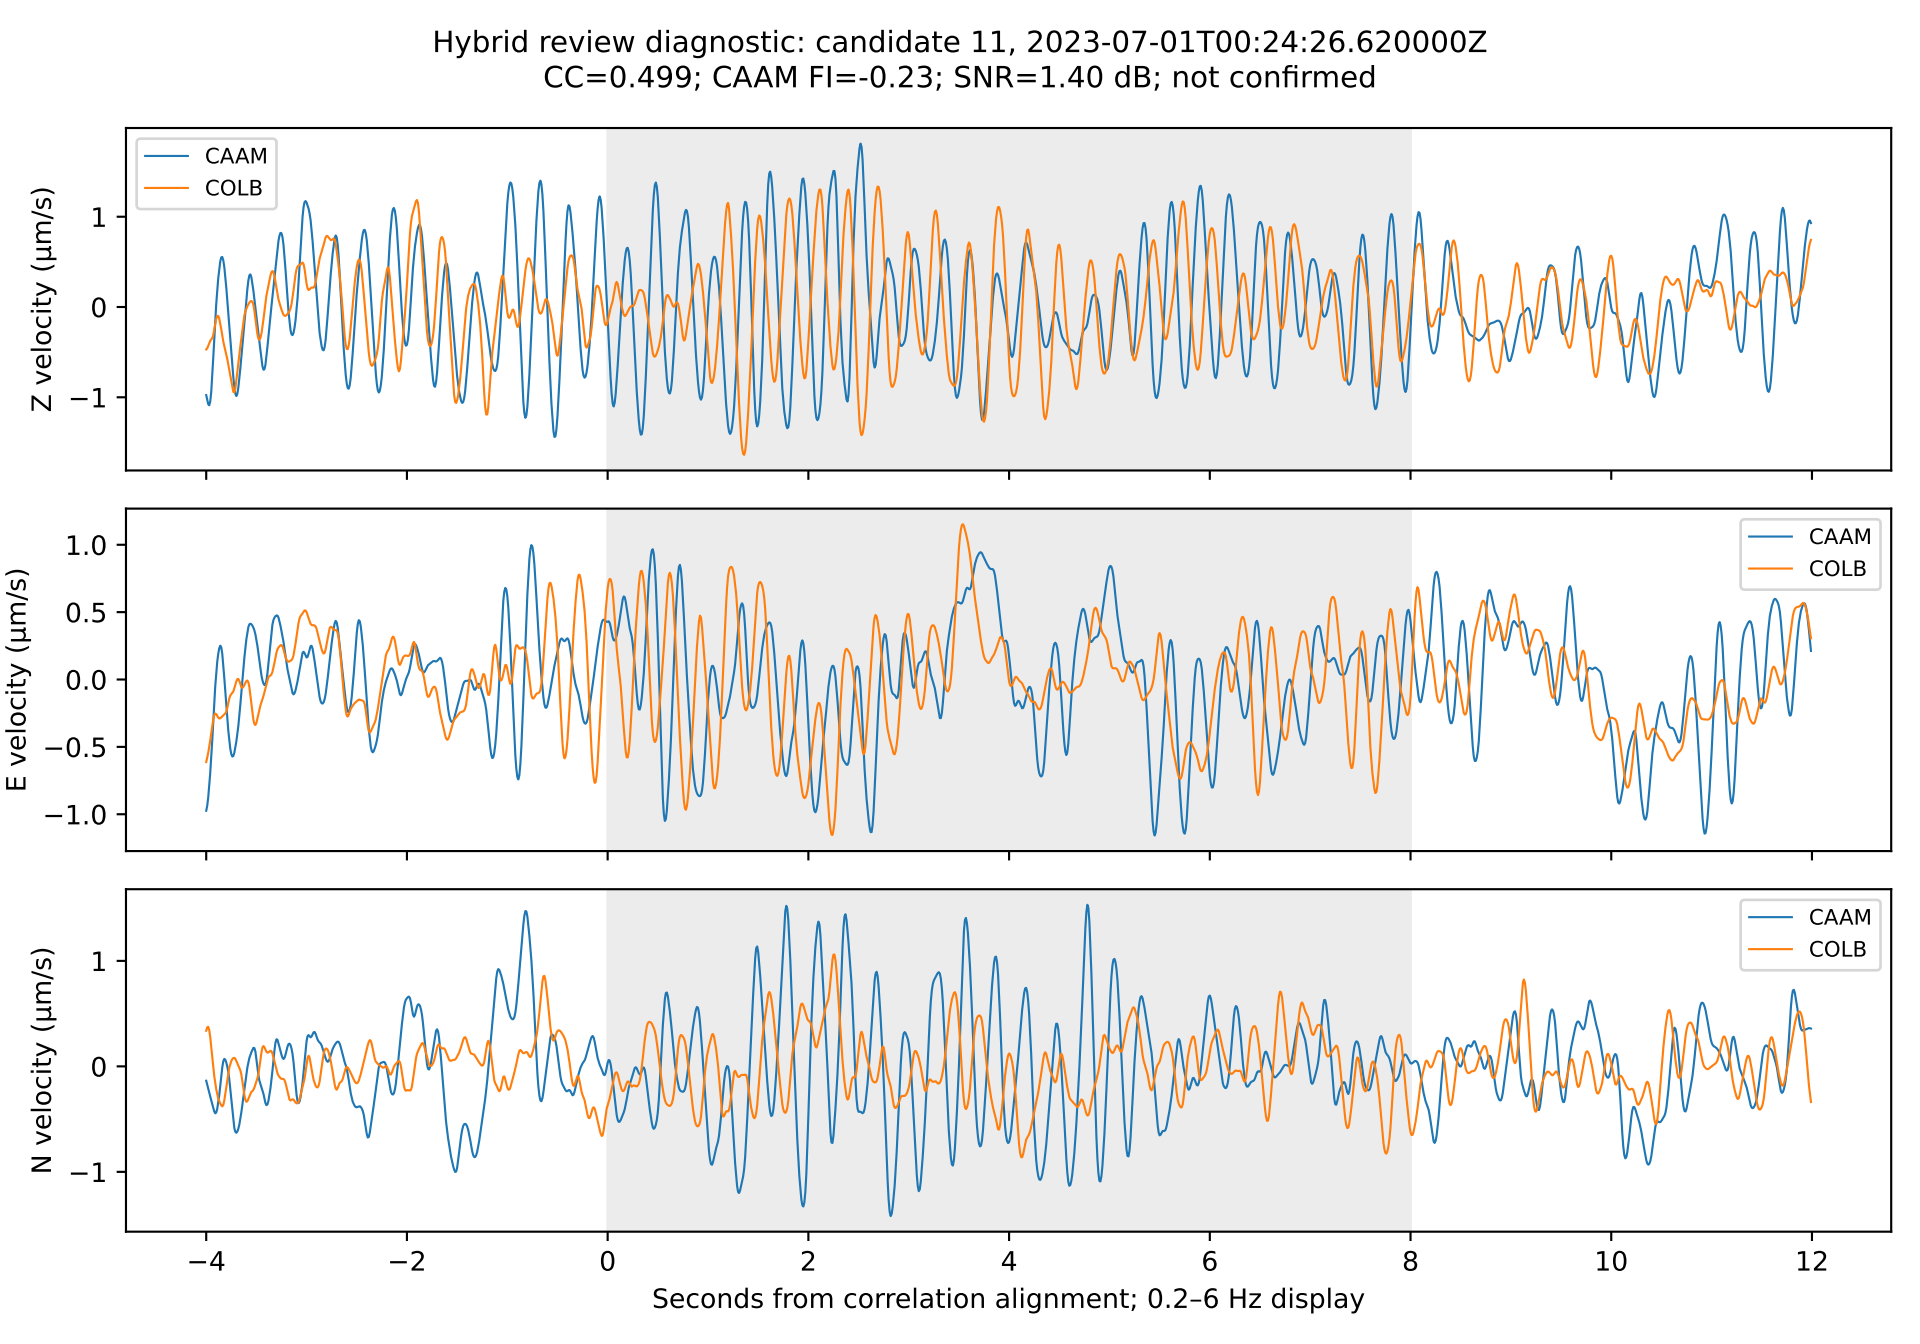
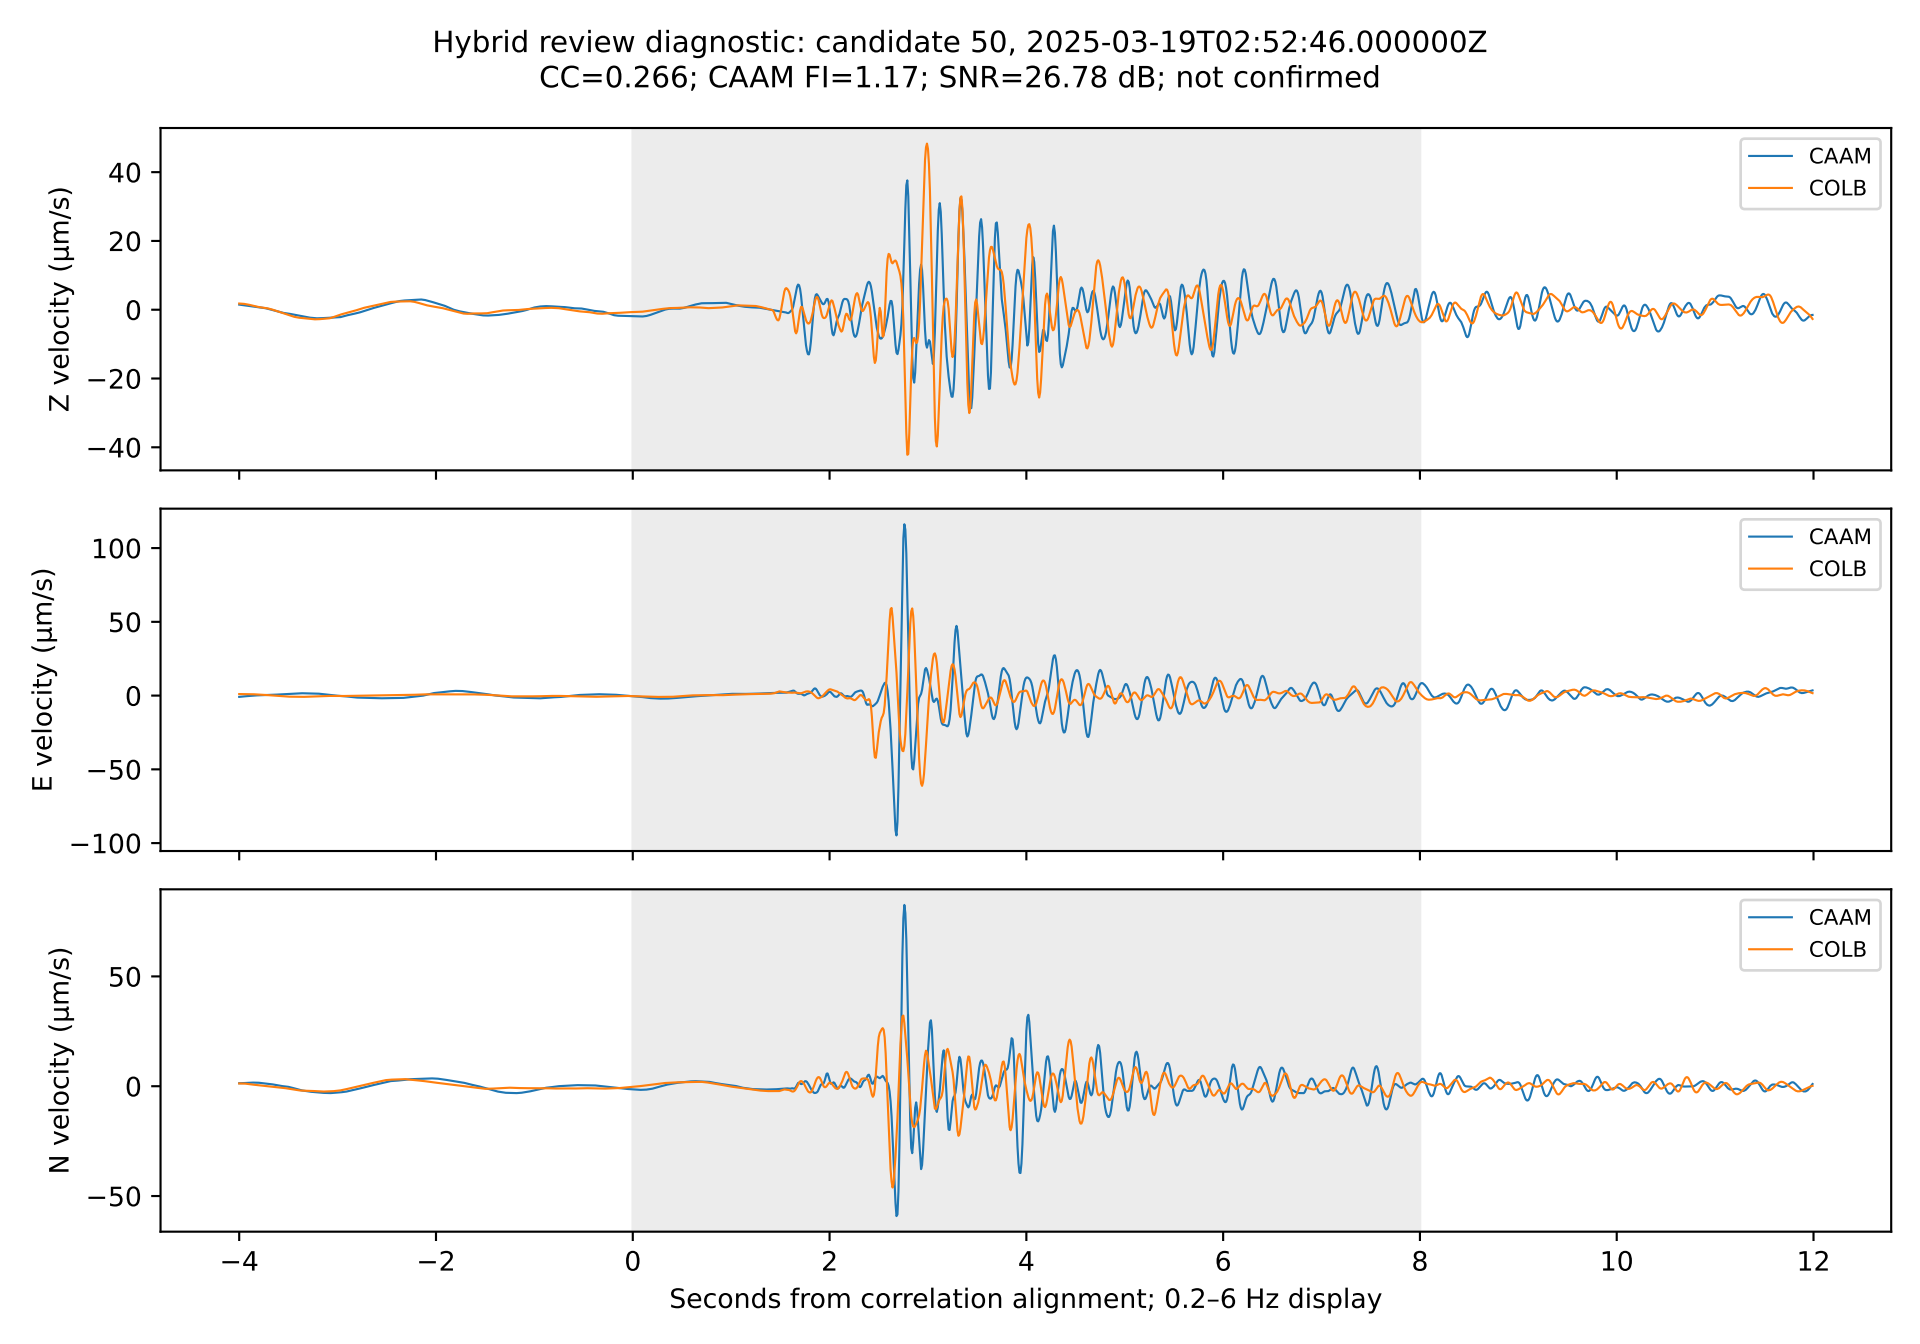
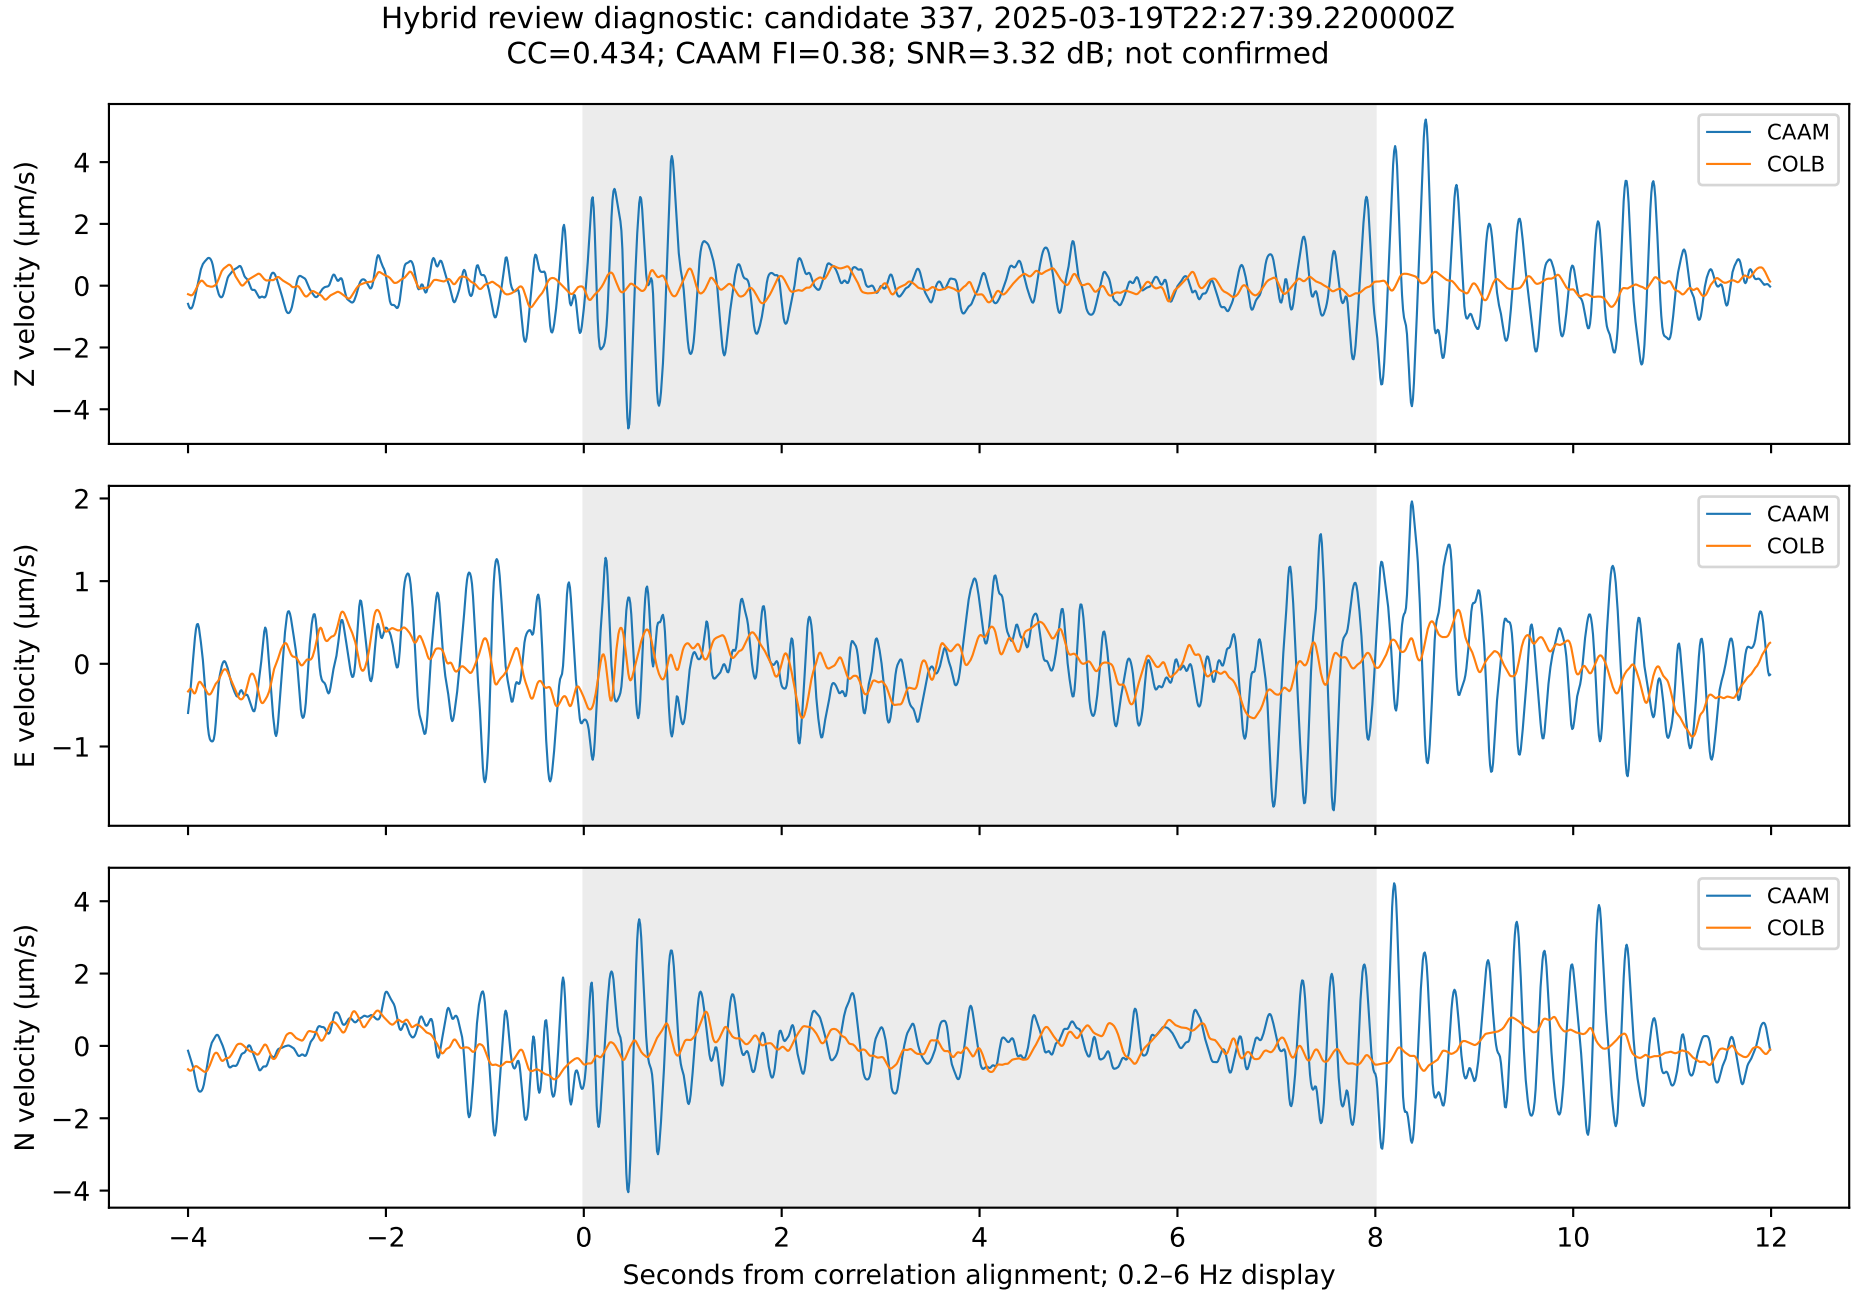
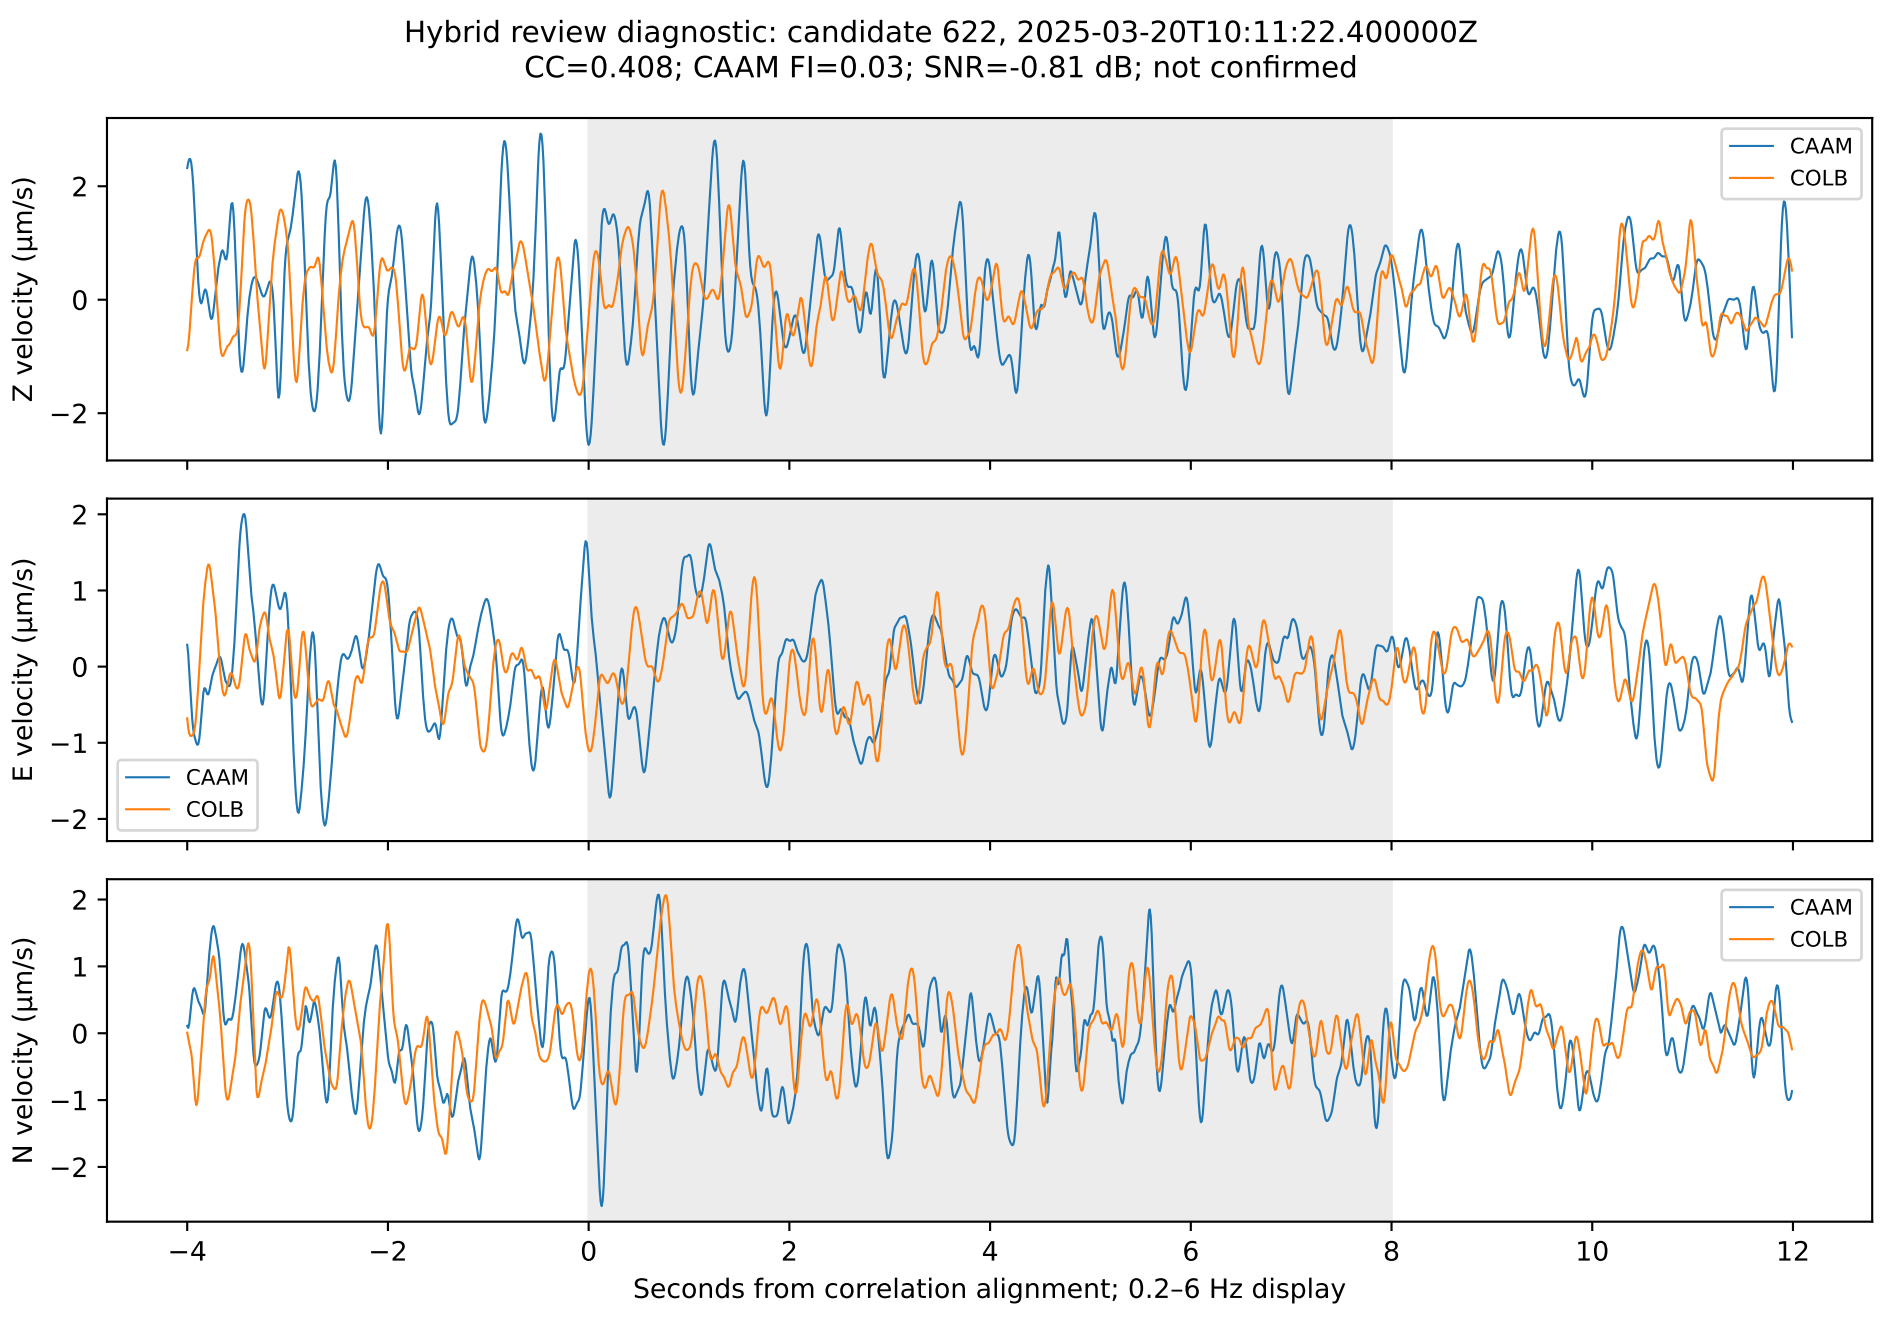
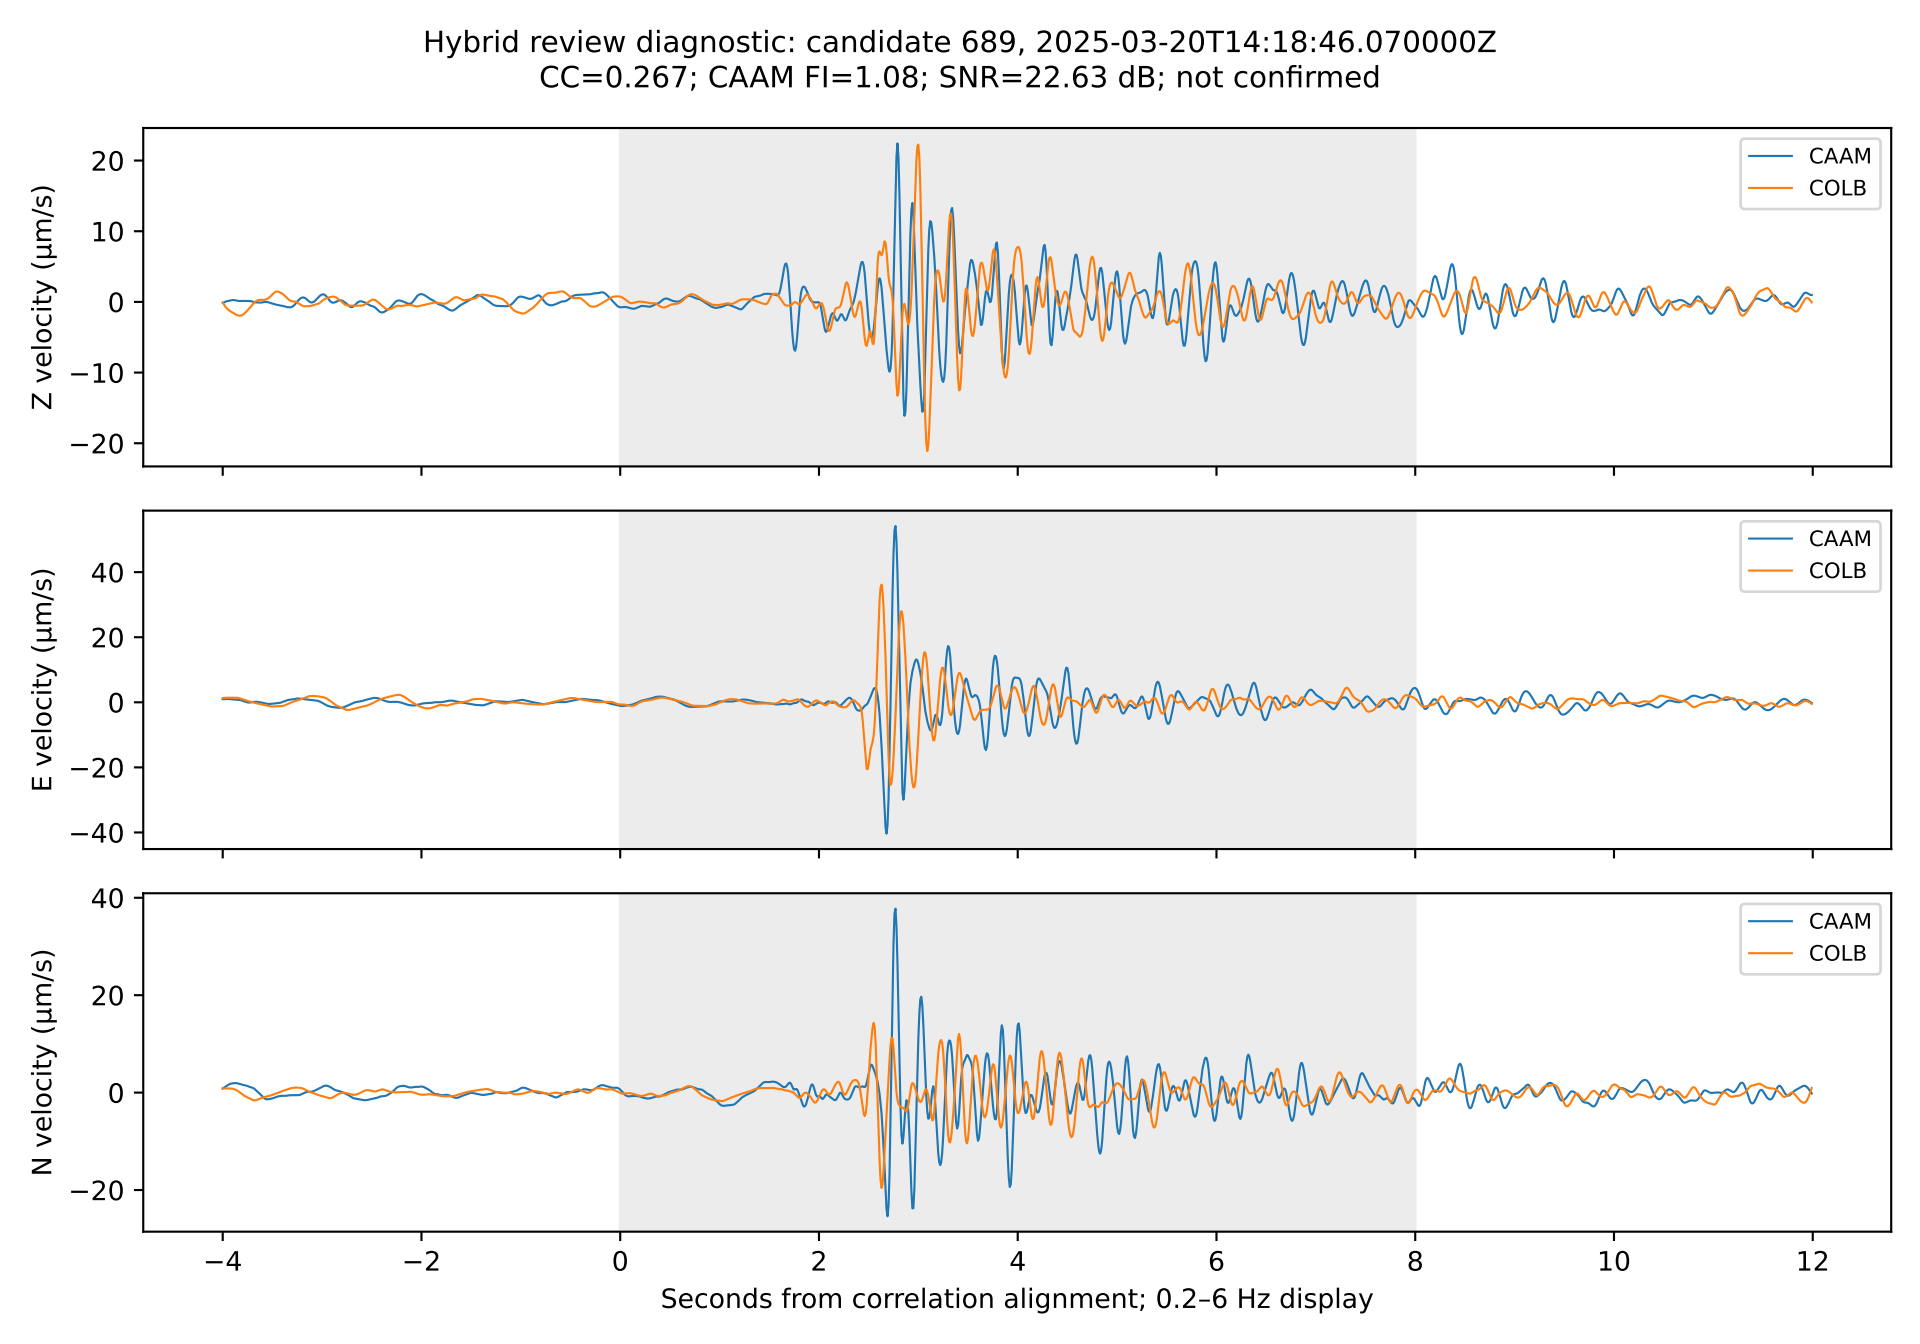
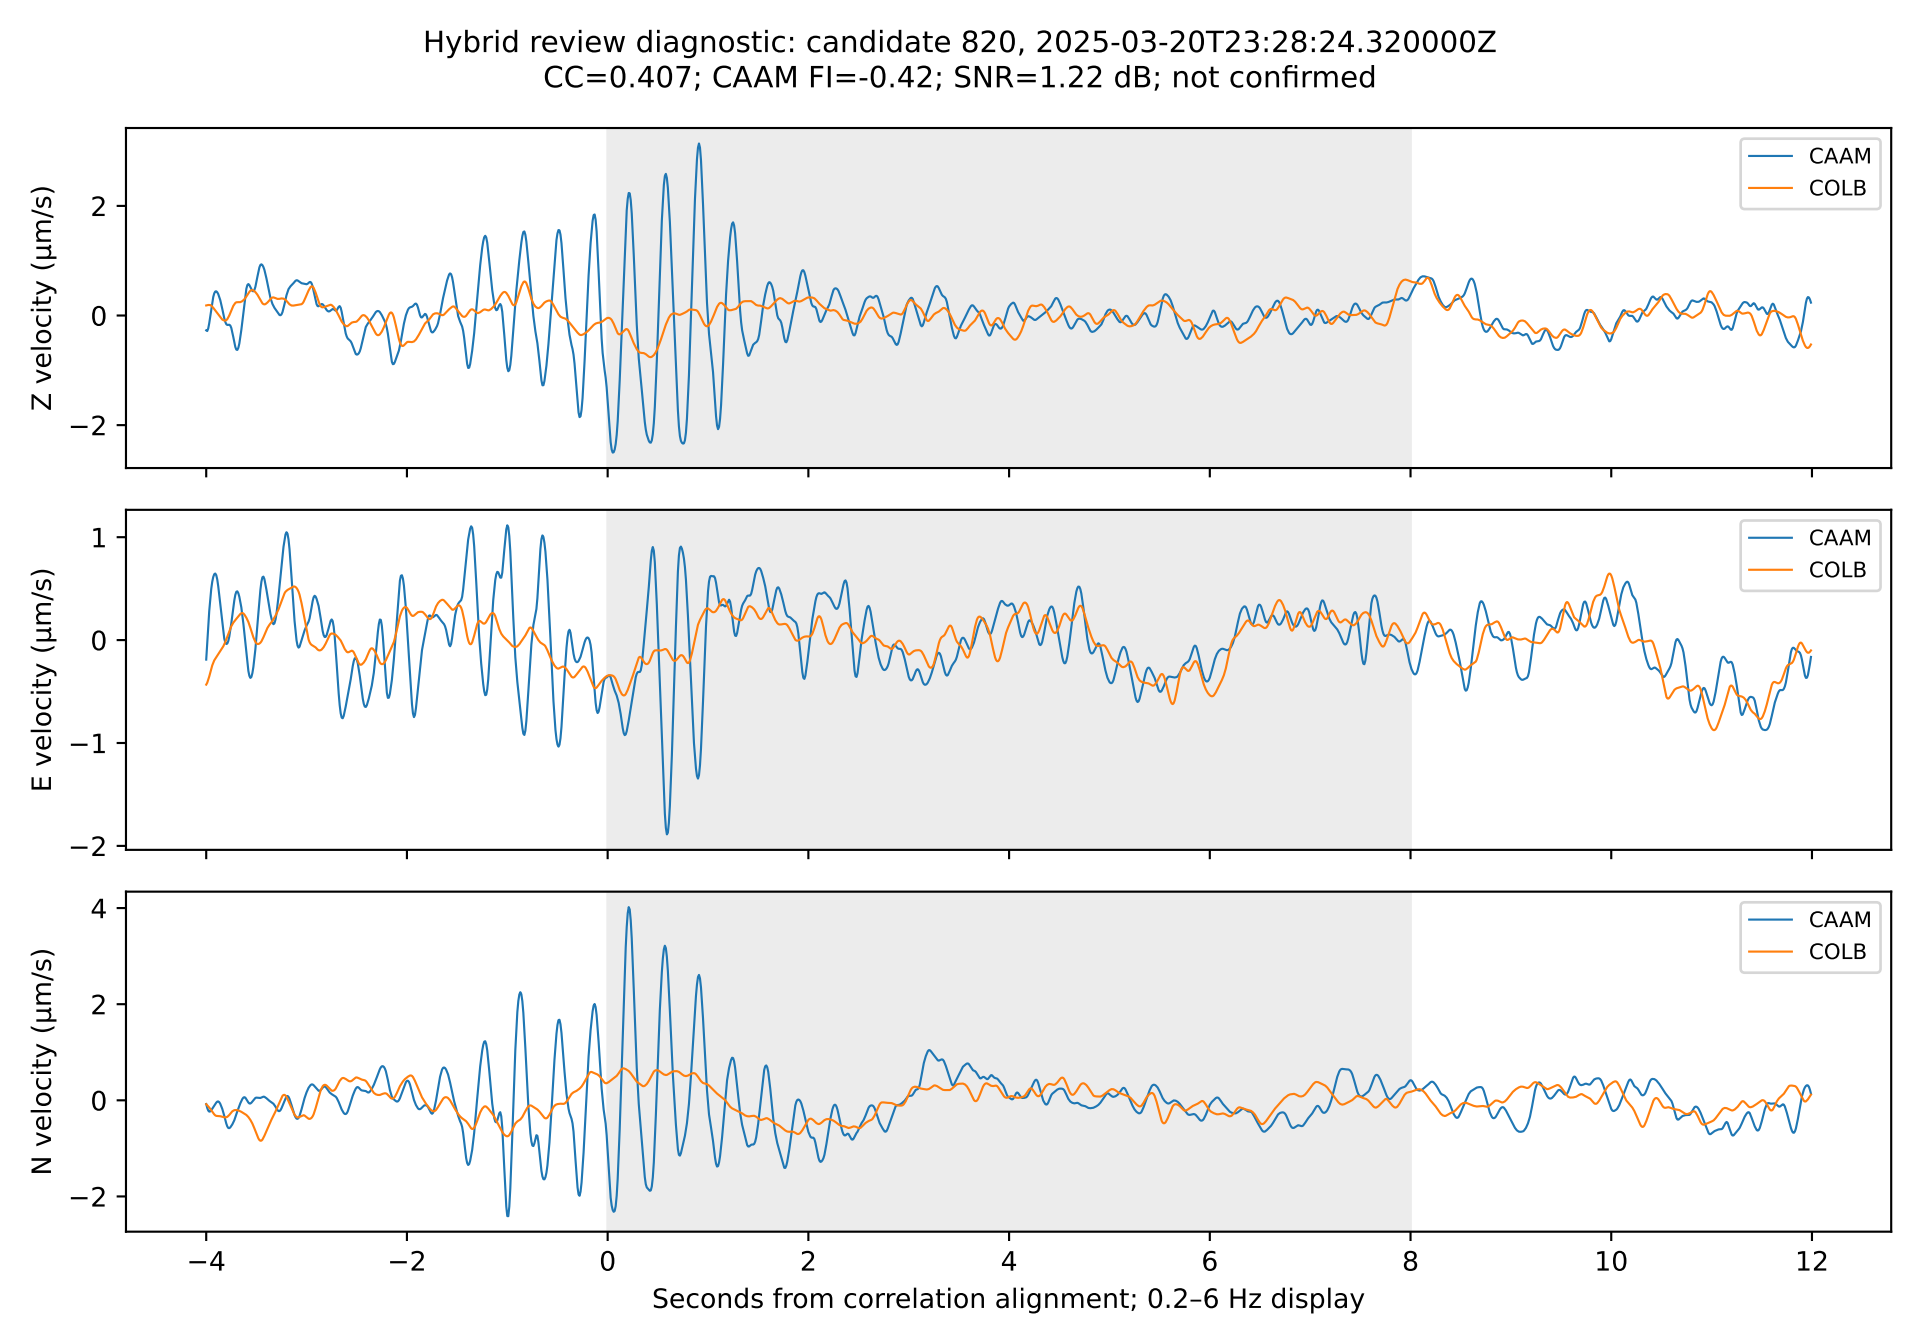

Hybrid review diagnostic: candidate 11, 2023-07-01T00:24:26.620000Z
CC=0.499; CAAM FI=-0.23; SNR=1.40 dB; not confirmed
CAAM
COLB
Z velocity (µm/s)
E velocity (µm/s)
N velocity (µm/s)
Seconds from correlation alignment; 0.2–6 Hz display


Hybrid review diagnostic: candidate 50, 2025-03-19T02:52:46.000000Z
CC=0.266; CAAM FI=1.17; SNR=26.78 dB; not confirmed
Z velocity (µm/s)
E velocity (µm/s)
N velocity (µm/s)
CAAM
COLB
Seconds from correlation alignment; 0.2–6 Hz display


Hybrid review diagnostic: candidate 337, 2025-03-19T22:27:39.220000Z
CC=0.434; CAAM FI=0.38; SNR=3.32 dB; not confirmed
Z velocity (µm/s)
E velocity (µm/s)
N velocity (µm/s)
CAAM
COLB
Seconds from correlation alignment; 0.2–6 Hz display


Hybrid review diagnostic: candidate 622, 2025-03-20T10:11:22.400000Z
CC=0.408; CAAM FI=0.03; SNR=-0.81 dB; not confirmed
Z velocity (µm/s)
E velocity (µm/s)
N velocity (µm/s)
CAAM
COLB
Seconds from correlation alignment; 0.2–6 Hz display


Hybrid review diagnostic: candidate 689, 2025-03-20T14:18:46.070000Z
CC=0.267; CAAM FI=1.08; SNR=22.63 dB; not confirmed
Z velocity (µm/s)
E velocity (µm/s)
N velocity (µm/s)
CAAM
COLB
Seconds from correlation alignment; 0.2–6 Hz display


Hybrid review diagnostic: candidate 820, 2025-03-20T23:28:24.320000Z
CC=0.407; CAAM FI=-0.42; SNR=1.22 dB; not confirmed
Z velocity (µm/s)
E velocity (µm/s)
N velocity (µm/s)
CAAM
COLB
Seconds from correlation alignment; 0.2–6 Hz display