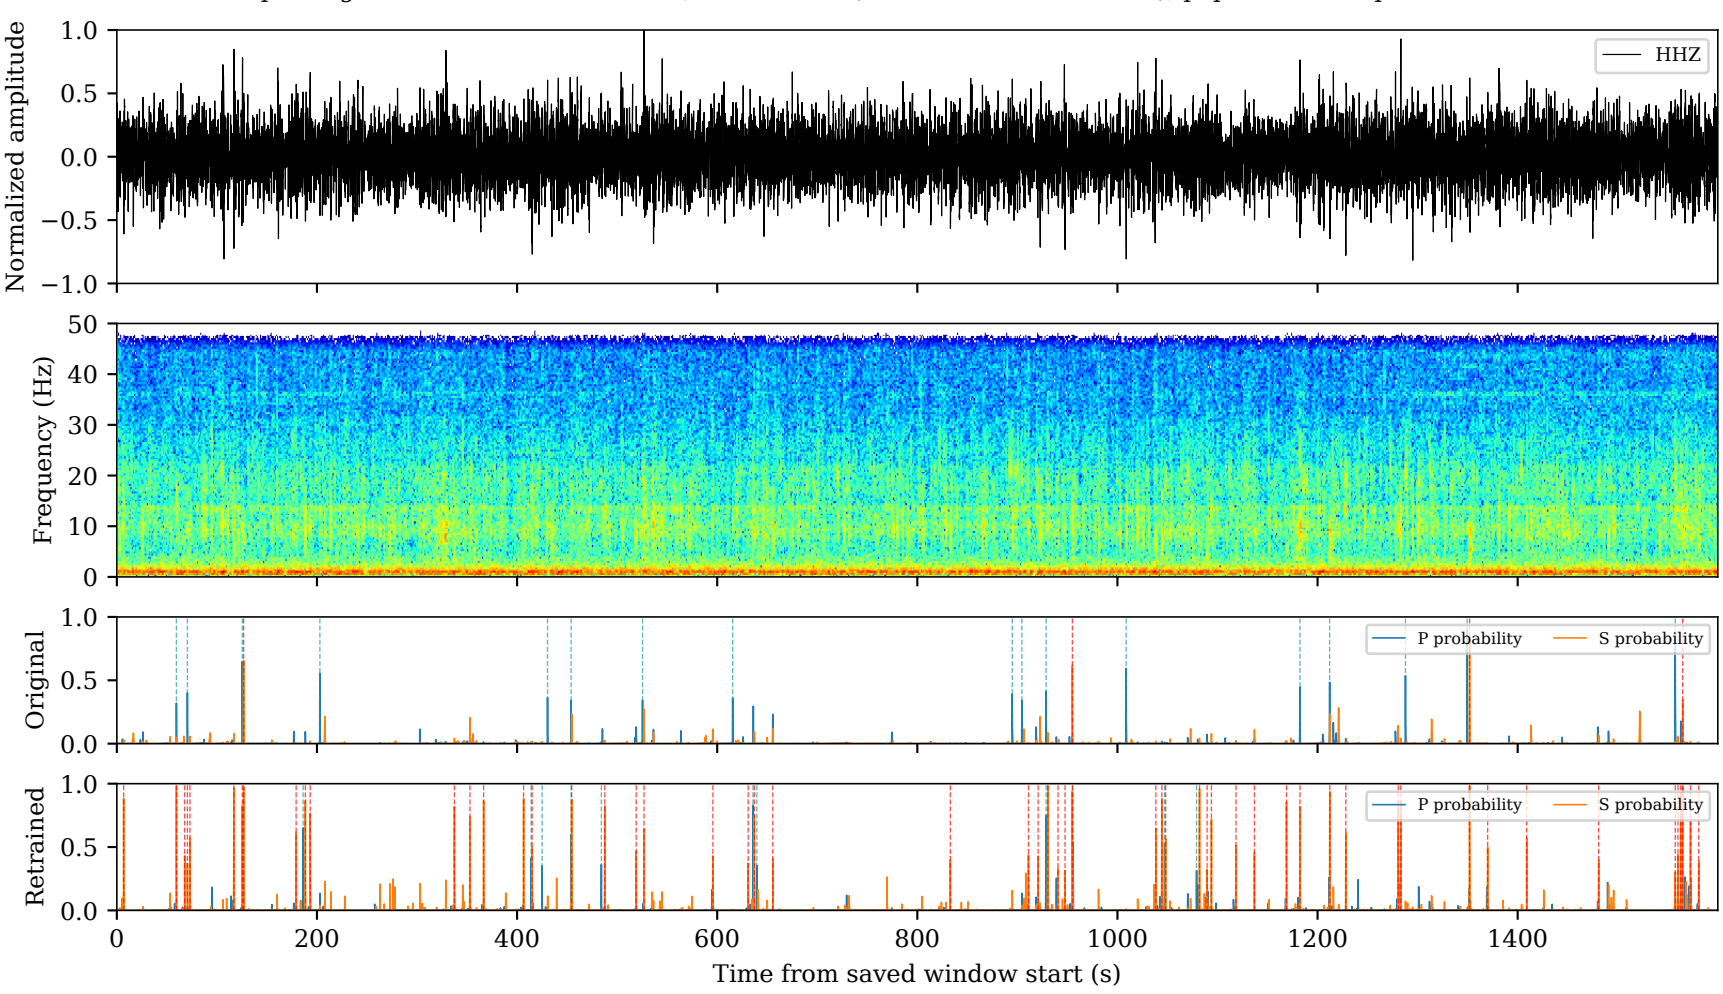

Reproduction diagnostic: separate calendar window, not S4
Spectrogram: normalized-count²/Hz, −80 to 0 dB (under white / over black); paper scale unspecified.
Normalized amplitude
1.0
0.5
0.0
−0.5
−1.0
HHZ
Frequency (Hz)
50
40
30
20
10
0
Original
1.0
0.5
0.0
P probability
S probability
Retrained
1.0
0.5
0.0
P probability
S probability
0
200
400
600
800
1000
1200
1400
Time from saved window start (s)