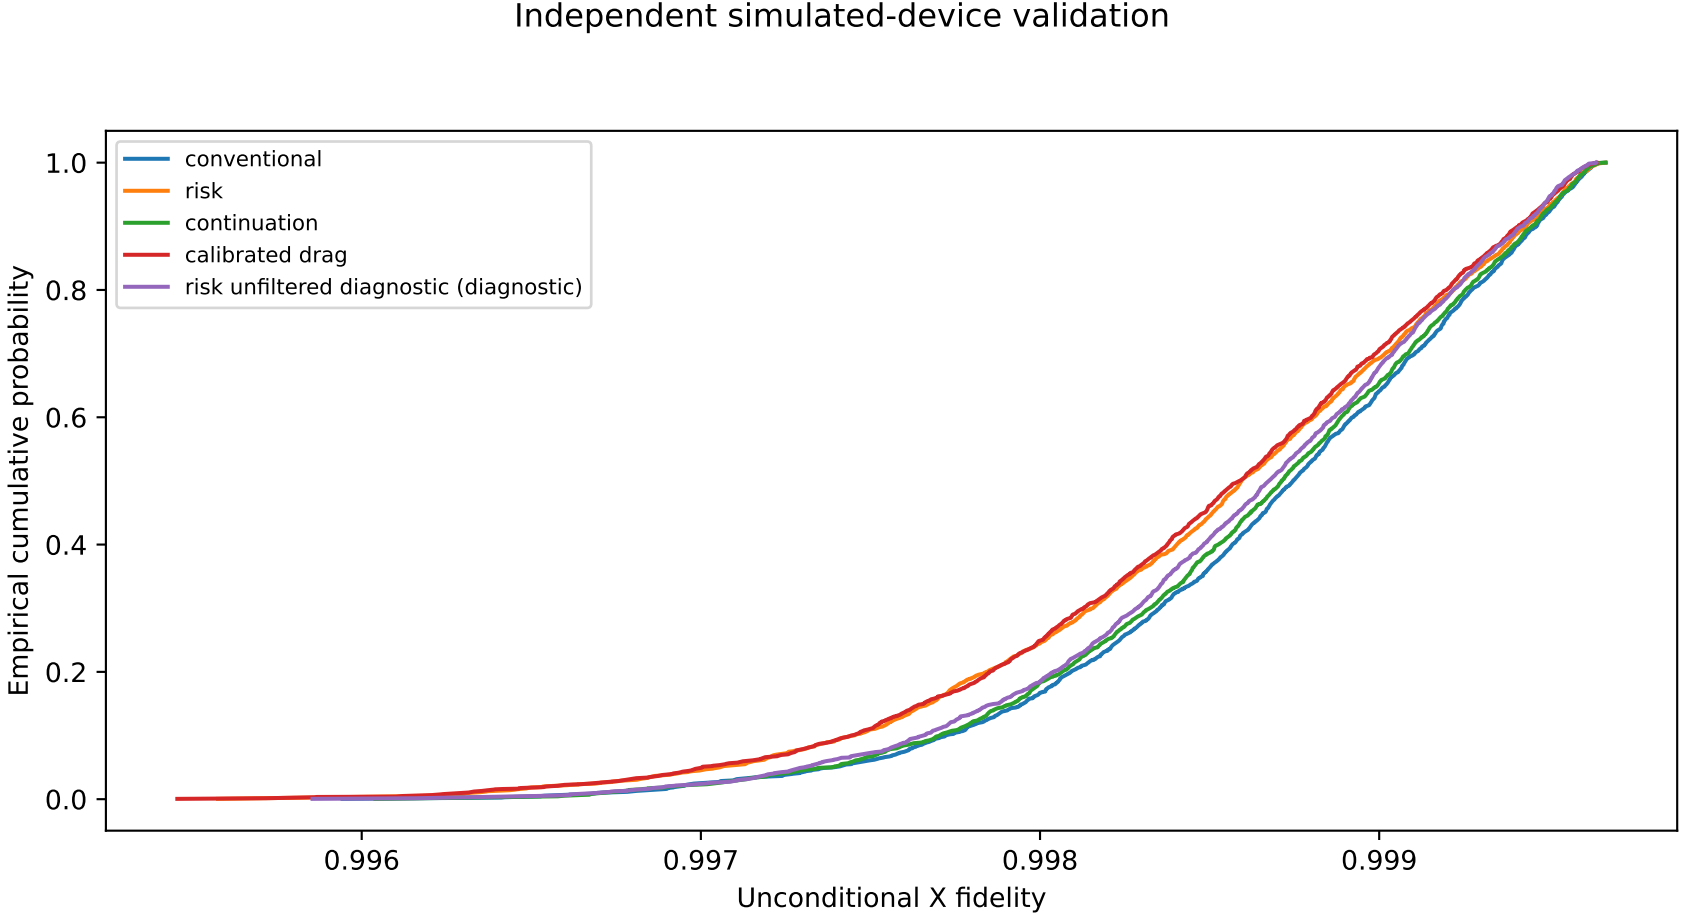
Independent simulated-device validation
conventional
risk
continuation
calibrated drag
risk unfiltered diagnostic (diagnostic)
Empirical cumulative probability
1.0
0.8
0.6
0.4
0.2
0.0
0.996
0.997
0.998
0.999
Unconditional X fidelity