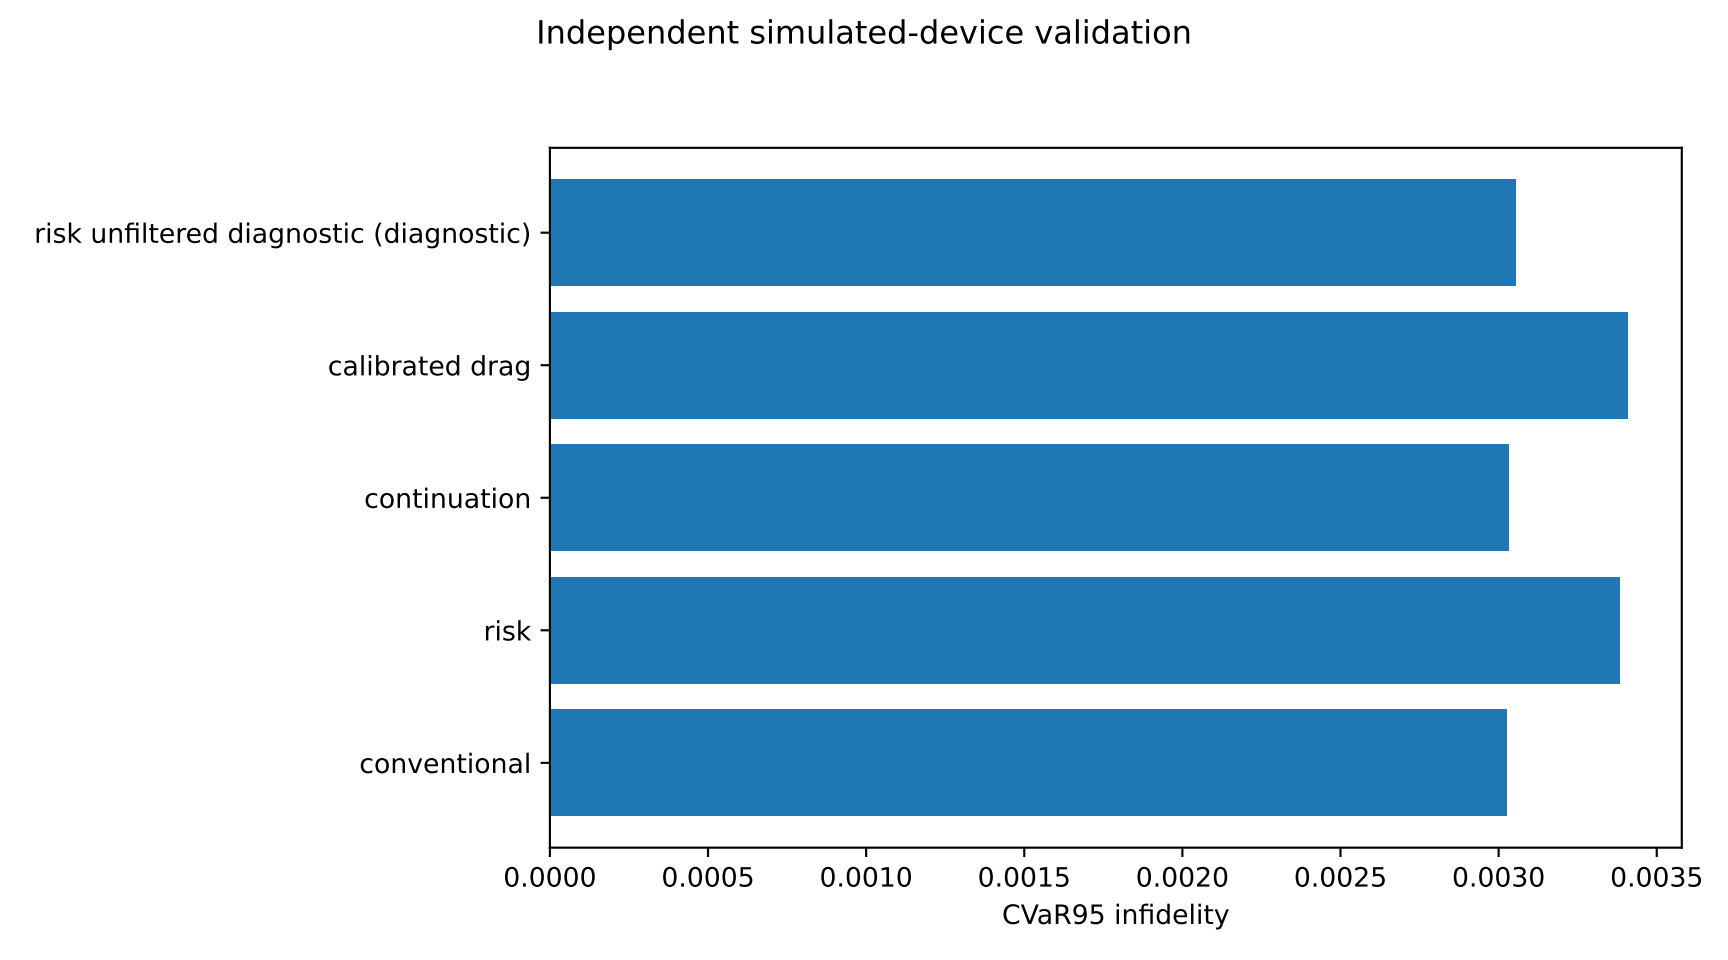
Independent simulated-device validation
risk unfiltered diagnostic (diagnostic)
calibrated drag
continuation
risk
conventional
0.0000
0.0005
0.0010
0.0015
0.0020
0.0025
0.0030
0.0035
CVaR95 infidelity