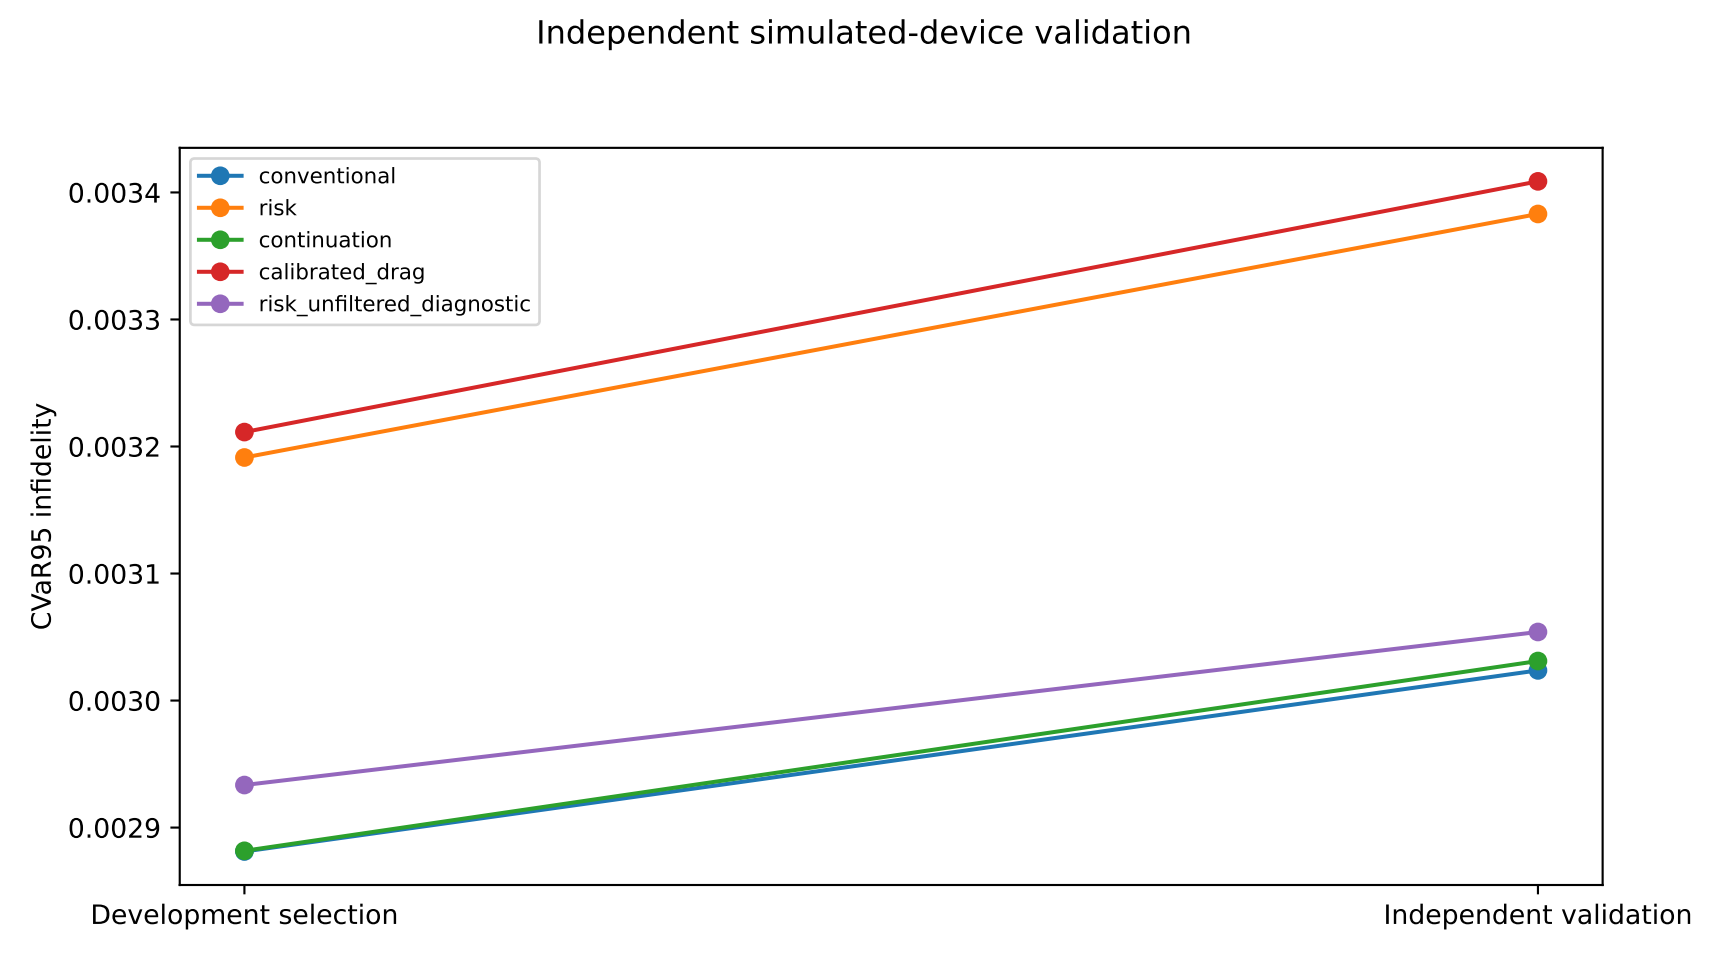
Independent simulated-device validation
conventional
risk
continuation
calibrated_drag
risk_unfiltered_diagnostic
CVaR95 infidelity
0.0034
0.0033
0.0032
0.0031
0.0030
0.0029
Development selection
Independent validation