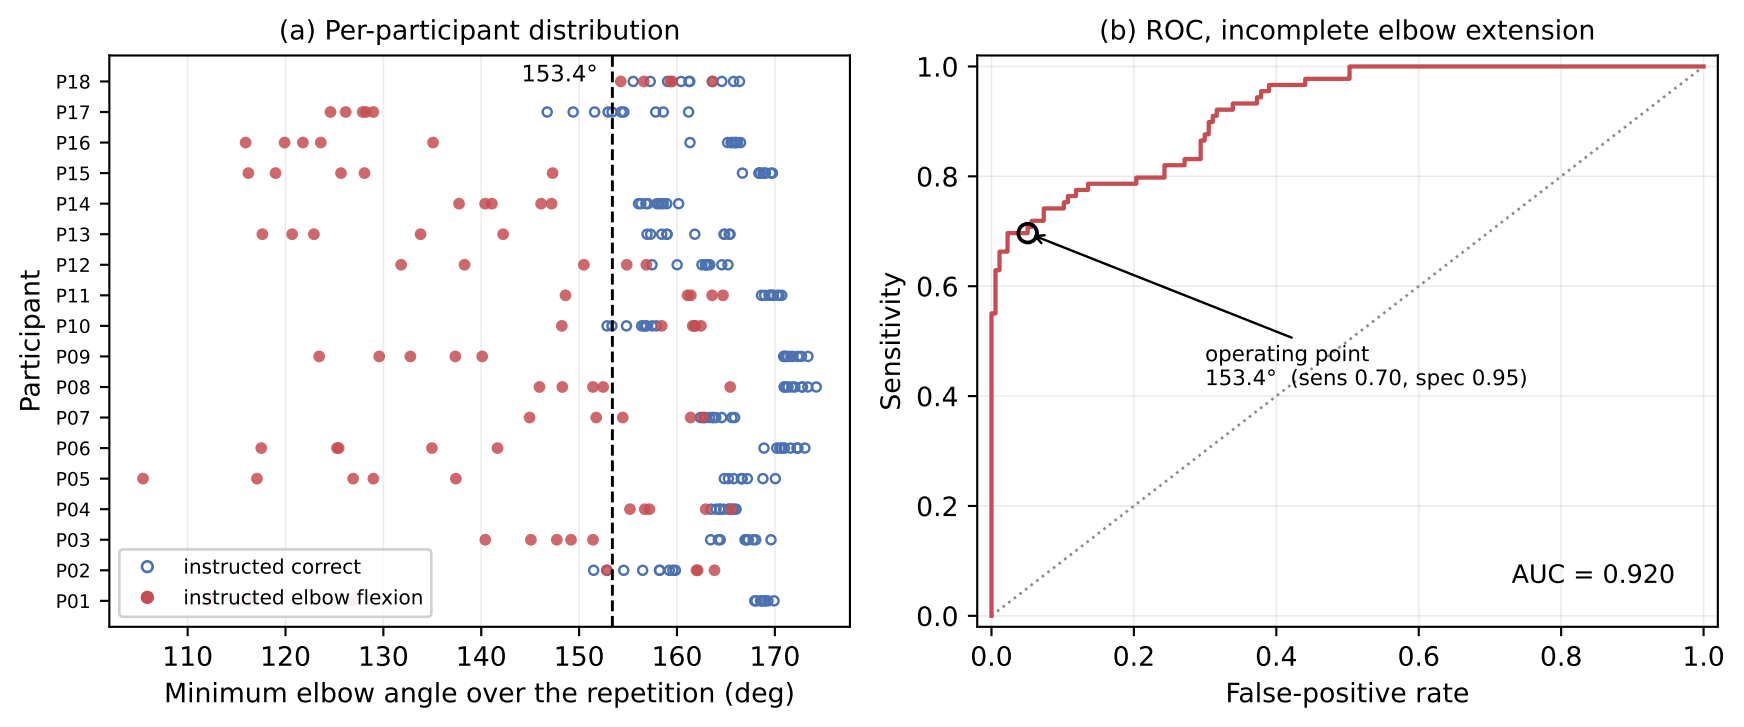
(a) Per-participant distribution
153.4°
P18
P17
P16
P15
P14
P13
P12
P11
P10
P09
P08
P07
P06
P05
P04
P03
P02
P01
Participant
instructed correct
instructed elbow flexion
110
120
130
140
150
160
170
Minimum elbow angle over the repetition (deg)
(b) ROC, incomplete elbow extension
1.0
0.8
0.6
0.4
0.2
0.0
Sensitivity
operating point
153.4° (sens 0.70, spec 0.95)
AUC = 0.920
0.0
0.2
0.4
0.6
0.8
1.0
False-positive rate