


(a) Sample efficiency under periodic 89°



(b) Sample efficiency under PML 45°

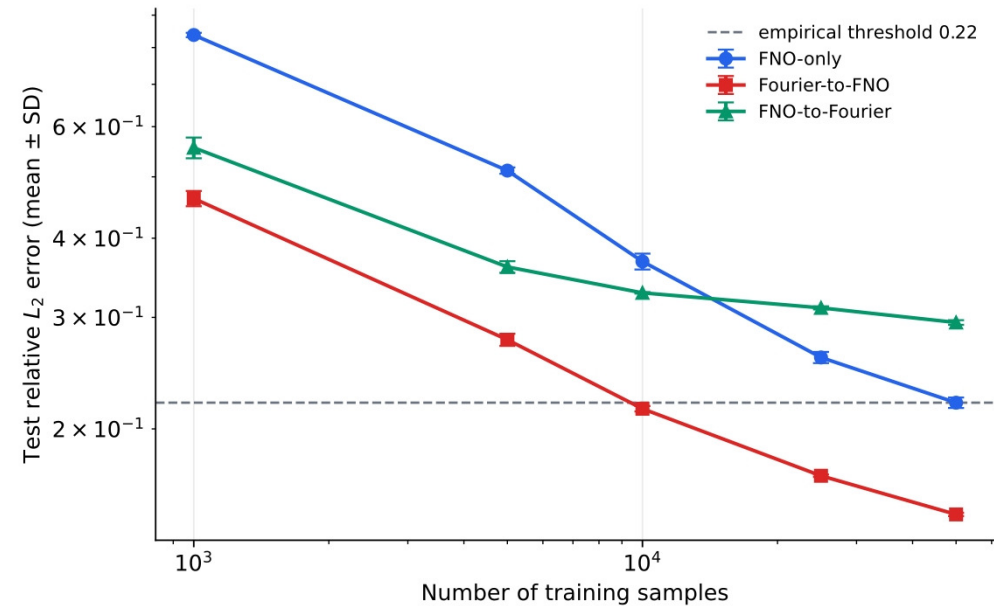