



AGGARWAL KAMIKAZES

CUTTING & CORING LTD.

123 Industrial Way, Burnaby BC V5A 1A1 · (604) 555-0199 · scans@aggarwalkamikazes.ca

PROJECT
AKCC-2026-0017

OPERATOR
D. Cunningham

DATE
2026-05-28

PROJECT INFORMATION

Site	1450 Industrial Way, Burnaby BC	Equipment	GSSI StructureScan Mini XT
Client	Pinnacle Structural Eng.	Slab type	200 mm two-way, post-tensioned
Structure	Level-2 parkade suspended deck	Coverage	3 grids · 6.2 m ²
Scan date	2026-05-28	Project no.	AKCC-2026-0017

SCAN SUMMARY

Ground-penetrating radar survey performed on the level-2 suspended deck to locate embedded reinforcement, post-tension cables and electrical conduit prior to core drilling at three proposed locations. Top-mat rebar identified at ~45 mm cover on 200 mm centres; a single post-tension tendon crosses Grid B on a diagonal; an electrical conduit run was detected beneath Grid C. Cores were assessed against a 50 mm minimum standoff to any marked target.

CORE CLEARANCE FINDINGS

CORE	SIZE	VERDICT	CLEARANCE & RECOMMENDATION
A	4"	SAFE	60 mm clear of all targets. Cleared to drill as marked.
B	6"	CAUTION	PT tendon within 25 mm — relocate 75 mm south and re-scan before drilling.
C	4"	NO-GO	Directly over conduit run. Do not drill; redesign required.

MARKED-UP LAYOUT


All targets were chalk-marked on the slab in the legend colours below. Proposed core centres are marked with their letter and verdict. A photographic record of each marked grid is included on the following pages.

SCAN LOCATION — GRID A (CORE A)

Grid A · Bay 1 mid-span

0.9 m × 0.9 m · depth scale 0-200 mm

COVER 45 mm	SPACING 200 mm	MAX DEPTH 165 mm	TARGETS Rebar only
----------------	-------------------	---------------------	-----------------------

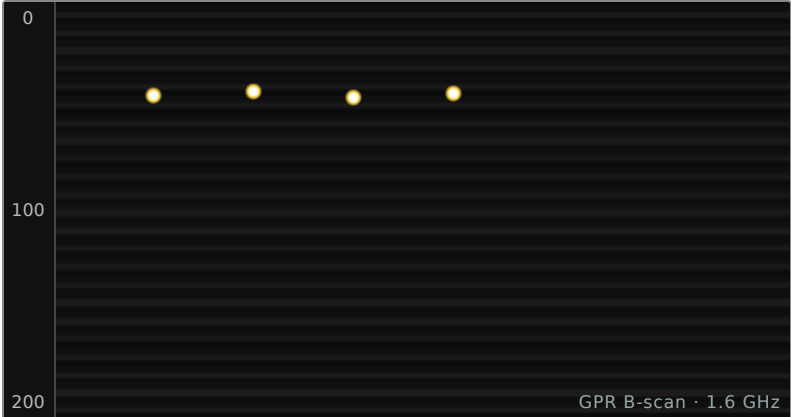

Rebar — top mat, ~45 mm

Post-tension tendon

Conduit / no-scan zone

Targets chalk-marked on slab in matching colours; marked-up photo on file.

Observation. Clear cone at the proposed core centre — no targets within 60 mm in any direction. Top mat consistent at ~45 mm cover. Safe to drill as marked.

SCAN LOCATION — GRID B (CORE B)

Grid B · Bay 2 column line

0.9 m × 0.9 m · depth scale 0-200 mm

COVER 45 mm	SPACING 200 mm	MAX DEPTH 180 mm	TARGETS Rebar + PT
----------------	-------------------	---------------------	-----------------------



Rebar — top mat, ~45 mm

Post-tension tendon

Conduit / no-scan zone

Targets chalk-marked on slab in matching colours; marked-up photo on file.

Observation. Post-tension tendon crosses on a diagonal within 25 mm of the proposed centre. Relocate the core 75 mm south, clear of the tendon envelope, and re-scan before drilling.

SCAN LOCATION — GRID C (CORE C)

Grid C · Bay 2 wall line

0.9 m × 0.9 m · depth scale 0–200 mm

COVER 45 mm	SPACING 200 mm	MAX DEPTH 120 mm	TARGETS Rebar + conduit
----------------	-------------------	---------------------	----------------------------



Rebar — top mat, ~45 mm

Post-tension tendon

Conduit / no-scan zone

Targets chalk-marked on slab in matching colours; marked-up photo on file.

GPR B-scan · 1.6 GHz

Observation. Energised electrical conduit detected directly beneath the proposed centre at ~110 mm. No-go — do not drill at this location; refer back to the EOR for a redesigned core position.

METHODOLOGY & STANDARD NOTES

- Survey performed with a GSSI StructureScan Mini XT (1.6 GHz) on orthogonal 50 mm line spacing.
- Depths are estimates based on an assumed dielectric for cured concrete and are ±15%.
- Targets marked on the slab supersede this report where any discrepancy exists.
- Clearances reference the marked grid origin; verify on site before cutting.

Limitations. GPR results are interpretive and depend on moisture, cover and congestion. Non-metallic and deeply embedded targets may not be detected. Aggarwal Kamikazes Cutting & Coring Ltd. accepts no liability for drilling outside the cleared zones described above. Report valid for the slab, locations and date stated.

SCANNED BY D. Cunningham · GPR Technician	DATE 2026-05-28
REVIEWED BY	PROJECT NO. AKCC-2026-0017

Aggarwal Kamikazes Cutting & Coring Ltd.

CONFIDENTIAL — FOR THE NAMED RECIPIENT

Page 3 of 3 · AKCC-2026-0017