

ACCESS CONTROL COMPLETION AND HANDOVER

NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance


AC01 | Pacific template revision 01 | 16 September 2026

JOB AND SYSTEM IDENTITY

Customer organisation	Customer representative
Site address	Simpro job number
Project / work title	Engineer / survey date
Work type	System state at visit
Select...	Select...

DESIGN AND RISK BASIS

Security risk / user requirements reference	Design / variation reference
Existing system / certification information	Fire strategy / responsible person / BS 7273-4 evidence
Agreed scope, areas, exclusions and protection objectives	
Simpro accepted quote baseline and installed versus quoted summary	

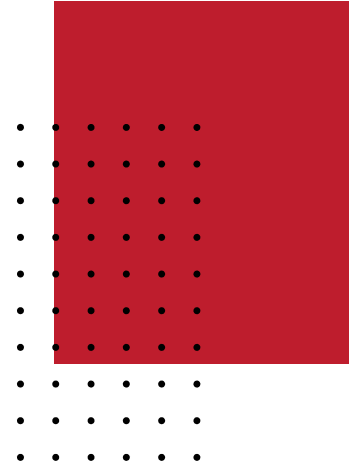

ACCESS CONTROL COMPLETION AND HANDOVER


NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance

AC01 | Pacific template revision 01 | 16 September 2026

SAFE EGRESS AND DOOR CLASSIFICATION

Assess each access-controlled door individually. Record escape route, fire compartment and occupancy considerations. Do not allow access security to compromise emergency egress.

Door population / schedule reference	Risk assessment completed
	Select...
☐ Escape route considered	☐ Fire strategy considered
☐ Visitor / accessibility needs considered	☐ Responsible person consulted
Applicable escape hardware basis	Design decision / evidence reference
Select...	
Door classification, egress method, fail-safe / fail-secure rationale and product certification limitations	

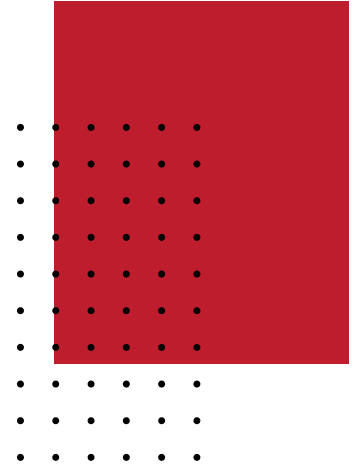

ACCESS CONTROL COMPLETION AND HANDOVER


NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance

AC01 | Pacific template revision 01 | 16 September 2026

ACCESS POINT SCHEDULE

Record actual installed doors and hardware. Use the result and evidence fields on the following page for functional tests. Add a continuation page when the schedule is longer than the rows provided.

Door / area	Door purpose / escape	Reader / credential	Lock / release	Fire / egress basis	Asset / ref
	Select...			Select...	
	Select...			Select...	
	Select...			Select...	
	Select...			Select...	
	Select...			Select...	
	Select...			Select...	
	Select...			Select...	
	Select...			Select...	

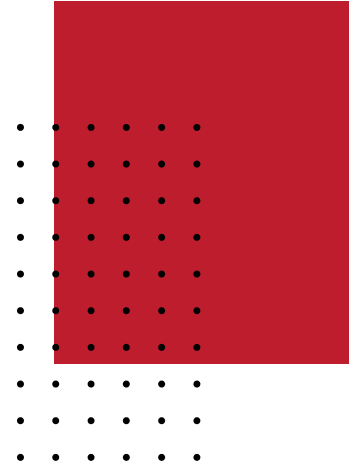


ACCESS CONTROL COMPLETION AND HANDOVER

NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance

AC01 | Pacific template revision 01 | 16 September 2026

CONTROLLER, READER AND RELEASE OVERVIEW

Controller / panel make and model	Location / asset reference
Software / firmware version	Network / communications method
Recognition technology	Credential type and issue method
Interface details: fire alarm, break-glass, request-to-exit, door-held, intercom, lift or other systems	
Installed quantities, serial references and differences from the accepted quote	

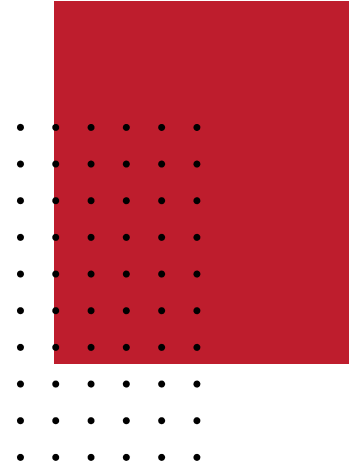

ACCESS CONTROL COMPLETION AND HANDOVER


NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance

AC01 | Pacific template revision 01 | 16 September 2026

OPERATIONAL AND LIFE-SAFETY CHECKS

Select the result for each applicable check. If a check fails or is not tested, record the reason and action below.

Check	Result	Evidence
Wiring is correctly terminated, supported and labelled at equipment and door endpoints	Select...	☐
Voltage and resistance readings are recorded for appropriate points and are within the approved limits	Select...	☐
Each reader accepts an authorised credential and rejects an unauthorised credential	Select...	☐
Each controlled door opens, closes, latches and aligns correctly	Select...	☐
Request-to-exit operation releases the door without creating an unsafe condition	Select...	☐
Emergency release / break-glass devices operate and are restored correctly	Select...	☐
Door-held monitoring and local indication operate where specified	Select...	☐

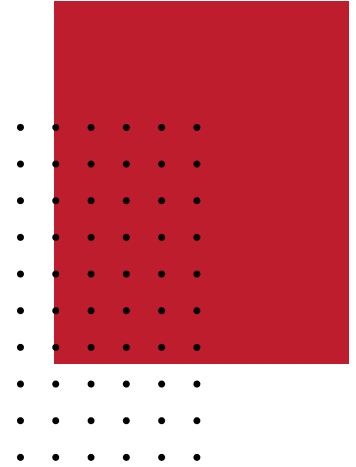

ACCESS CONTROL COMPLETION AND HANDOVER

NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance

AC01 | Pacific template revision 01 | 16 September 2026

OPERATIONAL AND LIFE-SAFETY CHECKS - CONTINUATION


Select the result for each applicable check. If a check fails or is not tested, record the reason and action below.

Check	Result	Evidence
Power failure and fire alarm release operate as designed for the door and fire strategy	Select...	☐
Escape remains single-action and immediate where BS EN 179 / 1125 / 13637 applies	Select...	☐
Controller, software, time, permissions and audit events operate within the agreed scope	Select...	☐
Standby power operates for the specified duty and recovery after mains restoration is verified	Select...	☐
CCTV, intercom, lift, intruder or other interfaces operate end to end where included	Select...	☐

Test instrument / reference	Applicable electrical edition / evidence

Recorded readings, expected limits, test conditions and linked evidence

Failures, inaccessible points, departures, untested items and corrective actions

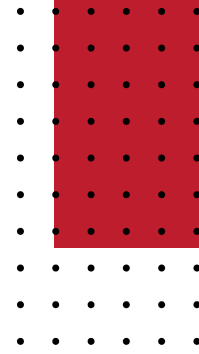

ACCESS CONTROL COMPLETION AND HANDOVER

NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance


AC01 | Pacific template revision 01 | 16 September 2026

TAKEOVER, UPGRADE AND MAINTENANCE RECORD

Existing provider / system age	Previous certificate / records available
	Select...
Compatibility / support / licence position	Account and credential custody arranged
	Select...
Takeover condition, missing records, inaccessible equipment and limits of verification	
Upgrade or corrective work: quoted scope, actual work, retained equipment and regression tests	
Final operational state	Outstanding action owner / due date
Select...	

DOCUMENTS AND USER INFORMATION

☐ As-fitted record	☐ Door schedule / drawings	☐ User instructions
☐ Logbook	☐ Maintenance details	☐ Certificate recorded separately
Training status	Training date / attendance record	
Select...		
Training topics, support procedure, emergency release precautions and information supplied		

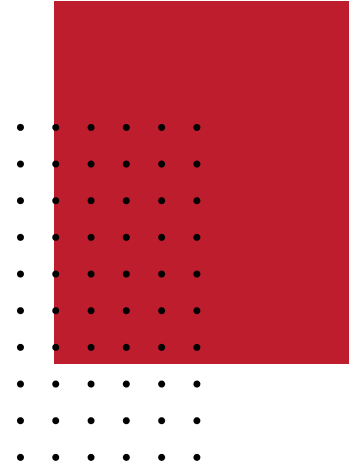

ACCESS CONTROL COMPLETION AND HANDOVER

NCP 109 Issue 4 | one standalone record for installation, takeover, upgrade and maintenance

AC01 | Pacific template revision 01 | 16 September 2026

COMPLETION AND HANDOVER

This standalone record covers the stated scope and event. The customer acknowledgement is for receipt and demonstration; technical responsibility remains with the installer and technical reviewer.

Handover reference / revision	Handover date / time
System status at handover	Monitoring / support status
Select...	Select...
Documents, keys, credentials and instructions handed over; changes, restrictions, disconnections, incomplete work and customer agreement details. Do not enter passwords or PINs in this record.	

SIGN-OFF

Engineer: I confirm that the recorded work and test results reflect the stated scope. Any limitations, failures or departures are recorded above.

Engineer name	Date / time
Engineer signature / signed record reference	Technical reviewer / date

Customer acknowledgement: I confirm receipt of the stated handover information and demonstration for this event. The customer does not certify the engineer's technical measurements or waive an unresolved failure.

Customer name / authorised role	Customer signature / date

Complete this additional acceptance only when a specific change, restriction, disconnection or incomplete item requires customer agreement.

Specific change or limitation accepted	Customer acceptance signature / date

Use with the controlled NCP 109 Issue 4 procedure, fire strategy, BS 7273-4 and building requirements. This company form is not an NSI certificate.