




INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance


IA01 | Pacific template revision 01 | 16 September 2026

JOB AND SYSTEM IDENTITY

Customer organisation	Customer representative
Site address	Simpro job number
Project / work title	Engineer / survey date
Work type	System state at visit
Select...	Select...

DESIGN, GRADE AND SIGNALLING

Alarm grade / class	Signalling category / route
Select...	Select...
Police / NPCC / Police Scotland requirement	Design / risk assessment reference
Protected areas, user requirements, setting / unsetting arrangements, exclusions and agreed scope	
Applicable standards and editions: NCP 120, PD 6662, BS 8243, BS 9263, BS 7671 and product requirements	
Simpro accepted quote baseline and installed versus quoted summary	

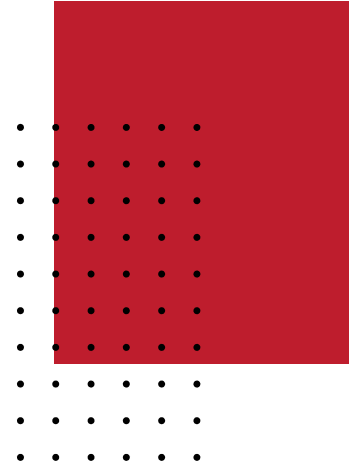


INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

AS-FITTED OVERVIEW

Panel / control equipment make and model	Panel location / asset reference
Software / firmware version	As-fitted record / revision

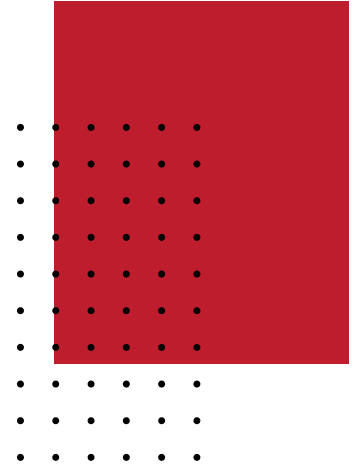

INTRUDER ALARM COMPLETION AND HANDOVER


NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

DETECTION AND DEVICE SCHEDULE

Record actual installed devices and circuit or wireless information. Use continuation pages when the schedule is longer than the rows provided. Never enter user or engineer codes in this record.

Zone / device	Location / area	Type / make / model	Wired / wireless	Reading / signal	Asset / ref
			Select...		
			Select...		
			Select...		
			Select...		
			Select...		
			Select...		
			Select...		
			Select...		

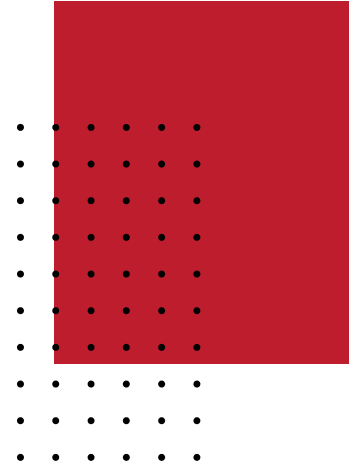


INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

CONTROL EQUIPMENT AND WARNING DEVICES

Expanders / keypads / readers	Warning devices / locations
PSU / battery make, model and capacity	Battery date / replacement due
Interfaces: ARC, fire alarm, CCTV, lighting, smoke control, hold-up or other connected equipment	
Installed quantities, serial references and changes from the accepted quote	

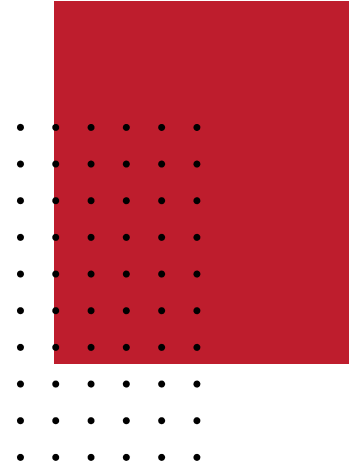

INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance


IA01 | Pacific template revision 01 | 16 September 2026

ELECTRICAL READINGS AND PROGRAMMED PARAMETERS

Panel / PSU test date and engineer		Instrument ID / calibration reference			

Supply / asset	Charging V DC	Standby mA	Alarm mA	Battery Ah / calculation	Evidence ref

Circuit resistance, tamper resistance, device voltage, wireless strength and test conditions



INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

SETTINGS AND RESPONSE


Exit time (seconds)	Entry time (seconds)	Sounder duration / delay

Confirmation method / timing	Reset method	Fault / tamper response
	Select...	Select...

Mains / battery duty required	Calculated / approved capacity

Battery calculation method, standby period, alarm duration, manufacturer limits and applicable evidence

Programmed areas, event types, ARC account / test reference and signalling path notes. Do not enter signalling secrets.



INTRUDER ALARM COMPLETION AND HANDOVER


NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

COMMISSIONING AND COMPLIANCE CHECKS

Select the result for each applicable check. If a check fails or is not tested, record the reason and action below.

Check	Result	Evidence
Installed components match the agreed grade and applicable system specification	Select...	☐
Detection, control, warning and signalling equipment is compatible and correctly installed	Select...	☐
Cabling, supports, labels, segregation and electrical supply evidence are complete	Select...	☐
All detection zones and devices operate, identify correctly and restore correctly	Select...	☐
Device, enclosure, back-tamper and wireless supervision functions are tested where applicable	Select...	☐
Walk test covers all circuits and areas; masking is tested where specified or required	Select...	☐
Setting, exit completion, entry, unsetting, reset, inhibit and fault indications operate correctly	Select...	☐
Warning devices operate and final exit tones / indications are satisfactory	Select...	☐
Mains failure, battery operation, supply faults and restoration are verified	Select...	☐
Required ARC signals and transmission paths are triggered, received and acknowledged	Select...	☐
Hold-up, confirmation, tamper, fault, set / unset and other required signals are tested	Select...	☐
Grade-specific and wireless requirements are checked and recorded	Select...	☐
Final keypad / panel status is normal and test modes or temporary isolations are cleared	Select...	☐
User training, logbook, operating instructions and support arrangements are issued	Select...	☐

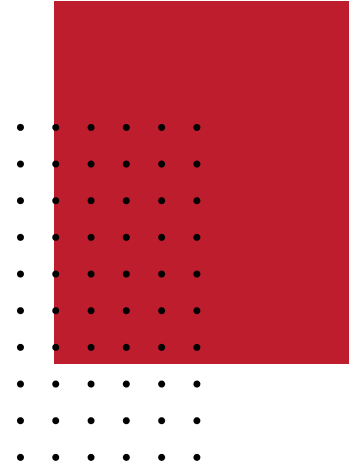

INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

COMMISSIONING FINDINGS AND TRANSFER EVIDENCE

ARC / monitoring test reference	Police / response status


Failures, deviations, untested items, restricted access and corrective actions

TAKEOVER AND UPGRADE EVIDENCE

Existing provider / system age	Records / certificate available
	Select...

Takeover condition, compatibility, missing records, protected areas not verified and maintenance transfer actions

Upgrade or corrective work: quoted scope, actual work, retained equipment and regression tests



INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

COMPLETION AND HANDOVER

This standalone record covers the stated scope and event. The customer acknowledgement covers receipt and demonstration; it does not certify measurements, resolve a failure or replace the separately issued certificate where applicable.

Handover reference / revision	Handover date / time
System status at handover	Signalling / monitoring status
Select...	Select...

DOCUMENTS AND TRAINING


☐ As-fitted record	☐ Zone / drawing schedule	☐ User instructions
☐ Logbook	☐ Maintenance details	☐ Certificate recorded separately

Training status	Training date / attendance record
Select...	

Topics demonstrated: setting / unsetting, alarms, faults, hold-up, false alarm prevention, logbook and support

Keys, fobs, reset arrangements and operating information handed over. Do not enter codes or passwords in this record.

Changes, restrictions, disconnections, incomplete work and customer agreement details



INTRUDER ALARM COMPLETION AND HANDOVER

NCP 120 Issue 1 | one standalone record for installation, takeover, upgrade and maintenance

IA01 | Pacific template revision 01 | 16 September 2026

SIGN-OFF

Engineer: I confirm that the recorded work and test results reflect the stated scope. Any limitations, failures or departures are recorded above.

Engineer name	Date / time
Engineer signature / signed record reference	Technical reviewer / date

Customer acknowledgement: I confirm receipt of the stated handover information and demonstration for this event. The customer does not certify the engineer's technical measurements or waive an unresolved failure.

Customer name / authorised role	Customer signature / date

Complete this additional acceptance only when a specific change, restriction, disconnection or incomplete item requires customer agreement.

Specific change or limitation accepted	Customer acceptance signature / date

NCP 120 Issue 1 requires controlled completion evidence, recording of deviations and uncompleted tests, transfer arrangements where maintenance changes, and appropriate customer communication. Use the applicable current standards, police requirements and company procedure. This company form is not an NSI certificate.