
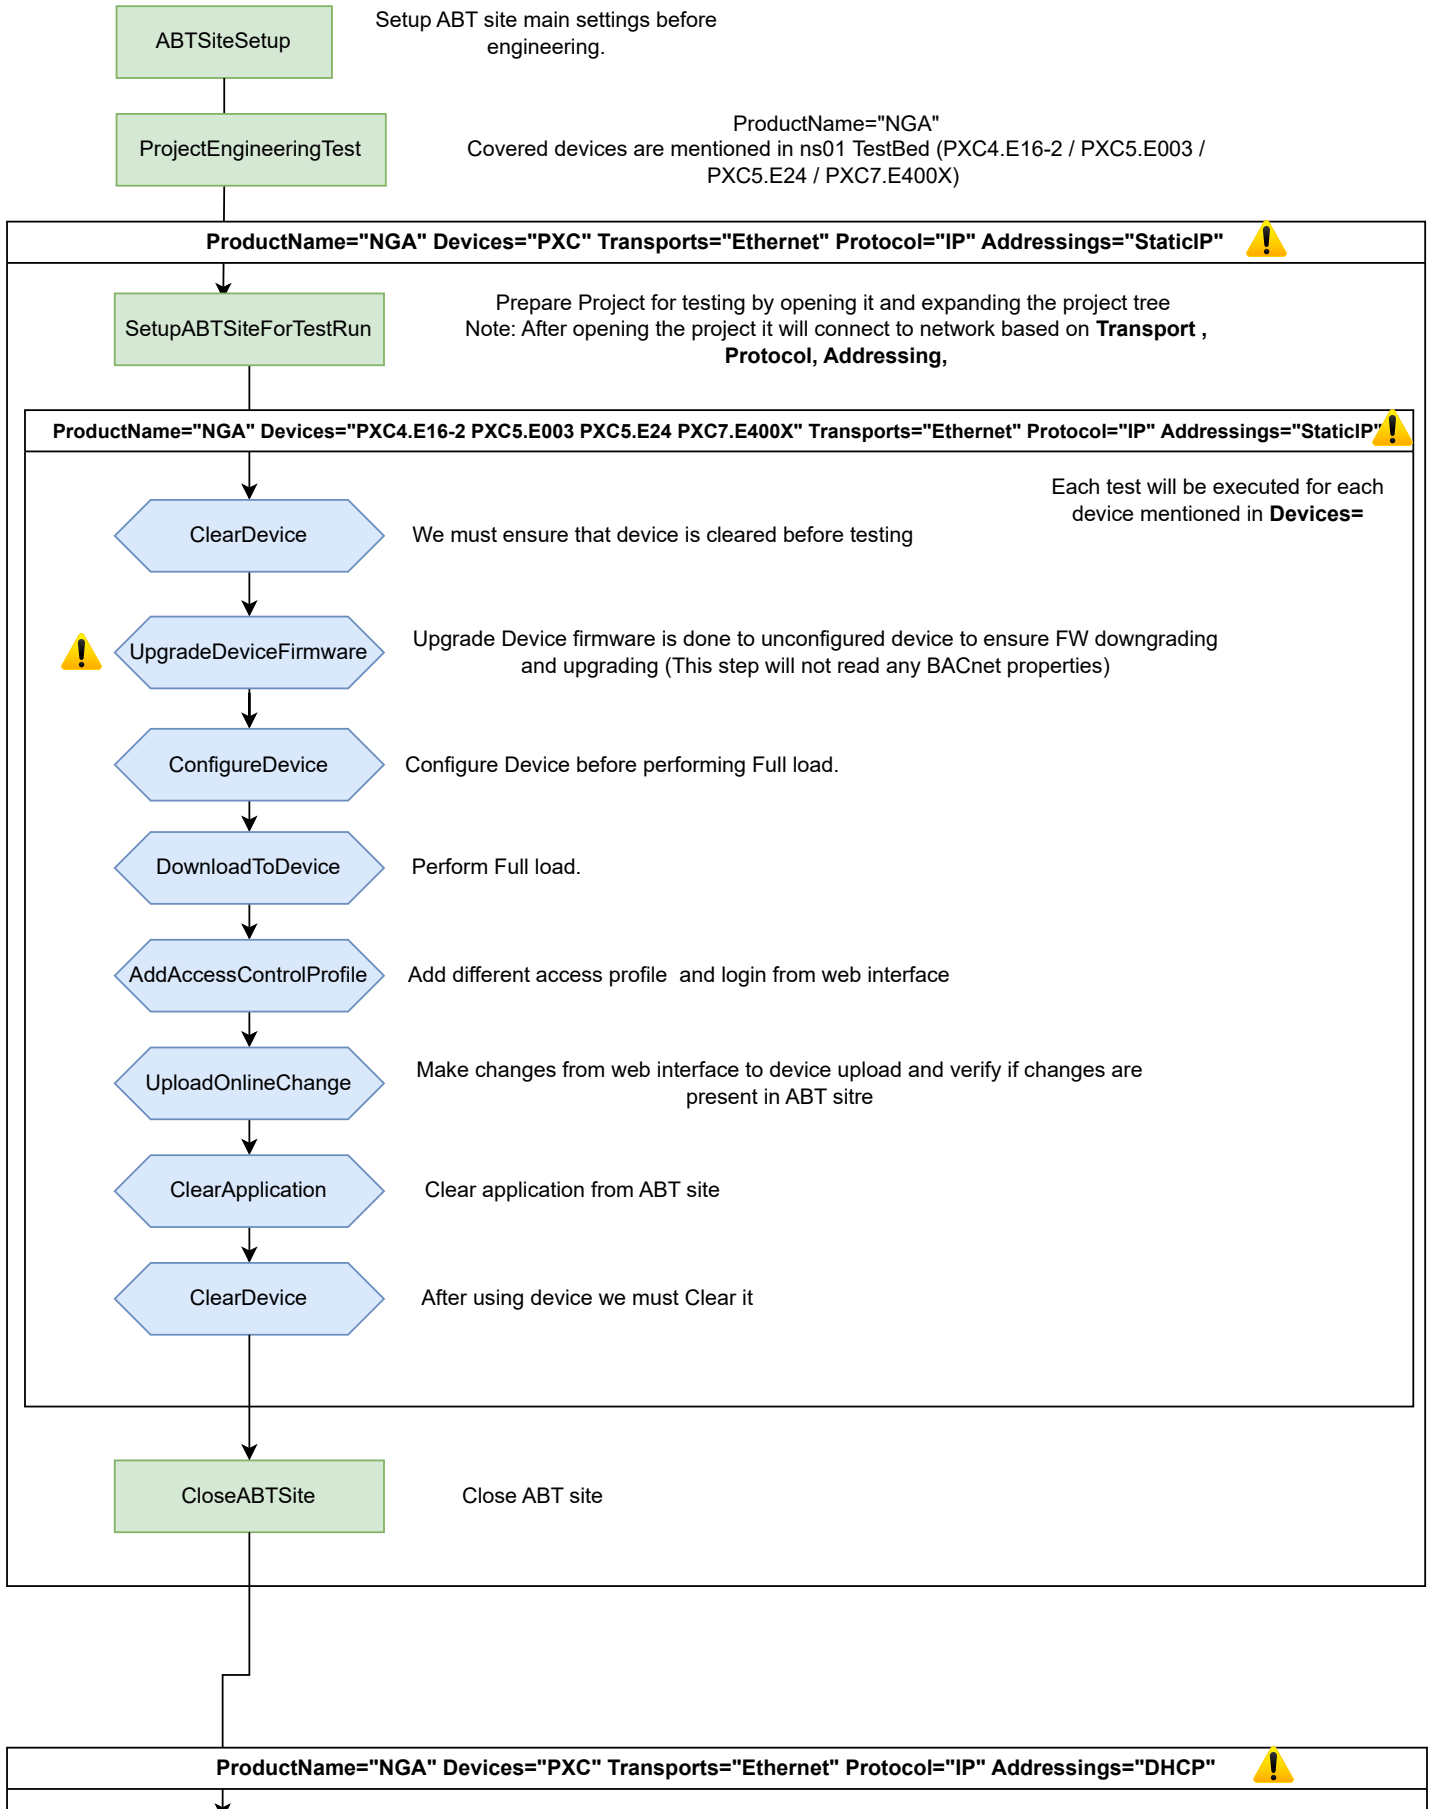


DVS_NWSec_NGA_NIGHTLY Testsuite
working principle and logic

Author: metin.hasanov@siemens.com

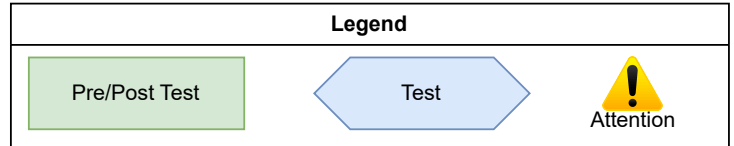

SetupABTSiteForTestRun

Prepare Project for testing by opening it and expanding the project tree
Note: After opening the project it will connect to network based on **Transport** ,
Protocol, Addressing,

ProductName="NGA" Devices="PXC4.E16-2 PXC5.E003 PXC5.E24 PXC7.E400X" Transports="Ethernet" Protocol="IP" Addressings="DHCP" !

ClearDevice

We must ensure that device is cleared before testing

Each test will be executed for each device mentioned in **Devices=**

ConfigureDevice

Configure Device before Upgrading FW

! UpgradeDeviceFirmware

Upgrade Device firmware to configured device and read BACnet properties

DownloadToDevice

Perform Full load.

AddAccessControlProfile

Add different access profile and login from web interface

UploadOnlineChange

Make changes from web interface to device upload and verify if changes are present in ABT site

ClearApplication

Clear application from ABT site

ClearDevice

After using device we must Clear it

BACnetSC_ClearDeviceOverSSH

Clear device over SSH (for some reason if Clear device failed over ABT site)