




Five Most Common Parameters Tested For (2018)

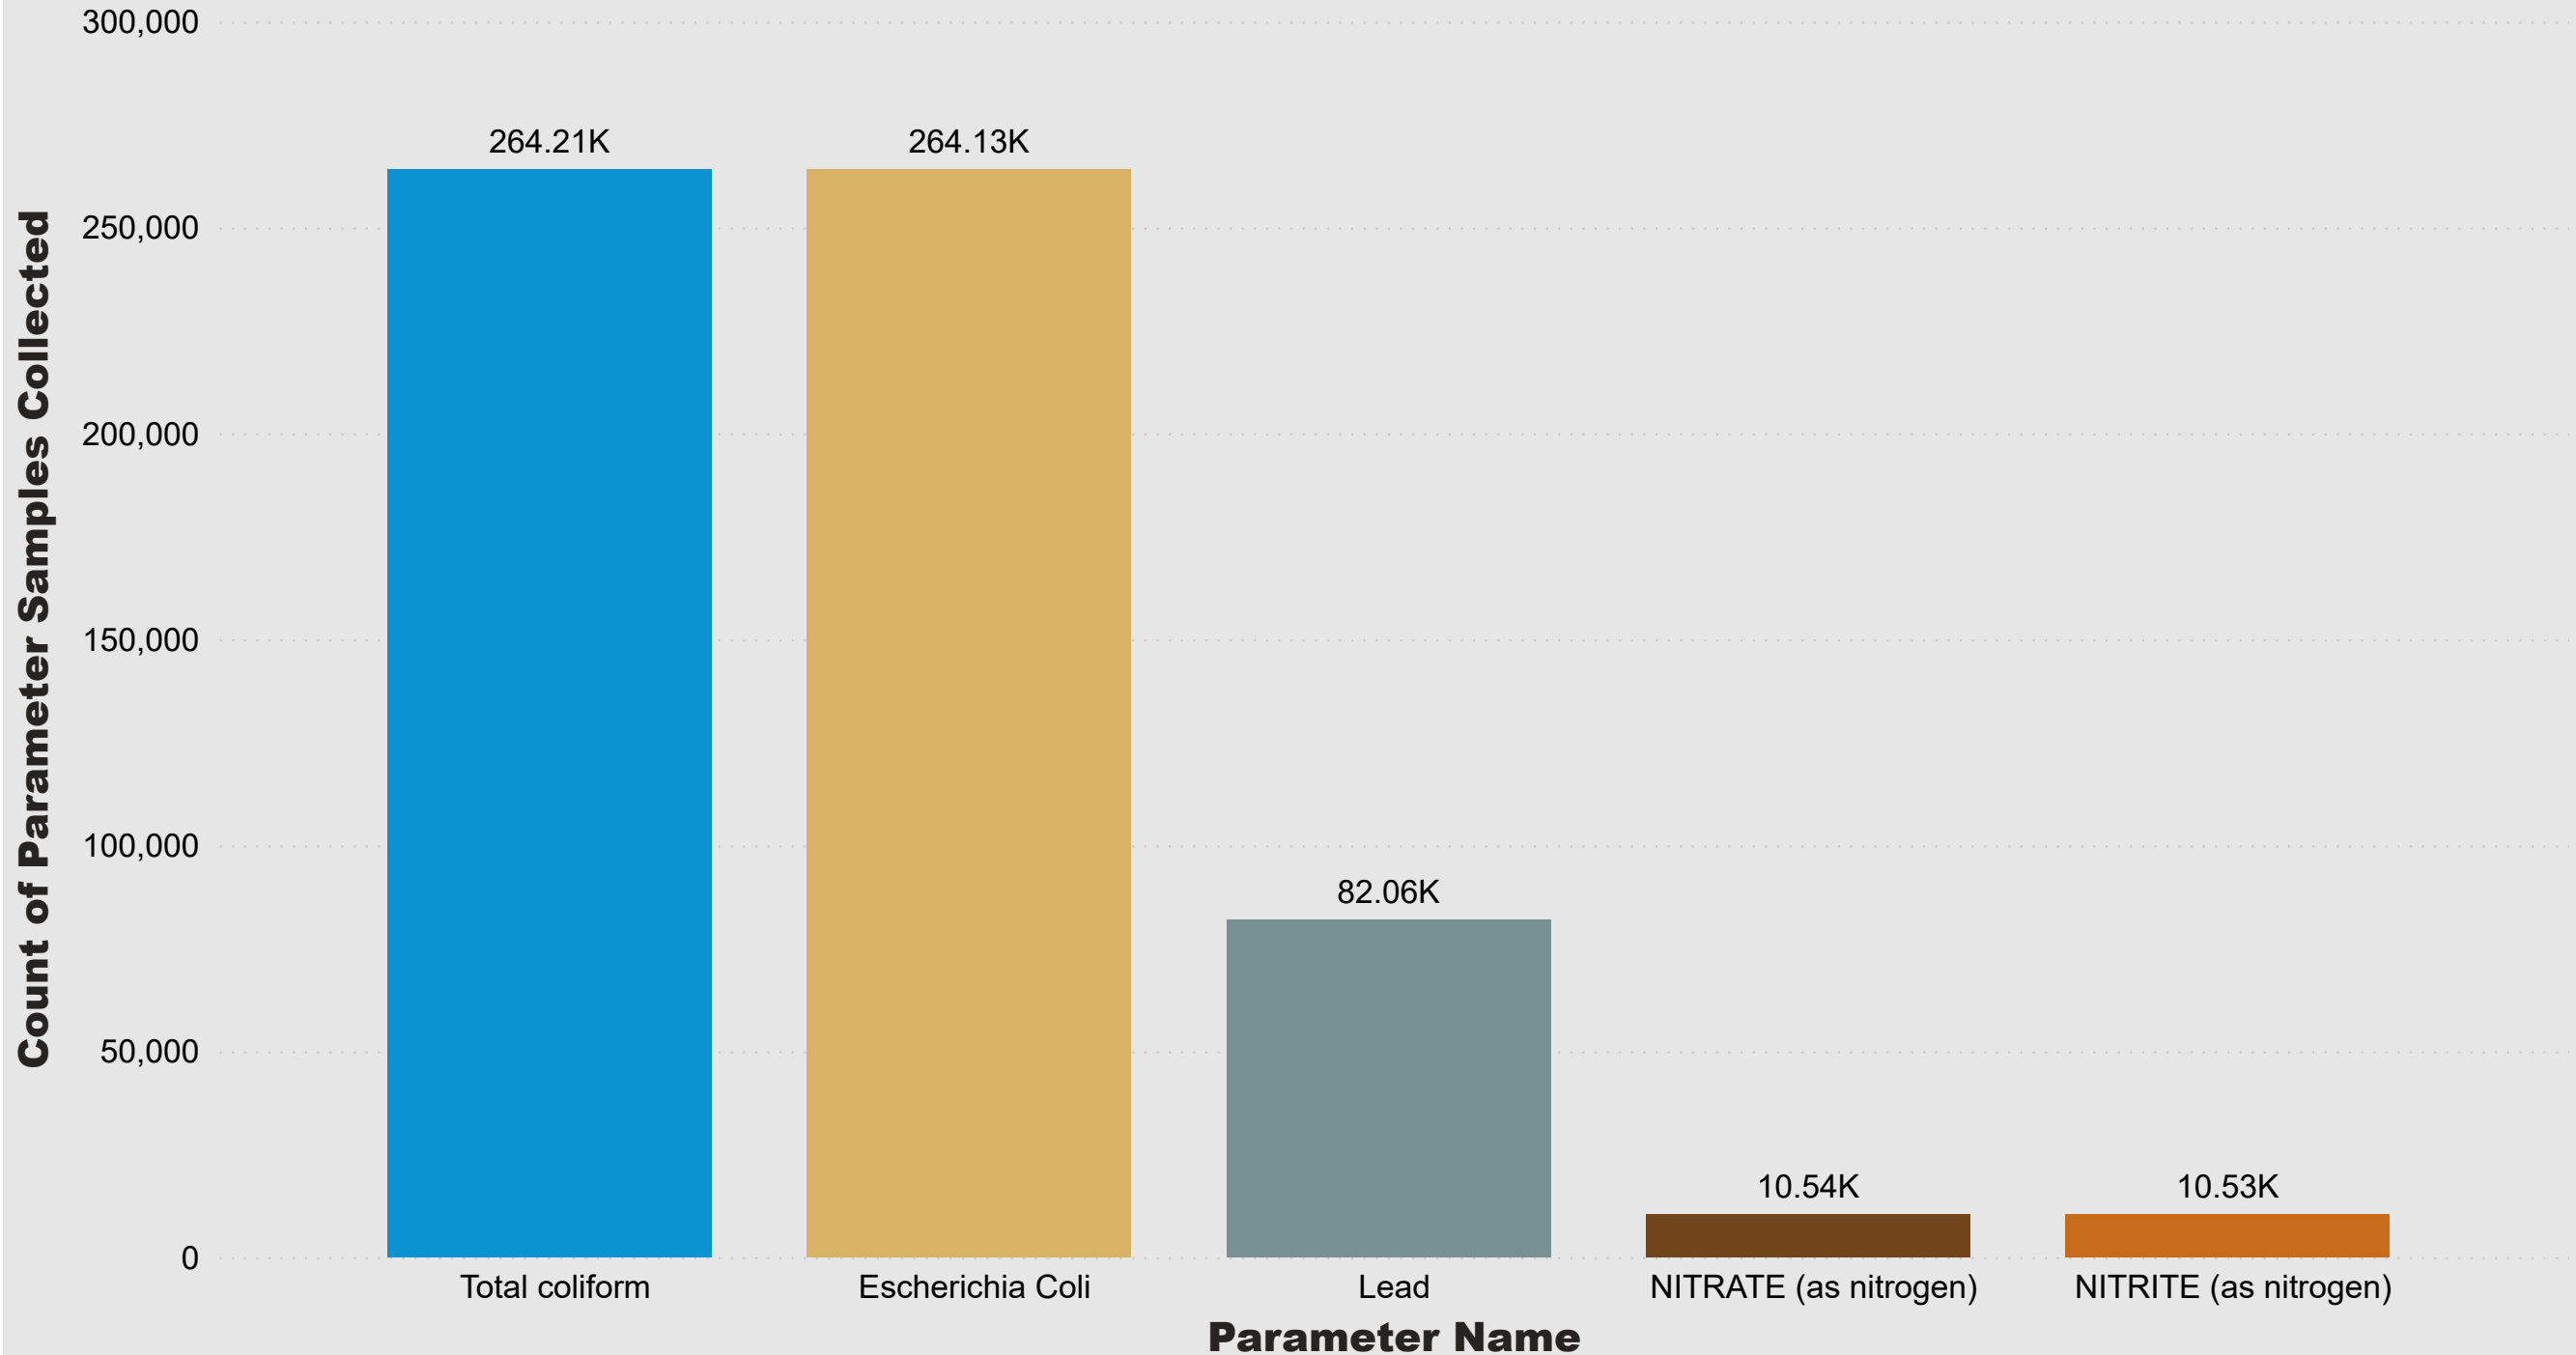

Distributed Drinking Water Samples Taken (2018)

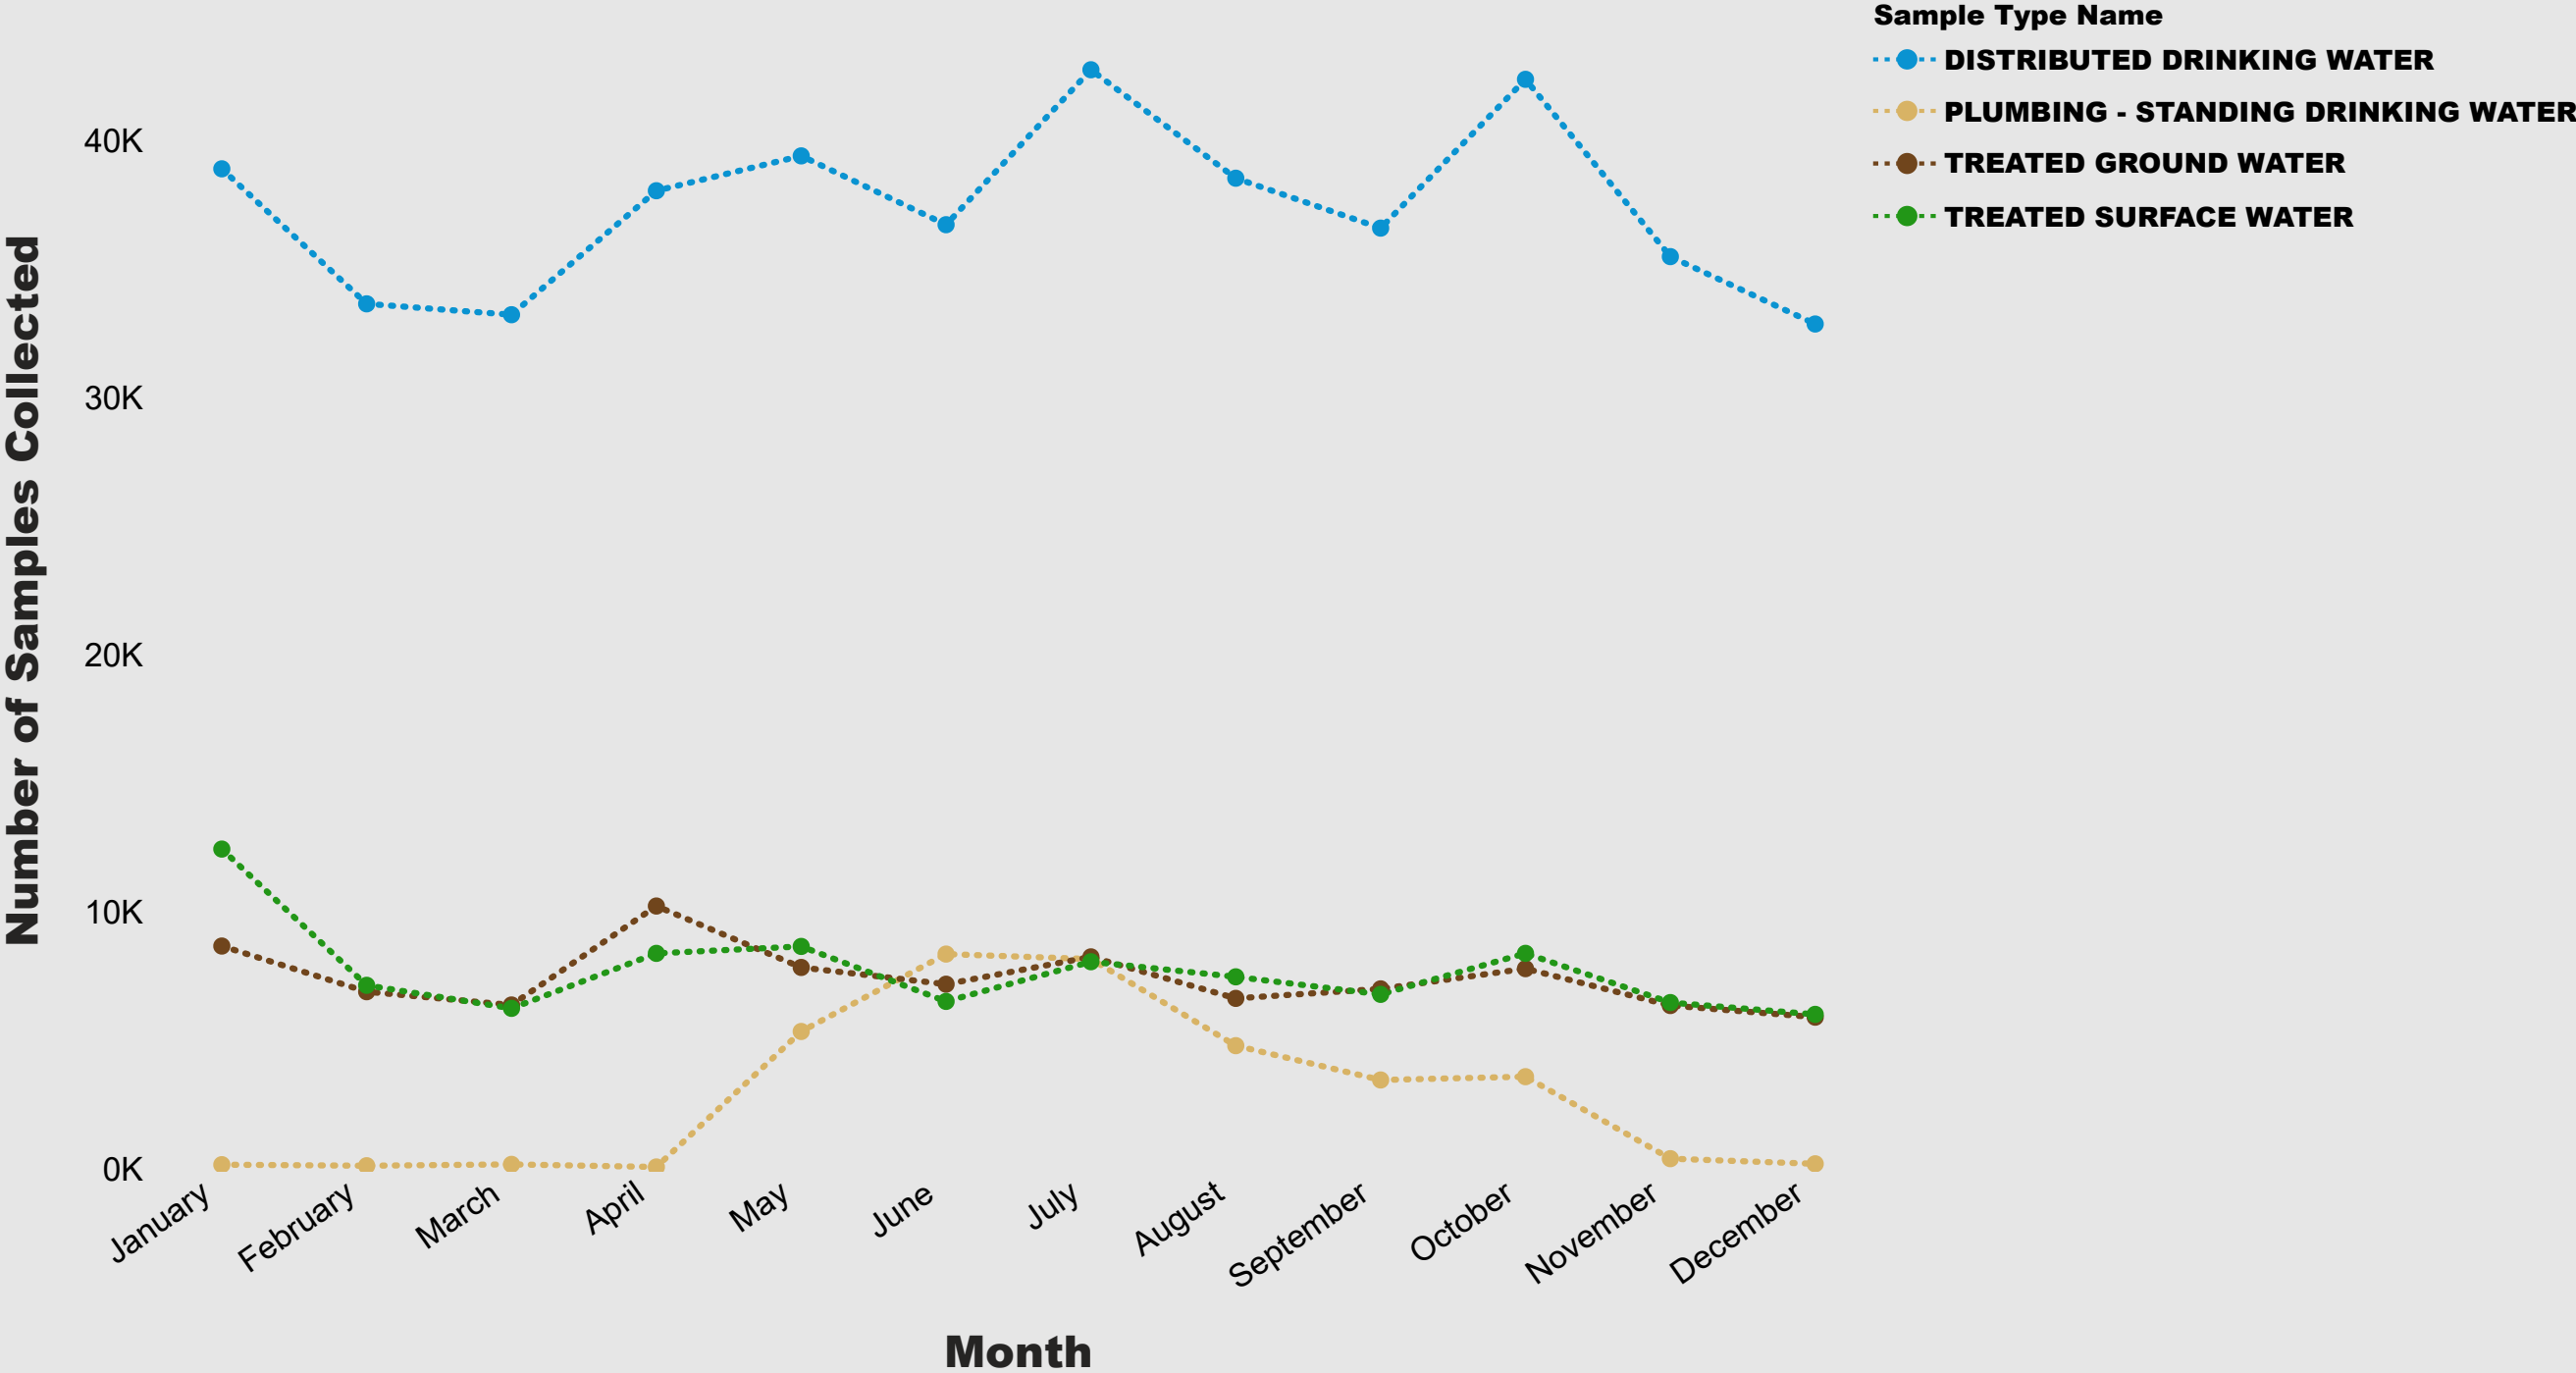

% of Total Exceedance of Legal Limit by Substance (2018)

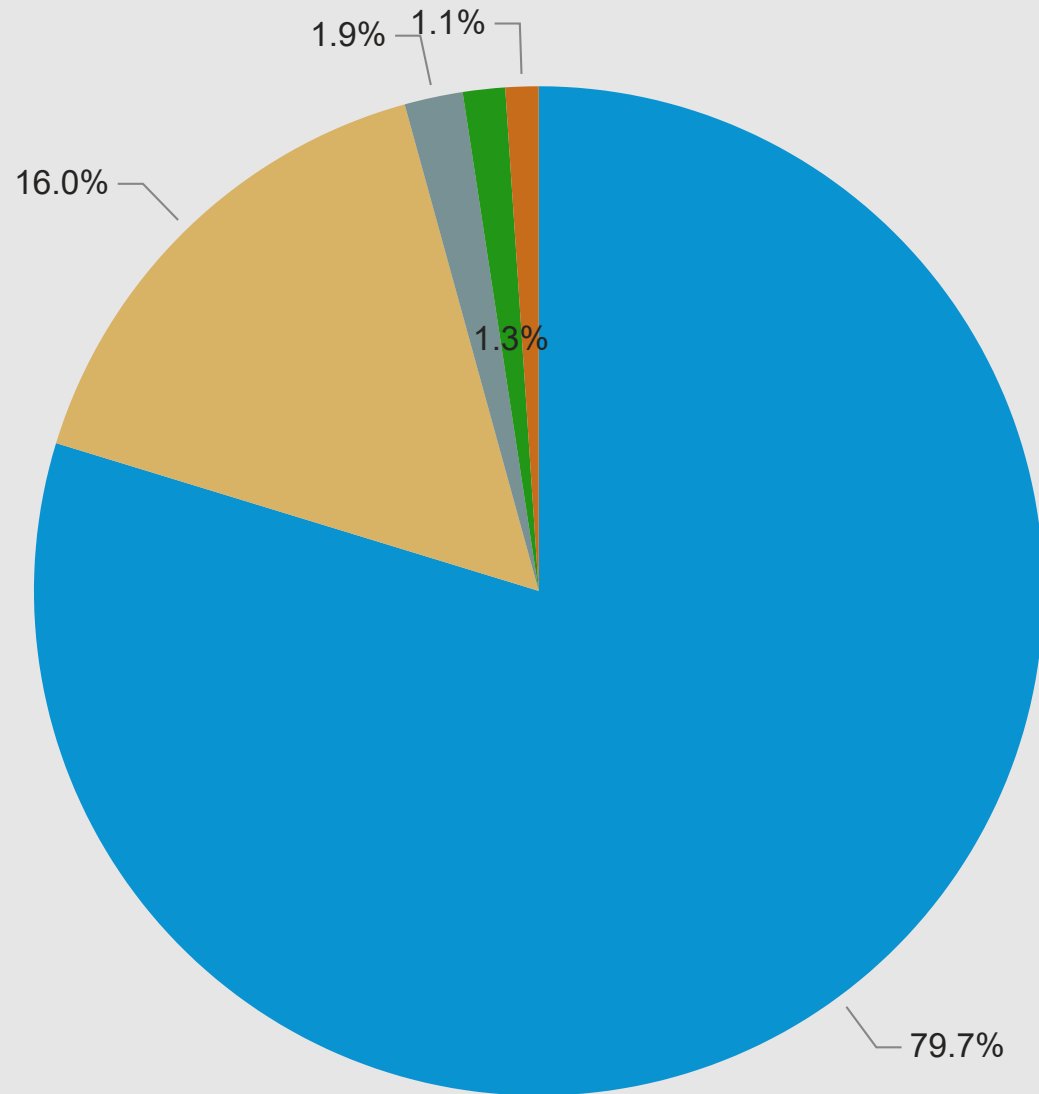


Count of Exceedance of Substance

- Lead
- Total coliform
- Fluoride
- Escherichia Coli
- NITRATE (as nitrogen)

Count of Exceedance by Sample Month and Exceedance

Exceedance ● N ● Y

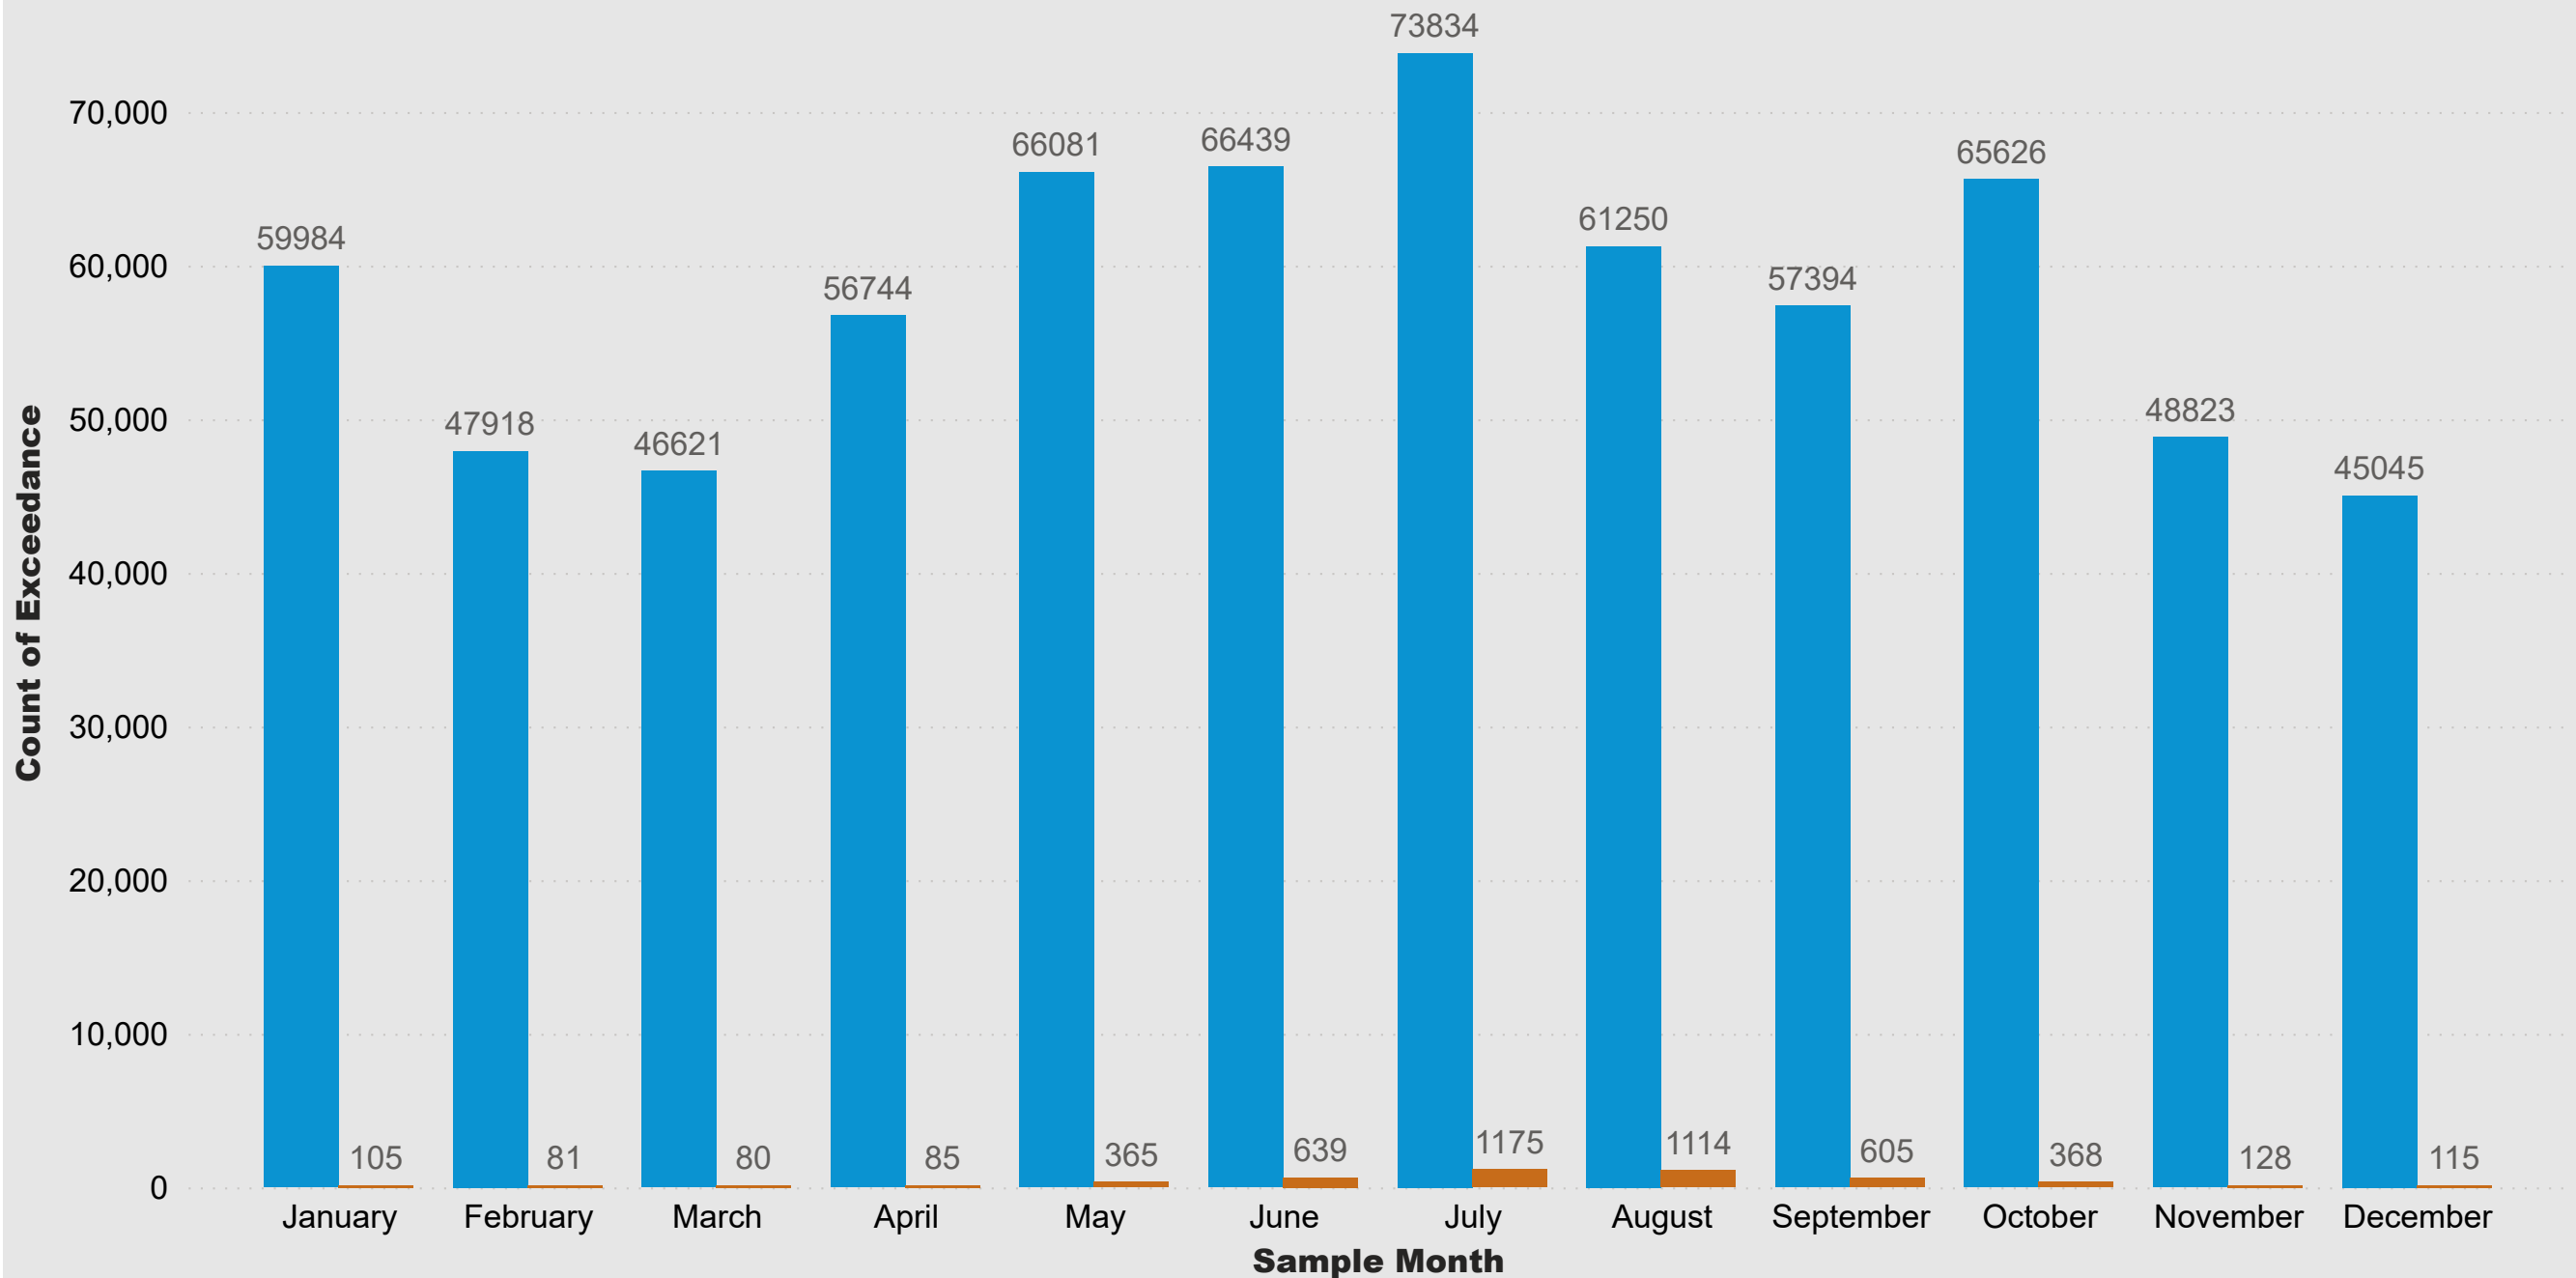

Number of Samples Collected of Each Type of Water (2018)

Sample Type Name

- **DISTRIBUTED DRINKING WATER**
- **PLUMBING - FLUSHED DRINKING WATER**
- **PLUMBING - STANDING DRINKING WATER**
- **TREATED GROUND WATER**
- **TREATED SURFACE WATER**

