




Five Most Common Parameters Tested For (2018)

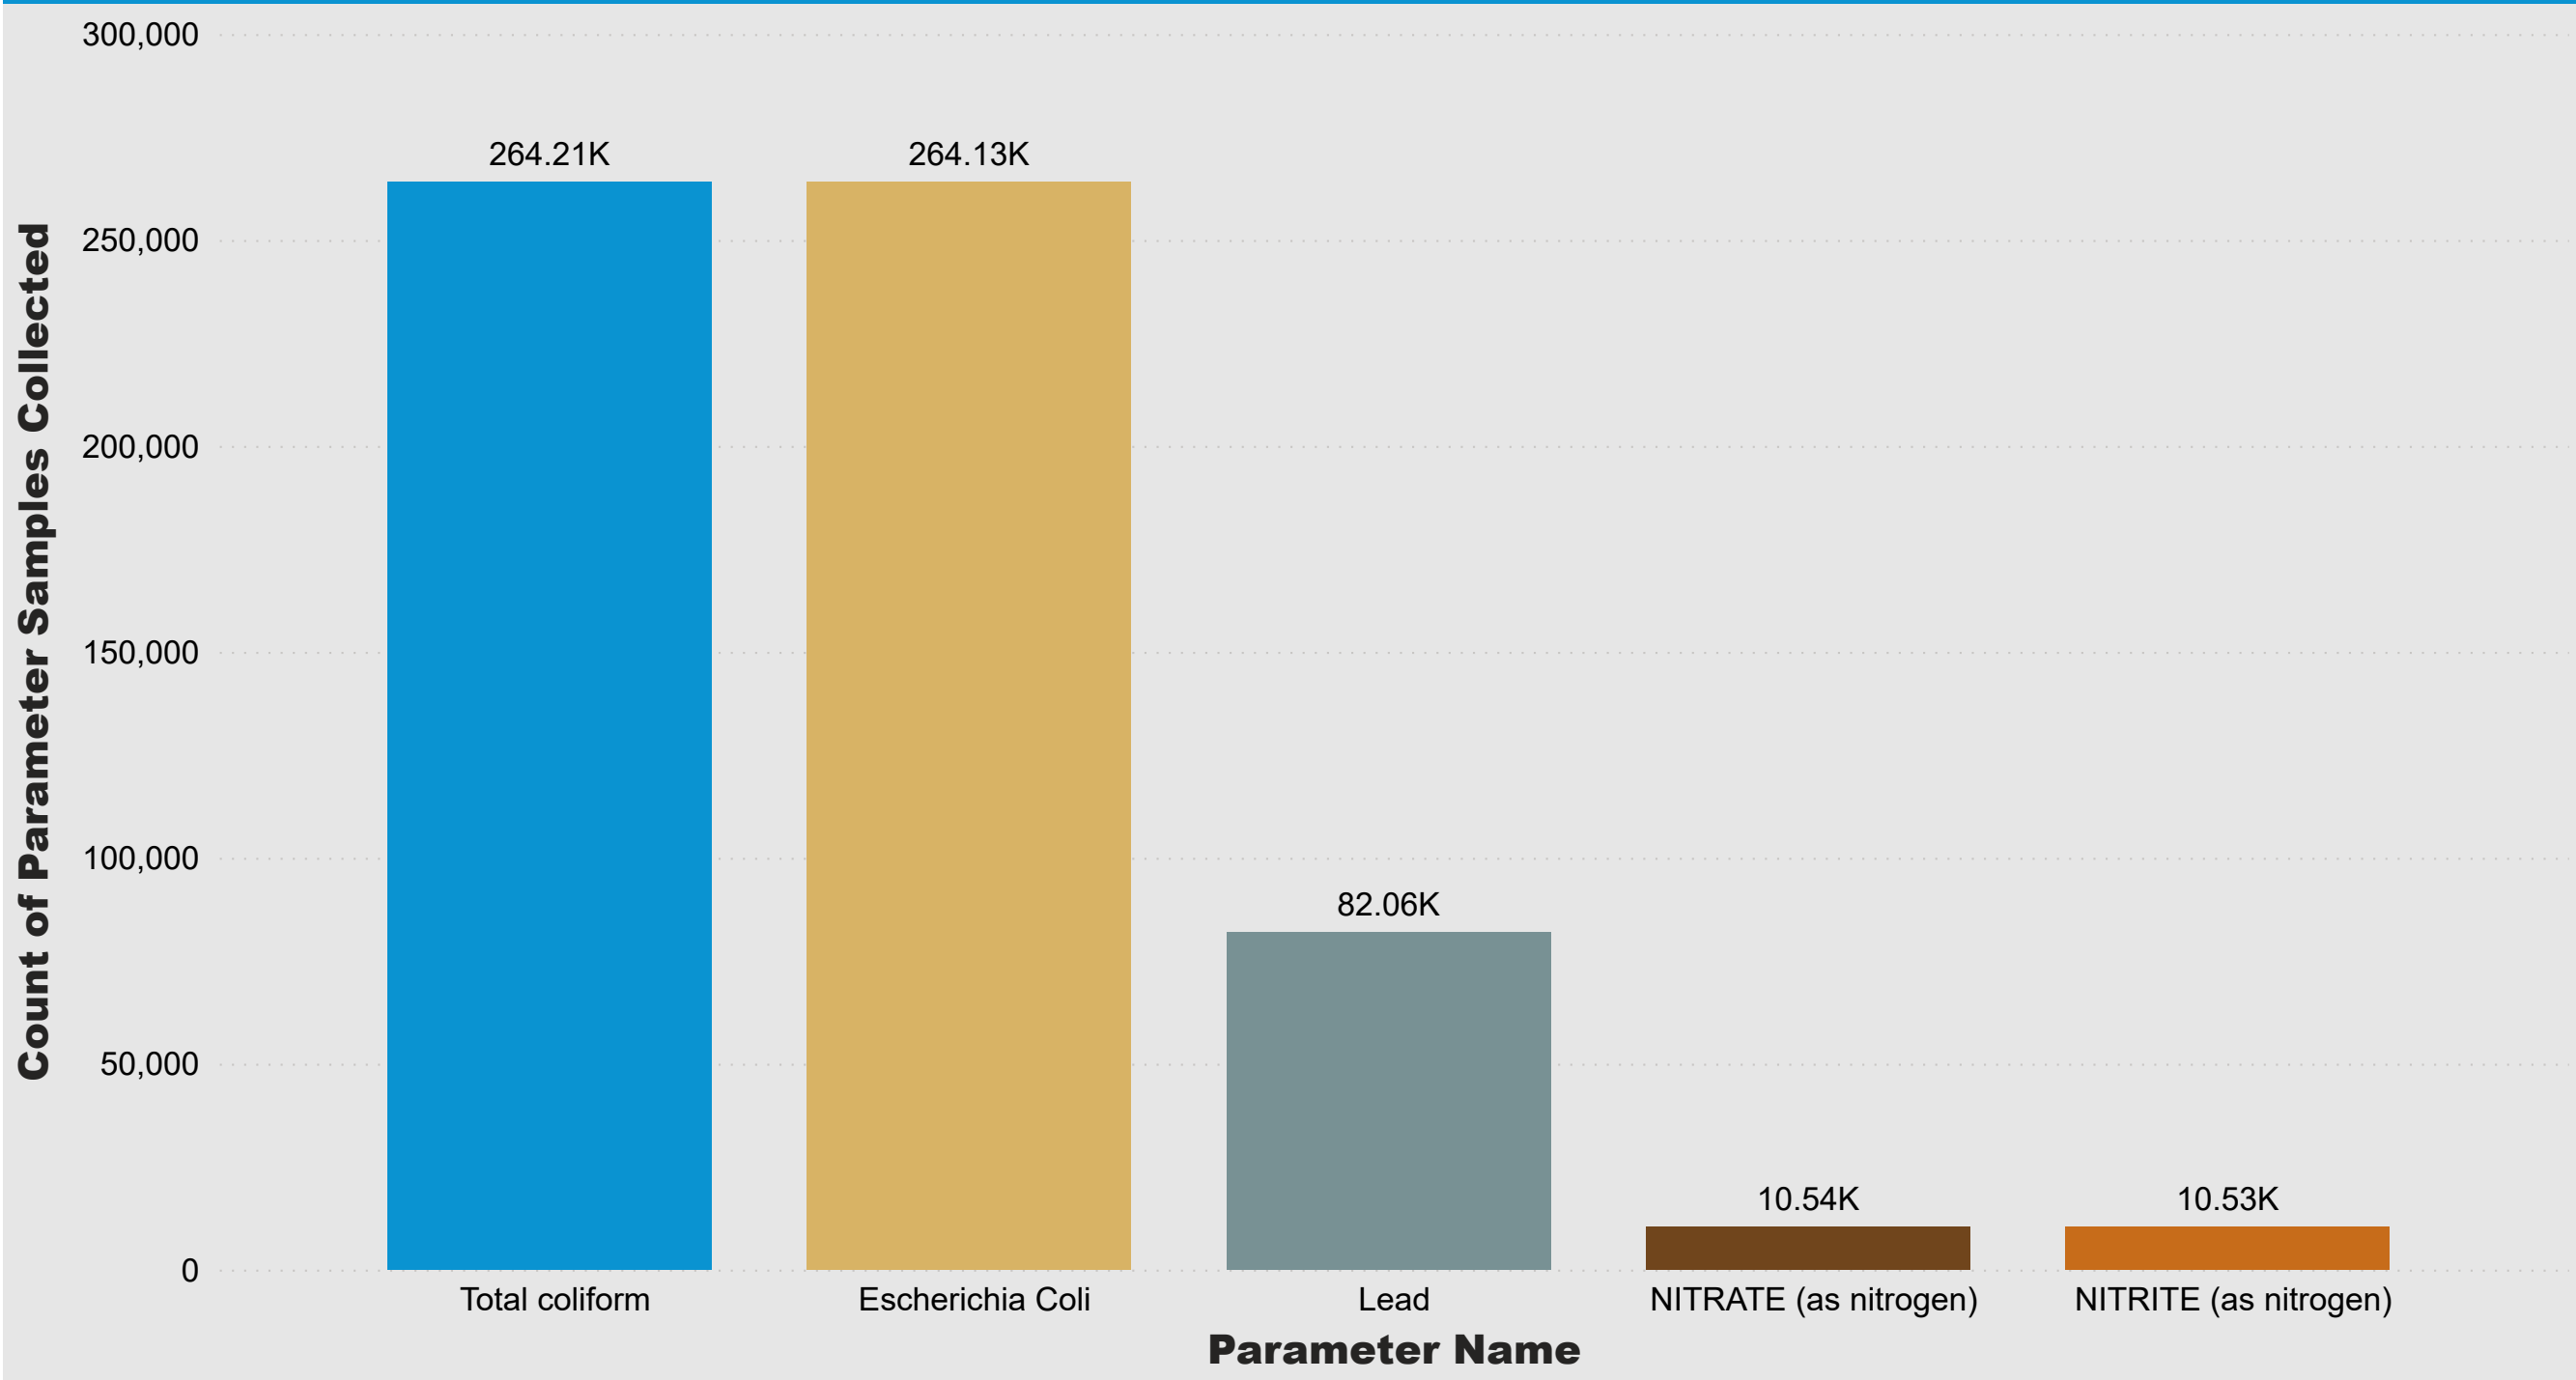

Distributed Drinking Water Samples Taken (2018)

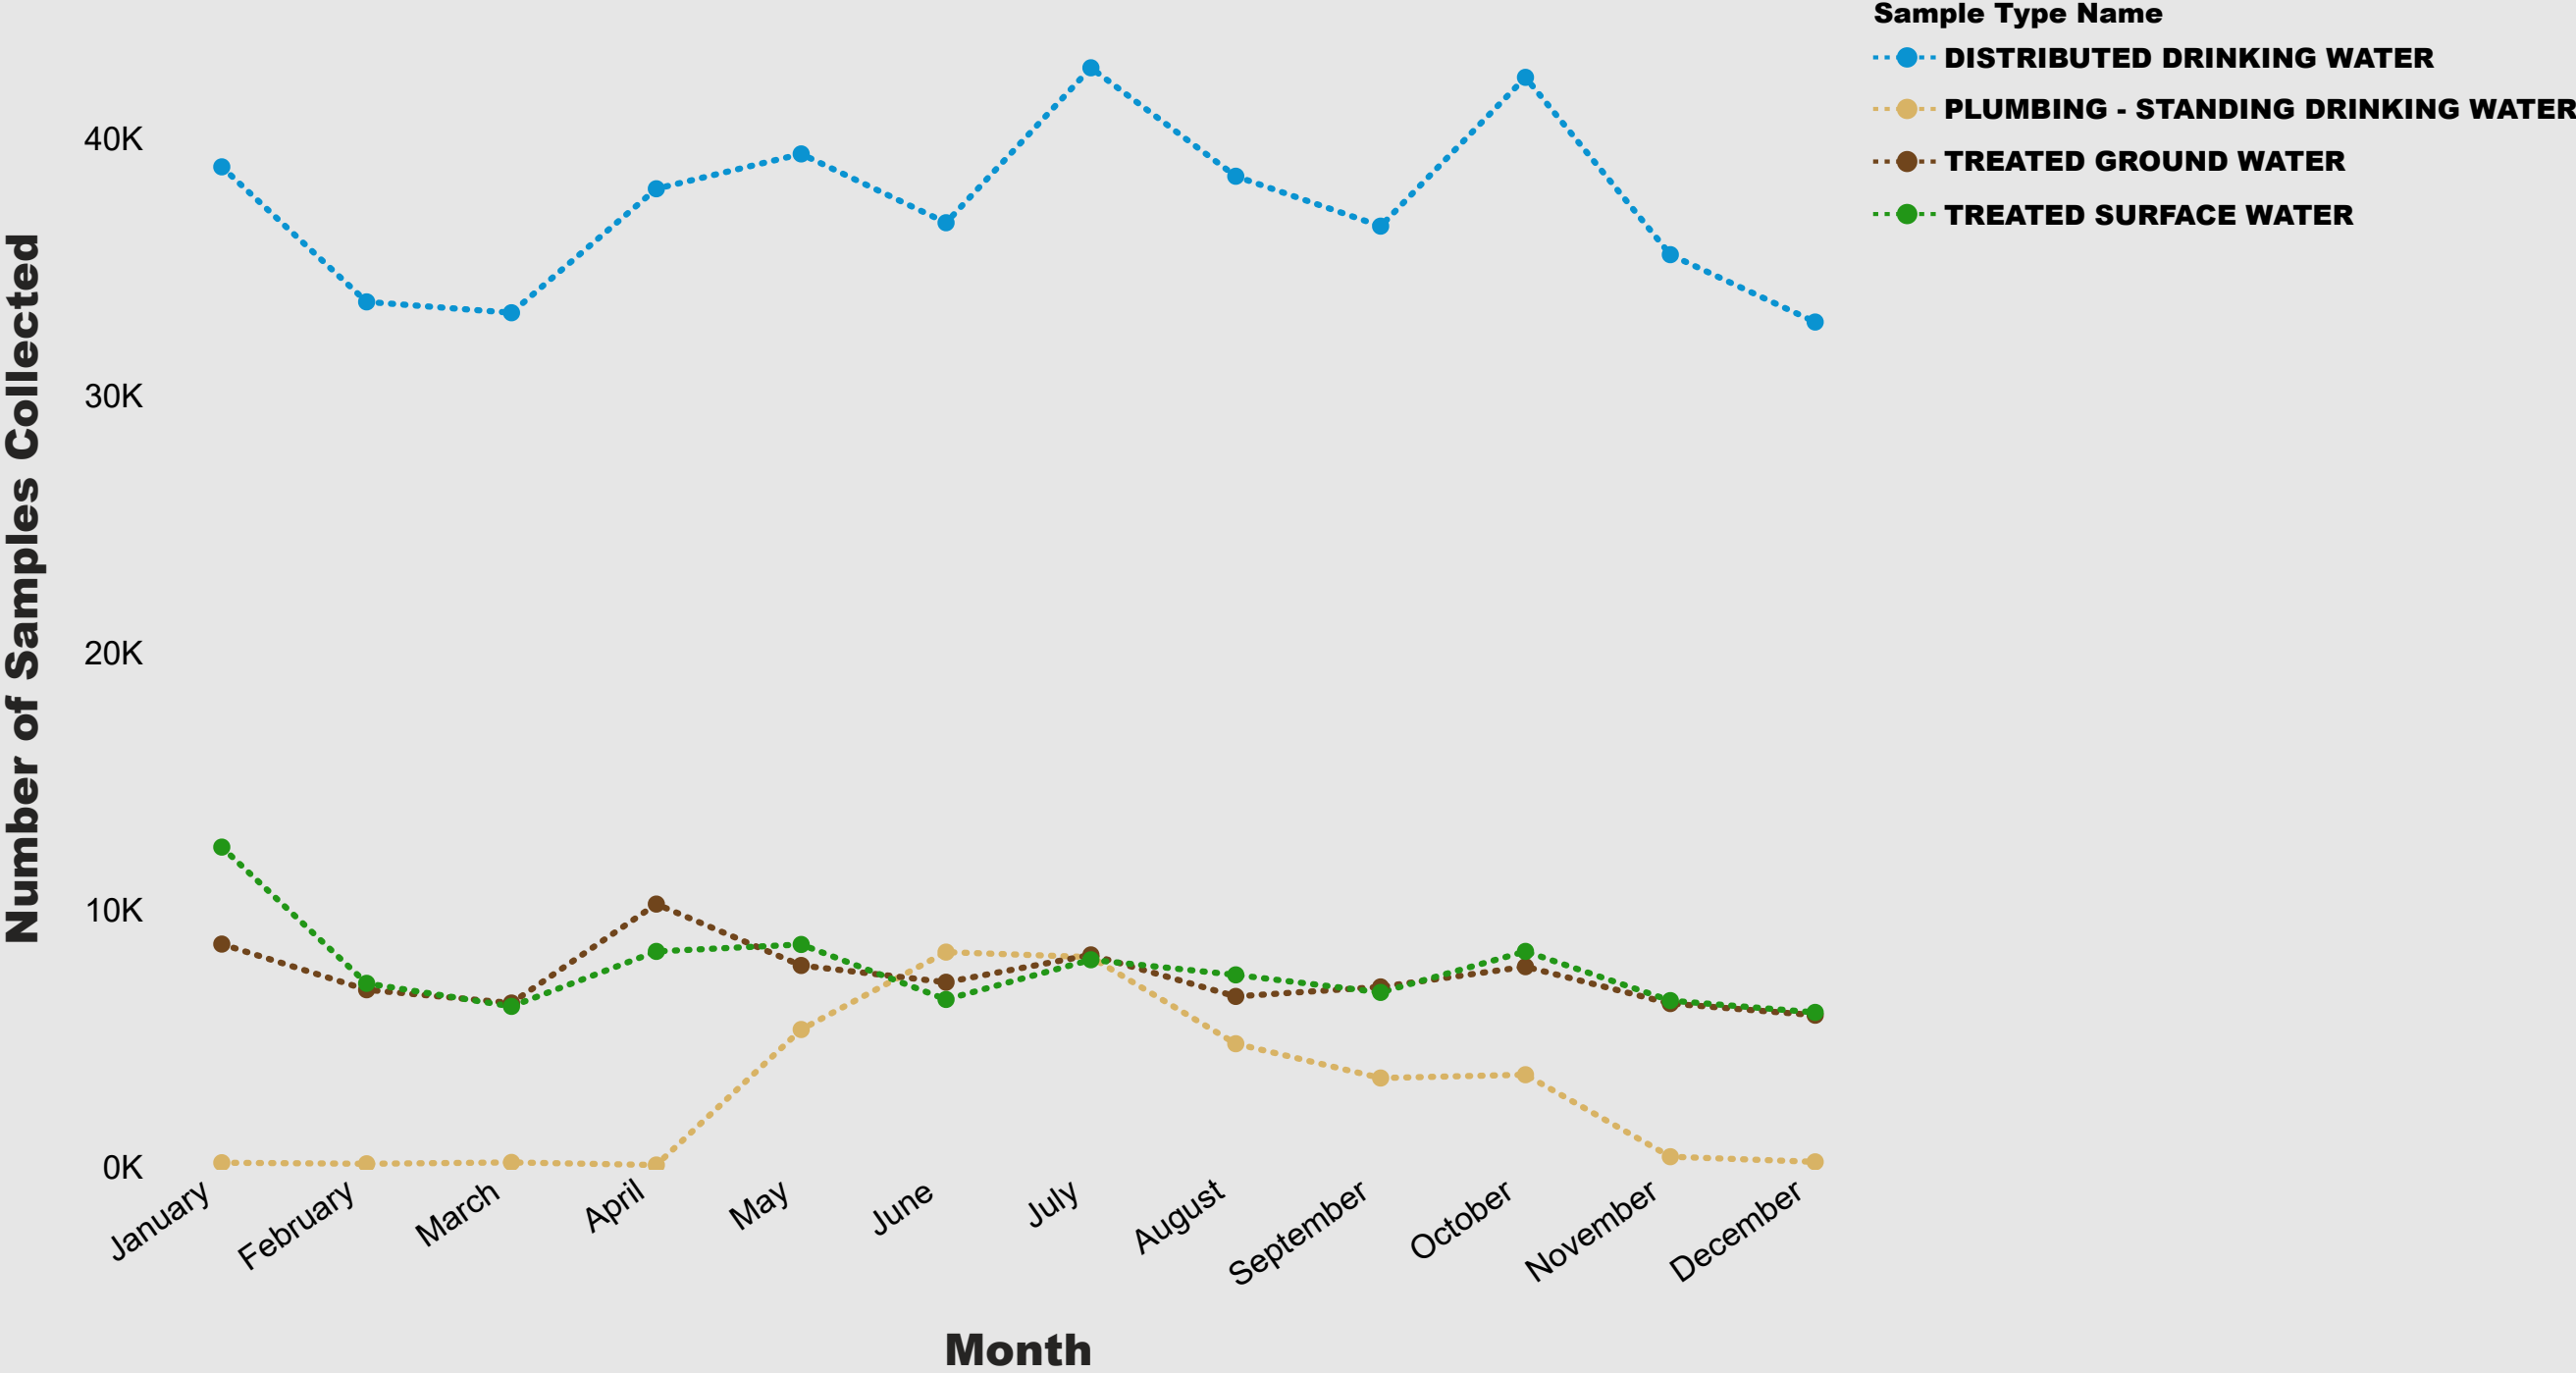

% of Exceedances of Legal Limit Per Substance in Water (2018)

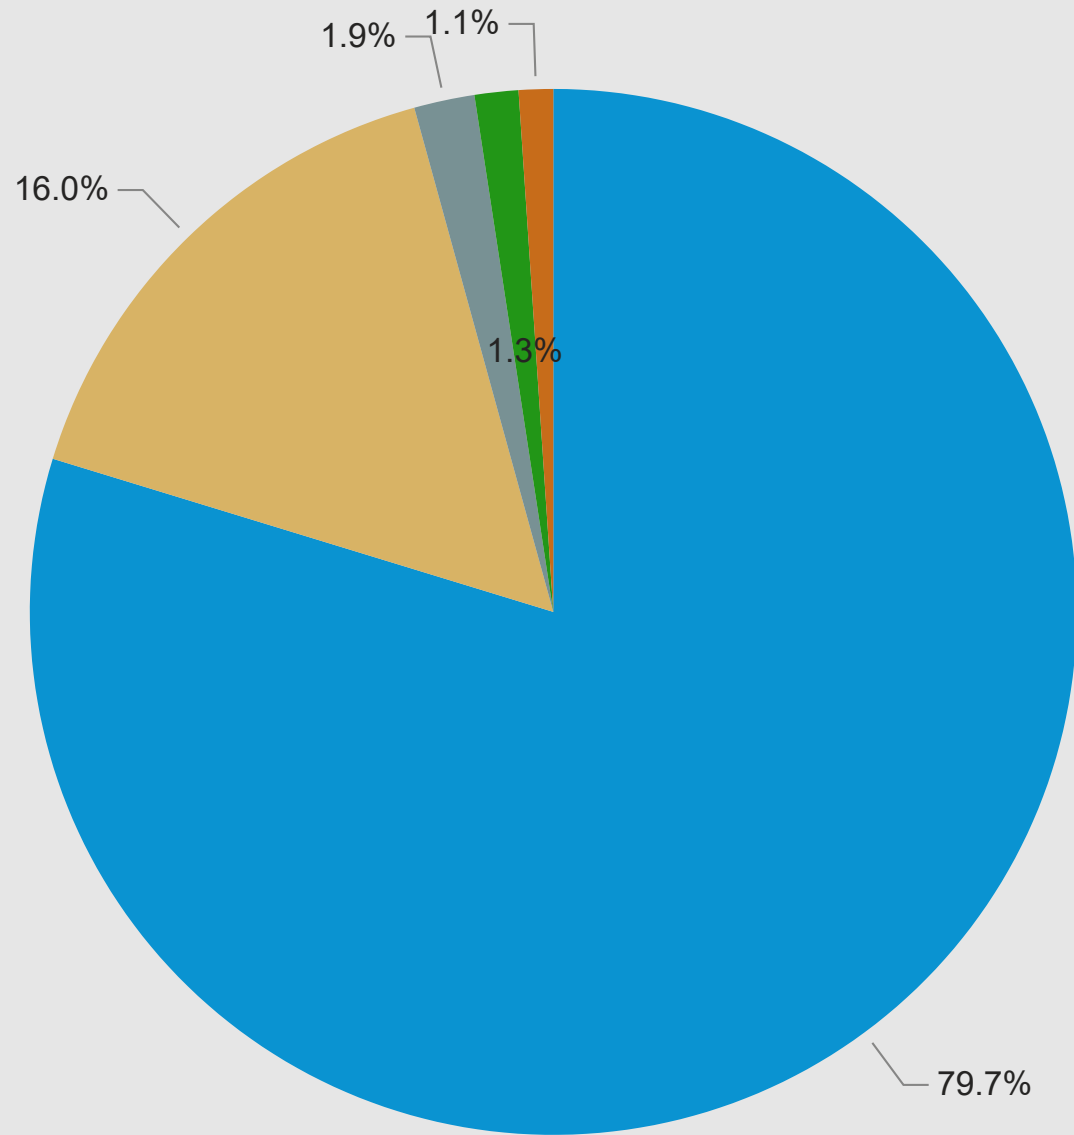


Substance Tested For

- **Lead**
- **Total coliform**
- **Fluoride**
- **Escherichia Coli**
- **NITRATE (as nitrogen)**

Count of Exceedance by Sample Month and Exceedance


Exceedance ● N ● Y

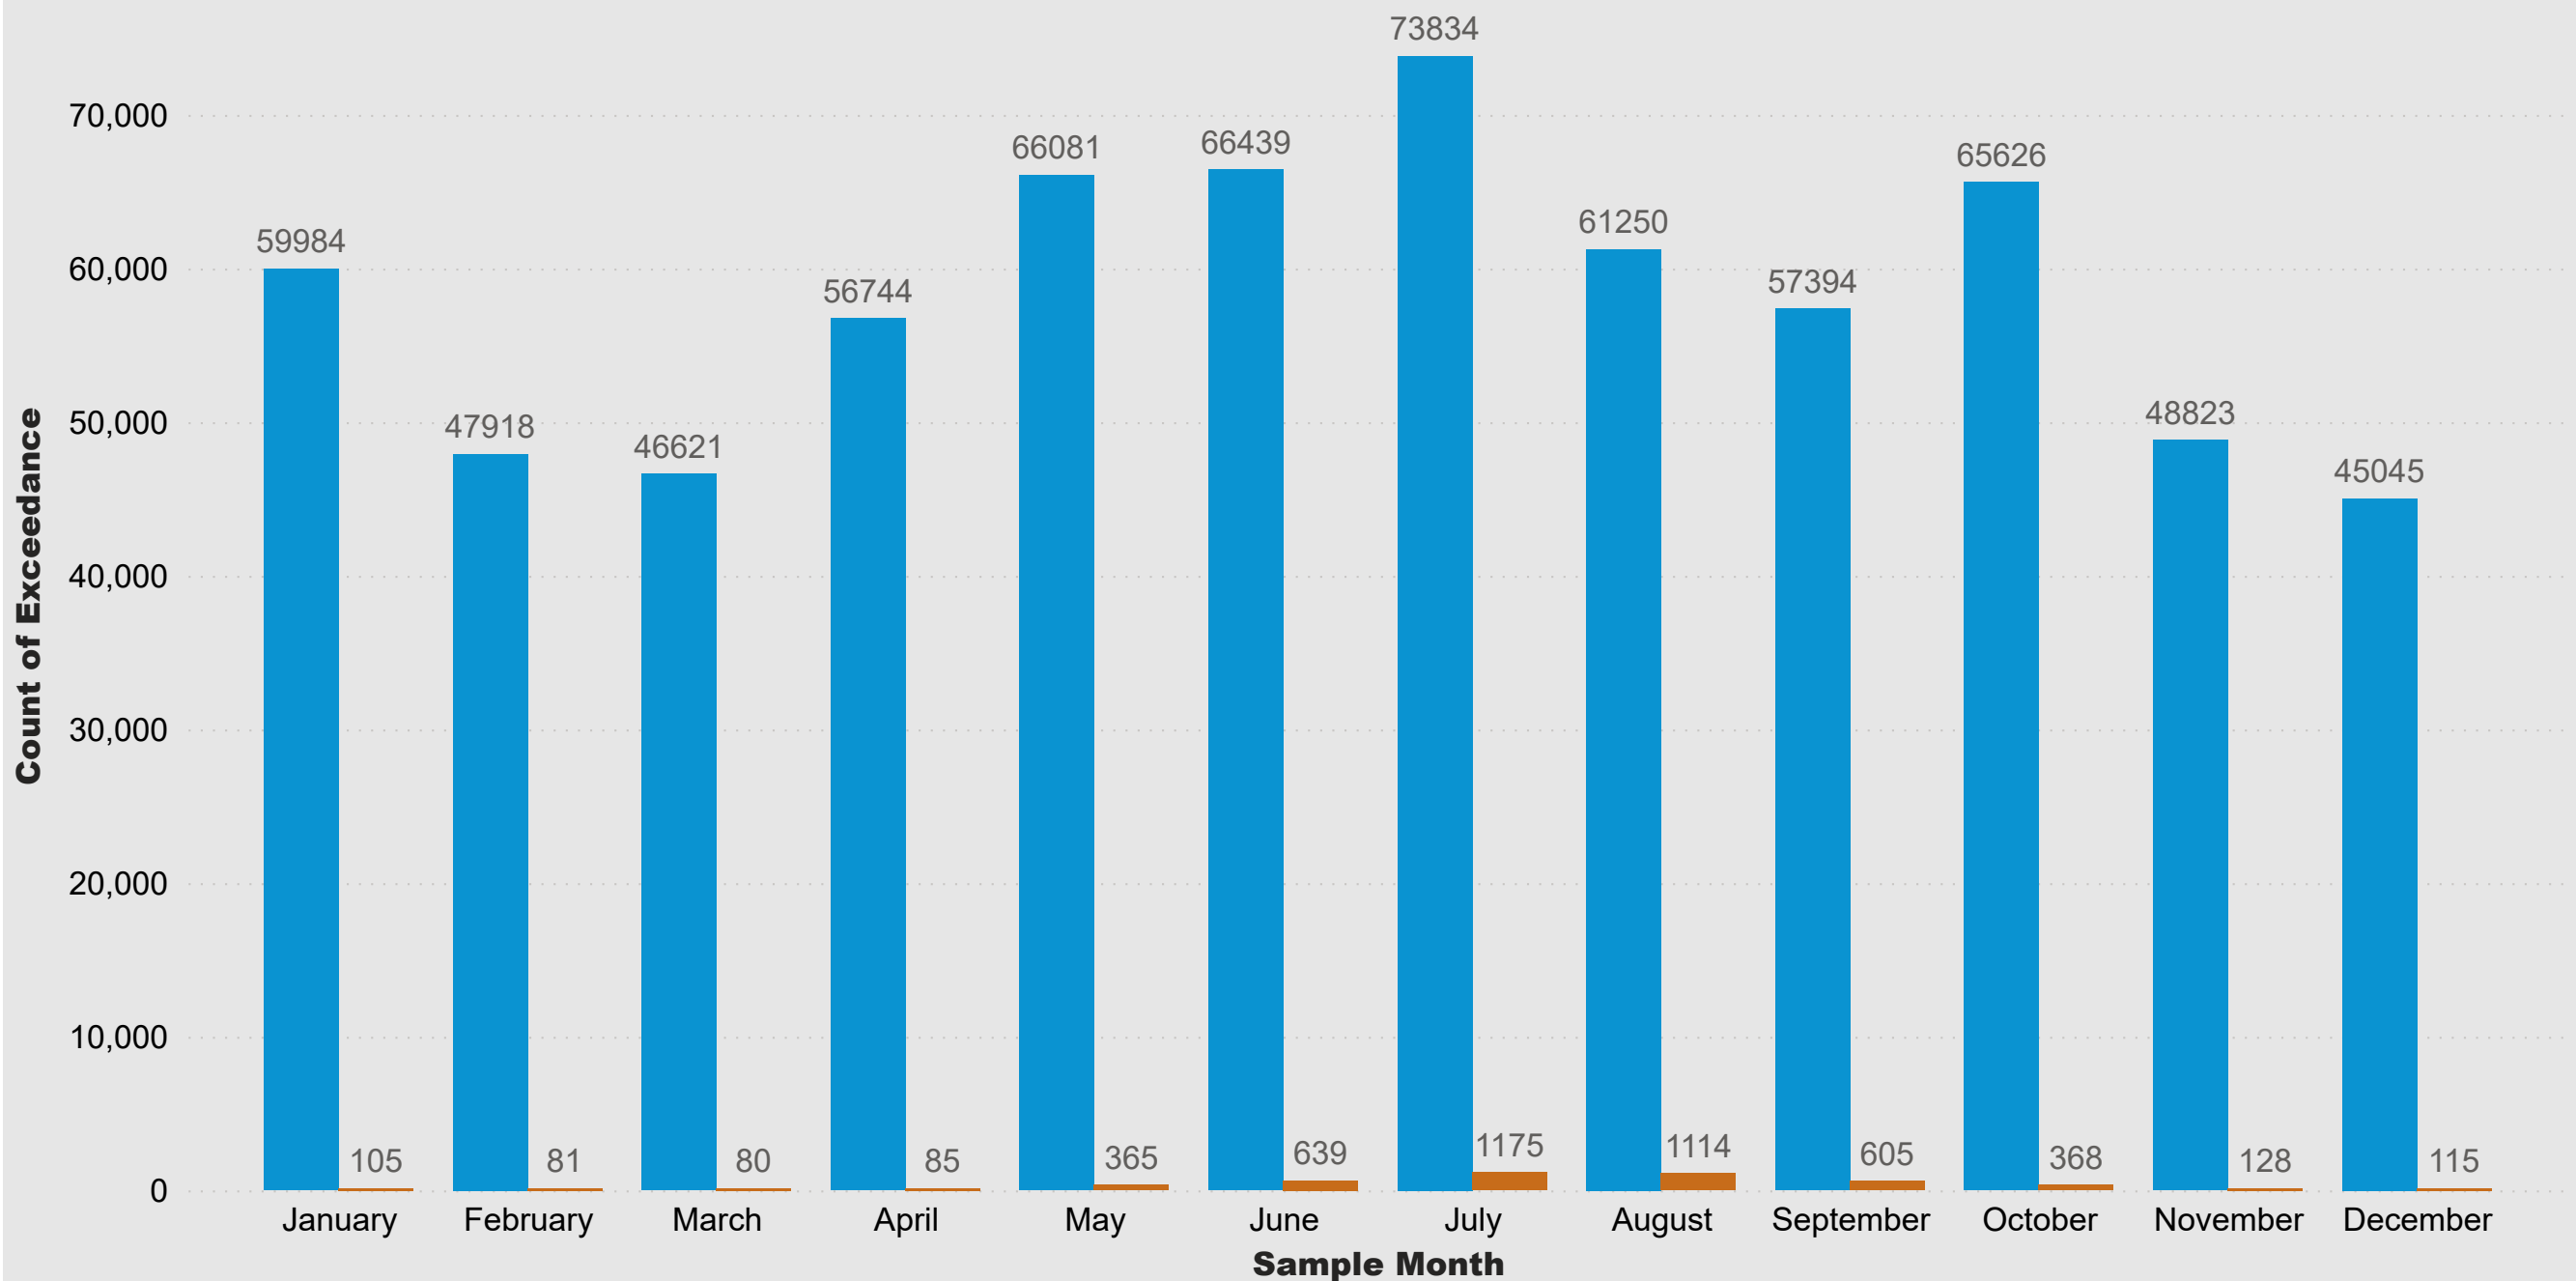

Number of Samples Collected of Each Type of Water (2018)

Sample Type Name

- **DISTRIBUTED DRINKING WATER**
- **PLUMBING - FLUSHED DRINKING WATER**
- **PLUMBING - STANDING DRINKING WATER**
- **TREATED GROUND WATER**
- **TREATED SURFACE WATER**

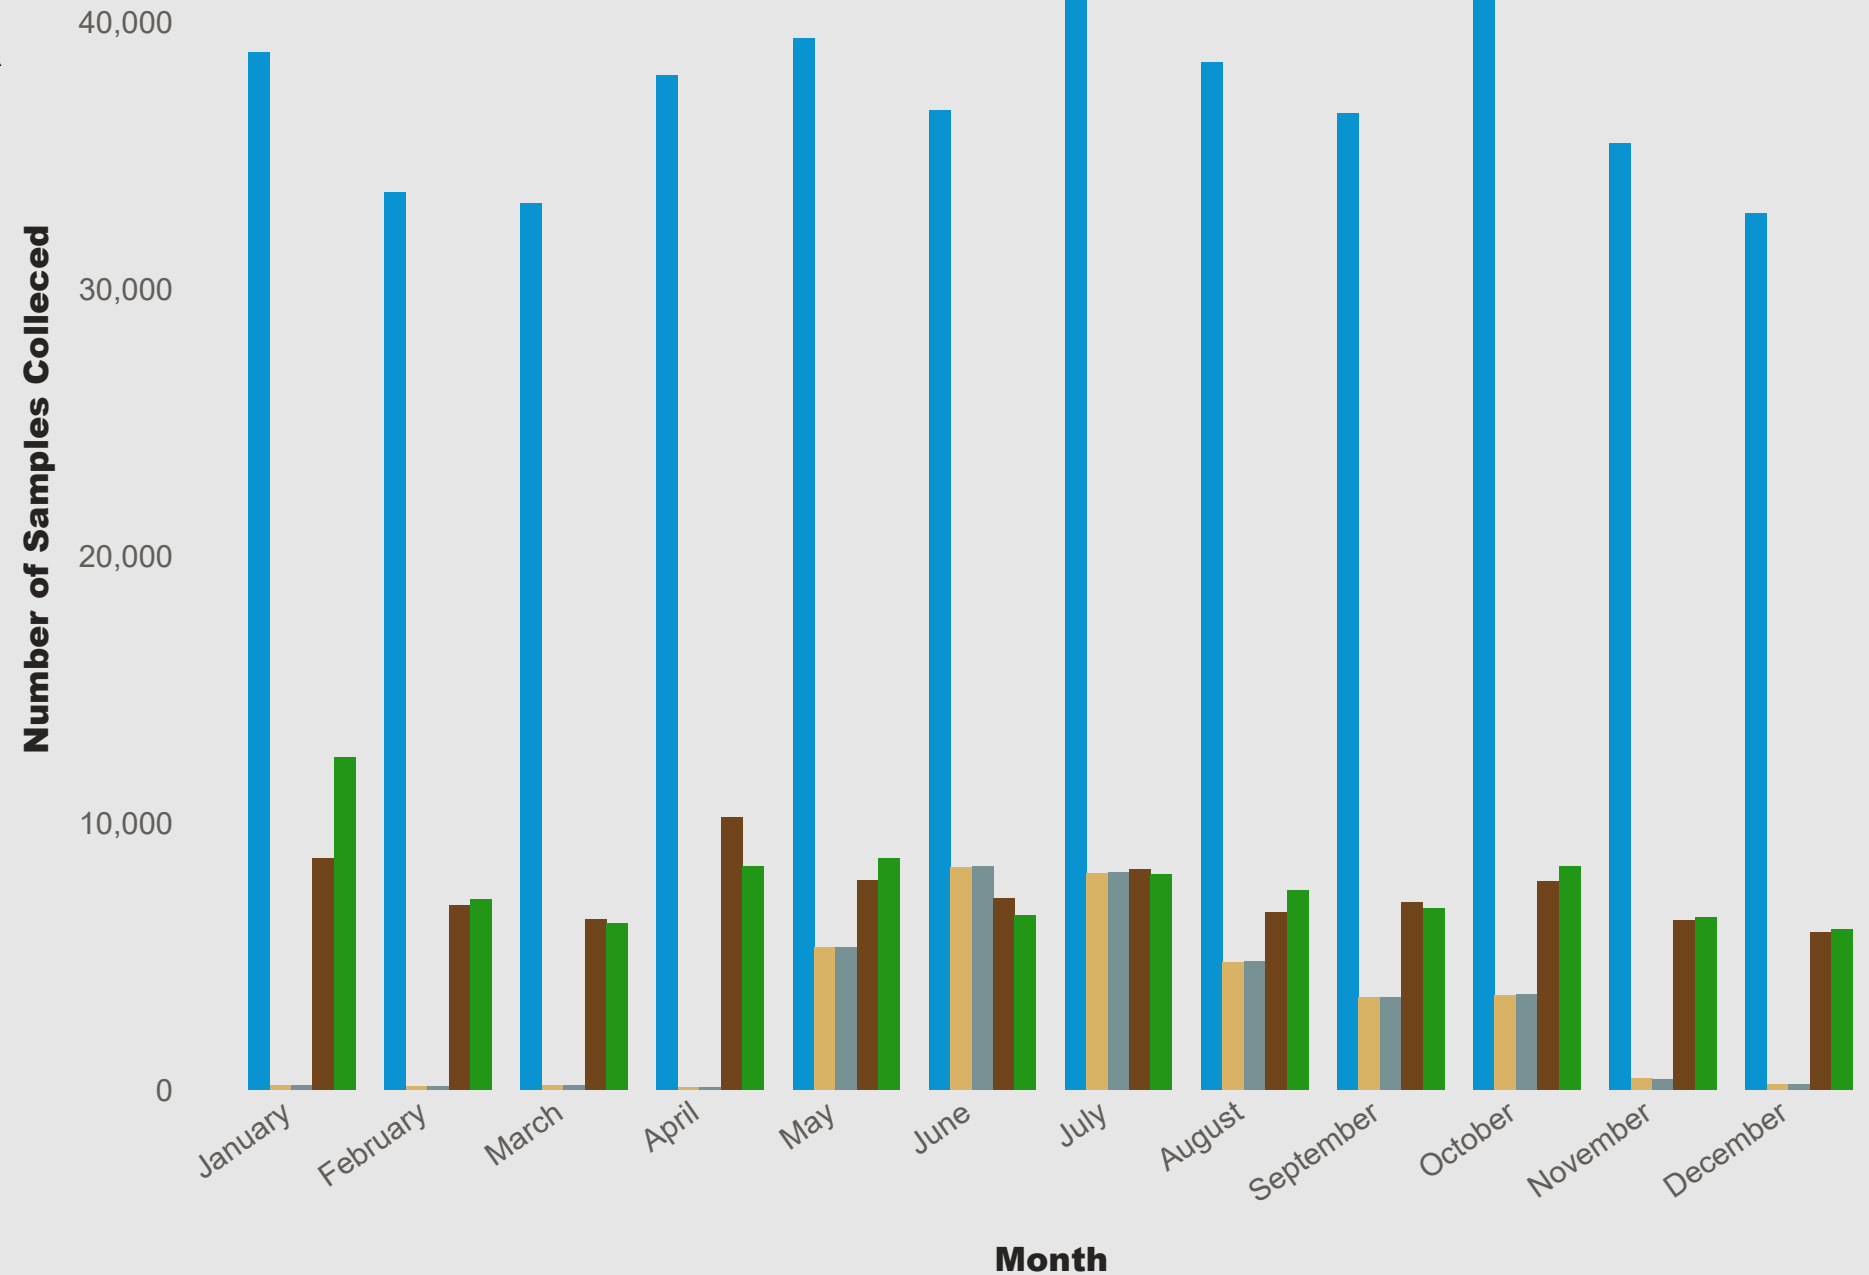

Number of Samples Collected of Each Type of Water (2018)

Sample Type Name

- **DISTRIBUTED DRINKING WATER**
- **PLUMBING - FLUSHED DRINKING WATER**
- **PLUMBING - STANDING DRINKING WATER**
- **TREATED GROUND WATER**
- **TREATED SURFACE WATER**

