

Manual Pull Stations¹

SIGA-270, SIGA-270P,
SIGA-278

Overview²

The SIGA-270 and SIGA-278 series Manual Pull Stations are part of EDWARDS's Signature Series system. The SIGA-270 Fire Alarm Manual Pull Stations feature our very familiar teardrop shape. They are made from die-cast zinc and finished with red epoxy powder-coat paint complemented by aluminum colored stripes and markings. With positive pull-lever operation, one pull on the station handle breaks the glass rod and turns in a positive alarm, ensuring protection plus fool-proof operation. Presignal models (SIGA-270P) are equipped with a general alarm (GA) keyswitch for applications where two stage operation is required. The up-front highly visible glass rod discourages tampering, but is not required for proper operation.

EDWARDS's double action single stage SIGA-278 station is a contemporary style manual station made from durable red colored lexan. To initiate an alarm, first lift the upper door marked "LIFT THEN PULL HANDLE", then pull the alarm handle.

Standard Features⁵

Note: Some features described here may not be supported by all control systems. Check your control panel's Installation and Operation Guide for details.

• Traditional familiar appearance⁷

SIGA-270 models feature our familiar teardrop design with simple positive pull action and sturdy die-cast metal body.

• One stage (GA), two stage (pre-signal), and double action models

SIGA-270 models are available for one or two stage alarm systems. The single stage double action SIGA-278 features a rugged Lexan housing with keyed reset mechanism.

• Break glass operation¹⁰

An up-front visible glass rod on the SIGA-270 discourages tampering.

• Intelligent device with integral microprocessor¹²

All decisions are made at the station allowing lower communication speed while substantially improving control panel response time. Less sensitive to line noise and loop wiring properties; twisted or shielded wire is not required.

• ADA Compliant¹⁴

Meets ADA requirements for manual pull stations.

• Electronic Addressing with Non-volatile memory¹⁵

Permanently stores programmable address, serial number, type of device, and job number. Automatically updates historic information including hours of operation, last maintenance date, number of alarms and troubles, and time and date of last alarm.

• Automatic device mapping¹⁷

Each station transmits wiring information to the loop controller regarding its location with respect to other devices on the circuit.

• Diagnostic LEDs¹⁹

Status LEDs; flashing GREEN shows normal polling; flashing RED shows alarm state.

• Designed for high ambient temperature operation

Install in ambient temperatures up to 120 °F (49 °C).

Application 1

The operating characteristics of the fire alarm stations are determined by their sub-type code or "Personality Code". NORMALLY-OPEN ALARM - LATCHING (Personality Code 1) is assigned by the factory; no user configuration is required. The device is configured for Class B IDC operation. An ALARM signal is sent to the loop controller when the station's pull lever is operated. The alarm condition is latched at the station.

Compatibility 3

Signature Series manual stations are compatible only with EDWARDS's Signature Loop Controller.

Warnings & Cautions 5

This device will not operate without electrical power. As fires frequently cause power interruption, we suggest you discuss further safeguards with your local fire protection specialist.

Testing & Maintenance 7

To test (or reset) the station simply open the station and operate the exposed switch. The SIGA-270 series are opened with a tool; the SIGA-278 requires the key which is supplied with that station.

The station's automatic self-diagnosis identifies when it is defective and causes a trouble message. The user-friendly maintenance program shows the current state of each Signature series device and other pertinent messages. Single devices may be deactivated temporarily, from the control panel. Availability of maintenance features is dependent on the fire alarm system used.

Scheduled maintenance (Regular or Selected) for proper system operation should be planned to meet the requirements of the Authority Having Jurisdiction (AHJ). Refer to current NFPA 72 and ULC CAN/ULC 536 standards.

Typical Wiring 11

The fire alarm station's terminal block accepts #18 AWG (0.75mm²) to #12 AWG (2.5mm²) wire sizes. See Signature Loop Controller catalog sheet for detailed wiring requirement specifications.

Wiring Notes 13

Refer to Signature Loop Controller manual for maximum wire distance.

2. All wiring is power limited and supervised.

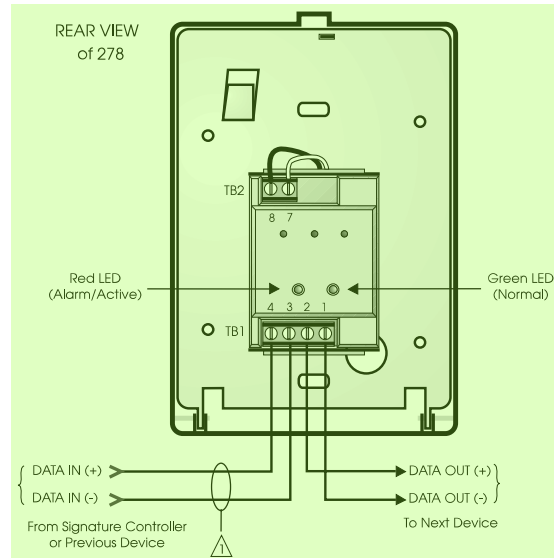


Figure 4. Single Stage Systems

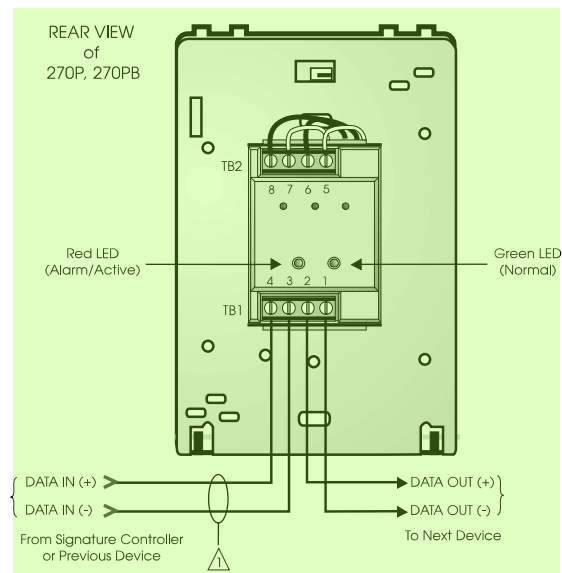


Figure 5. Two Stage Systems

Installation 1

Single-stage Signature Series fire alarm manual pull stations mount to North American 2½ inch (64 mm) deep 1-gang boxes. 2

Two stage presignal (270P) models require 1½ inch (38 mm) deep 4-inch square boxes with 1-gang, ½-inch raised covers. Openings must be angular. *Rounded openings are not acceptable.* Recommended box: Steel City Model 52-C-13; in Canada, use Iberville Model CI-52-C-49-1/2. 3

All models include terminals are suited for #12 to #18 AWG (2.5 mm² to 0.75 mm²) wire size. EDWARDS recommends that these fire alarm stations be installed according to latest recognized edition of national and local fire alarm codes. 4

Electronic Addressing: The loop controller electronically addresses each manual station, saving valuable time during system commissioning. Setting complicated switches or dials is not required. Each station has its own unique serial number stored in its on-board memory. The loop controller identifies each device on the loop and assigns a “soft” address to each serial number. If desired, the stations can be addressed using the SIGA-PRO Signature Program/Service Tool. 5

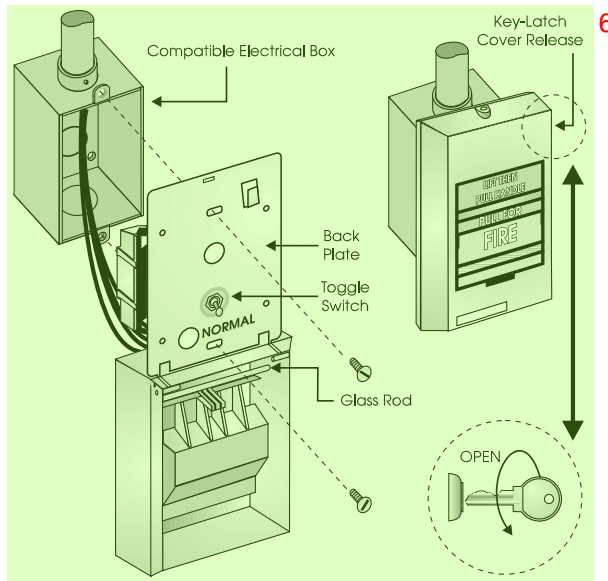


Figure 1. SIGA-278 installation 7

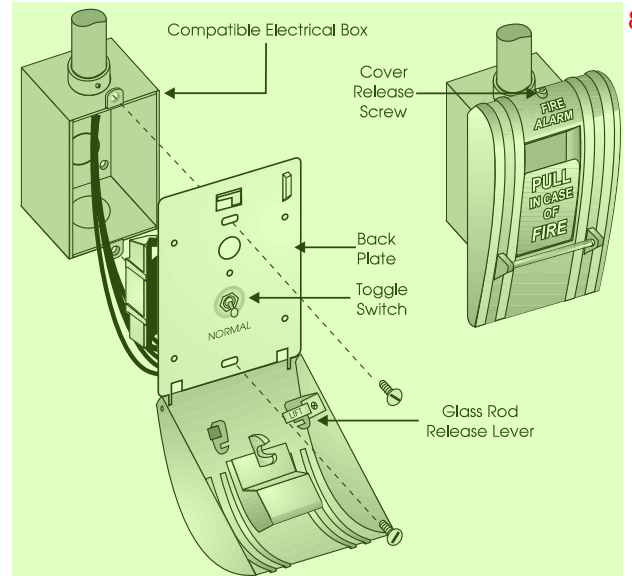


Figure 2. SIGA-270, SIGC-270F, SIGC-270B installation 9

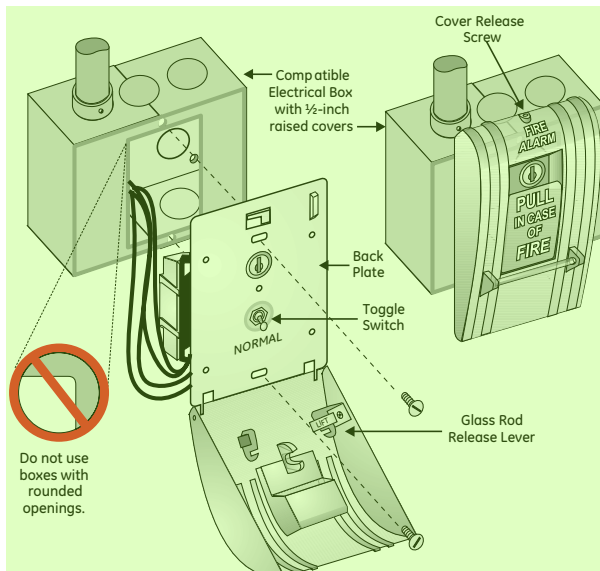


Figure 3. SIGA-270P, SIGC-270PB installation 11

Specifications ¹

| Catalog Number | SIGA-270, SIGC-270F, SIGC-270B | SIGA-270P, SIGC-270PB | SIGA-278 |
|-----------------------------------|--|---------------------------------------|--------------------------------------|
| Description | Single Action - One Stage | Single Action - Two Stage (Presignal) | Double Action - One Stage |
| Addressing Requirements | Uses 1 Module Address | Uses 2 Module Addresses | Uses 1 Module Address |
| Operating Current | Standby = 250µA Activated = 400µA | Standby = 396µA Activated = 680µA | Standby = 250µA Activated = 400µA |
| Construction & Finish | Diecast Zinc - Red Epoxy with aluminum markings | | Lexan - Red with white markings |
| Type Code | Factory Set | | |
| Operating Voltage | 15.2 to 19.95 Vdc (19 Vdc nominal) | | |
| Storage and Operating Environment | Operating Temperature: 32°F to 120°F (0°C to 49°C) Storage Temperature: -4°F to 140°F (-20°C to 60°C) Humidity: 0 to 93% RH | | |
| LED Operation | On-board Green LED - Flashes when polled On-board Red LED - Flashes when in alarm | | |
| Compatibility | Use With: Signature Loop Controller | | |
| Agency Listings | UL, ULC (note 1), MEA, CSFM, FM | | |

Note: SIGC-270F, SIGC-270B and SIGC-270PB are ULC listed only. Suffix "F" indicates French markings. Suffix "B" indicates English/French bilingual markings.

Ordering Information ⁴

| Catalog Number | Description | Ship Wt. lbs (kg) |
|----------------|--|-------------------|
| SIGA-270 | One Stage Fire Alarm Station, English Markings - UL/ULC Listed | 1 (0.5) |
| SIGC-270F | One Stage Fire Alarm Station, French Markings - ULC Listed | |
| SIGC-270B | One Stage Fire Alarm Station, French/English Markings - ULC Listed | |
| SIGA-270P | Two Stage (Presignal) Fire Alarm Station, English Markings - UL/ULC Listed | |
| SIGC-270PB | Two Stage (Presignal) Fire Alarm Station, French/English Markings - ULC Listed | |
| SIGA-278 | Double Action (One Stage) Fire Alarm Station, English Markings - UL/ULC Listed | |
| Accessories | | |
| 32997 | GA Key w/Tag - for pre-signal station (CANADA ONLY) | 0.1 (.05) |
| 276-K2 | GA Key - for pre-signal station (USA ONLY) | |
| 276-K1 | Station Reset Key, Supplied with all Key Reset Stations | |
| 27165 | 12 Glass Rods - for SIGA-270 series (CANADA ONLY) | |
| 270-GLR | 20 Glass Rods - for SIGA-270 series (USA ONLY) | |
| 276-GLR | 20 Glass Rods - for SIGA-278 series | |
| 276B-RSB | Surface Mount Box, Red - for SIGA pull stations | 1 (0.6) |