
GOZO SITE CONSTRAINT ASSESSMENT

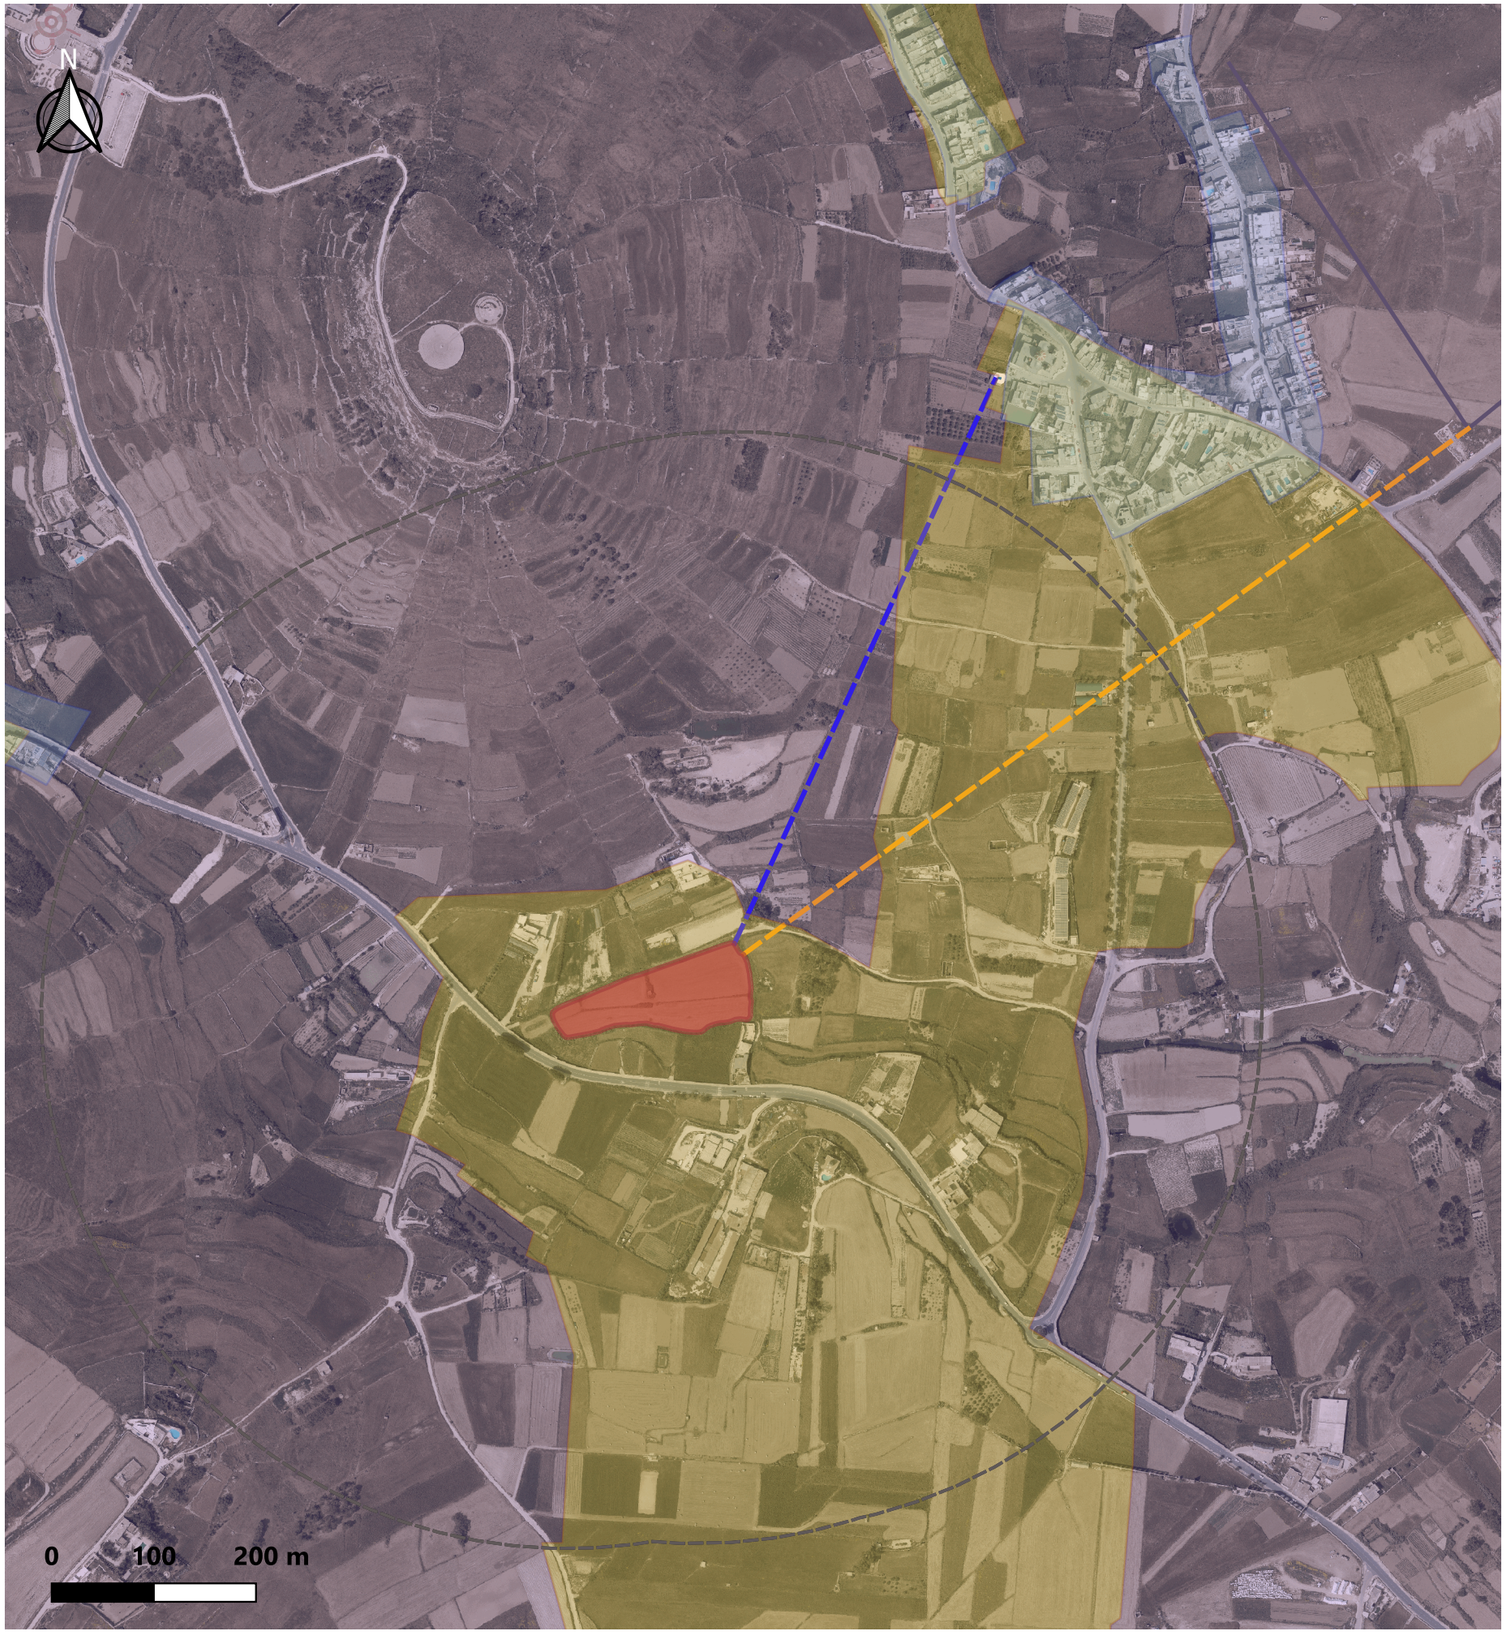

GHASRI, GOZO, MALTA
Preliminary site screening

SITE OVERVIEW

Candidate site: 1.04 ha
Study area: 500 m buffer
Assessment type: Preliminary constraint screening
Coordinate system: ETRS89 / UTM zone 33N

CONSTRAINT SUMMARY

Landscape protection
ALS intersects site • AHLS no intersection

Protected sites
No mapped sites within 500 m

Flood hazard
No mapped hazard within 500 m

Electricity infrastructure
Substation: 608 m
11 kV line: 876 m
33 kV: no public Gozo data

Terrain
Mean slope: 3.18°
Predominantly gentle terrain

CONSTRAINT RATING

LOW	Flood hazard
LOW	Protected sites
LOW	Terrain
LOW	Grid proximity
MODERATE	Landscape protection

MAP LEGEND

- Candidate site
- Nearest substation – 608 m
- Nearest 11 kV line – 876 m
- Landscape Protection (ALS)
- 500 m study area

DATA & ANALYSIS

Planning Authority / Malta Data Portal · Enemalta · DTM 2018
Analysis & cartography: Maria Hellqvist · QGIS

ANALYSIS & METHODOLOGY

Gozo Site Constraint Assessment · Għasri, Malta

METHODOLOGY

01 DATA ACQUISITION

Official spatial datasets were obtained from the Malta Planning Authority, Malta Data Portal and Enemalta, including planning constraints, electricity infrastructure, orthophotography and terrain data.

02 DATA PREPARATION

Spatial datasets were reviewed, reprojected to ETRS89 / UTM zone 33N and prepared for analysis. Invalid geometries were corrected where required and relevant datasets were stored in a structured GeoPackage.


03 DATA ANALYSIS

A 500 m study area was generated around the candidate site. Spatial intersection was used to identify planning and environmental constraints, while shortest-distance analysis was used to assess proximity to electricity infrastructure. Terrain slope was derived from the 1 m DTM and classified into slope categories.

04 SITE ASSESSMENT

Analysis results were combined into a qualitative constraint assessment. Flood hazard, protected sites, terrain and grid proximity were assessed as low constraints, while landscape protection was identified as a moderate constraint requiring further consideration.

TERRAIN & SLOPE ANALYSIS

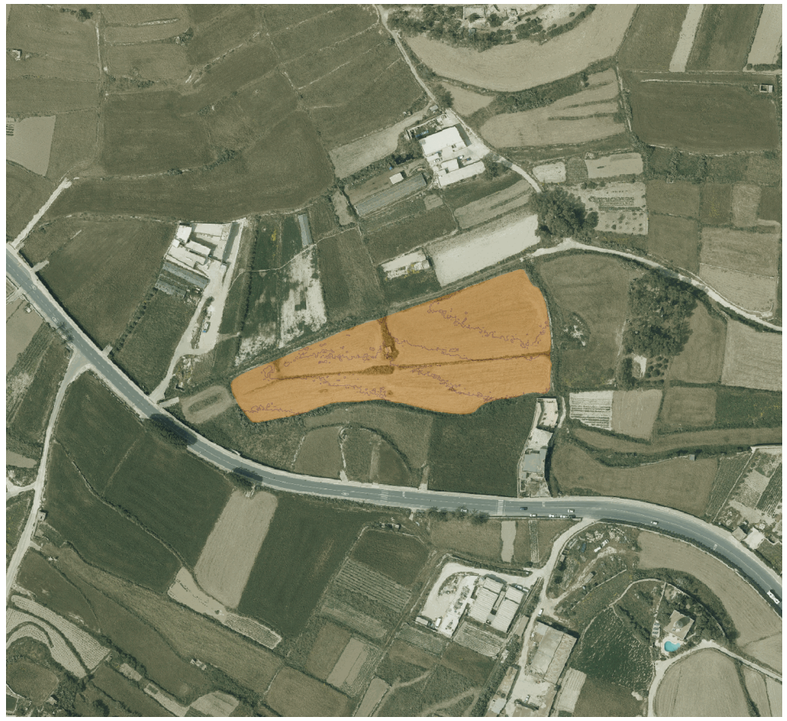

SLOPE CLASSIFICATION

0–5° Gentle terrain
>15° Steep terrace edges

TERRAIN RESULTS

Mean slope: 3.18°
95.2% of site ≤5°
4.8% of site >15°
No cells classified between >5–15°
Steep slopes concentrated along terrace edges

KEY ANALYSIS RESULTS

Grid proximity

Nearest substation — 608 m
Nearest 11 kV line — 876 m
33 kV network — Public Gozo data unavailable

PLANNING & ENVIRONMENTAL ANALYSIS



PLANNING RESULTS

Landscape protection
Site intersects ALS
No intersection with AHLS

Protected sites
No mapped protected sites within 500 m

Flood hazard
No mapped flood hazard within 500 m

Overall assessment

Low constraints identified for terrain, flood hazard, protected sites and grid proximity. Landscape protection represents the principal planning constraint identified in this screening.