
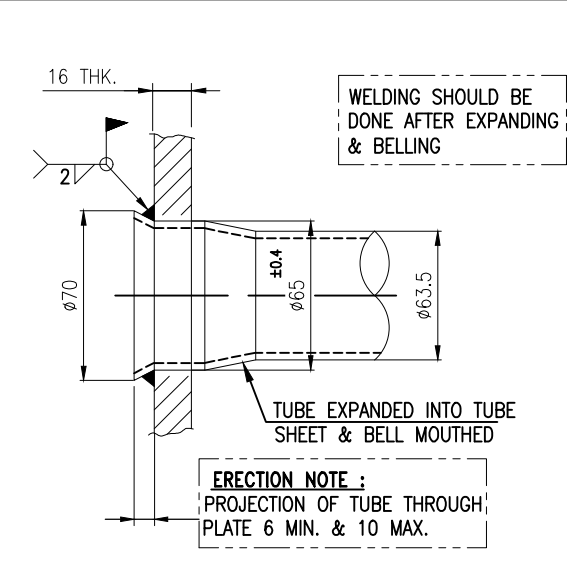
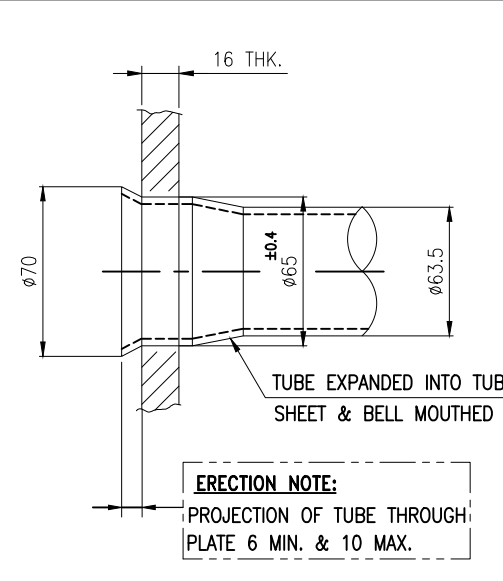
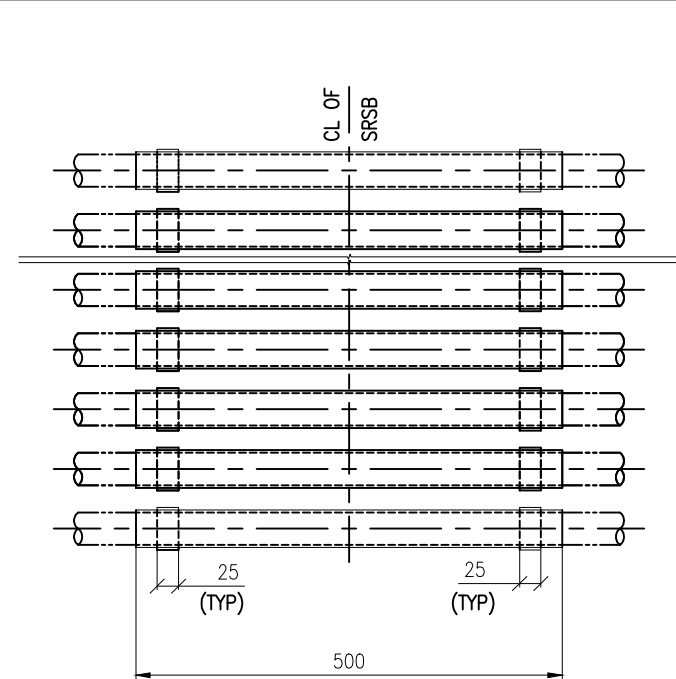
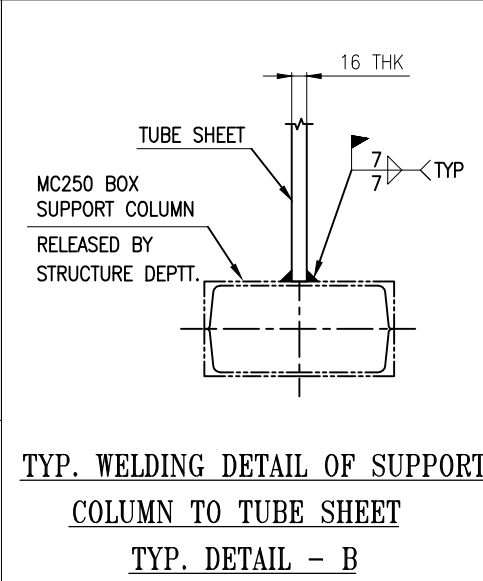


THIS IS A CAD FILE - DO NOT CORRECT IT MANUALLY

1000-838-0010050050100-JB1003	DOCUMENT ID
JB1003	PROJECT ID

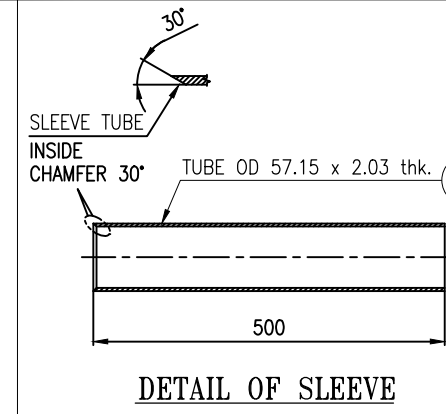

- NOTES:-**
01. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 02. HOLE TOLERANCE OF $\phi 65^{+0.10}_{-0.05}$ TO BE STRICTLY MAINTAINED.
 03. FABRICATION TO BE DONE BY FULL SCALE SHOP LAYOUT.
 04. TUBE HOLE & TUBE ENDS ARE TO BE THOROUGHLY CLEANED BEFORE EXPANSION AT SITE.
 05. I/S - DENOTES INSIDE DIMENSIONS, FW - DENOTES FLEET WELD.
 06. WELDING ELECTRODE SHALL CONFORM TO IS-814 (LATEST).
 07. ALL WELDING SHALL BE DONE AS PER IS-816 & 823 & SHALL BE FULL CONTACT LENGTH UNLESS STATED OTHERWISE.
 08. ALL STRUCTURAL MEMBERS CONFORM TO IS-808.
 09. SURFACE FINISH OF TUBES (50mm AT BOTH ENDS) TO BE MAINTAINED AS 120 MICRONS INCHES.
 10. FOR DIMENSIONAL TOLERANCE REQUIREMENT PLEASE REFER DOC.No. GEN-50990100-DSM-002 AND ITS ASSOCIATED DRAWING.
 11. AIR HEATER TUBES (ITEM CODE : AHT001, AHT002 & AHT003), SLEEVE (ITEM CODE : AHT004) ARE RELEASED AS BOUGHT OUT ITEMS ALONG WITH OUR AIR HEATER TUBE SPECIFICATION JB1003-50050100-SPC-001.
 12. BOTH TUBE SHEET OF EACH AIR HEATER BLOCK TO BE CLAMPED TOGETHER AND STACK DRILLED TO ENSURE THAT ALL TUBE HOLES COINCIDE.











SURFACE PREPARATION & PAINTING NOTES:-
MECHANICAL CLEANING TO 2 COAT 30 DPT RED OXIDE ZINC PHOSPHATE PRIMER BEFORE DISPATCH.

- ERECTION NOTES:-**
01. ALL WELDING SHOULD BE SOUND AND COMPLETE WITHOUT ANY GAP, TO AVOID LEAKAGE OF AIR FROM ONE SIDE TO ANOTHER.
 02. REFRACTORY TO BE APPLIED BEFORE ERECTING COLD AIR DUCT.
 03. ANCHOR STUD TO BE WELDED (REF-038-0002) WITH TUBE SHEET AT GROUND.
 04. SLEEVES TO BE PROVIDED AT AIR HEATER BLOCK-I, AIR ENTRY INSIDE ONLY.
 05. SLEEVES ARE TO BE INSERTED & WELDED WITH TUBES AFTER REFRACTORY APPLICATION.
 06. ON COMPLETION OF REFRACTORY APPLICATION THE COTTON WASTE SHALL BE REMOVED. INSPECTION BY THE QA ENGINEER FOR 100% REMOVAL OF COTTON WASTE IS REQUIRED.
 07. AFTER THE INSERTION OF AIR HEATER TUBE, THE SLEEVE WITH ATTACHMENT CLIP TO BE WELDED AT SITE.
 08. AIR HEATER TUBES SHALL BE PROTECTED USING END CAPS SUPPLIED ALONG WITH THEM BEFORE APPLICATION OF REFRACTORY.

LIST OF REFERENCE DRAWINGS	
DRAWING DOCUMENT ID	DESCRIPTION
JB1003-50050100-038-0002	DETAIL OF AIR HEATER TUBE SHEET

FOR AIR HEATER TUBES REFER SPEC. DOCUMENT ID - JB1003-50050100-SPC-001

THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH DWG. No. JB1003-50110107-040-0001 (A & D OF AIR HEATER CASING)

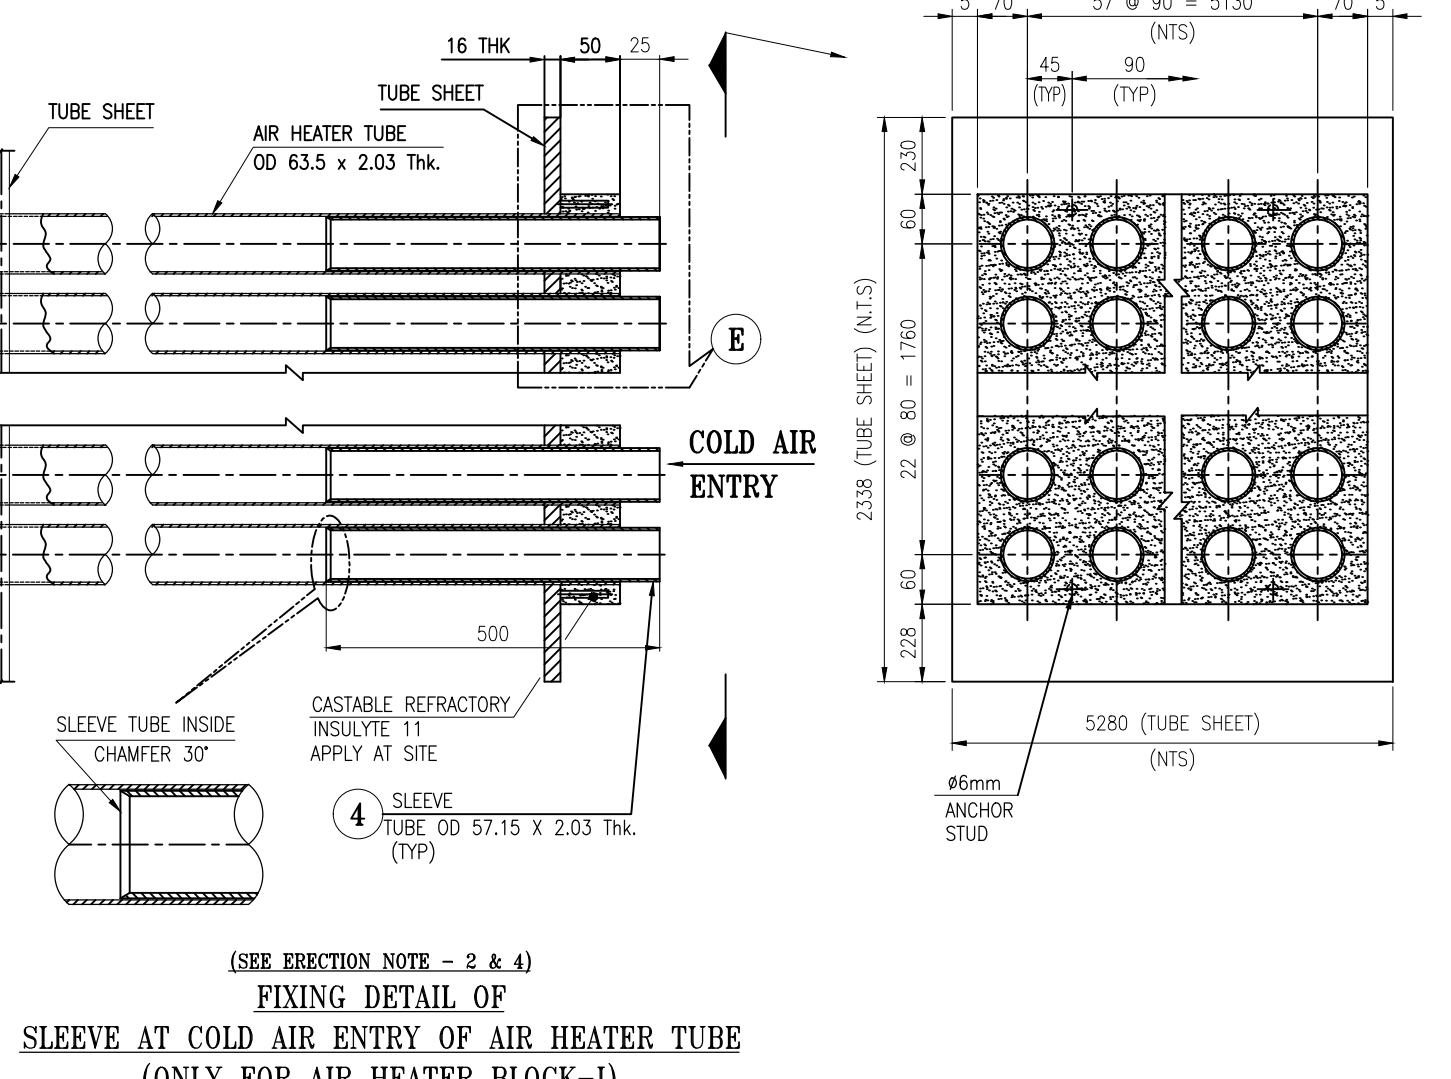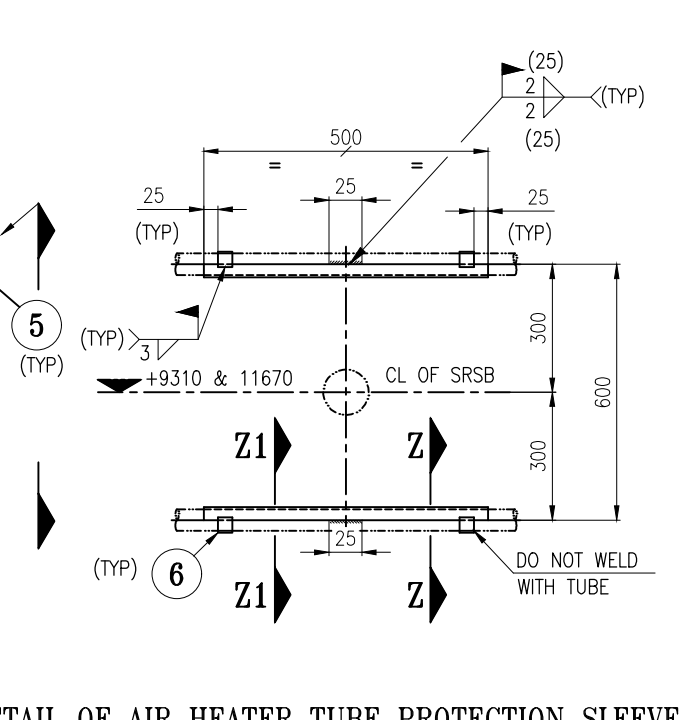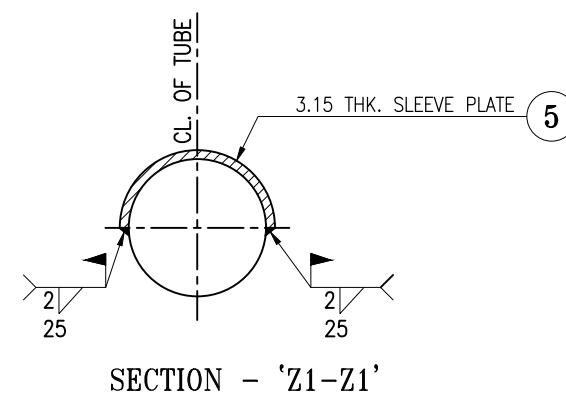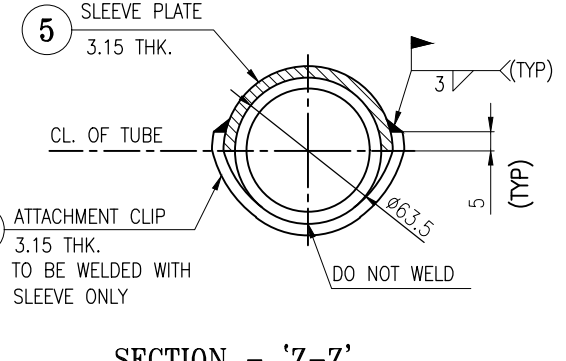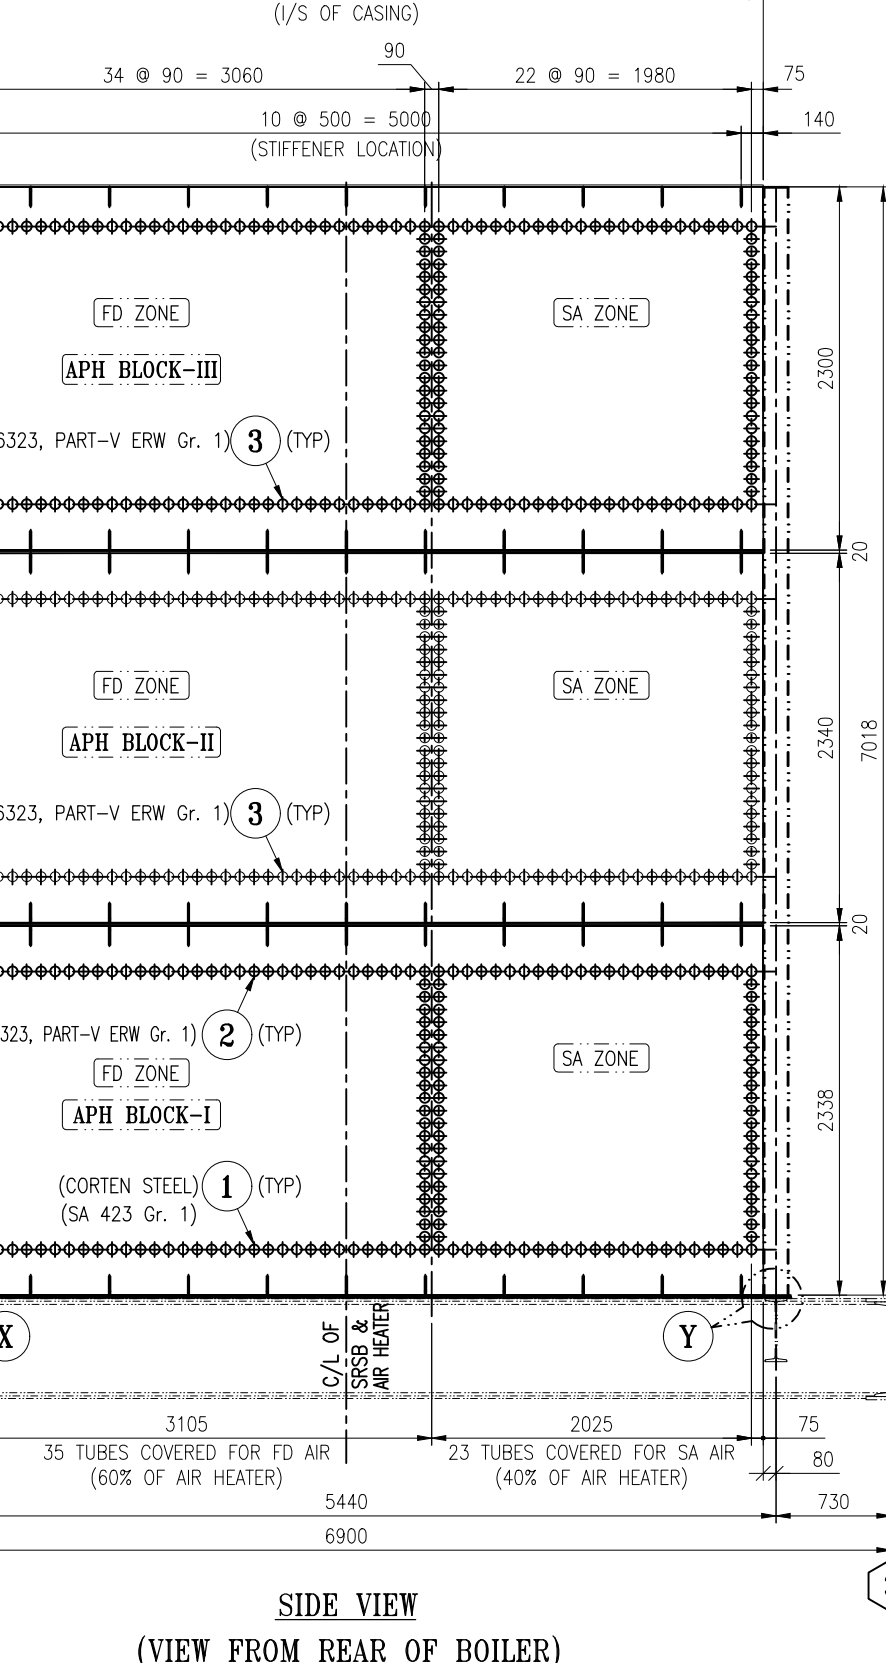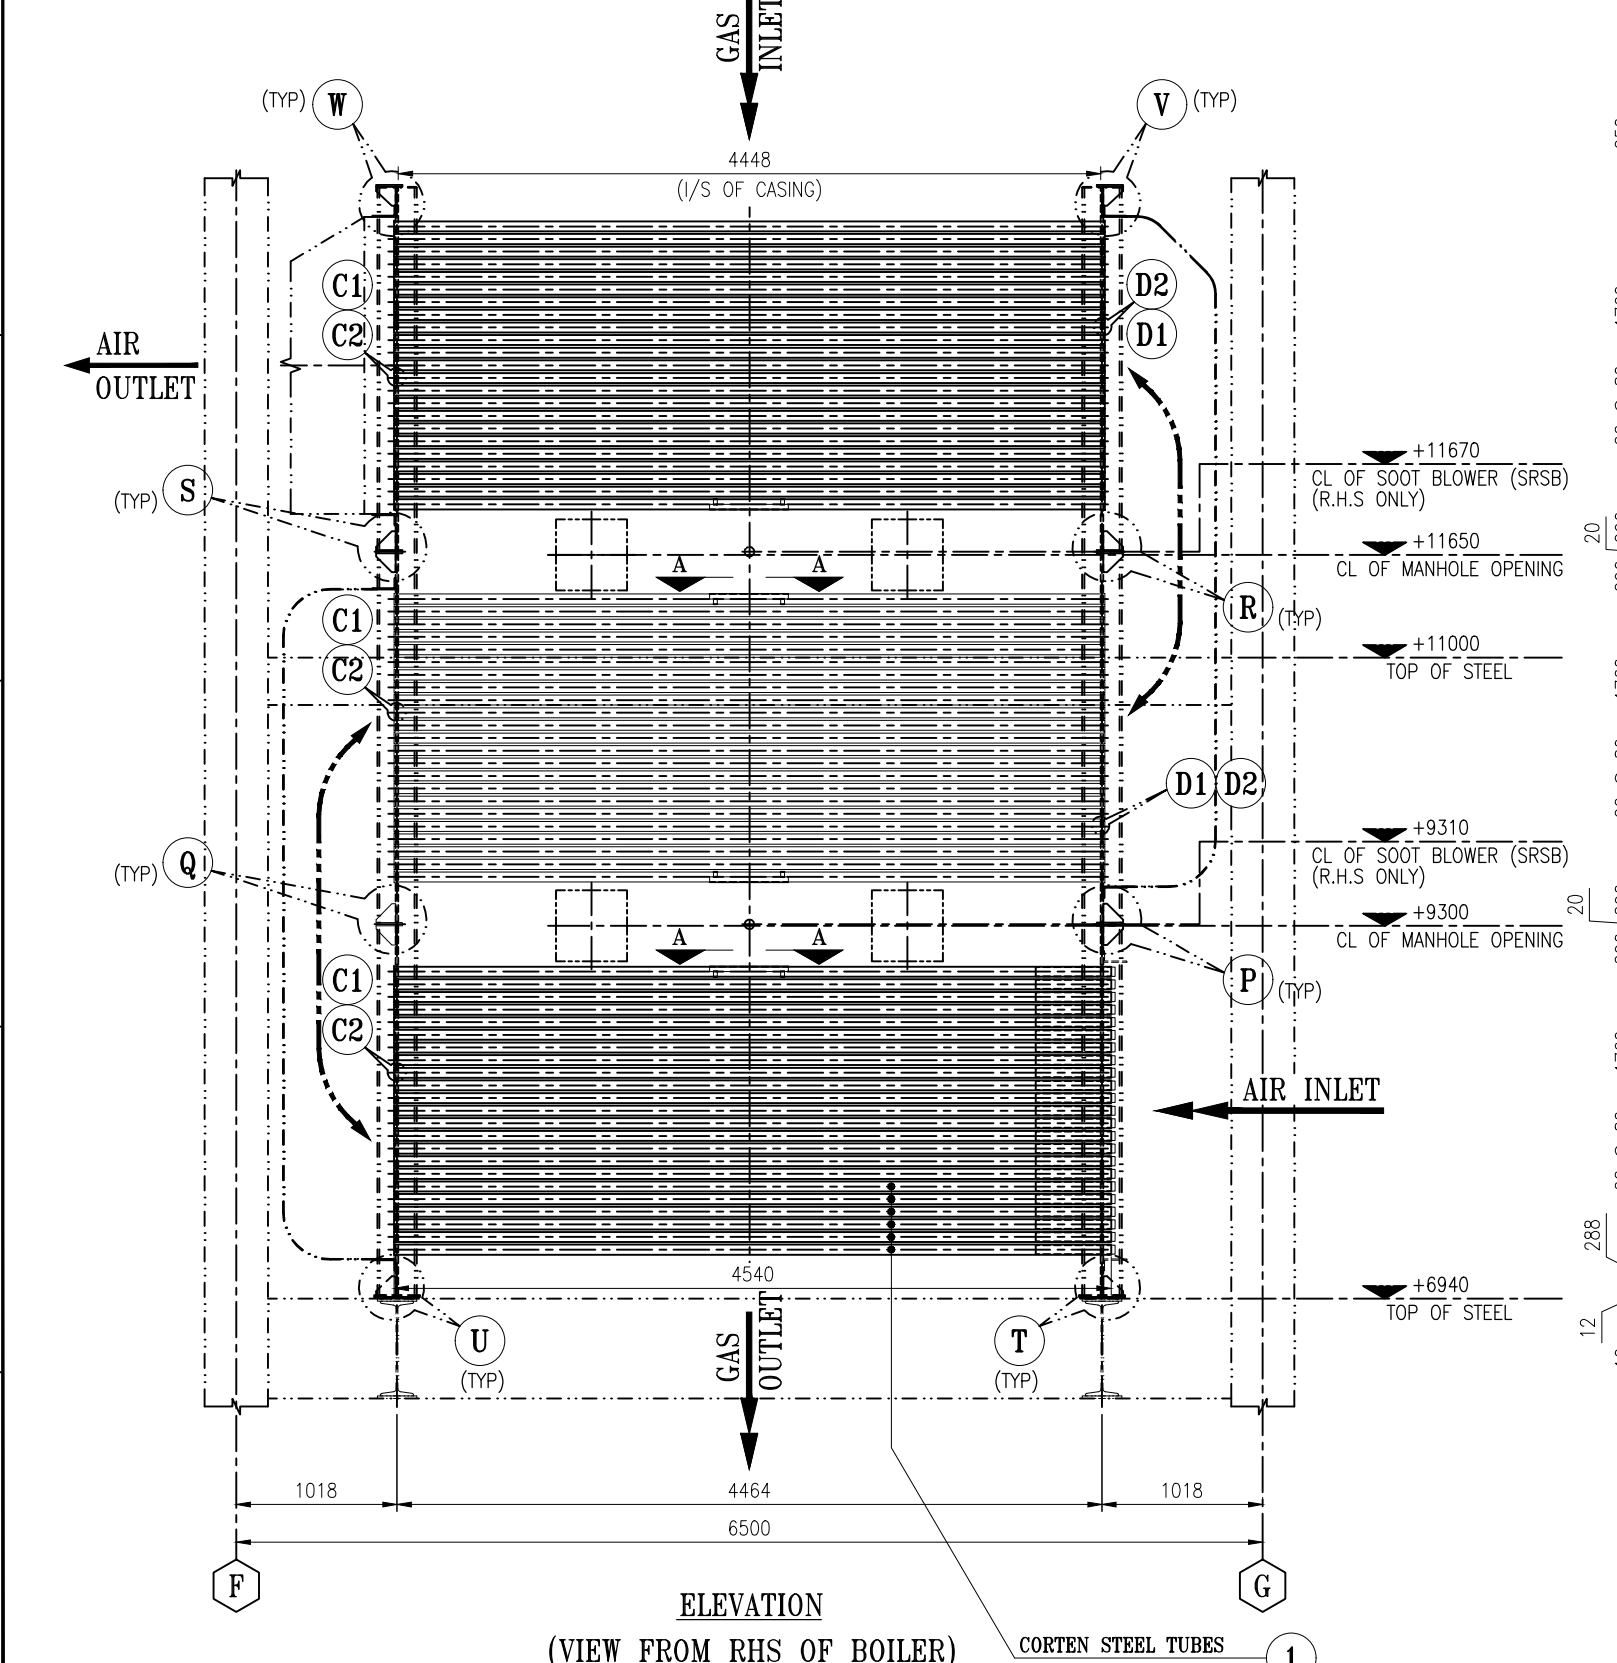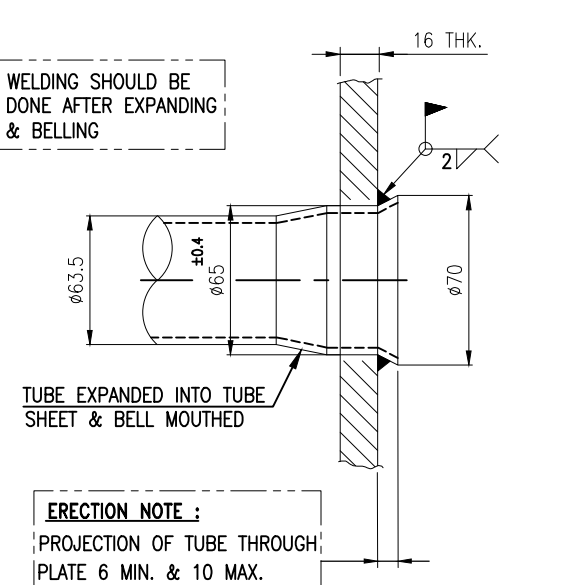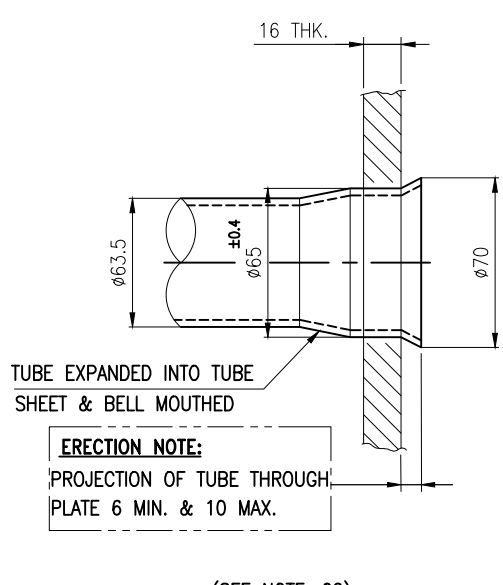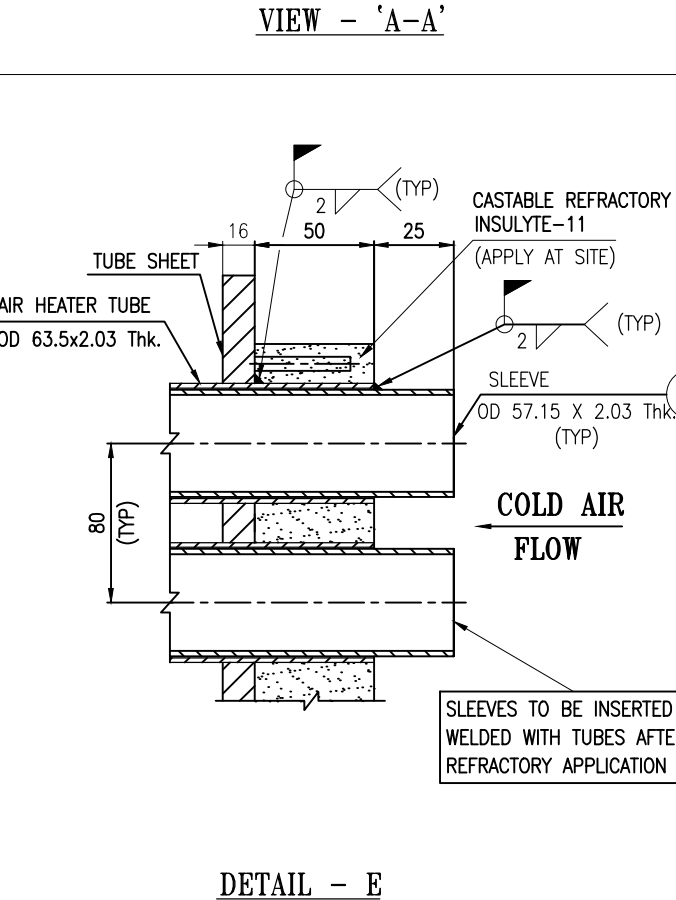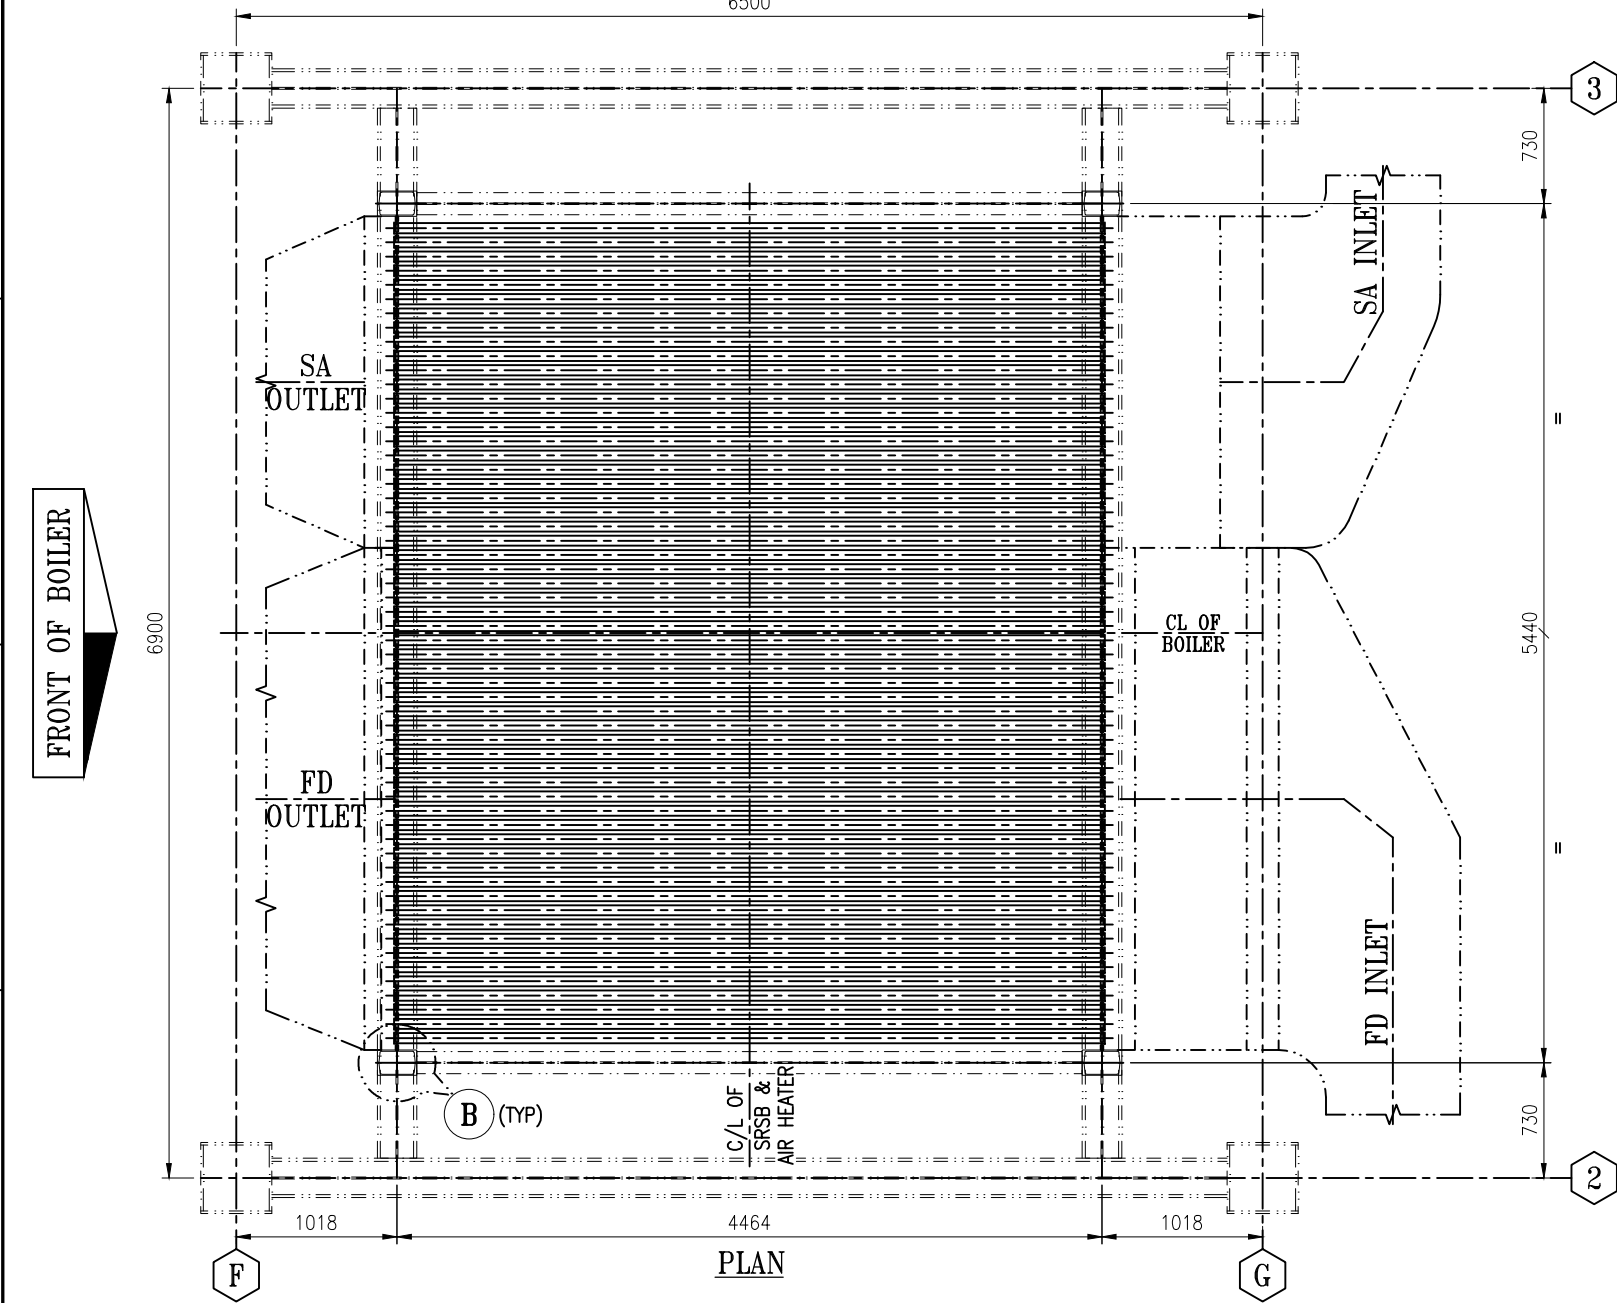

CASTABLE REFRACTORY		FIRECRETE (SPL)-1250kg/m ³		BOUGHT OUT WILL BE RELEASED IN ELEMENT ID: 50140100	
--	CASTABLE REFRACTORY	P	B225	--	--

ITEM CODE	ITEM DESCRIPTION	I.TYPE	I.GROUP	I.QTY	I.WT (Kg)	REMARK
RPSAH202511A	ATTACHMENT CLIP (#63.5x251g)	S	B006	480	33.60	16 Nos. EXTRA (REF.DWG: (BIS-EPC-001-32-S1)
RPSAH250011A	HALF SLEEVE (#63.5x5001g)	S	B006	240	312.00	8 Nos. EXTRA (REF.DWG: (BIS-EPS-001-31-S1)

MATERIAL LIST (FOR STANDARD ITEMS)

6	BIS-EPC-001-32-S1	B006	280	33.60	16 Nos. EXTRA
5	BIS-EPS-001-31-S1	B006	240	312.00	8 Nos. EXTRA
PART.NO	STANDARD.DRAWING.NO:	ITEM.GROUP	QTY	WEIGHT	REMARKS

PART Nos. APPLICABLE WITH STANDARD DWGS. ALONG WITH RESPECTIVE ITEM CODES

ITEM CODE	ITEM DESCRIPTION	I.TYPE	I.GROUP	I.QTY	I.WT (Kg)	REMARK
AHT004	AIR HEATER TUBE SLEEVE	P	B006	151	1896.56	SLEEVES FOR AHT001 TUBES
3	AIRHEATER TUBE BLOCK-II & III	P	B006	2700	37395.00	ACTUAL+ERECTION SPARE (32 Nos.)
AHT003	AIR HEATER TUBE	P	B006	2700	37395.00	
2	AIRHEATER TUBE BLOCK-I	P	B006	1000	13970.00	ACTUAL+ERECTION SPARE (14 Nos.)
AHT002	AIR HEATER TUBE	P	B006	1000	13970.00	
1	AIRHEATER TUBE BLOCK-I	P	B006	355	4959.35	ACTUAL+ERECTION SPARE (7 Nos.)
AHT001	AIR HEATER TUBE	P	B006	355	4959.35	
P.NO.	P.DESCRPTION	SPECIFICATION	SIZE	P.QTY	P.WT(kg)	REMARK
ITEM CODE	ITEM DESCRIPTION	I.TYPE	I.GROUP	I.QTY	I.WT (Kg)	REMARK

CONSULTANT		NFCFS	
CLIENT		M/s. U.P. STATE SUGAR CORPORATION LTD.,	
DO NOT SCALE IF IN DOUBT PLEASE ASK		THIS DESIGN IS THE PROPERTY OF M/S. ISGEC HEAVY ENGINEERING LTD. AND IS ONLY ALLOWED TO BE USED BY EXPRESSED PERMISSION AND LICENSE FROM M/S. ISGEC HEAVY ENGINEERING LTD.	
FOR APPROVAL	NO	FOR INFORMATION	NO
RESPONSIBLE DEPT.	DRAWN BY	CHECKED BY	APPROVED BY
MECHANICAL	PANKAJ	KRISH/K.ARUN	SSSEN
TOTAL WEIGHT IN kg.		PROJECT ID	
58566.51		JB1003	
YEAR		SHEET SIZE	
2016		A1	
SCALE		SCALE	
1 : 45		1 : 45	
SERVICE		TITLE	
1 x 90 TPH(NET), BI-DRUM, WATER TUBE, GIRTH SUPPORTED, TRAVELLING GRATE BOILER		ARRANGEMENT AND DETAIL OF AIR HEATER	
DRAWING DOCUMENT ID		REVISION	
JB1003-50050100-038-0001		00	



Isgec Heavy Engineering Ltd. Noida 201 301 (U.P.) India

CAD FILE FROM SOFTWARE - AUTOMATION