



THIS IS A CAD FILE - DO NOT CORRECT IT MANUALLY

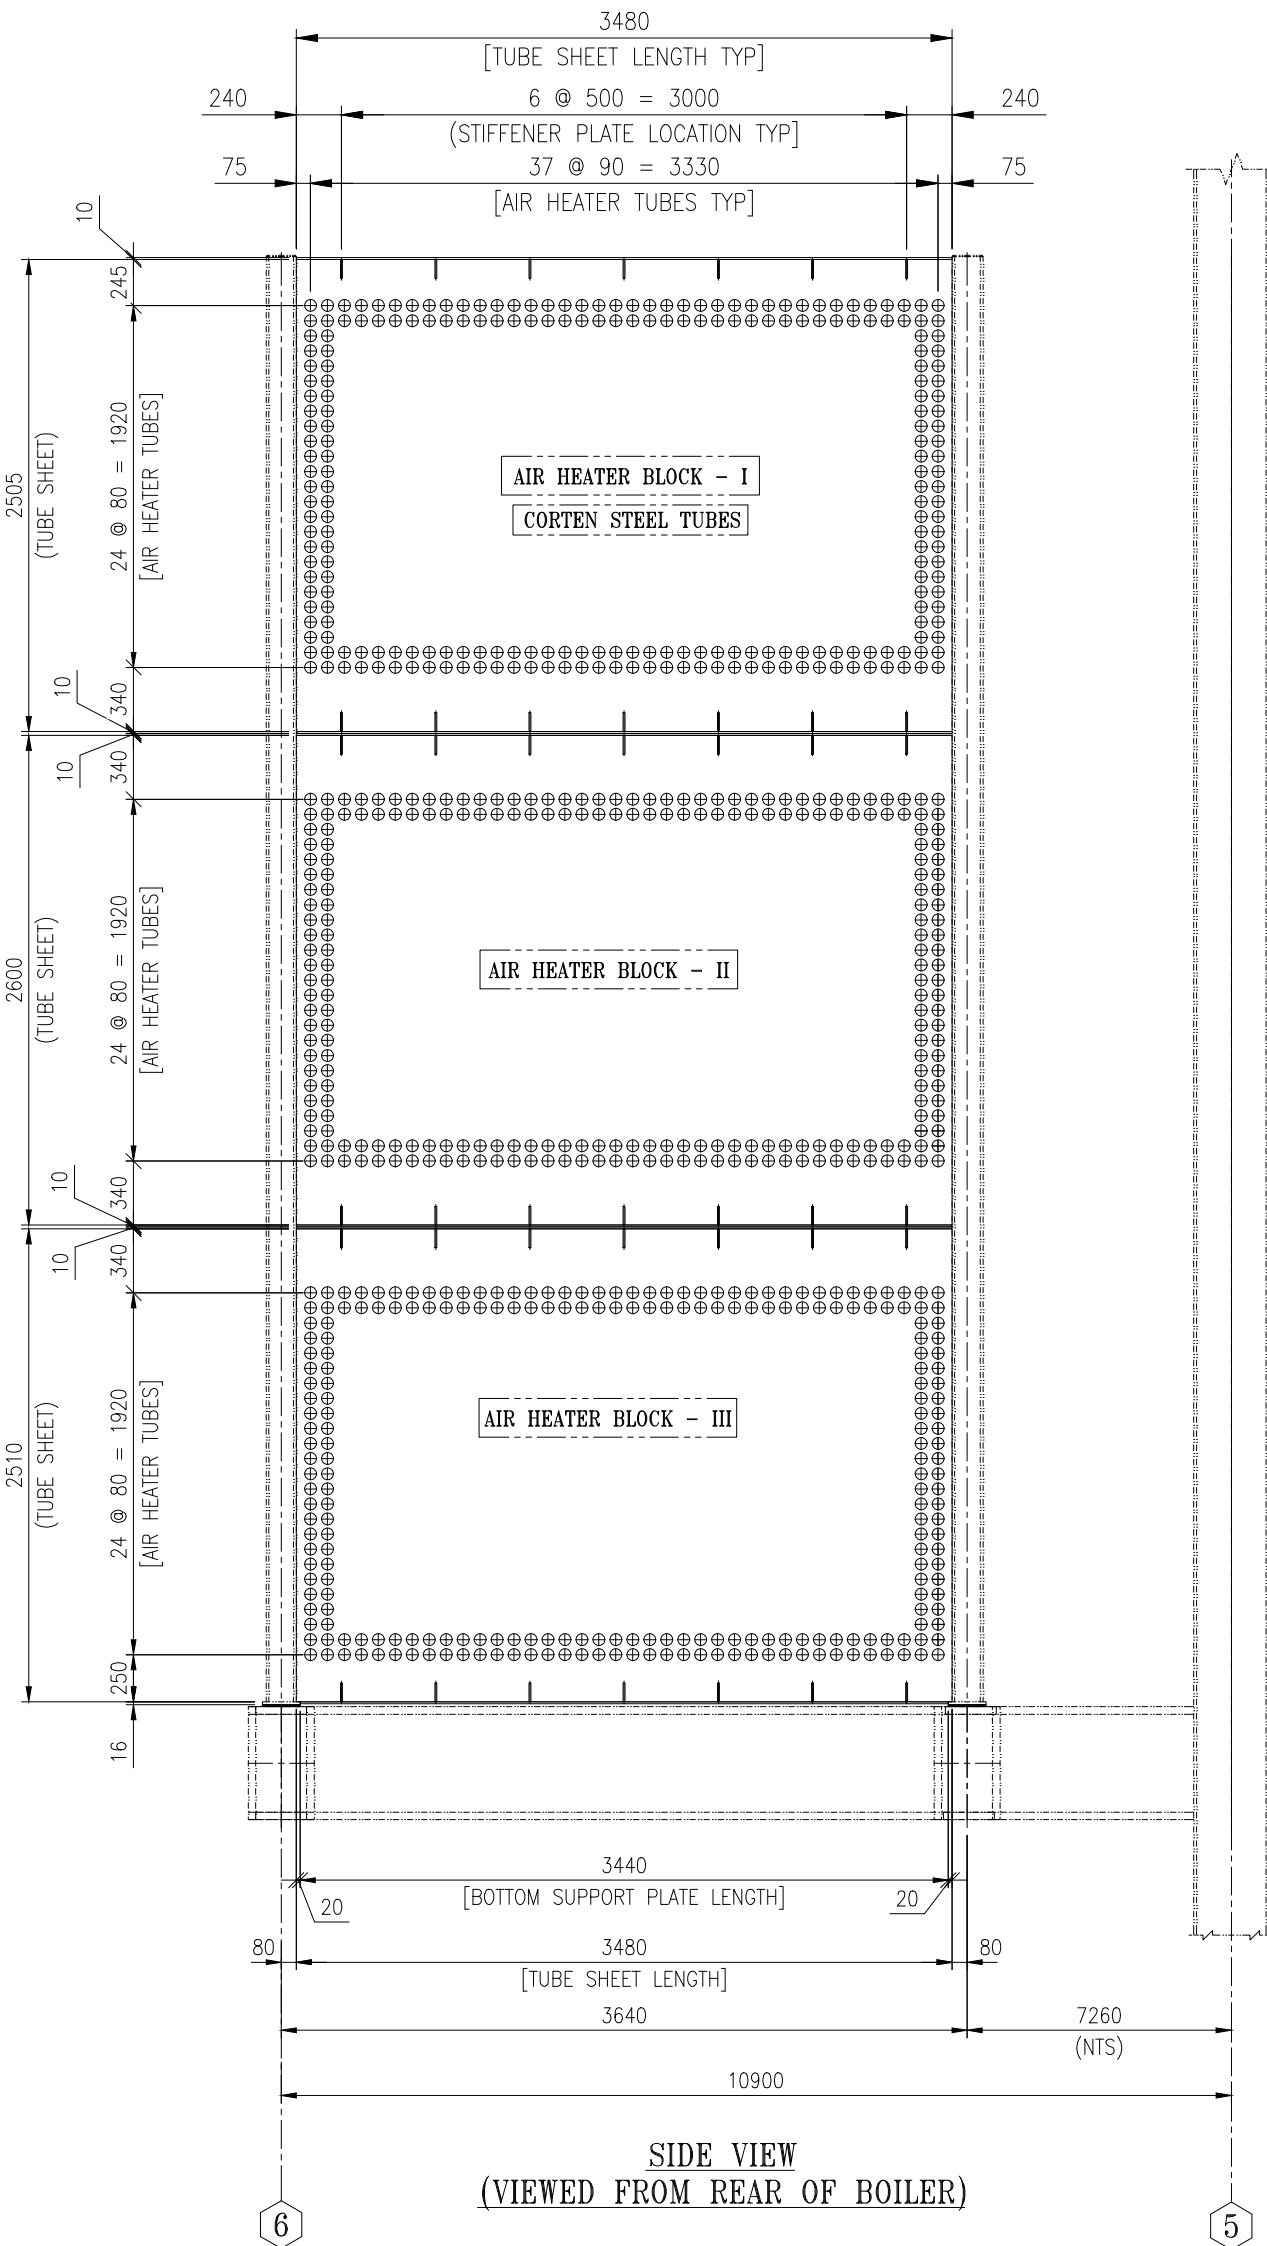

UNTOLERENCED DIMENSIONS CONFORM TO IS-2102:1998 COARSE					
LINEAR			RADIUS		
7 - 30	±0.5	1001 - 2000	±3.0	3 - 6	±1.0
31 - 120	±0.8	2001 - 4000	±4.0	OVER 6	±2.0
121 - 400	±1.2	-	-	-	-
401 - 1000	±2.0	-	-	-	-
* SPECIFIC TOLERANCE IF ANY INDICATED IN THE DRAWING SHALL BE STRICTLY FOLLOWED.					

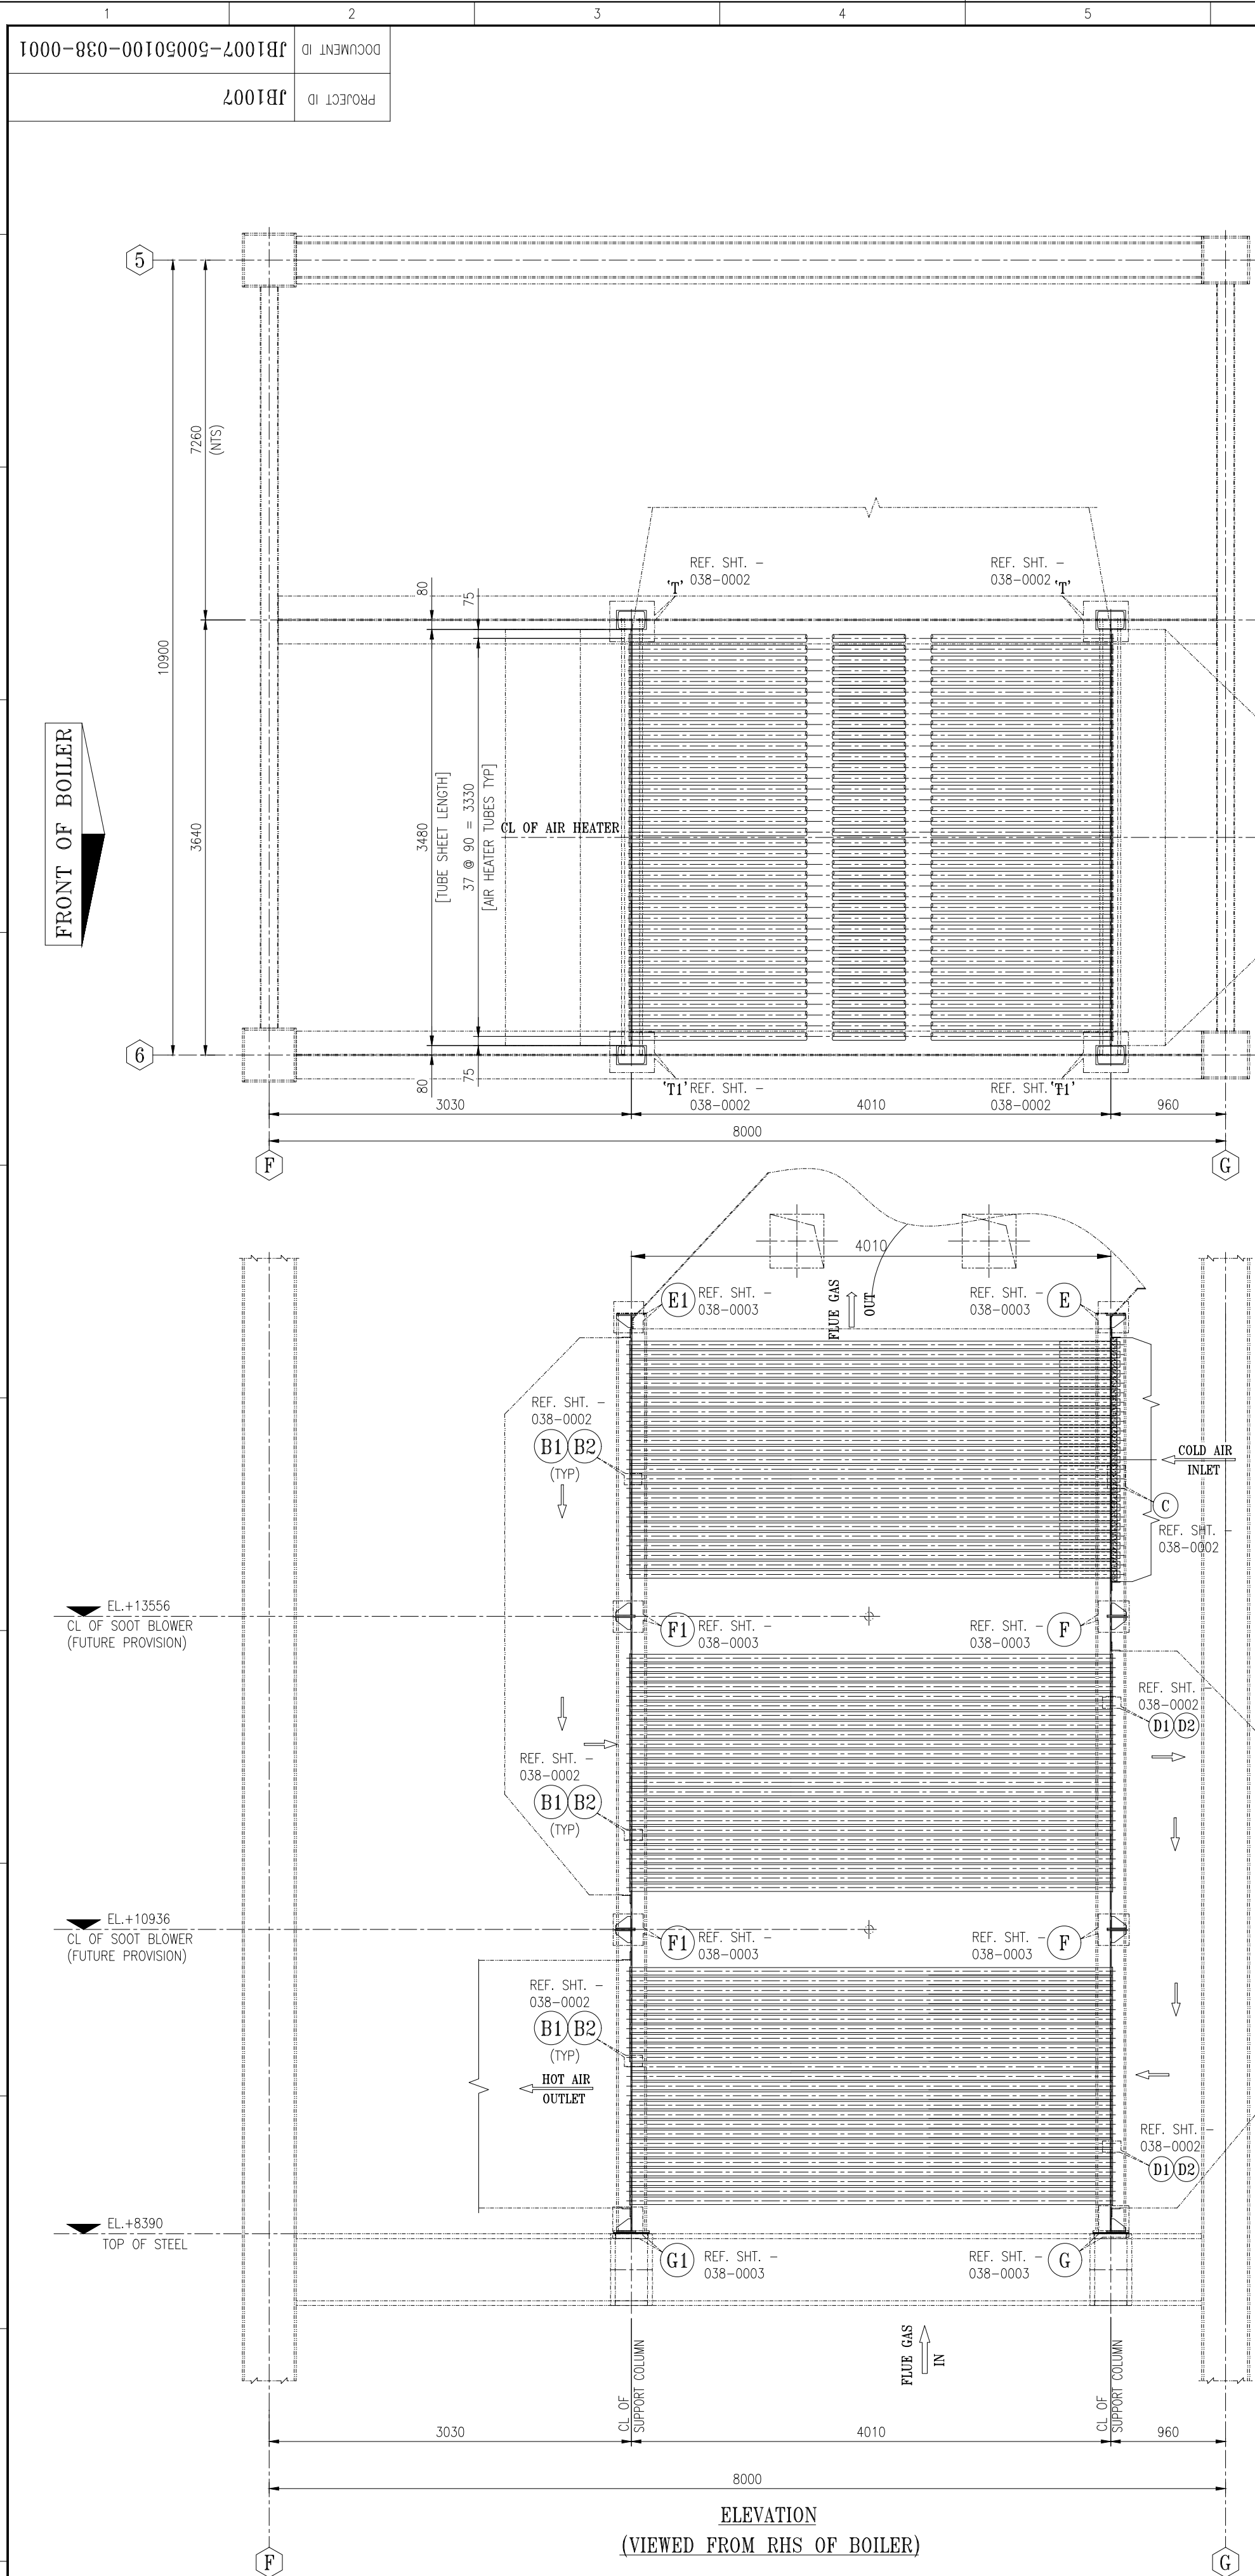

1) TITLE BLOCK REVISED. 11) CO-ORDINATES TABLE HAS BEEN ADDED.
1) NTPC PAINTING DOCUMENT NO. UPDATED.

REV. NO. ZONE

DESCRIPTION

MANE

SWARUP

SATHE

07.09.2017

ABHISHEK

SWARUP

SATHE

03.11.2017

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

DESCRIPTION

REV. NO.

ZONE

NOTES:-

01. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
02. HOLE TOLERANCE OF ± 0.4 TO BE STRICTLY MAINTAINED.
03. FABRICATION TO BE DONE BY FULL SCALE SHOP LAYOUT.
04. TUBE HOLE & TUBE ENDS ARE TO BE THOROUGHLY CLEANED BEFORE EXPANSION AT SITE.
05. 1/S - DENOTES INSIDE DIMENSIONS, FW - DENOTES FIELD WELD.
06. WELDING ELECTRODE SHALL CONFORM TO IS:814 (LATEST).
07. ALL WELDING SHALL BE DONE AS PER IS:816 & 823 & SHALL BE FULL CONTACT LENGTH UNLESS STATED OTHERWISE.
08. ALL STRUCTURAL MEMBERS CONFORM TO IS:808.
09. SURFACE FINISH OF TUBES (50mm AT BOTH ENDS) TO BE MAINTAINED AS 120 MICRONS INCHES.
10. GENERAL TOLERANCES ARE AS PER IS:2102-1998 (COARSE) UNLESS OTHERWISE SPECIFIED (SEE TABLE).
11. AIR HEATER TUBES (ITEM CODE : AHT001 & AHT002), SLEEVE (ITEM CODE : AHT003) ARE RELEASED AS BOUGHT OUT ITEMS ALONG WITH OUR AIR HEATER TUBE SPECIFICATION JB1007-50050100-SPC-0001.
12. BOTH TUBE SHEET OF EACH AIR HEATER BLOCK TO BE CLAMPED TOGETHER AND STACK DRILLED TO ENSURE THAT ALL TUBE HOLES COINCIDE.

PAINTING NOTES:-

FOR PAINTING NOTES & SURFACE PREPARATION REFER

SPECIFICATION No: JB1007-50570900-PSH-000(NTPC DOC.NO.-9861-102-PVM-W-002).

ERECTION NOTES:-

01. ALL WELDING SHOULD BE SOUND AND COMPLETE WITHOUT ANY GAP, TO AVOID LEAKAGE OF AIR FROM ONE SIDE TO ANOTHER.
02. REFRACTORY TO BE APPLIED BEFORE ERECTING COLD AIR DUCT.
03. ANCHOR STUD TO BE WELDED (REF-038-0002) WITH TUBE SHEET AT GROUND.
04. SLEEVES TO BE PROVIDED AT AIR HEATER BLOCK-L, AIR ENTRY INSIDE ONLY.
05. SLEEVES ARE TO BE INSERTED & WELDED WITH TUBES AFTER REFRACTORY APPLICATION.
06. ON COMPLETION OF REFRACTORY APPLICATION THE COTTON WASTE SHALL BE REMOVED.
07. AFTER THE INSERTION OF AIR HEATER TUBE, THE SLEEVE WITH ATTACHMENT CLIP TO BE WELDED AT SITE.
08. AIR HEATER TUBES SHALL BE PROTECTS USING END CAPS SUPPLIED ALONG WITH THEM BEFORE APPLICATION OF REFRACTORY.

LIST OF REFERENCE DRAWINGS

DRAWING DOCUMENT ID	DESCRIPTION
JB1007-50050100-038-0002	DETAIL OF AIR HEATER
JB1007-50050100-038-0003	DETAIL OF AIR HEATER TUBE SHEET

FOR AIR HEATER TUBES REFER SPEC. DOCUMENT ID - JB1007-50050100-SPC-0001

THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH DWG. No. JB1007-50110107-040-0001 (A & D OF AIR HEATER CASING)

3	SLEEVES	BS 6323 PART-4, 1982 EN 10217-4	O/D 57.15 X 2.03 THK x 2520 Lg.	192	1334.40	2 QTY. EXTRA (SLEEVES FOR AHT003 TUBES)
AHT003	AIR HEATER TUBE SLEEVE	P	B006	182	1334.40	
2	AIRHEATER TUBE BLOCK-I	SA 423 Gr.ERW	O/D 63.5 X 2.34 THK x 4077 Lg.	960	13814.4	ACTUAL+ERECTION SPARE (10 Nos.)
AHT002	AIR HEATER TUBE	P	B006	960	13814.4	
1	AIRHEATER TUBE BLOCK-II & III	BS 6323 PART-4, 1982 EN 10217-4	O/D 63.5 X 2.34 THK x 4040 Lg.	1920	27379.20	ACTUAL+ERECTION SPARE (20 Nos.)
AHT001	AIR HEATER TUBE	P	B006	1920	27379.20	
P.NO.	P.DESCRPTION	SPECIFICATION	SIZE	P.QTY	P.WT(kg)	REMARK
ITEM CODE	ITEM DESCRIPTION	LTYPE	L.GROUP	I.QTY	L.WT(kg) (TOTAL)	REMARK

PROJECT	DURGAPUR POWER PROJECT-III (2x20 MW)				
OWNER	M/s. NTPC SAIL POWER COMPANY PVT. LTD.,				
OWNER CONSULTANT	M/s. NTPC LIMITED.				
EPC CONTRACTOR	M/s. ISGEC HEAVY ENGINEERING LIMITED.				
NSPCL DOCUMENT NO.	9861-102-PVM-B-014			REV NO.	02
DO NOT SCALE IF IN DOUBT PLEASE ASK		THIS DESIGN IS THE PROPERTY OF M/S. ISGEC HEAVY ENGINEERING LTD. AND IS ONLY ALLOWED TO BE USED BY EXPRESSED PERMISSION AND LICENSE FROM M/S. ISGEC HEAVY ENGINEERING LTD.			
FOR APPROVAL	NO	FOR INFORMATION	NO	FOR PRODUCTION	YES
RESPONSIBLE DEPT.	MECHANICAL	DRAWN BY	ABHISHEK/BHUPESH	CHECKED BY	MANE
APPROVED BY	SWARUP/S.SATHE	DATE	30.05.2017	PROJECT ID	JB1007
ELEMENT ID	50050100	L.W.T. NO.	6506	SHEET SIZE	A1
SCALE	1:40	TOTAL WEIGHT IN kg.	42765.60	YEAR	2017
SERVICE	2 X 88 TPH, SINGLE DRUM, NATURAL CIRCULATION, TOP SUPPORTED, AFBC BOILER				
TITLE	GENERAL ARRANGEMENT OF AIR HEATER				
DRAWING DOCUMENT ID	JB1007-50050100-038-0001			REVISION	02