


THIS IS A CAD FILE - DO NOT CORRECT IT MANUALLY

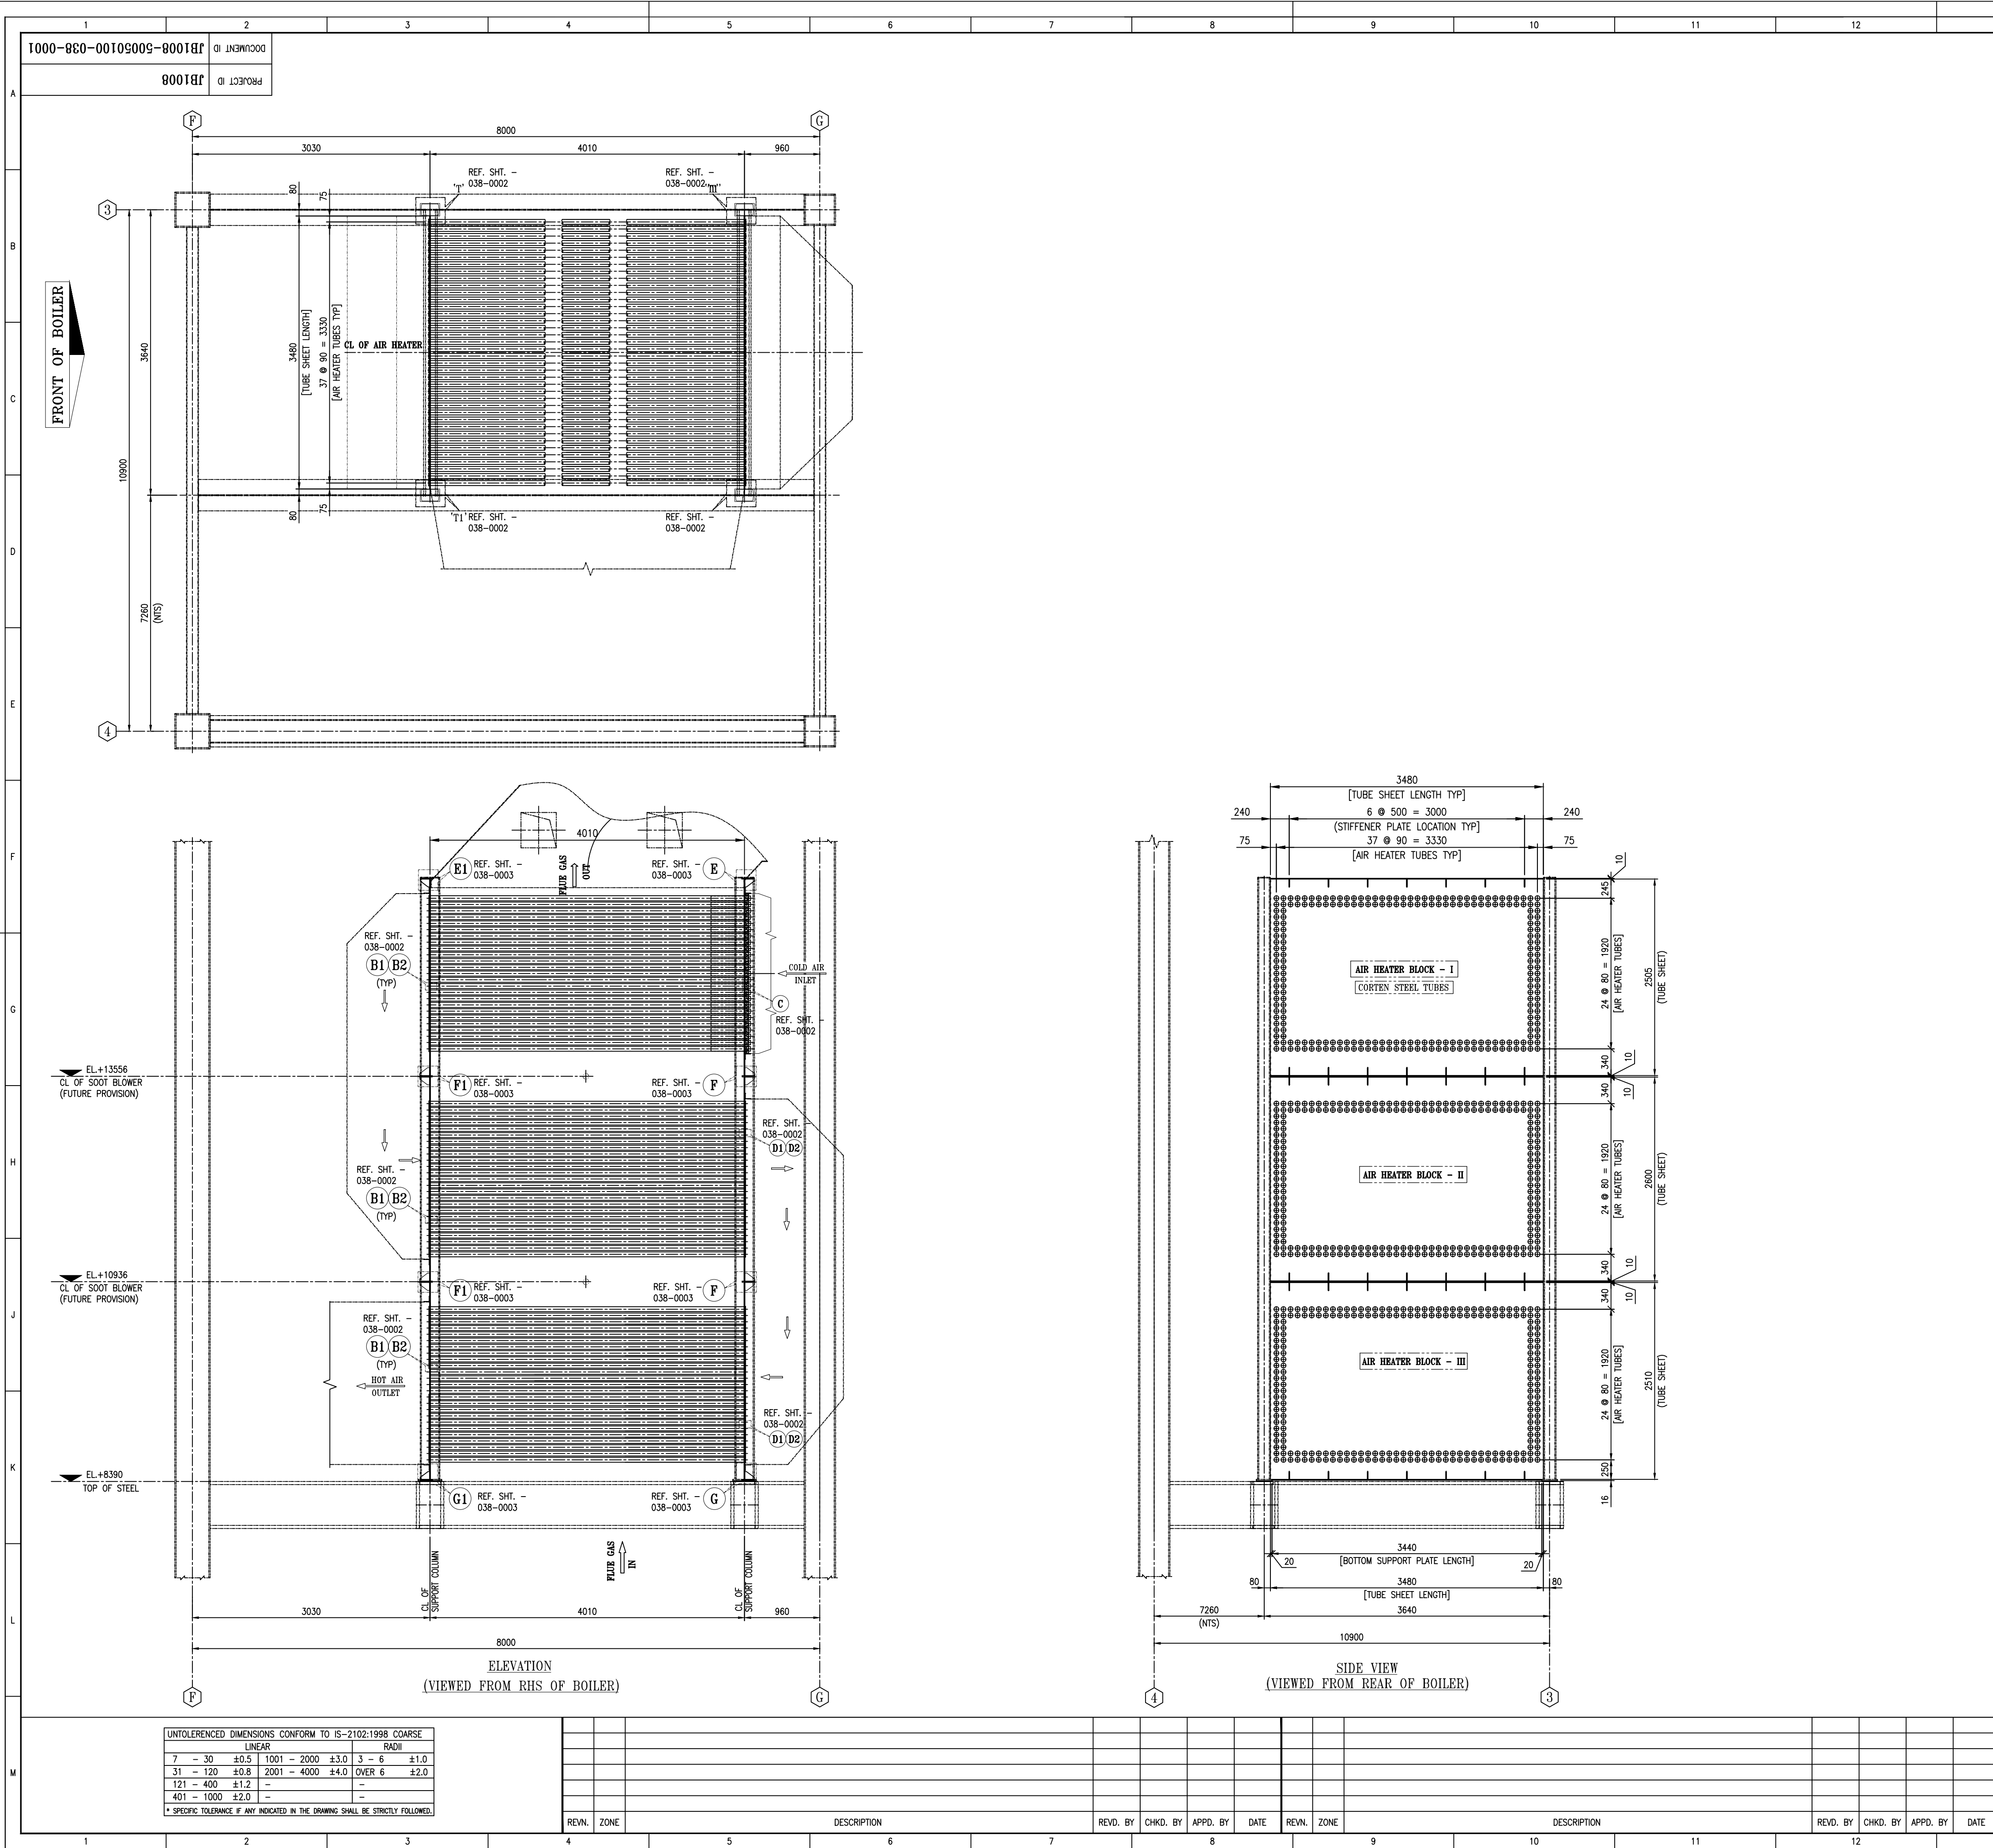

- NOTES:-**
01. ALL DIMENSIONS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 02. HOLE TOLERANCE OF ± 0.1 TO BE STRICTLY MAINTAINED.
 03. FABRICATION TO BE DONE BY FULL SCALE SHOP LAYOUT.
 04. TUBE HOLE & TUBE ENDS ARE TO BE THOROUGHLY CLEANED BEFORE EXPANSION AT SITE.
 05. I/S - DENOTES INSIDE DIMENSIONS, FW - DENOTES FIELD WELD.
 06. WELDING ELECTRODE SHALL CONFORM TO IS-814 (LATEST).
 07. ALL WELDING SHALL BE DONE AS PER IS-816 & 823 & SHALL BE FULL CONTACT LENGTH UNLESS STATED OTHERWISE.
 08. ALL STRUCTURAL MEMBERS CONFORM TO IS-808.
 09. SURFACE FINISH OF TUBES (50mm AT BOTH ENDS) TO BE MAINTAINED AS 120 MICRONS INCHES.
 10. GENERAL TOLERANCES ARE AS PER IS-2102-1998 (COARSE) UNLESS OTHERWISE SPECIFIED(SEE TABLE).
 11. AIR HEATER TUBES (ITEM CODE : AHT001 & AHT002), SLEEVE (ITEM CODE : AHT003) ARE RELEASED AS BOUGHT OUT ITEMS ALONG WITH OUR AIR HEATER TUBE SPECIFICATION JB1008-50050100-SPC-0001.
 12. BOTH TUBE SHEET OF EACH AIR HEATER BLOCK TO BE CLAMPED TOGETHER AND STACK DRILLED TO ENSURE THAT ALL TUBE HOLES COINCIDE.

PAINTING NOTES:-
FOR PAINTING NOTES & SURFACE PREPARATION REFER SPECIFICATION No: JB1007-50570900-PSH-0001.


- ERECTION NOTES:-**
01. ALL WELDING SHOULD BE SOUND AND COMPLETE WITHOUT ANY GAP, TO AVOID LEAKAGE OF AIR FROM ONE SIDE TO ANOTHER.
 02. REFRACTORY TO BE APPLIED BEFORE ERECTING COLD AIR DUCT.
 03. ANCHOR STUD TO BE WELDED (REF.-038-0002) WITH TUBE SHEET AT GROUND.
 04. SLEEVES TO BE PROVIDED AT AIR HEATER BLOCK-I AIR ENTRY INSIDE ONLY.
 05. SLEEVES ARE TO BE INSERTED & WELDED WITH TUBES AFTER REFRACTORY APPLICATION.
 06. ON COMPLETION OF REFRACTORY APPLICATION THE COTTON WASTE SHALL BE REMOVED.
 07. AFTER THE INSERTION OF AIR HEATER TUBE, THE SLEEVE WITH ATTACHMENT CLIP TO BE WELDED AT SITE.
 08. AIR HEATER TUBES SHALL BE PROTECTS USING END CAPS SUPPLIED ALONG WITH THEM BEFORE APPLICATION OF REFRACTORY.

LIST OF REFERENCE DRAWINGS	
DRAWING DOCUMENT ID	DESCRIPTION
JB1008-50050100-038-0002	DETAIL OF AIR HEATER
JB1008-50050100-038-0003	DETAIL OF AIR HEATER TUBE SHEET

FOR AIR HEATER TUBES REFER SPEC. DOCUMENT ID - JB1008-50050100-SPC-0001

THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH DWG. No. JB1008-50110107-040-0001 (A & D OF AIR HEATER CASING)

3	SLEEVES	IS 433 PMF-A, 1982 Q19 1	O/D 57.15 X 2.03 THK x 2520 Lg.	192	1334.40	2 QTY. EXTRA (SLEEVES FOR AHT003 TUBES)
AHT003	AIR HEATER TUBE SLEEVE	P	B006	192	1334.40	
2	AIRHEATER TUBE BLOCK-I	SA 423 Cr1,ERW	O/D 63.5 X 2.34 THK x 4077 Lg.	960	13814.4	ACTUAL+ERECTION SPARE (10 Nos.)
AHT002	AIR HEATER TUBE	P	B006	960	13814.4	
1	AIRHEATER TUBE BLOCK-II & III	IS 433 PMF-A, 1982 Q19 1	O/D 63.5 X 2.34 THK x 4040 Lg.	1920	27379.20	ACTUAL+ERECTION SPARE (20 Nos.)
AHT001	AIR HEATER TUBE	P	B006	1920	27379.20	
P.NO.	P.DESCRPTION	SPECIFICATION	SIZE	P.QTY	P.WT(kg)	REMARK
ITEM CODE	ITEM DESCRIPTION	L.TYPR	L.GROUP	L.QTY	L.WT(Kg) (TOTAL)	REMARK

CONSULTANT	-									
CLIENT	M/s. NTPC SAIL POWER COMPANY PVT. LTD.,									
DO NOT SCALE IF IN DOUBT PLEASE ASK	THIS DESIGN IS THE PROPERTY OF M/S. ISGEC HEAVY ENGINEERING LTD. AND IS ONLY ALLOWED TO BE USED BY EXPRESSED PERMISSION AND LICENSE FROM M/S. ISGEC HEAVY ENGINEERING LTD.									
FOR APPROVAL	NO	FOR INFORMATION	NO	FOR PRODUCTION	YES	FOR ERECTION	YES			
RESPONSIBLE DEPT.	DRAWN BY		CHECKED BY		APPROVED BY		DATE			
MECHANICAL	ABHISHEK/BHUPESH		MANE		SWARUP/S.SATHE		30.05.2017			
	TOTAL WEIGHT IN kg.		PROJECT ID		ELEMENT ID		L.W.T. NO.			
	42765.60		JB1008		50050100		6507			
			YEAR : 2017		SHEET SIZE : A1		SCALE : 1:40			
										
BOILERS (formerly Isgec John Thompson)			SERVICE		2 X 88 TPH, SINGLE DRUM, NATURAL CIRCULATION TOP SUPPORTED, AFBC BOILER					
			TITLE		GENERAL ARRANGEMENT OF AIR HEATER					
Isgec Heavy Engineering Ltd. Noida 201 301 (U.P.) India			DRAWING DOCUMENT ID		JB1008-50050100-038-0001				REVISION 00	



ISGEC
(formerly Isgec John Thompson)

Isgec Heavy Engineering Ltd.
Noida 201 301 (U.P.) India

CAD FILE FROM SOFTWARE : NO