
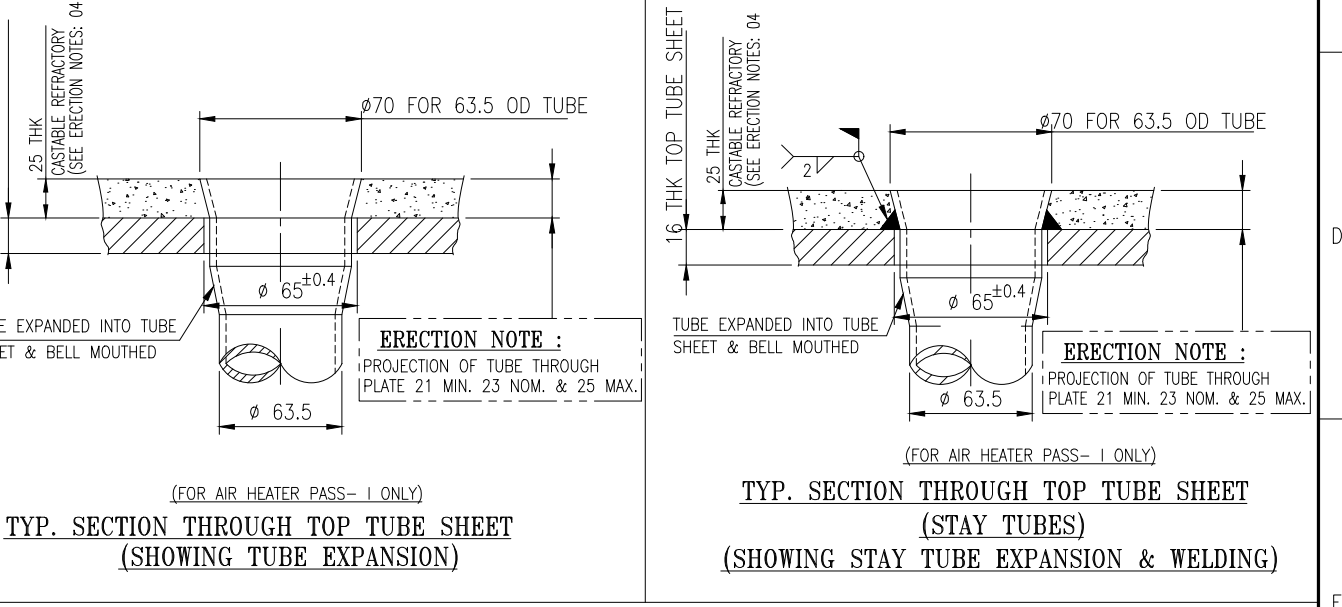
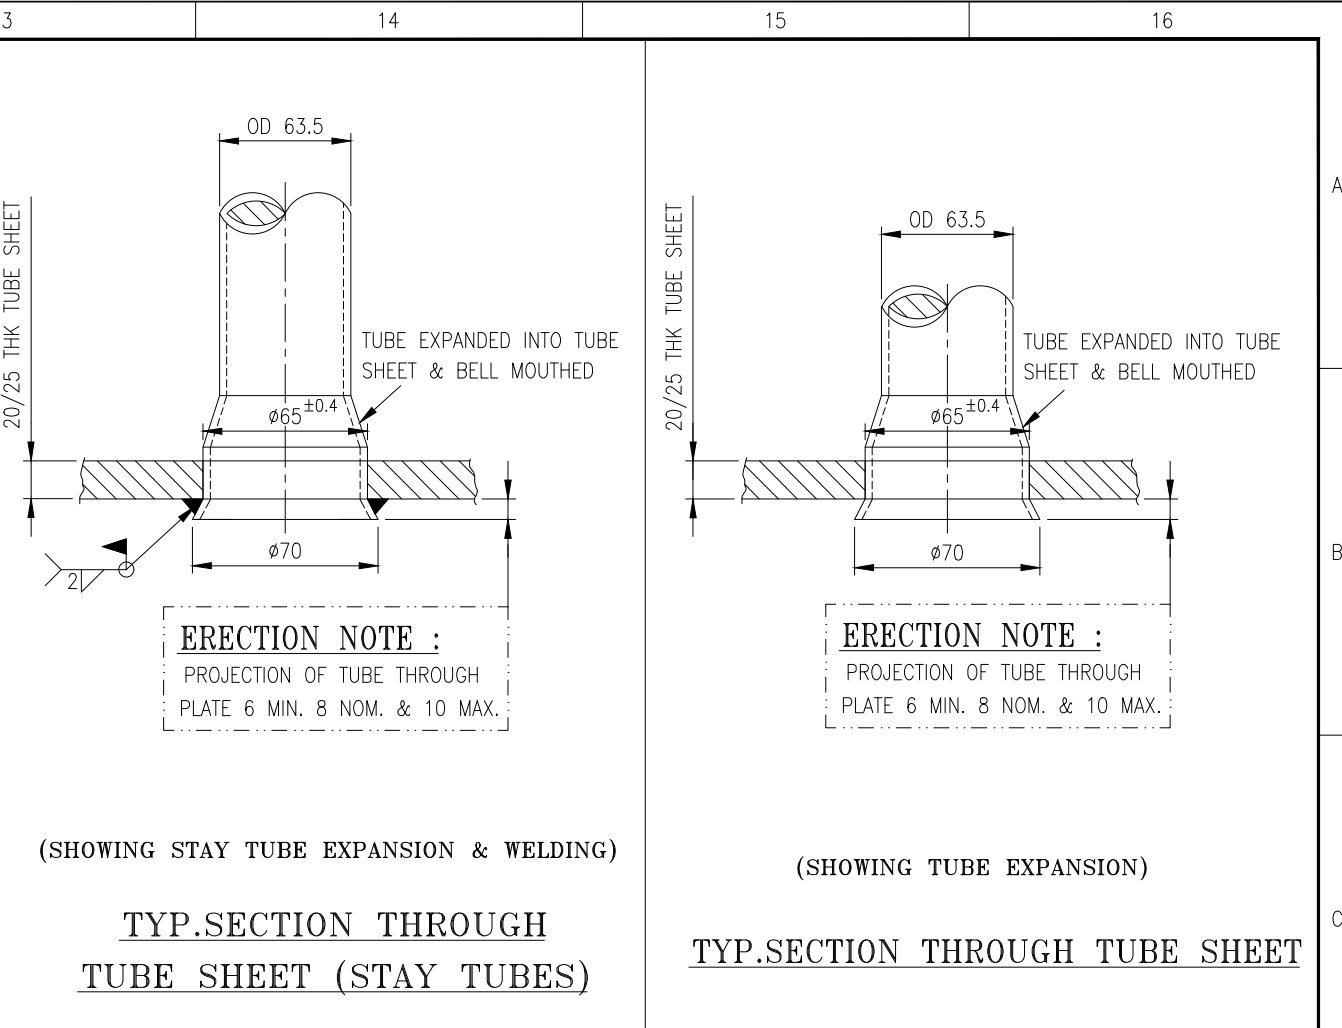
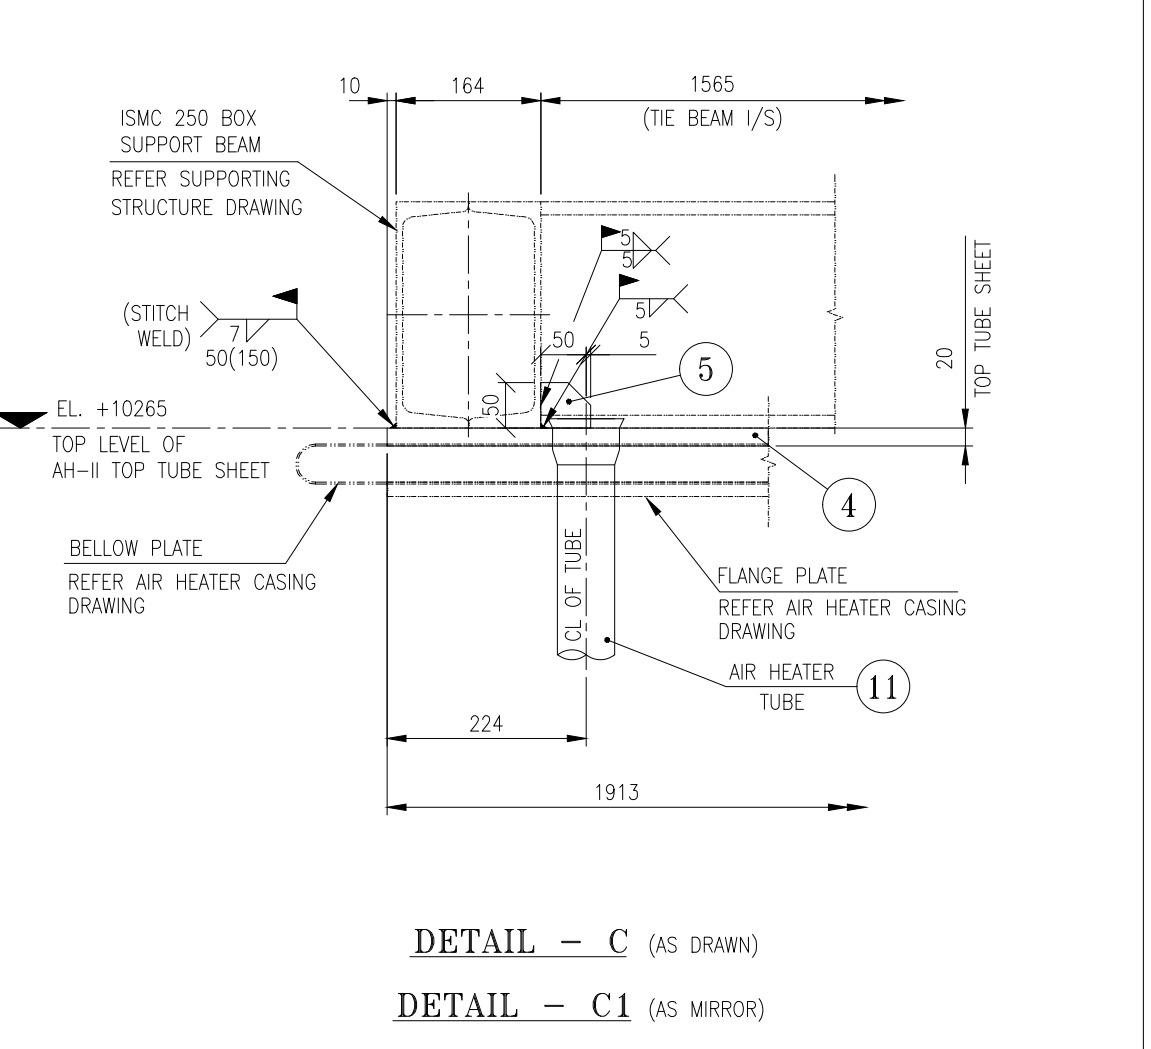
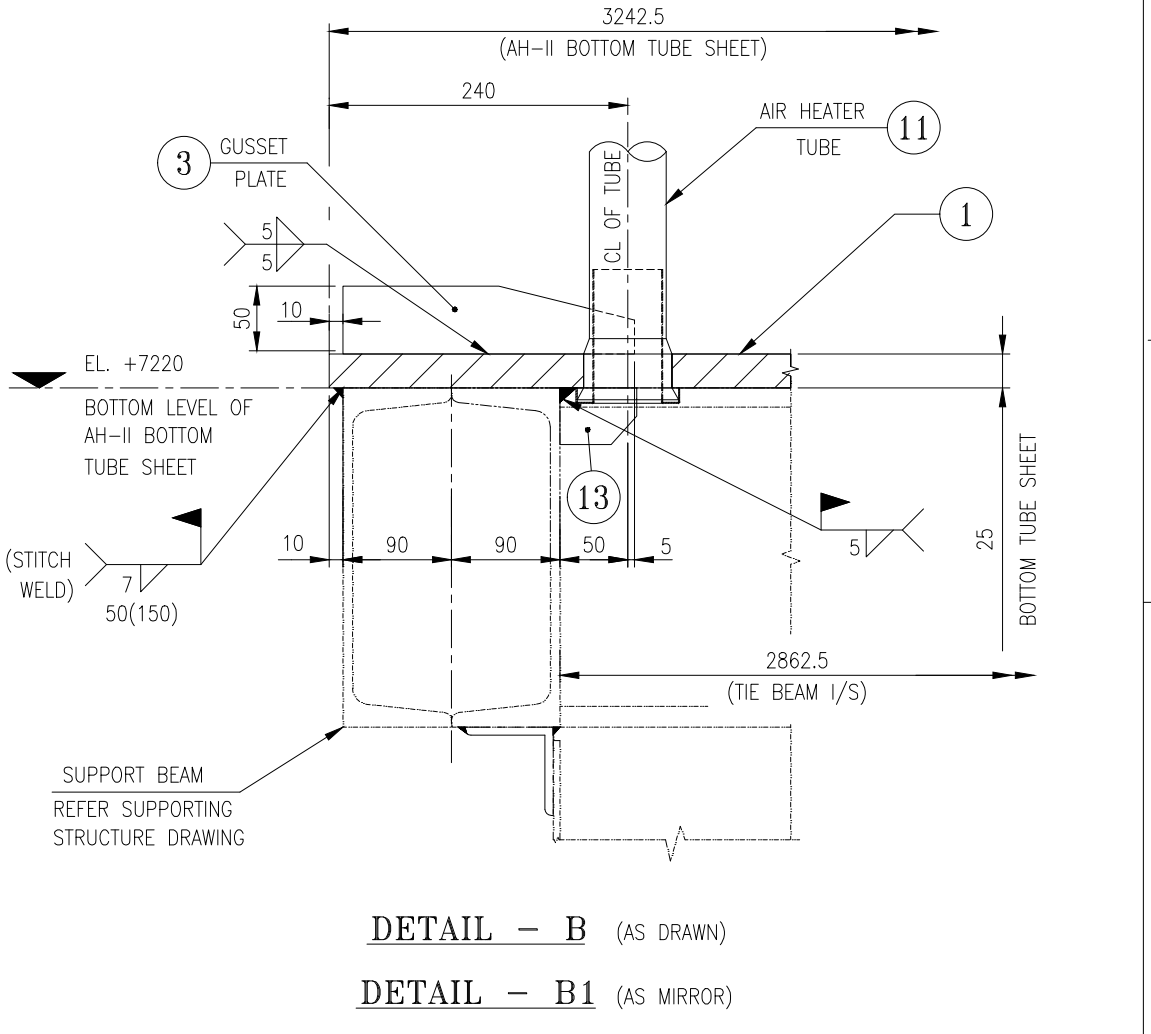
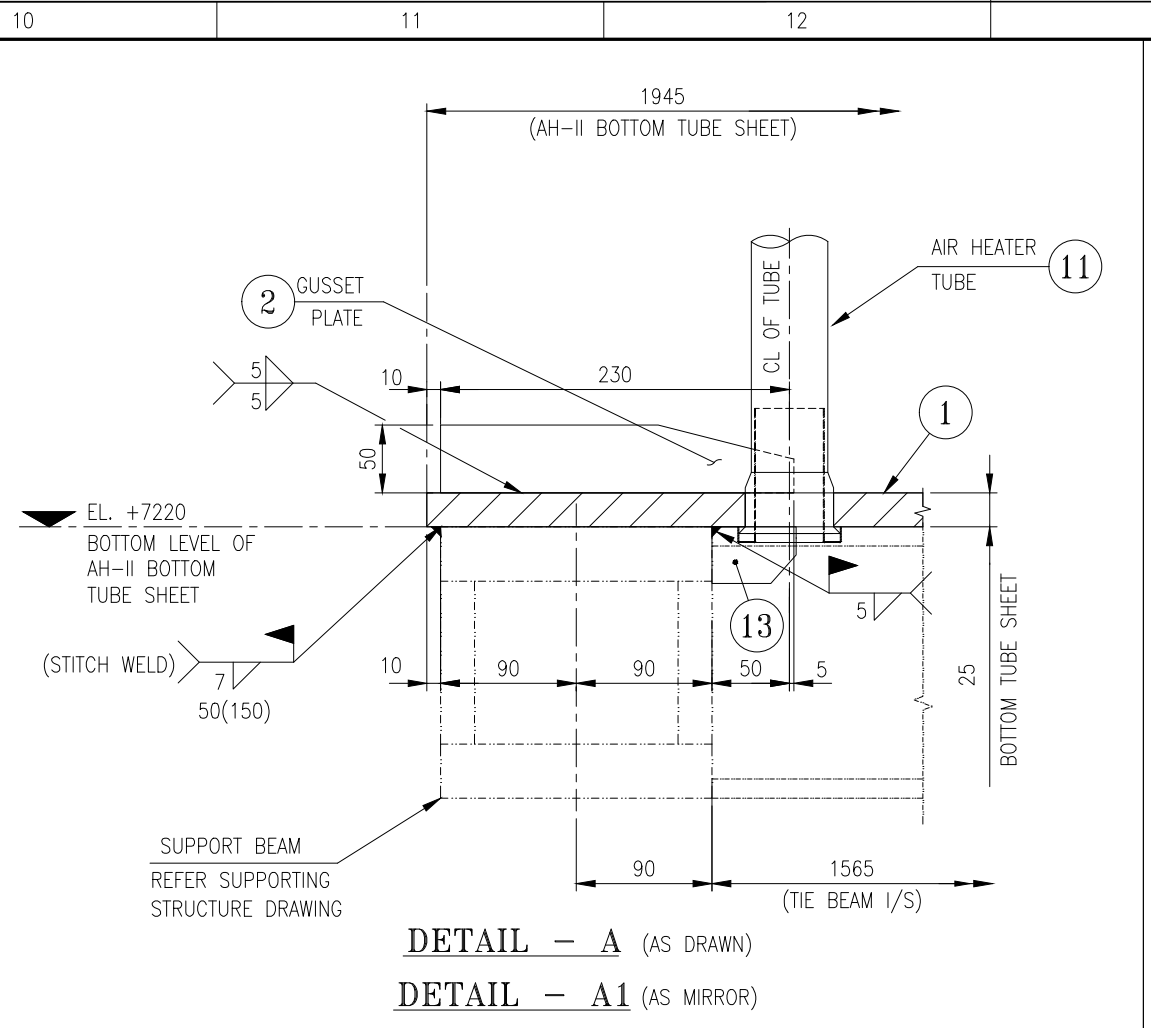
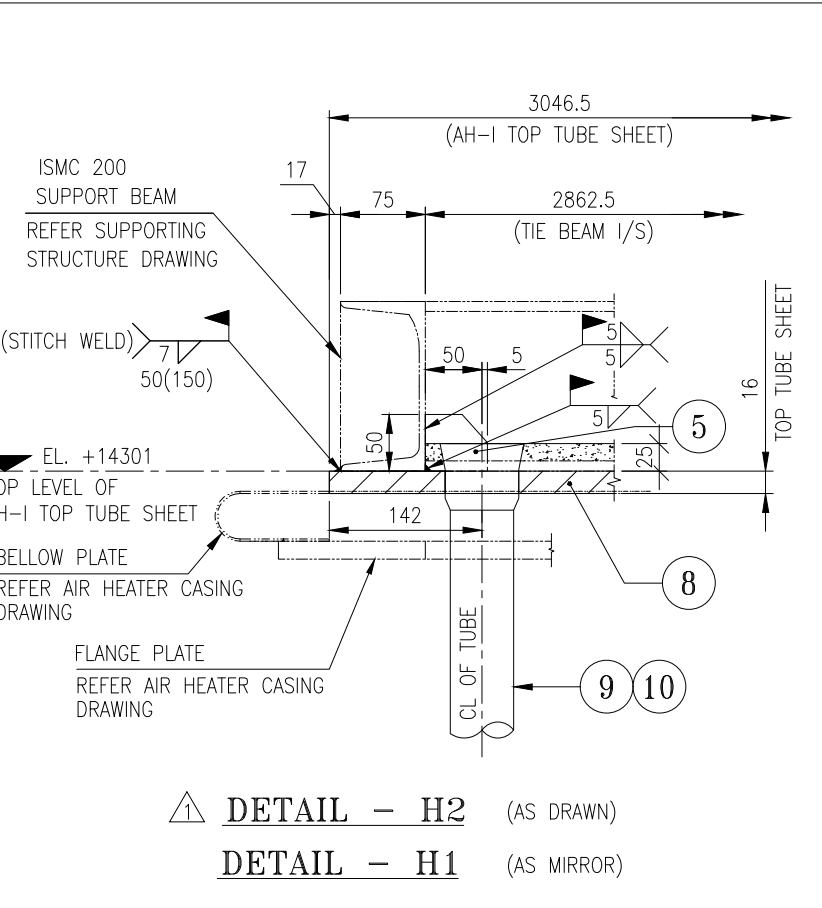
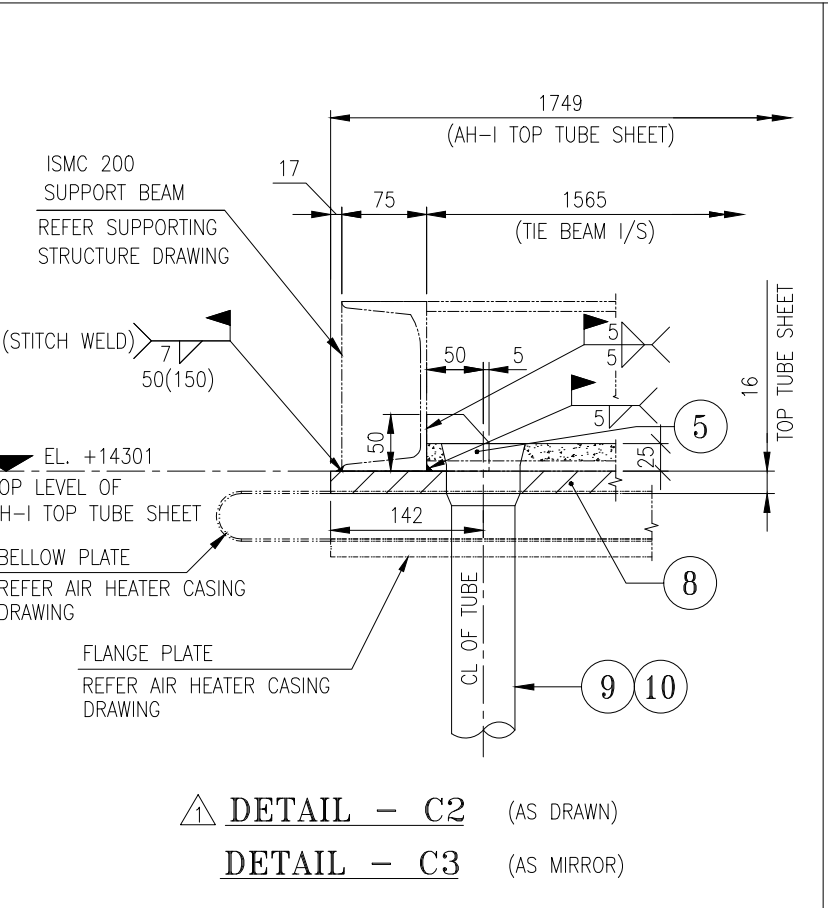
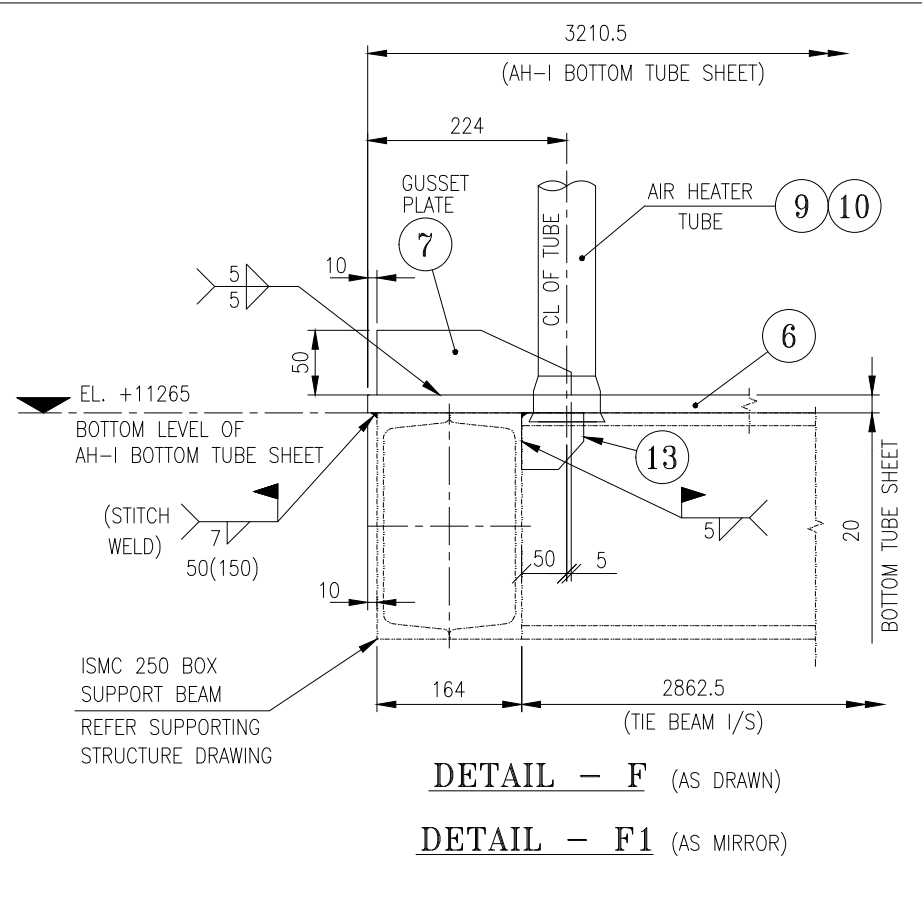
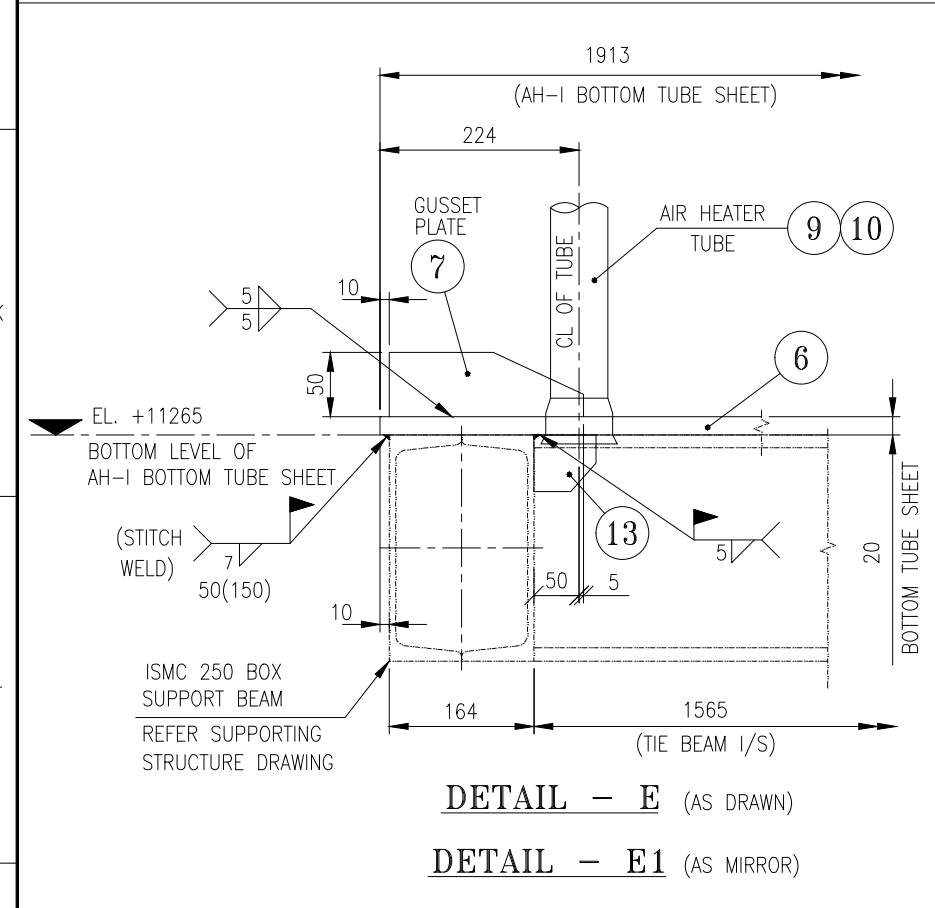


THIS IS A CAD FILE - DO NOT CORRECT IT MANUALLY

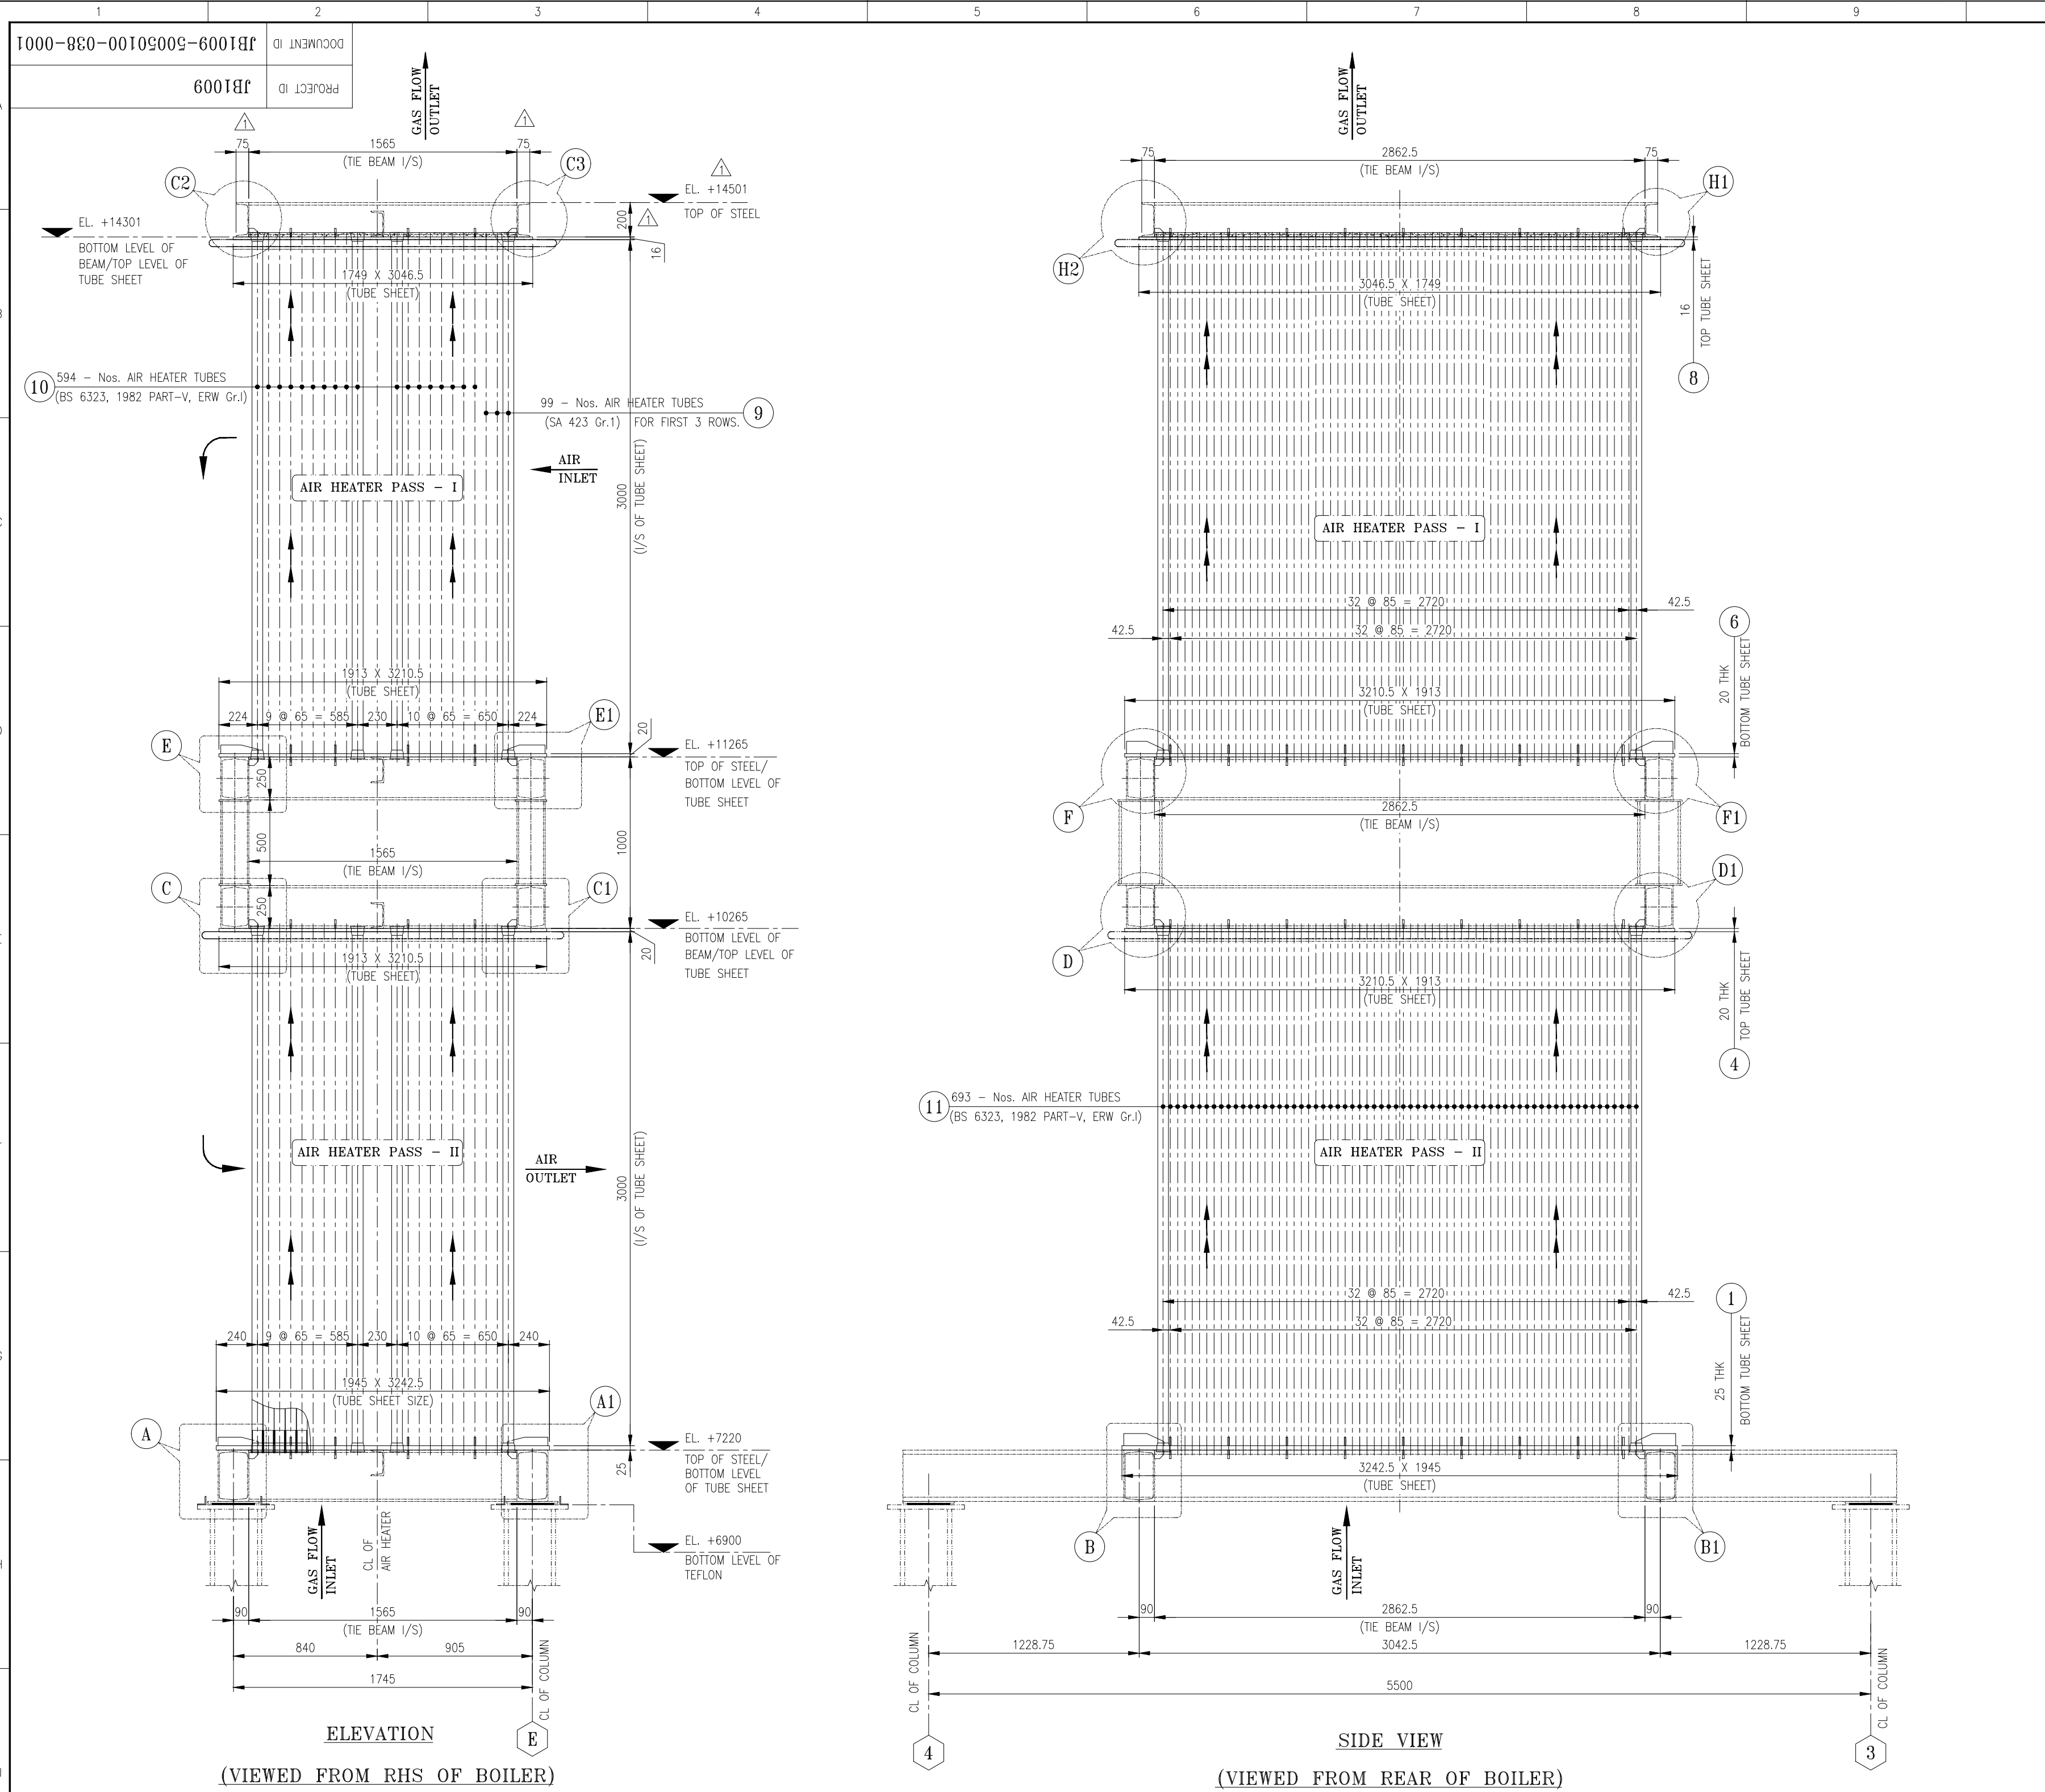

- GENERAL NOTES:-**
01. ALL DIMENSIONS & LEVELS ARE IN mm UNLESS OTHERWISE SPECIFIED.
 02. SURFACE FINISH OF HOLES TO BE MAINTAINED AS 250 MICRON INCHES.
 03. TUBE PLATES ARE TO BE MANUFACTURED FROM ROLLED PLATE TO IS-2062 WITH HOLES TO BE ACCURATELY BORED & SPACED.
 04. TOP & BOTTOM PLATES TO BE CLAMPED TOGETHER AND STACK DRILLED TO ENSURE THAT ALL TUBE HOLES COINCIDE.
 05. ALL TUBE PLATES & TUBES TO HAVE THEIR RESPECTIVE L.W.T. NO. & ITEM CODE. PAINTED ON IN WHITE WATER PROOF PAINT.
 06. FABRICATION TO BE DONE BY FULL SCALE SHOP LAYOUT.
 07. IN AIR HEATER TUBE SHEET HOLES APPLY RUST PREVENTIVE OIL BEFORE DESPATCH.
 08. TUBE HOLE & TUBE ENDS ARE TO BE THOROUGHLY CLEANED BEFORE WELDED AT SITE.
 09. ALL WELDINGS ARE 5mm FILLET WELD UNLESS STATED OTHERWISE SPECIFIED.
 11. WELDING ELECTRODE SHALL CONFORM TO IS:814 (LATEST).
 12. ALL WELDING SHALL BE DONE AS PER IS:816&823 & SHALL BE FULL CONTACT LENGTH UNLESS STATED OTHERWISE.
 13. ALL STRUCTURAL MEMBERS CONFORM TO IS:808.
 14. HOLE TOLERANCE OF ± 0.4 TO BE STRICTLY MAINTAINED AS SHOWN IN DETAIL.
 15. EXTRA QTY. IS RELEASED IN P.Nos. 9, 10 & 11 FOR ERECTION CONTINGENCY.
 16. SS FERRULE TO BE PROVIDED AT FIRST GAS ENTRY OF AIR HEATER PASS - II (BOTTOM ONLY).
 17. I/S DENOTES - INSIDE, P.NG. DENOTES - PART NUMBER, AH DENOTES - AIR HEATER.
 18. IN THIS DRAWINGS IF ANY DOUBT \ DISCREPANCY, FABRICATOR TO BE CONFIRM BEFORE CUTTING MATERIAL.
 19. AIR HEATER TUBES (ITEM CODE : AHT001, AHT002 & AHT003) ARE RELEASED AS BOUGHT OUT ITEMS ALONG WITH OUR AIR HEATER TUBE SPECIFICATION JB1009-50050100-SPC-0001.
 20. FOR DIMENSIONAL TOLERANCE REQUIREMENT PLEASE REFER DOC.No. GEN-50990100-DSM-002 AND ITS ASSOCIATED DRAWING.

- ERECTION NOTES:-**
01. ALL WELDING SHOULD BE SOUND AND COMPLETE WITHOUT ANY GAP, TO AVOID LEAKAGE OF AIR FROM ONE SIDE TO ANOTHER.
 02. FERRULES ARE TO BE FIXED AFTER WELDING OF AIR HEATER TUBE WITH AIR HEATER PASS - II BOTTOM TUBE SHEET.
 03. FERRULES ARE TO BE INSERTED AND WELDED WITH AIR HEATER TUBE SHEET AT ALL POSSIBLE LOCATION.
 04. REFRACTORY OF 25 mm THK. IS TO BE APPLIED ON AIR HEATER PASS-I TOP TUBE SHEET (REF. REFRACTORY DRG. FOR MORE DETAIL).

- SPECIAL ERECTION NOTES:-**
01. ALL TUBE TO TUBE SHEET WELDING SHOULD BE DONE AFTER WELDING THE SUPPORTING CHANNELS (REFER AIR HEATER CASING DRAWING) WITH RESPECTIVE AIR HEATER TUBE SHEETS.
 02. BEFORE ERECTION OF AIR HEATER PASS - I TUBES, ALL AIR HEATER PASS - II TUBES ALONG WITH GUSSET PLATE (P.Nos.-2, 3,5,7, & 13) ARE TO BE WELDED WITH TUBE SHEET.

- PAINTING NOTES FOR TUBE:-**
01. THE EXTERNAL SURFACES OF ALL FABRICATED TO BE WIRE BRUSHED THOROUGHLY AND PAINTED WITH TWO COATS OF ZINC CHROMATE/PHOSPHATE (RED COLOR) PRIMER PAINTING AT SHOP PRIOR TO DISPATCH.

THIS DRAWING TO BE READ IN CONJUNCTION WITH DOCUMENT ID.: JB1009-50050100-038-0002

CONSULTANT	M/s. SHAKTIPUNJ ENGINEERS PVT. LTD.,
CLIENT	M/s. RASHMI ISPAT LIMITED, WEST BENGAL
DO NOT SCALE IF IN DOUBT PLEASE ASK	THIS DESIGN IS THE PROPERTY OF M/S. ISGEC HEAVY ENGINEERING LTD. AND IS ONLY ALLOWED TO BE USED BY EXPRESSED PERMISSION AND LICENSE FROM M/S. ISGEC HEAVY ENGINEERING LTD.
FOR APPROVAL	NO FOR INFORMATION NO FOR PRODUCTION YES FOR ERECTION YES
RESPONSIBLE DEPT. MECHANICAL	DRAWN BY P.PRABU CHECKED BY R.BALA/A.N.K. APPROVED BY J.D.J. DATE 27.02.2017
TOTAL WEIGHT IN kg. REF.DRG No.-038-0002	PROJECT ID JB1009 ELEMENT ID 50050100 I.W.T. NO. 6505
	YEAR : 2016 SHEET SIZE : A1 SCALE : 1:25
SERVICE	1 x 30 TPH, SINGLE DRUM, WATER TUBE, BOTTOM SUPPORTED, AFBC BOILER
TITLE	ARRANGEMENT AND DETAILS OF AIR HEATER
DRAWING DOCUMENT ID	JB1009-50050100-038-0001 REVISION 01

REVN	ZONE	DESCRIPTION	REV'D. BY	CHK'D. BY	APP'D. BY	DATE	REVN	ZONE	DESCRIPTION	REV'D. BY	CHK'D. BY	APP'D. BY	DATE
		1. TOP LEVEL OF AIRHEATER CASING LEVEL HAS BEEN REVISED.	P.PRABU	R.BALA/A.N.K.	R.ARUN	19.05.2017							