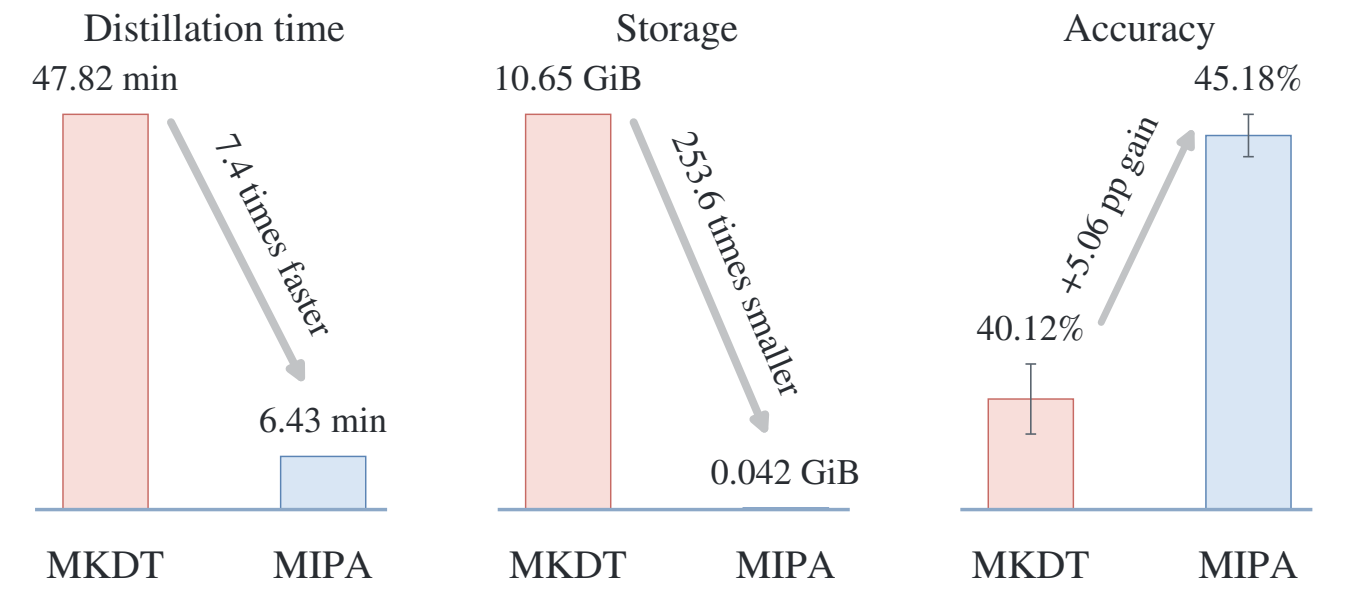
Distillation time
47.82 min
7.4 times faster
6.43 min
MKDT
MIPA
Storage
10.65 GiB
253.6 times smaller
0.042 GiB
MKDT
MIPA
Accuracy
45.18%
+5.06 pp gain
40.12%
MKDT
MIPA