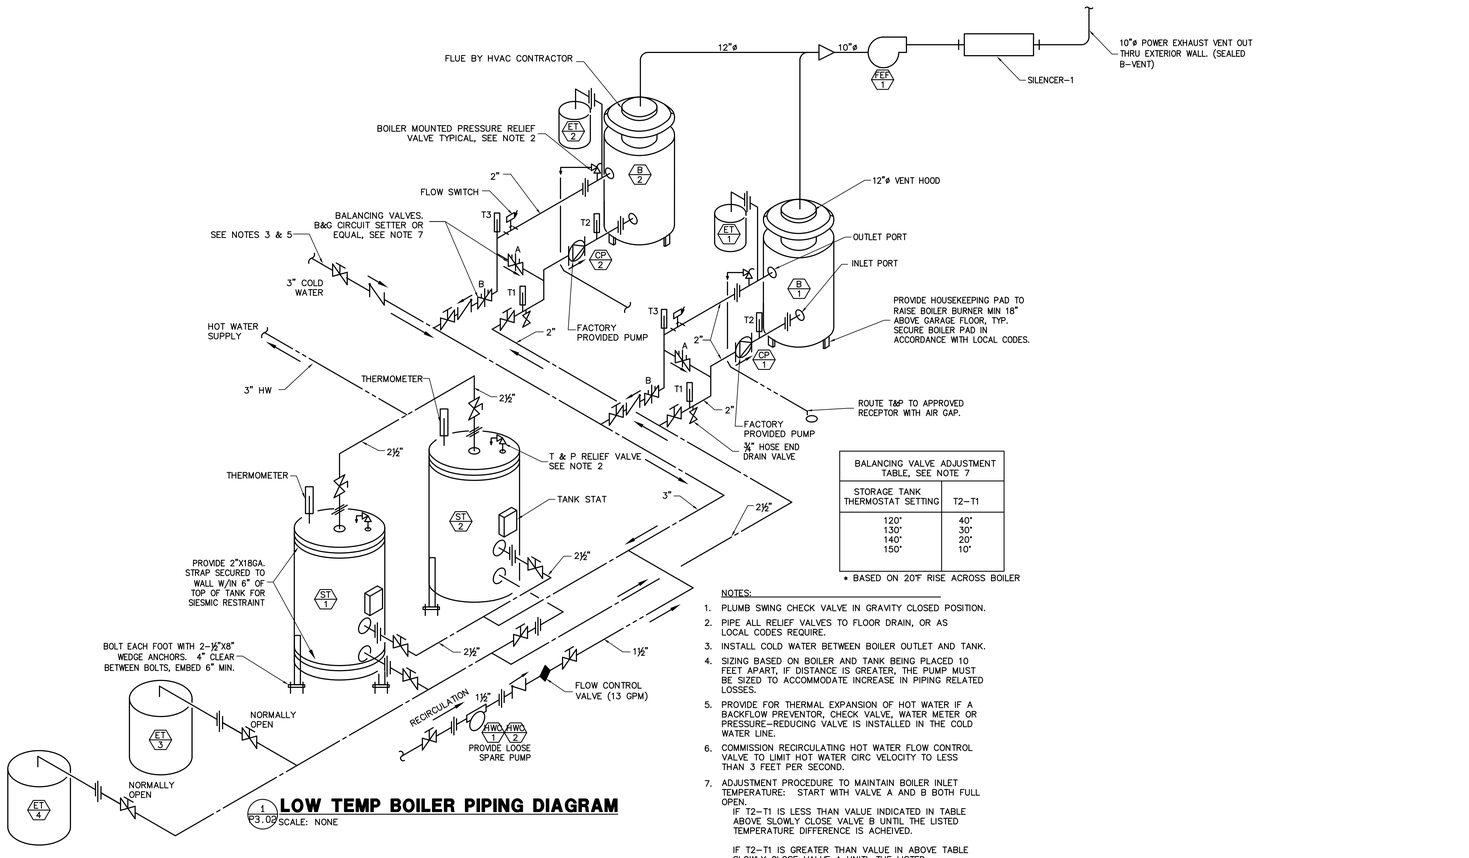


BALANCING VALVE ADJUSTMENT TABLE, SEE NOTE 7	
STORAGE TANK THERMOSTAT SETTING	T2–T1
120° 130° 140° 150°	40° 30° 20° 10°


* BASED ON 20°F RISE ACROSS BOILER

NOTES:

1. PLUMB SWING CHECK VALVE IN GRAVITY CLOSED POSITION.
2. PIPE ALL RELIEF VALVES TO FLOOR DRAIN, OR AS LOCAL CODES REQUIRE.
3. INSTALL COLD WATER BETWEEN BOILER OUTLET AND TANK.
4. SIZING BASED ON BOILER AND TANK BEING PLACED 10 FEET APART, IF DISTANCE IS GREATER, THE PUMP MUST BE SIZED TO ACCOMMODATE INCREASE IN PIPING RELATED LOSSES.
5. PROVIDE FOR THERMAL EXPANSION OF HOT WATER IF A BACKFLOW PREVENTOR, CHECK VALVE, WATER METER OR PRESSURE-REDUCING VALVE IS INSTALLED IN THE COLD WATER LINE.
6. COMMISSION RECIRCULATING HOT WATER FLOW CONTROL VALVE TO LIMIT HOT WATER CIRC VELOCITY TO LESS THAN 3 FEET PER SECOND.
7. ADJUSTMENT PROCEDURE TO MAINTAIN BOILER INLET TEMPERATURE: START WITH VALVE A AND B BOTH FULL OPEN.
   IF T2–T1 IS LESS THAN VALUE INDICATED IN TABLE ABOVE SLOWLY CLOSE VALVE B UNTIL THE LISTED TEMPERATURE DIFFERENCE IS ACHEIVED.
   IF T2–T1 IS GREATER THAN VALUE IN ABOVE TABLE SLOWLY CLOSE VALVE A UNITL THE LISTED TEMPERATURE DIFFERENCE IS ACHEIVED.
   CONFIRM T3–T2 = 20°F. AS STORED WATER REACHES THERMOSTAT SET POINT, THE TEMPERATURE INDICATED ON THERMOSTAT T3 APPROACHES 180°F.

1 P3.02 LOW TEMP BOILER PIPING DIAGRAM

SCALE: NONE

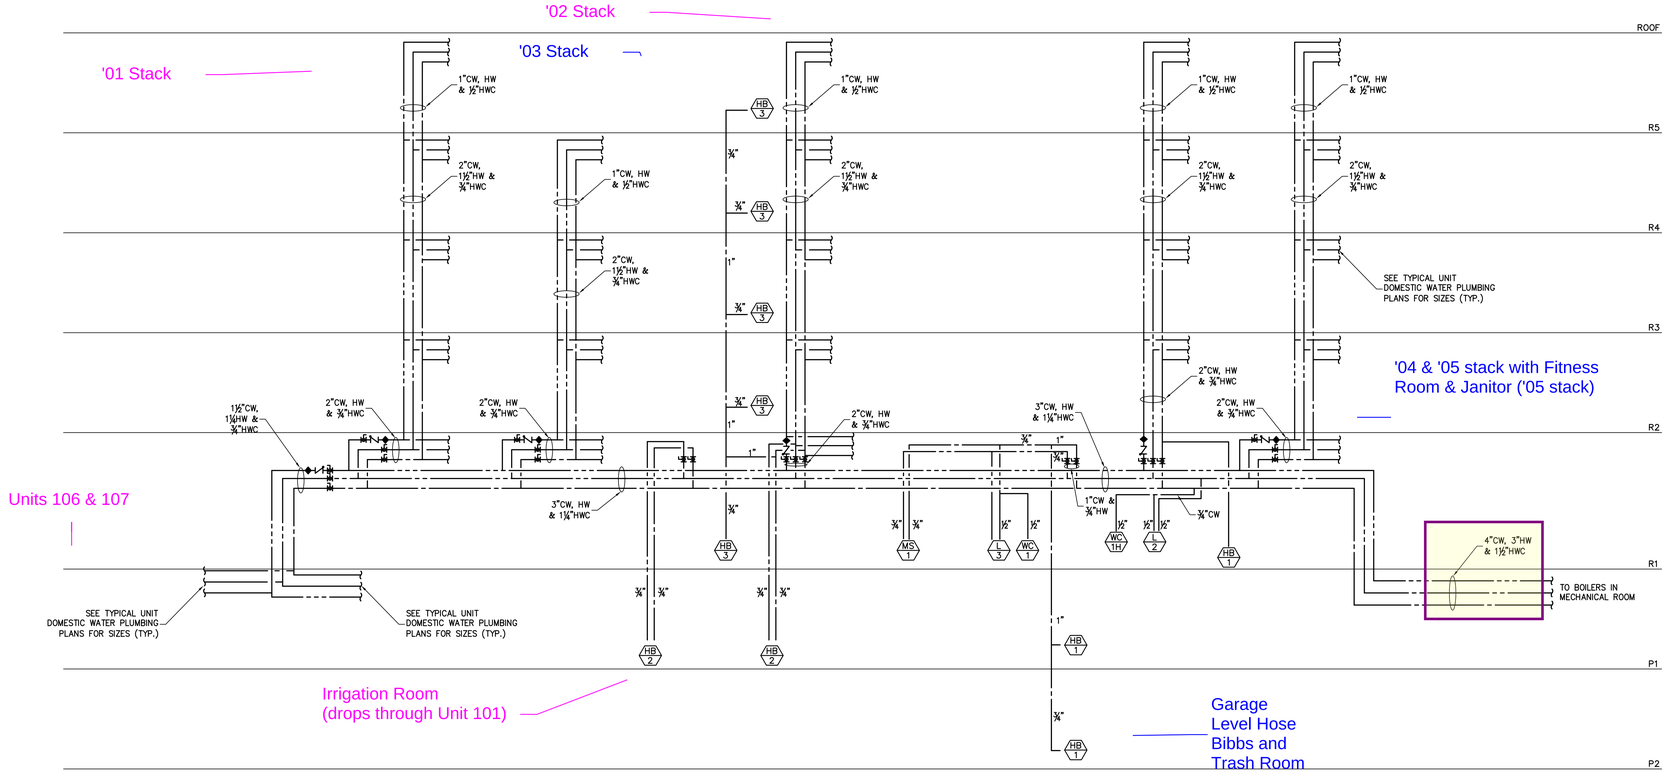

DOMESTIC WATER RISER DIAGRAMS

REUSE OF DOCUMENTS

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF HV ENGINEERING, INC. AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF HV ENGINEERING.

COPYRIGHT, HV ENGINEERING, INC.

VERIFY SCALE

BAR MEASURES ONE INCH ON ORIGINAL DRAWING.
0" 1"
IF NOT ONE INCH ON THIS DRAWING, ADJUST SCALES ACCORDINGLY.

HV Engineering, Inc.
Consulting Engineers
7100 Linden Ave. N.
Seattle, Washington, 98103
Phone: (206) 706-9689
Fax: (206) 706-1630
www. hvengineering. biz

Project

200 WEST HIGHLAND DRIVE

Location

202 W. HIGHLAND DRIVE
SEATTLE, WA 98119

Prepared For

SUNRISE Plumbing, Inc.
1415 22nd Street NW
Auburn, WA 98001
(253) 874-4083

THESE DRAWINGS WERE DEVELOPED FOR EXCLUSIVE USE BY SUNRISE PLUMBING, INC. ON A DESIGN BUILD CONCEPT. THEY ARE TO BE USED ONLY WITH WRITTEN PERMISSION OF SUNRISE PLUMBING, INC. FOR INFORMATION CONTACT: DAVID WEST.

NO.	DATE	REVISION

PARTNER IN CHARGE: BWR
PROJECT MANAGER: BWR
PROJECT ENGINEER: BWR
PROJECT TEAM MEMBERS: BWR, SDB
CHECK: TGH

ENGINEERS SEAL

BRIAN W. ROETCISOENDER — STATE OF WASHINGTON — 20321 — REGISTERED PROFESSIONAL ENGINEER

EXPIRES 12/01/07


TITLE: DETAILS & RISER DIAGRAMS

PROJECT NO.: 2006-082
DATE: OCTOBER 29, 2007
PROJECT NETWORK PATH:


SHEET NUMBER: **P3.02**

ISSUED FOR PERMIT/CONSTRUCTION

I:\2006\2006-082 - Highlands Condo\DWGS\Plumb\P0.01.dwg Oct 29, 2007 10:53am steve

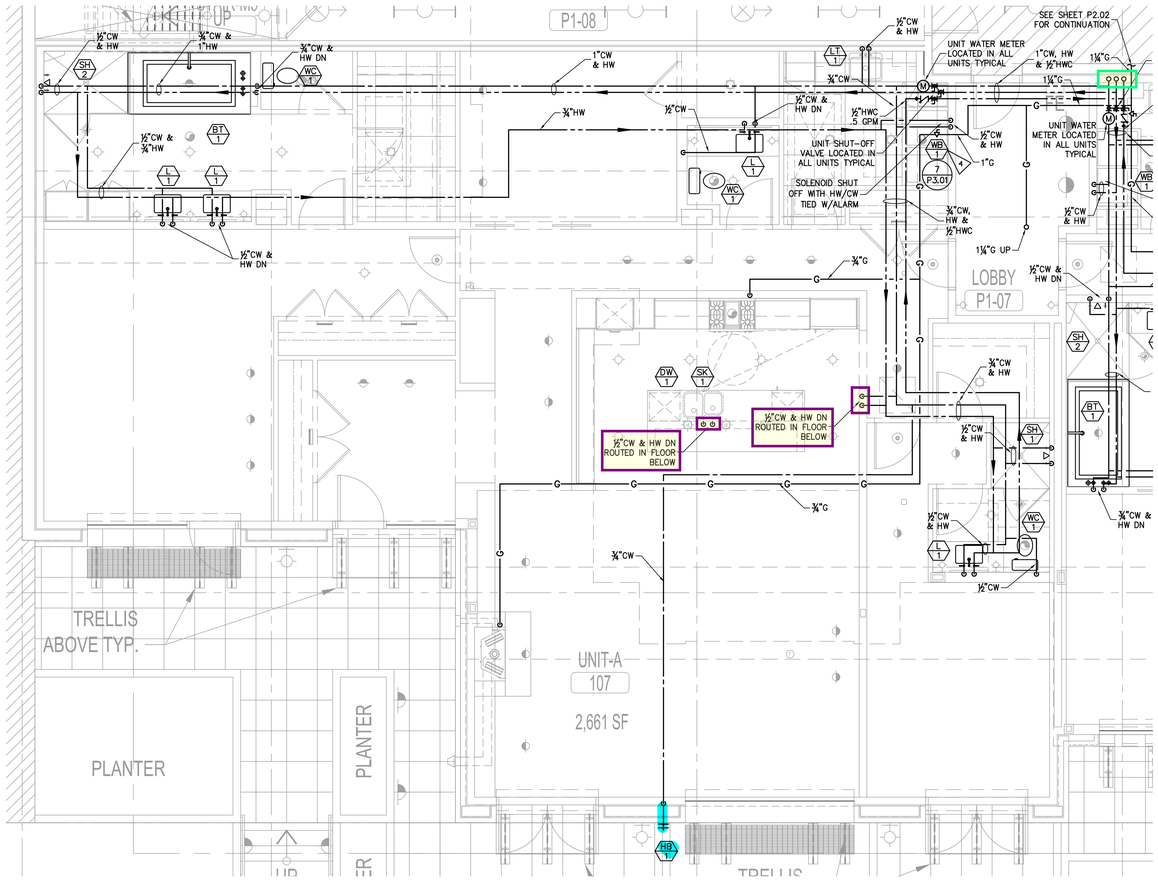

A **UNIT A DOMESTIC WATER PLAN**
SCALE: ¼" = 1'0"

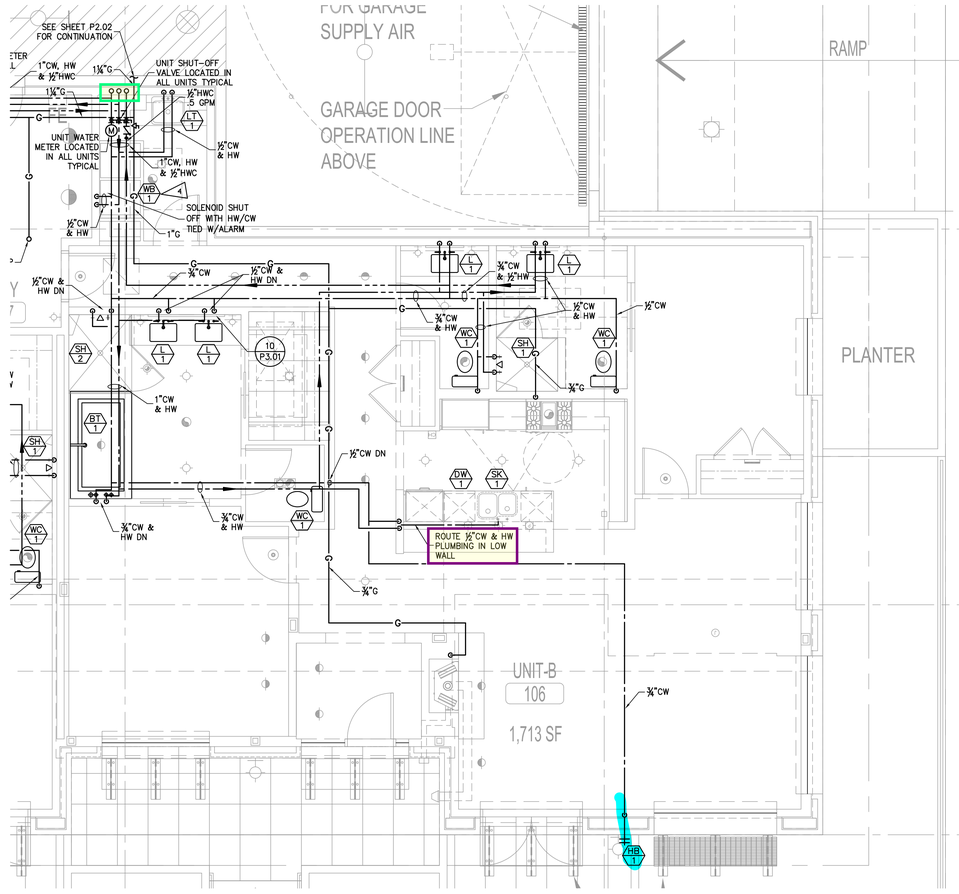

B **UNIT B DOMESTIC WATER PLAN**
SCALE: ¼" = 1'0"

REUSE OF DOCUMENTS

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF HV ENGINEERING, INC. AND IS NOT TO BE USED, IN WHOLE OR IN PART, FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF HV ENGINEERING.

COPYRIGHT, HV ENGINEERING, INC.

VERIFY SCALE

BAR MEASURES ONE INCH ON ORIGINAL DRAWING
0" 1"
IF NOT ONE INCH ON THIS DRAWING, ADJUST SCALES ACCORDINGLY.

HV Engineering, Inc.
Consulting Engineers
7100 Linden Ave. N.
Seattle, Washington, 98103
Phone: (206) 706-9669
Fax: (206) 706-1630
www. hvengineering. biz

Project
200 WEST HIGHLAND DRIVE

Location
202 W. HIGHLAND DRIVE
SEATTLE, WA 98119

Prepared For
SUNRISE Plumbing, Inc.
1415 22nd Street NW
Auburn, WA 98001
(253) 874-4083

THESE DRAWINGS WERE DEVELOPED FOR EXCLUSIVE USE BY SUNRISE PLUMBING, INC. ON A DESIGN BUILD CONCEPT. THEY ARE TO BE USED ONLY WITH WRITTEN PERMISSION OF SUNRISE PLUMBING, INC.. FOR INFORMATION CONTACT: DAVID WEST.

NO.	DATE	REVISION

PARTNER IN CHARGE: BWR
PROJECT MANAGER: BWR
PROJECT ENGINEER: BWR
PROJECT TEAM MEMBERS: BWR, SDB
CHECK: TGH

ENGINEERS SEAL
BRIAN W. ROETCISOENDER — STATE OF WASHINGTON — 20321 — REGISTERED PROFESSIONAL ENGINEER
EXPIRES 12/01/07

TITLE
TYPICAL UNIT
DOMESTIC WATER
PLUMBING PLANS

PROJECT NO. 2006-082
DATE OCTOBER 29, 2007
PROJECT NETWORK PATH

SHEET NUMBER
P4.01

ISSUED FOR PERMIT/CONSTRUCTION

I:\2006\2006-082 - Highlands Condo\DWGS\Plumb\P4.01.dwg Oct. 29, 2007 10:54am steve