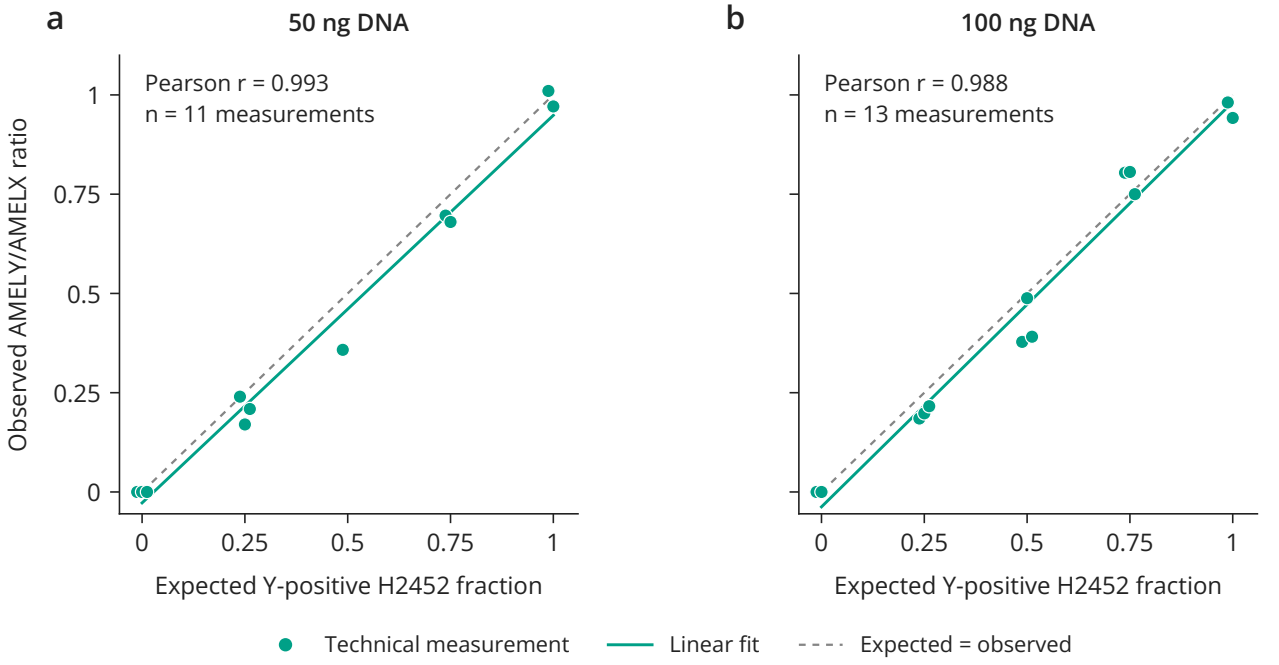
a
50 ng DNA
Pearson r = 0.993
n = 11 measurements
Observed AMELY/AMELX ratio
0
0.25
0.5
0.75
1
Expected Y-positive H2452 fraction
b
100 ng DNA
Pearson r = 0.988
n = 13 measurements
0
0.25
0.5
0.75
1
Expected Y-positive H2452 fraction
Technical measurement
Linear fit
Expected = observed