



Cluster anchoring — disease track (AUC lead; colour = signed rg, alpha = coherence, ring = q<0.05)


C0 — ambiguous [focal]

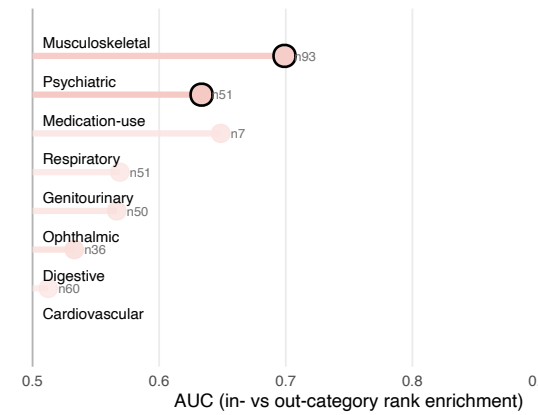


C1 — ambiguous [focal]

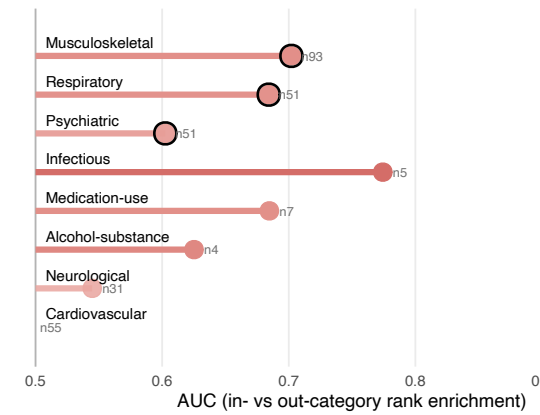


C2_sub0 — ambiguous [focal]

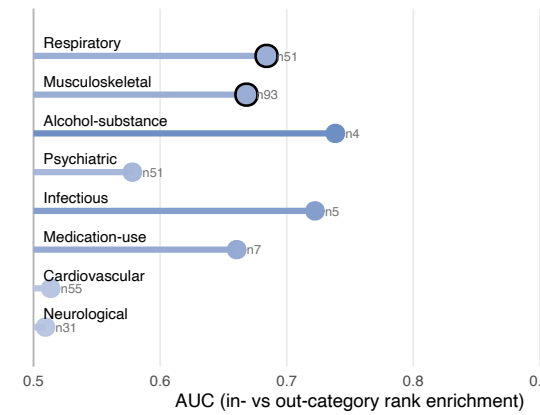


C2_sub1 — ambiguous [focal]

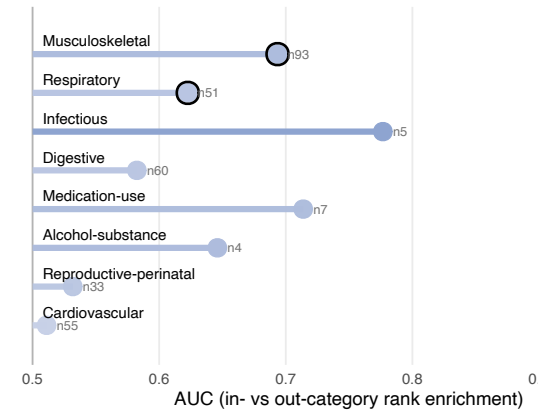


C3 — Alcohol-substance [focal]

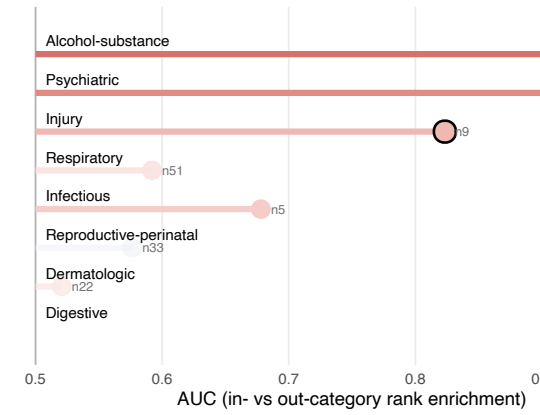


C4 — Psychiatric [sharp]

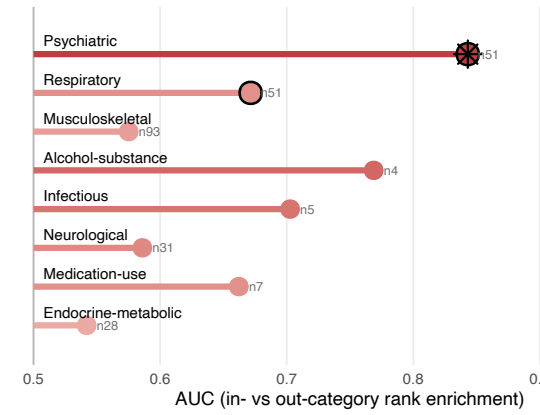



C5_sub0 — Cardiovascular [diffuse]

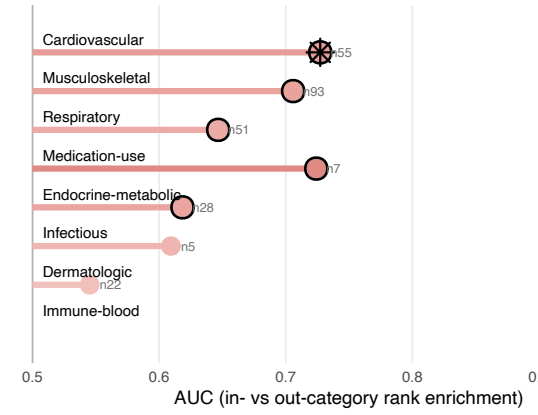


C5_sub1 — Cardiovascular [focal]

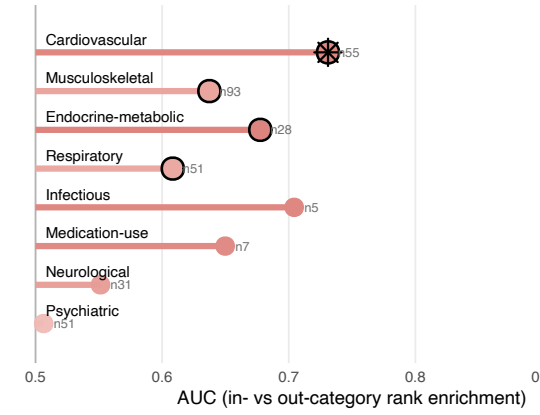


C6_sub0 — Respiratory [focal]

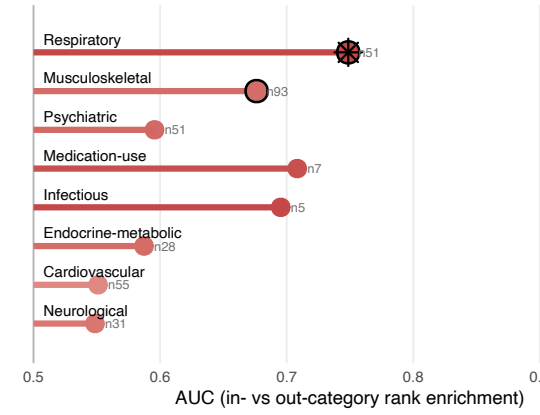


C6_sub1 — Psychiatric [sharp]

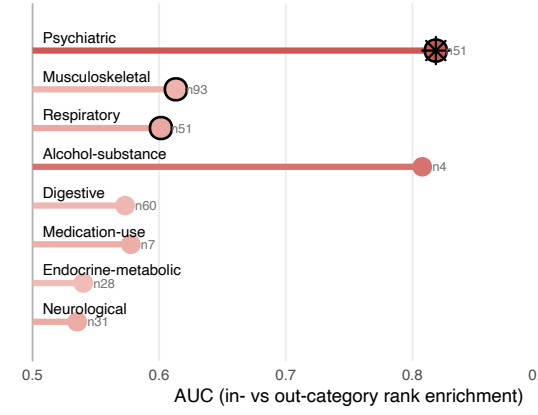


noise_re0 — Cardiovascular [focal]

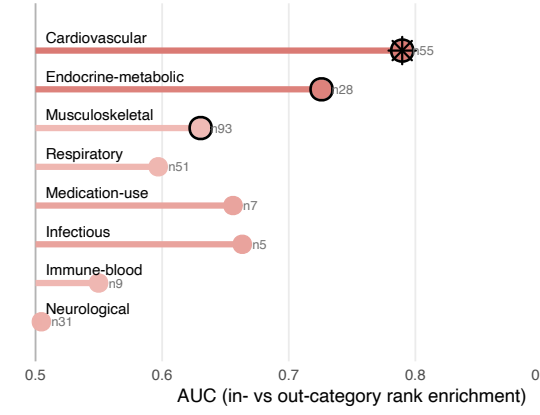


noise_re1 — ambiguous [focal]

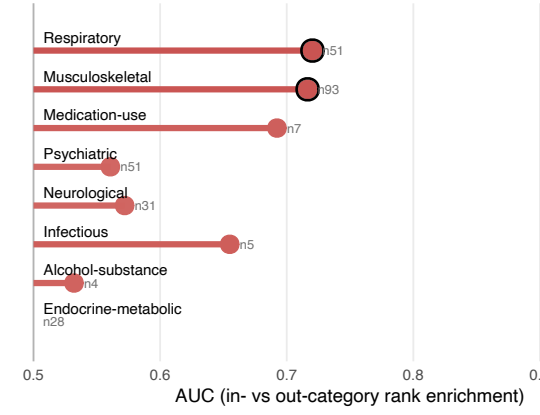

noise_re2 — Psychiatric [focal]

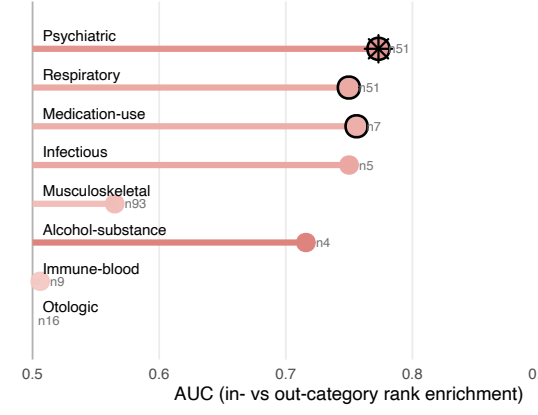

noise_re3 — ambiguous [focal]

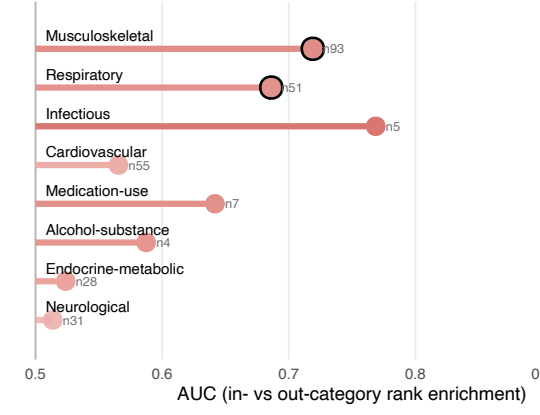

noise_re4 — Respiratory [sharp]

