



CONTROL IN



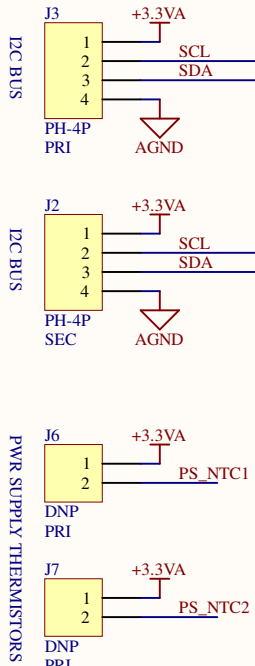


PWR / TEMP / FAN MONITORING AND CONTROL


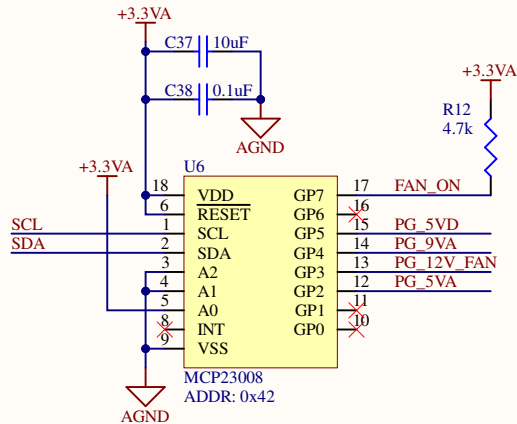


24V HV = 1.077V
36V HV = 1.616V
48V HV = 2.155V


0dC = 30k => 0.447V
60dC = 2.5k => 2.154V

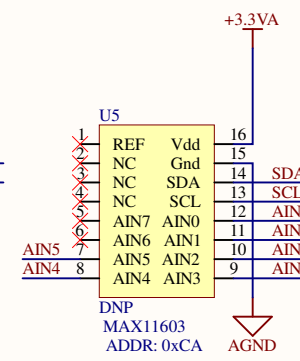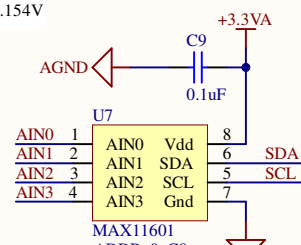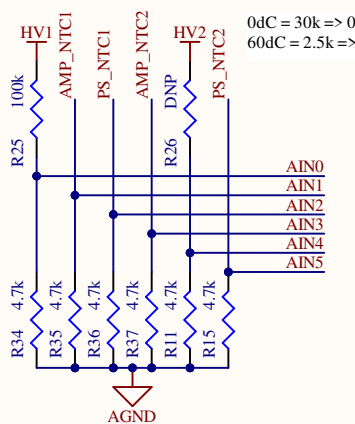


CONTROL OUT

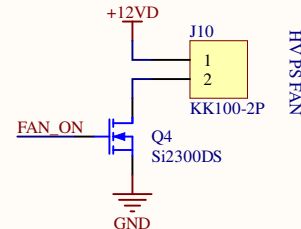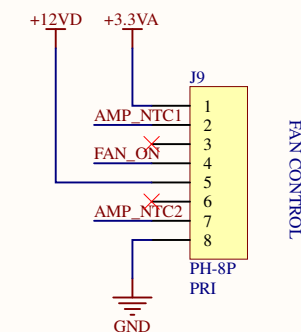


9V ANALOG SUPPLY

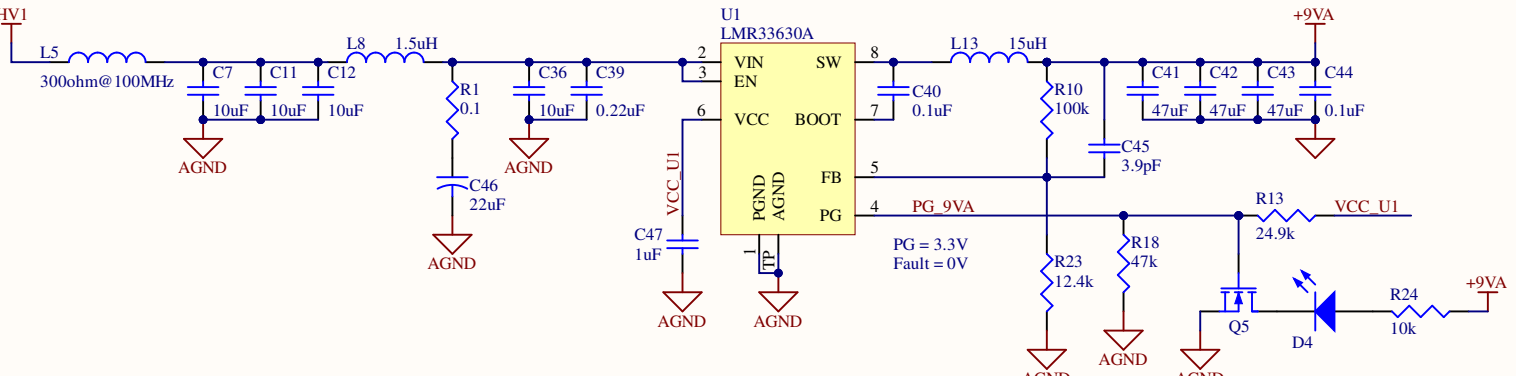


5V ANALOG SUPPLY

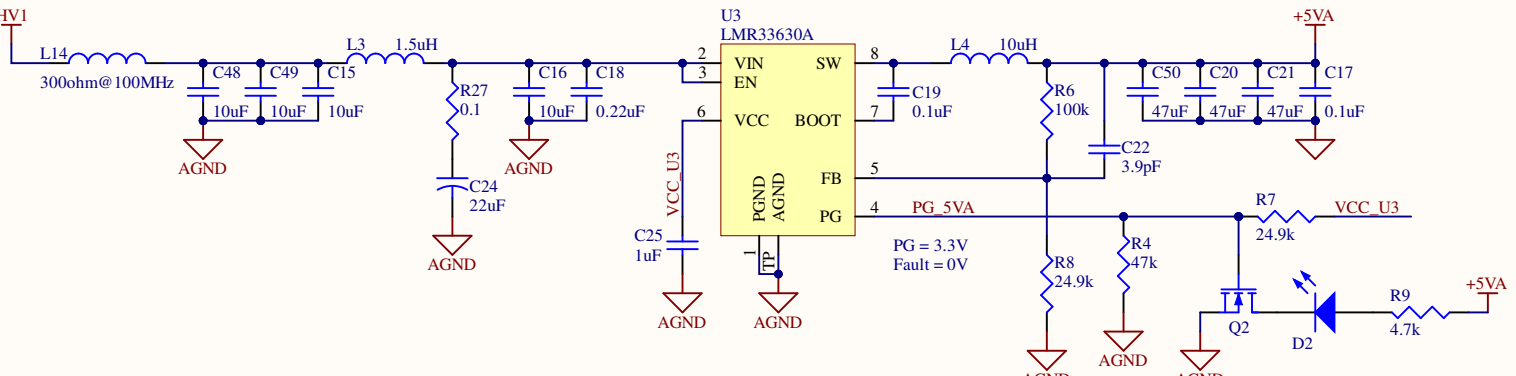




5V DIGITAL SUPPLY

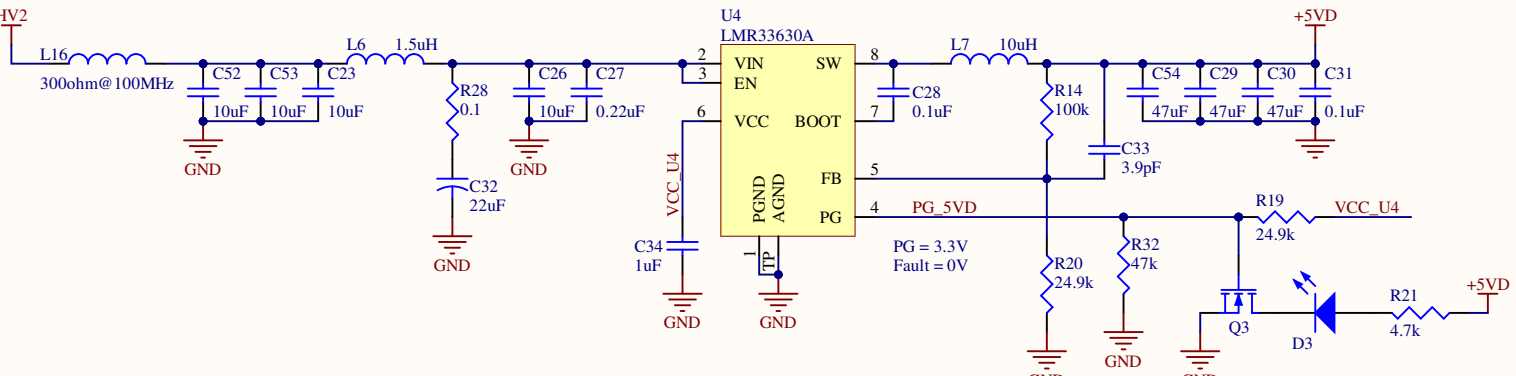






12V DIGITAL / FAN SUPPLY

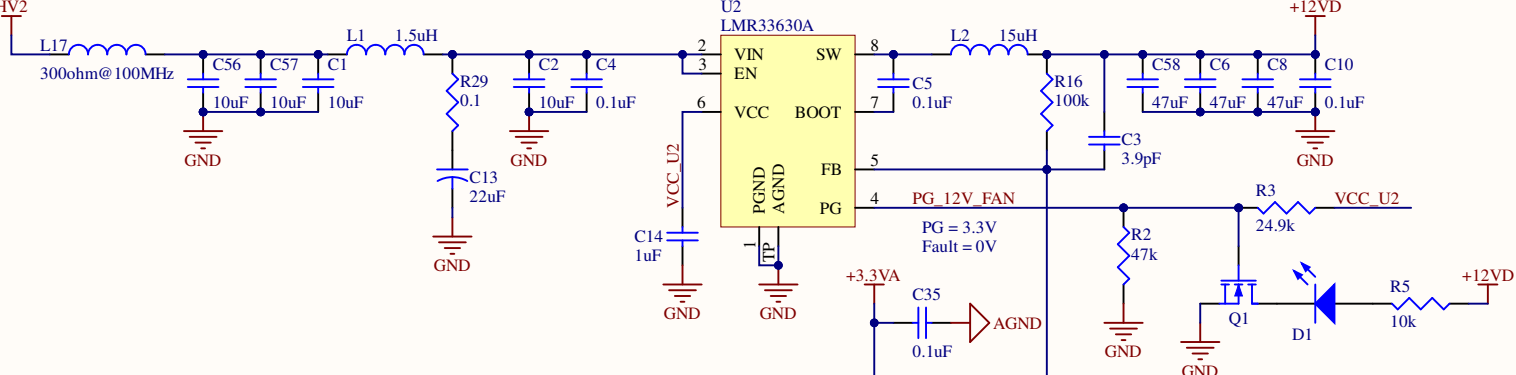

POWER IN

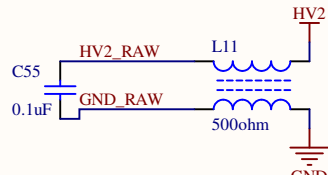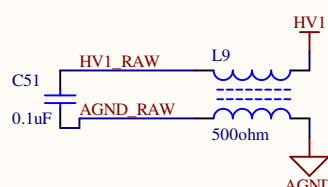

POWER OUTs

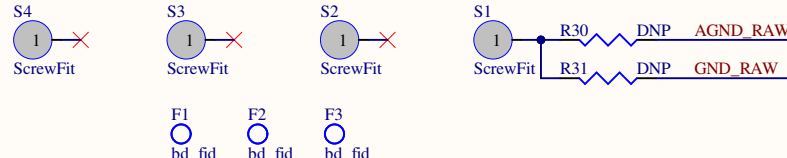

AmpliPi.com

Title		Rev
Power Board		6.A
Date	4/19/24	
Author	JG	
Sheet #	1 of 1	
©	2024	

