AI OPEN
DATA CENTER

Open Systems for AI: Why Open Communities Are Essential for the Next Era of Computing Infrastructure

Michael Sweeney

AI Factory Architect at Phaidra

OCP BRONZE™ Member

OPEN Compute Project SOLUTION PROVIDER®

AI infrastructure is scaling faster than public acceptance

$130B

in US data center projects blocked or delayed in Q1 2026 alone — matching all of 2025 in a single quarter

14+ states

now have active moratoriums

Water use cited in

40%+

of contested projects and power rate escalation a close second.

"2 years ago, 'I build data centers' got a friendly reaction. Now I brace for the pitchforks”

*Sources: Data Center Watch, reported by Yahoo Finance, July 8, 2026, Data Center Watch, May 2024–March 2025

Do we regulate ourselves, or get regulated?

2003 Black-Out

~20 hrs before blackout

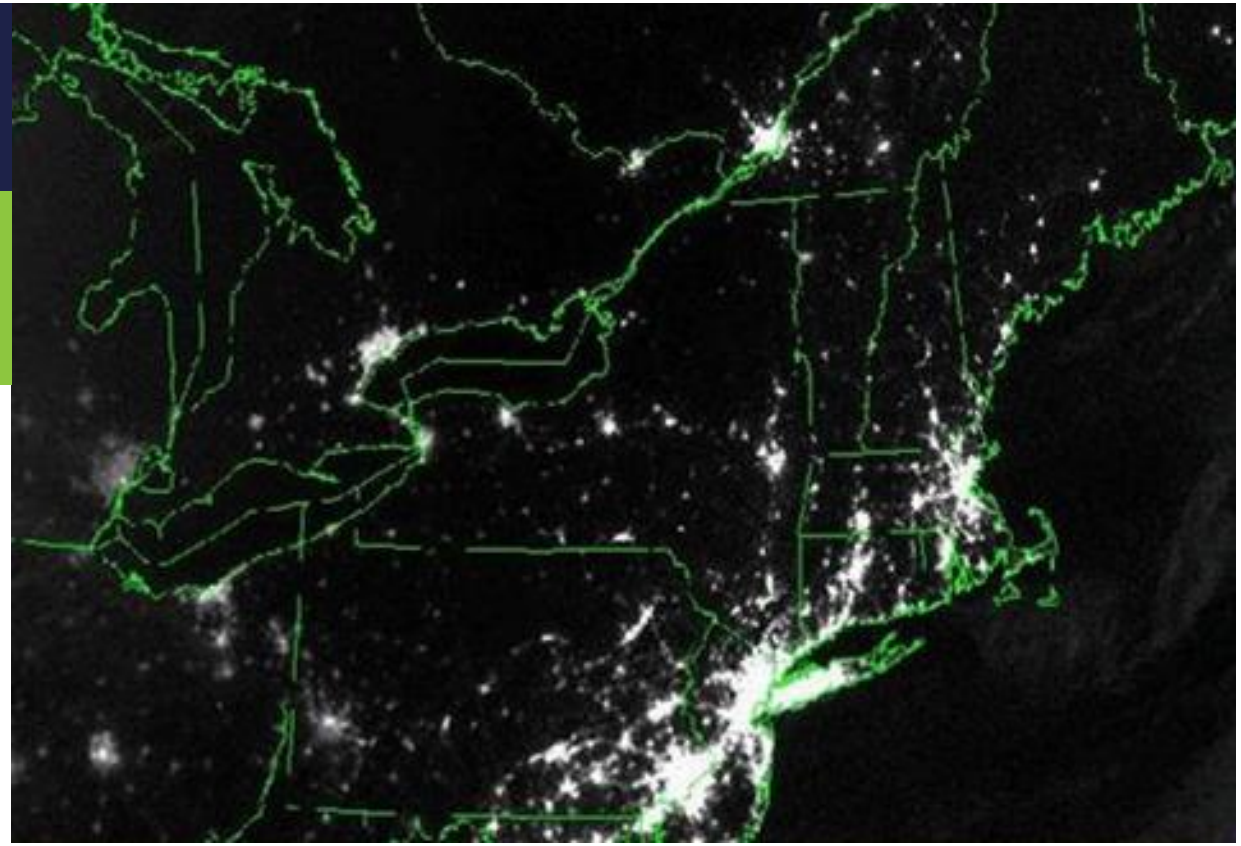


Image: U.S. Department of Energy

Do we regulate ourselves, or get regulated?

2003 Black-Out

~7 hrs after blackout

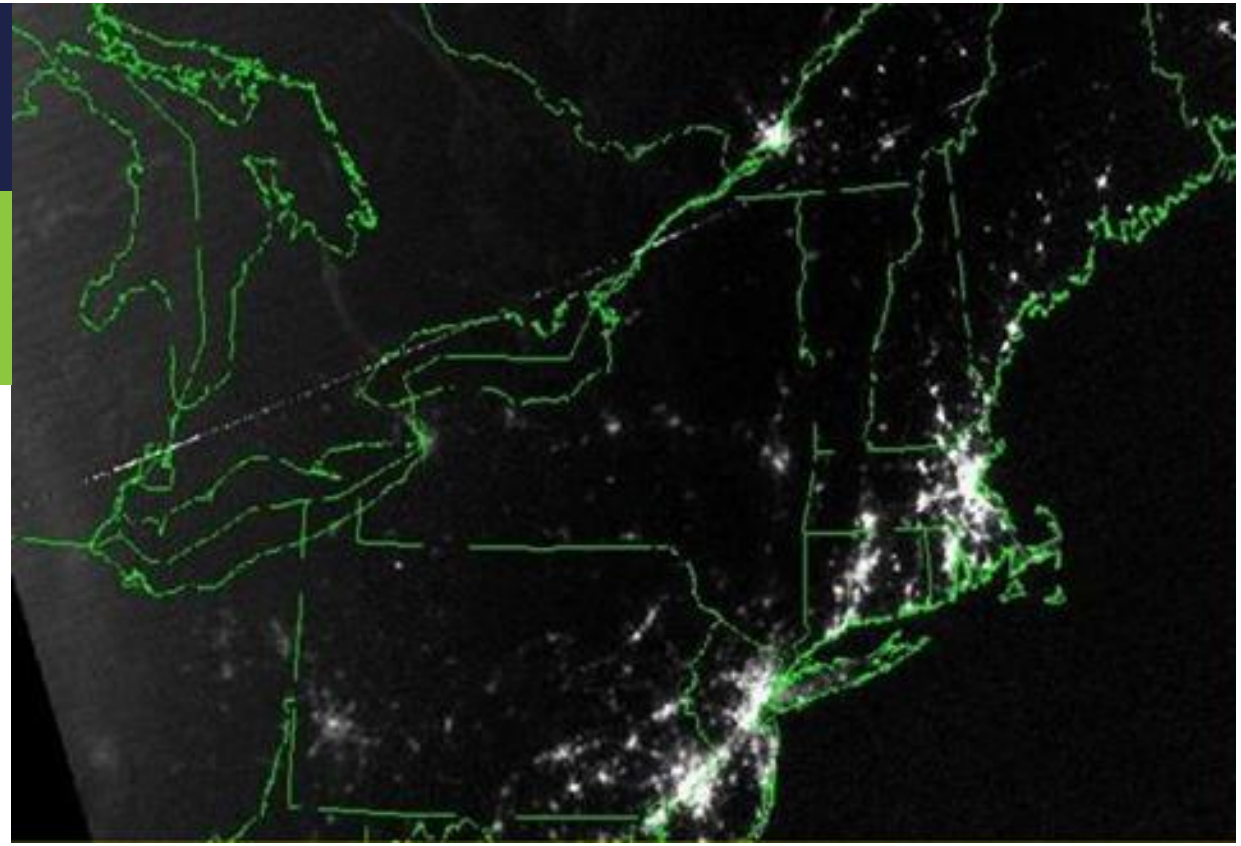


Image: U.S. Department of Energy

Do we regulate ourselves, or get regulated?

Image: MIT Libraries, via JSTOR Daily



Asilomar Conference


In 1975, scientists at Asilomar chose to self-regulate emerging recombinant DNA research before government regulation followed.

Open standards accelerate the entire ecosystem



Image: Maurice Ward Group

Three initiatives. One open framework.

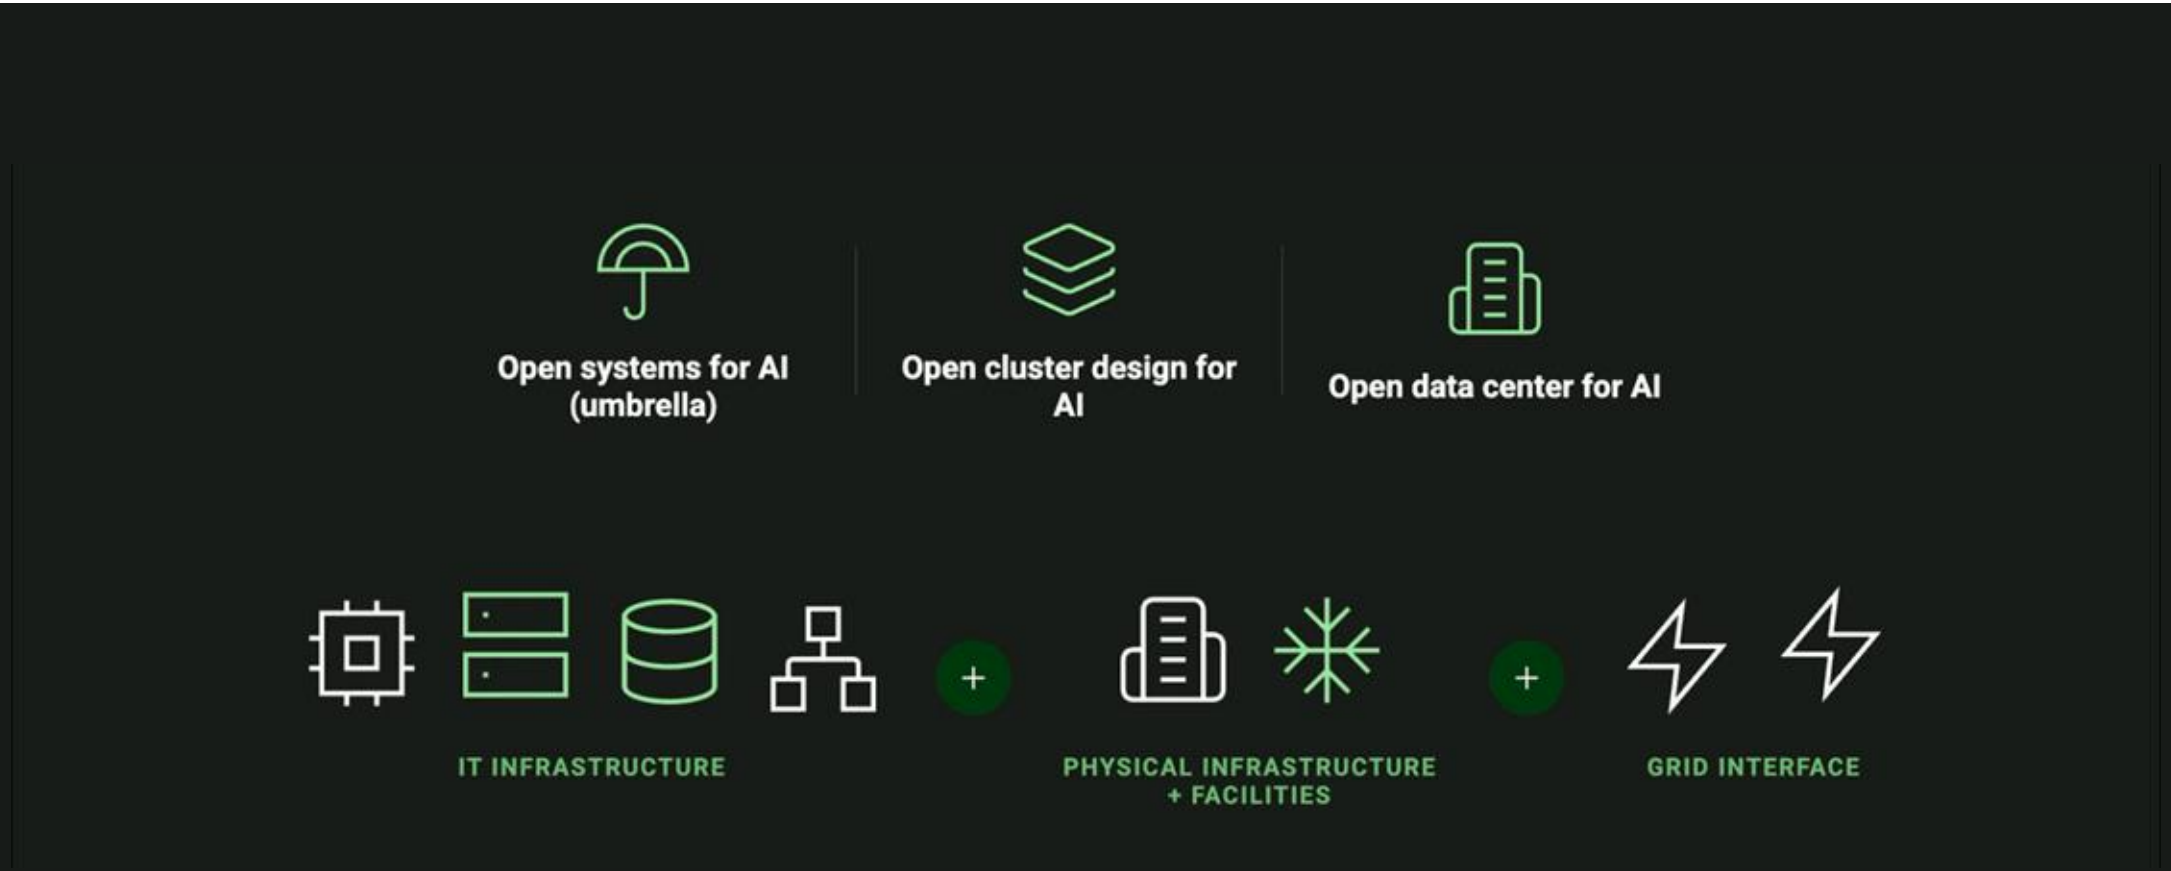


Long live the silos!




The GPU is now an infrastructure control signal



Open data exchange is the bridge between IT / OT

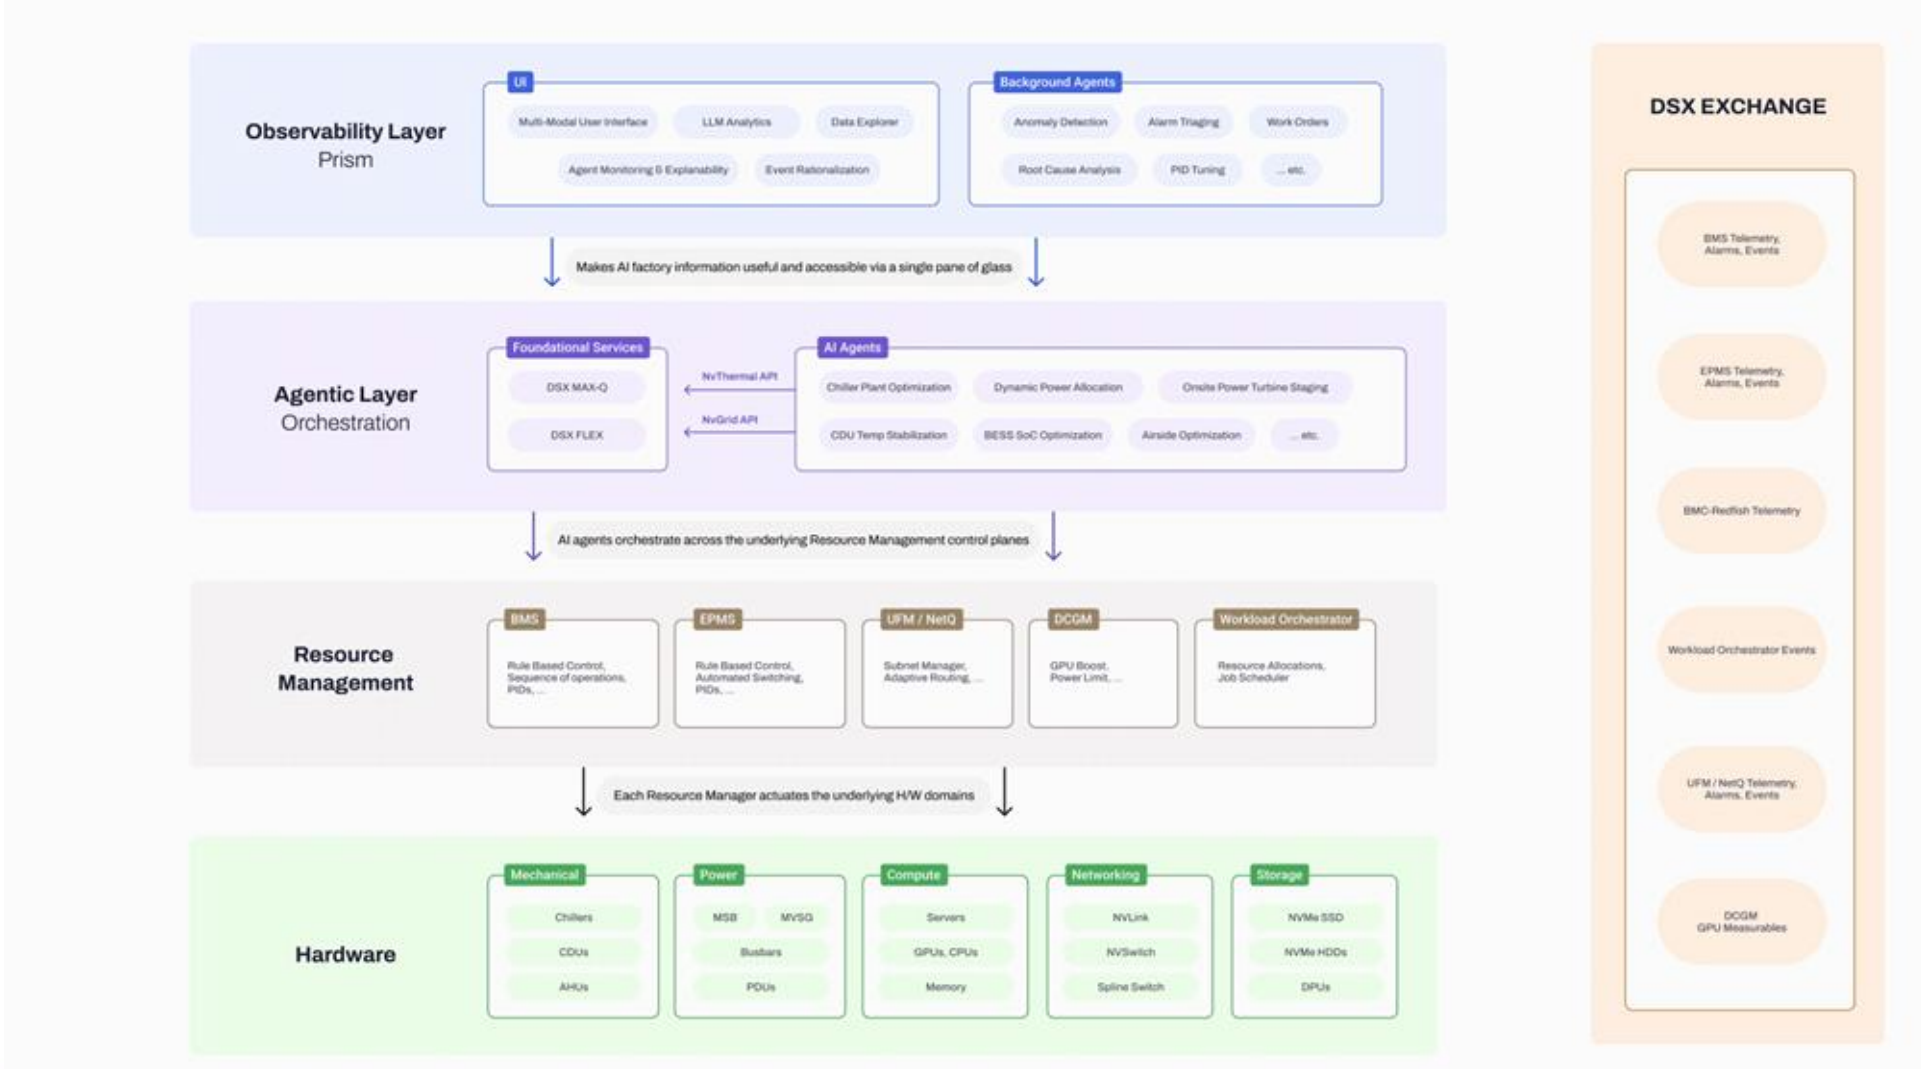

Air-gapping everything isn’t a security strategy

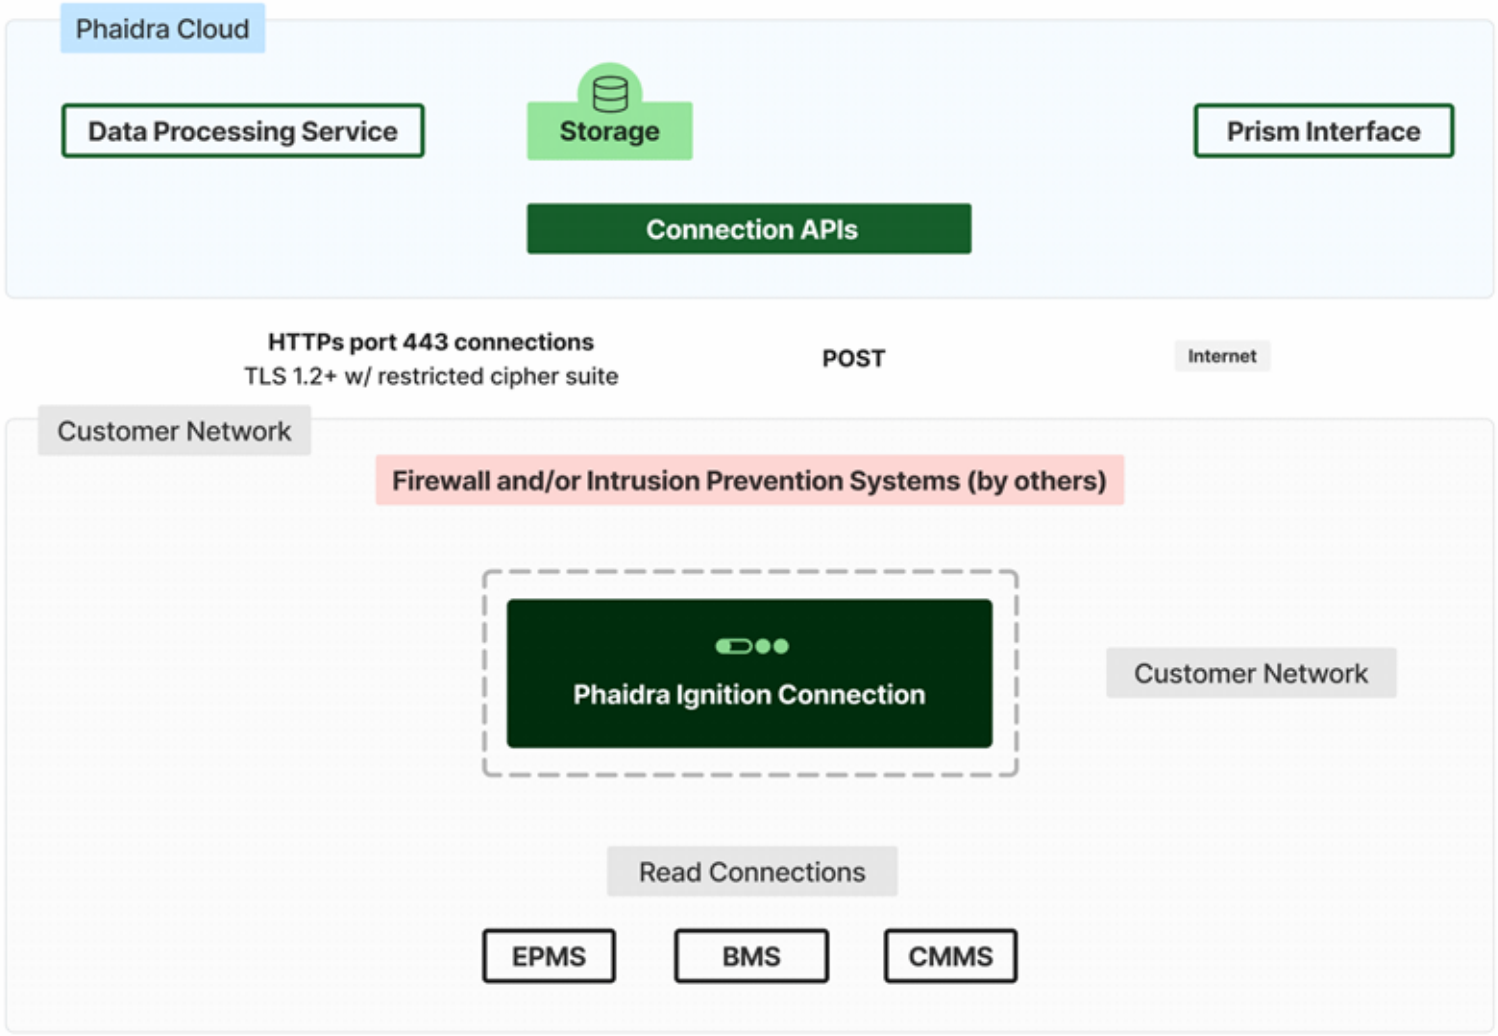

We can't even agree on tag names



EVERY EQUIPMENT NAME

`rack-12 / gpu-03` `chiller-a / supply-temp` `pump-07 / speed` `valve-22 / position` `switch-09 / port-4` `meter-44 / kw` `cdu-2 / flow`

`tower-3 / fan` `pdu-5 / leg-b` `ahu-1 / return-temp` `sensor-88 / humidity` `busbar-4 / current` `rack-12 / gpu-04` `coil-2 / delta-p`

`damper-7 / pos` `vfd-09 / hz` `tank-1 / level` `rack-31 / gpu-11` `filter-6 / delta-p` `breaker-15 / state` `zone-3 / temp`

`rack-31 / gpu-12` `pump-08 / speed` `manifold-4 / flow` `node-22 / inlet-temp` `pdu-6 / leg-a` `tower-4 / fan` `meter-45 / kw`

`rack-77 / gpu-01` `exch-3 / approach` `valve-23 / position` `crac-2 / supply`

Open it up before someone forces us to

- Problem to solve
  - Open-source frameworks for data transfer security and best practices
  - Standardized naming conventions and processes
- How to get involved in the project/sub-project community
  - Join the DC Facility – Data Center Telemetry group
  - Submit feedback and alternatives to the community
- Where to find additional information (URL links)
  - https://www.opencompute.org/community/data-center-facility
  - https://www.opencompute.org/documents/third-party-integration-telemetry-apis-final-pdf
  - https://docs.open223.info/



Open Discussion

