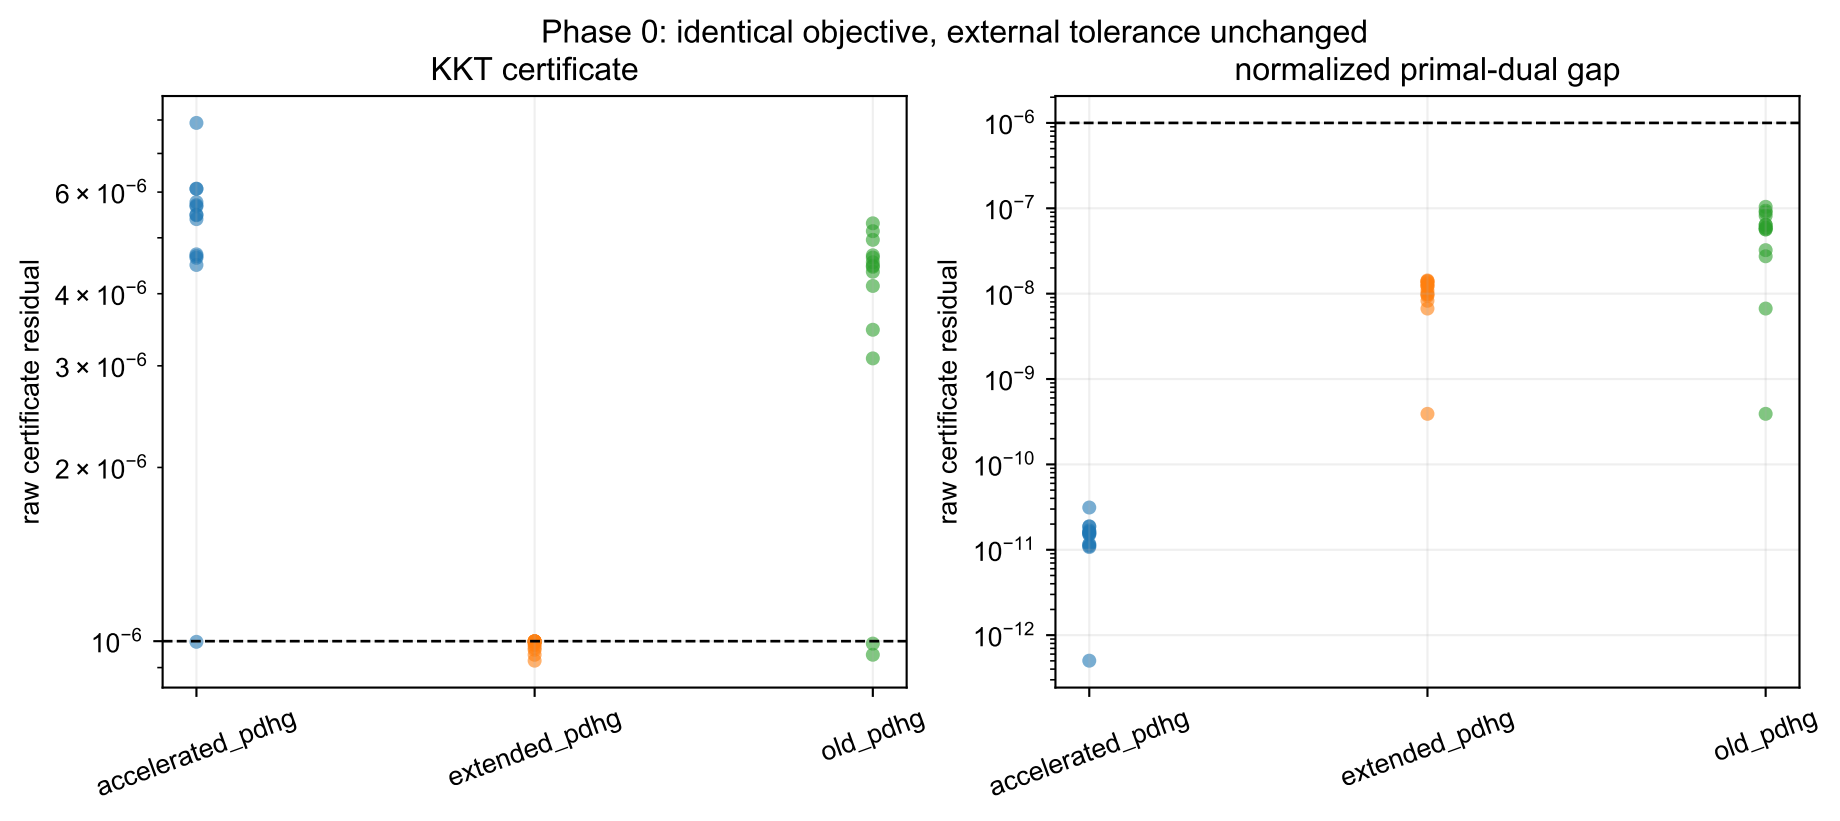
Phase 0: identical objective, external tolerance unchanged
KKT certificate
normalized primal-dual gap
raw certificate residual
raw certificate residual
6×10^{-6}
4×10^{-6}
3×10^{-6}
2×10^{-6}
10^{-6}
10^{-6}
10^{-7}
10^{-8}
10^{-9}
10^{-10}
10^{-11}
10^{-12}
accelerated_pdhg
extended_pdhg
old_pdhg
accelerated_pdhg
extended_pdhg
old_pdhg