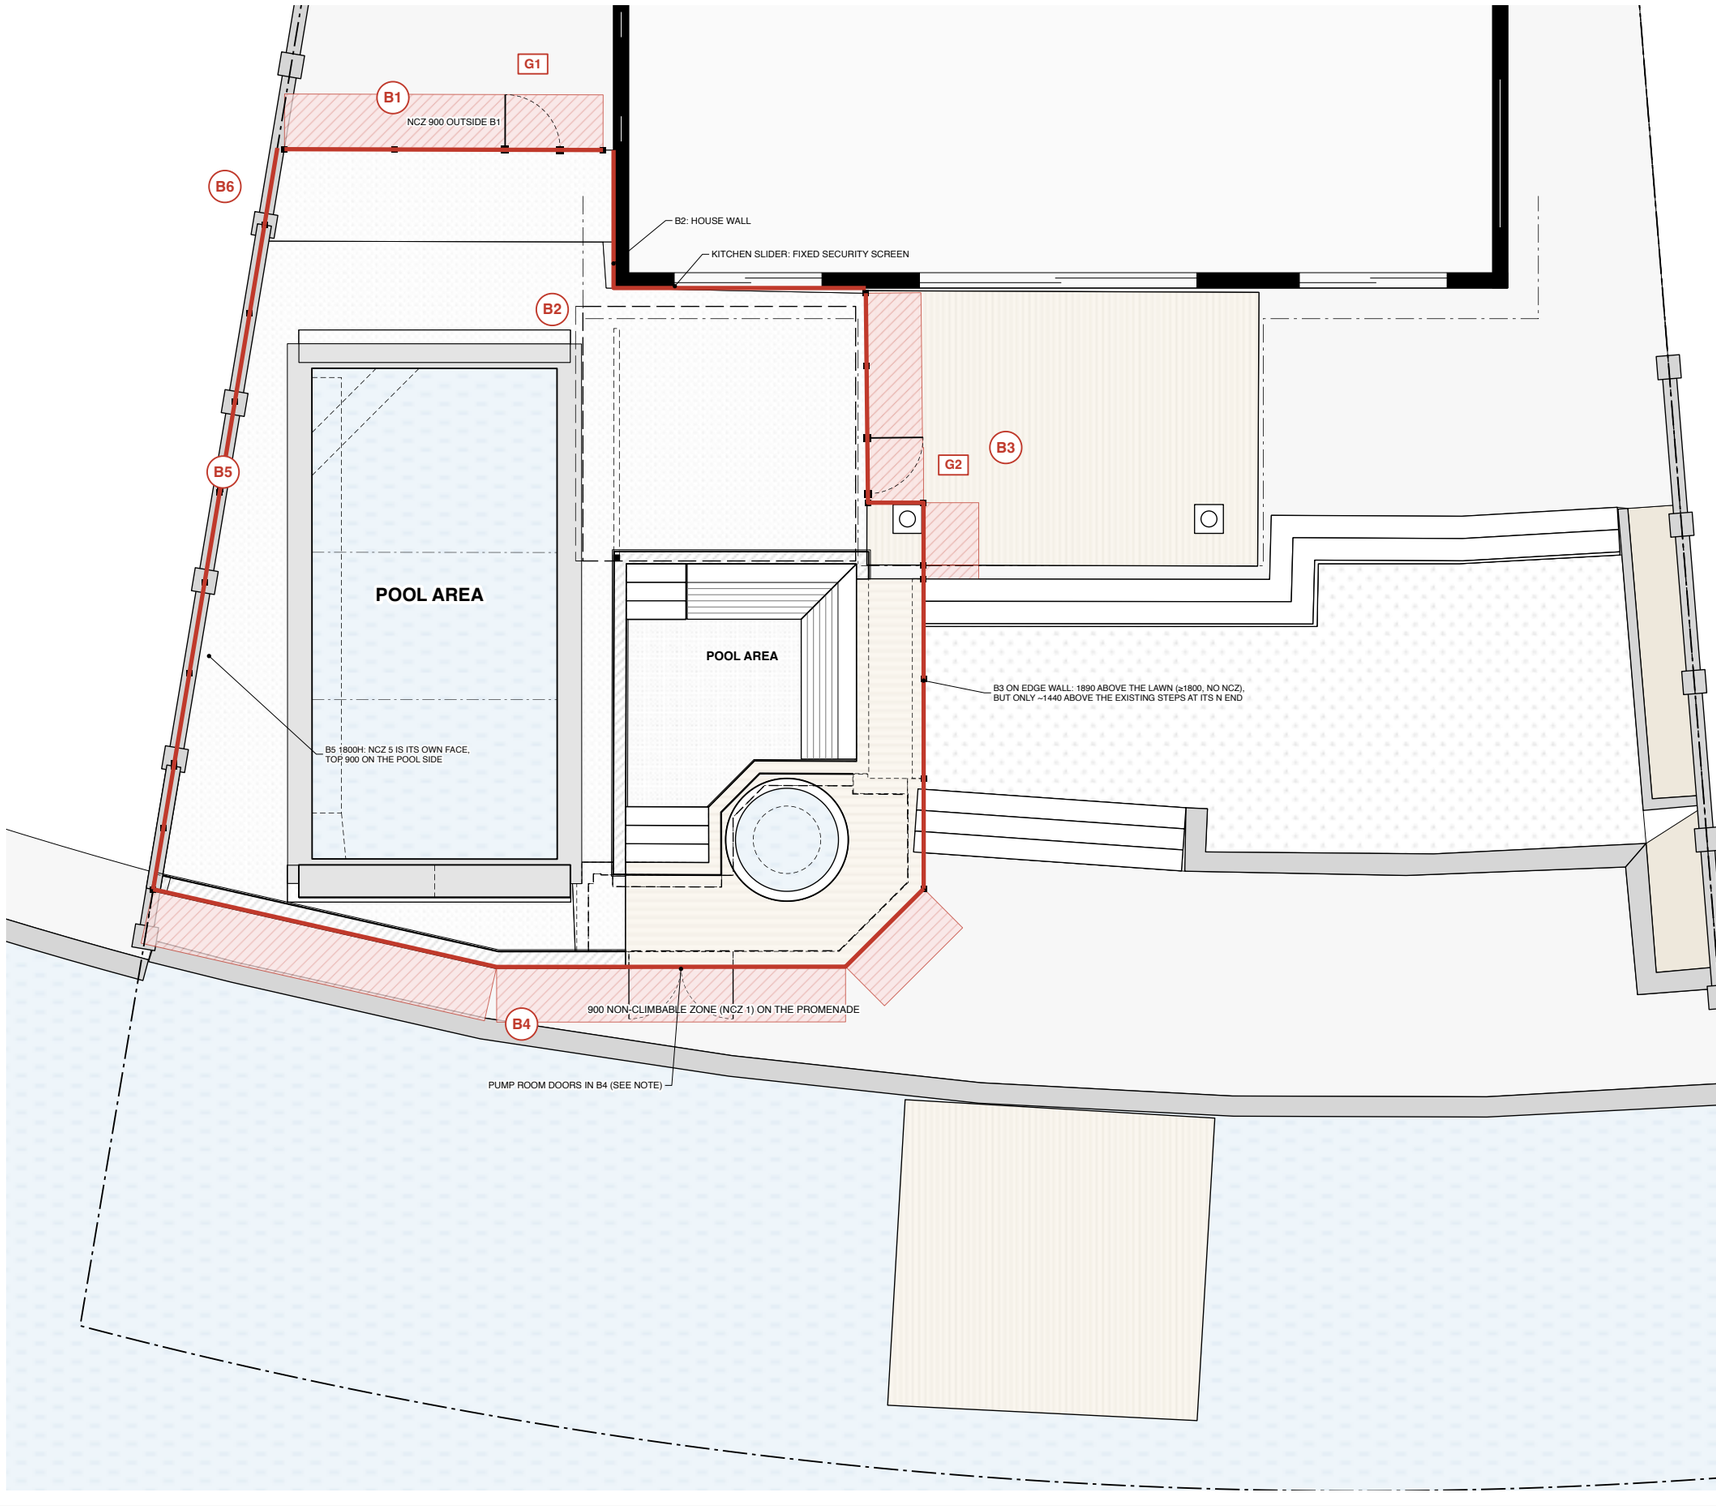


POOL BARRIER PLAN

SCALE 1:100 @ A3

N

SCALE 1:100 @ A3

0 1 2 3 4 5 10 m

BARRIER SCHEDULE

B1 Pool fence, perforated aluminium (charcoal). Height above the ground outside: 1240 mm, top RL +1.250.

B2 House walls (existing); kitchen slider with fixed security screen. Full-height wall.

B3 Pool fence, perforated aluminium, on the deck edge / edge wall. Height above the ground outside: 1200 to 2590 mm, top RL +1.300.

B4 Limestone retaining wall + cap (terrace wall). Height above the ground outside: 1310 mm, top RL +0.020.

B5 West boundary fence (tubular), poolside option. Height above the ground on the pool side: 1800 mm, top RL +1.800.

B6 Existing boundary wall (block), between B5 and B1. Height above the ground on the pool side: 2030 mm, top RL +2.030.

G1 Gate 900 wide in B1, 1250 high: self-closing and self-latching, swings out, away from the pool (arc shown).

G2 Gate 910 wide in B3, 1200 high: self-closing and self-latching, swings out, away from the pool (arc shown).

NOTES

Heights are from the model: barrier top minus the ground 350 mm outside it, every 250 mm along each run (range shown). WA Rules for Pools and Spas (2025): 1200 min. on the outside, 1800 for the boundary (poolside option).

Shaded: the 900 non-climbable zone (NCZ 1) outside barriers under 1800. Nothing climbable is to be built in it (no taps, ledges or footholds), and anything movable put there (pots, furniture, a BBQ) must be kept out of it.

Keep pots and planters 900 mm clear of the boundary fence (B5), or they count as a climbable foothold.

B2: the kitchen slider opens from the house into the pool area. A fixed security screen is to be fitted (estimate 7 Oct); SK02 also notes re-glazing it to pool requirements. Certifier to confirm.

B4: the retaining wall is the barrier on the canal side. Its face must stay smooth (no footholds). The pump room doors (1700 x 950) sit in it under the deck, opening out onto the promenade; the pump room has no opening into the pool area.

The pavilion's pillar is inside the fence, 28 from it.

TO CONFIRM WITH BOB

- B3 at its north end: only about 1440 above the existing lawn steps against it. OK as is?
- Pump room doors in B4, the canal-side barrier wall: their outside face must be non-climbable. Which door and finish?
- B1 and B3 stop 170 and 90 short of the house wall: close them up.

STATUS

Design intent from the 3D model.

For Bob Bruce to draw up.

NOT FOR CONSTRUCTION

Project:	PROPOSED POOL, SPA & ALFRESCO
Client:	CANN
Site:	35 KEEL RETREAT, PORT GEOGRAPHE

Sheet title	**POOL BARRIER PLAN**
Date	21 Oct 2026
Revision	A
Scale	1:100

SHEET

A3-03

Rev A