


3-5 RENEWAL PARTS


COMPACT PDU

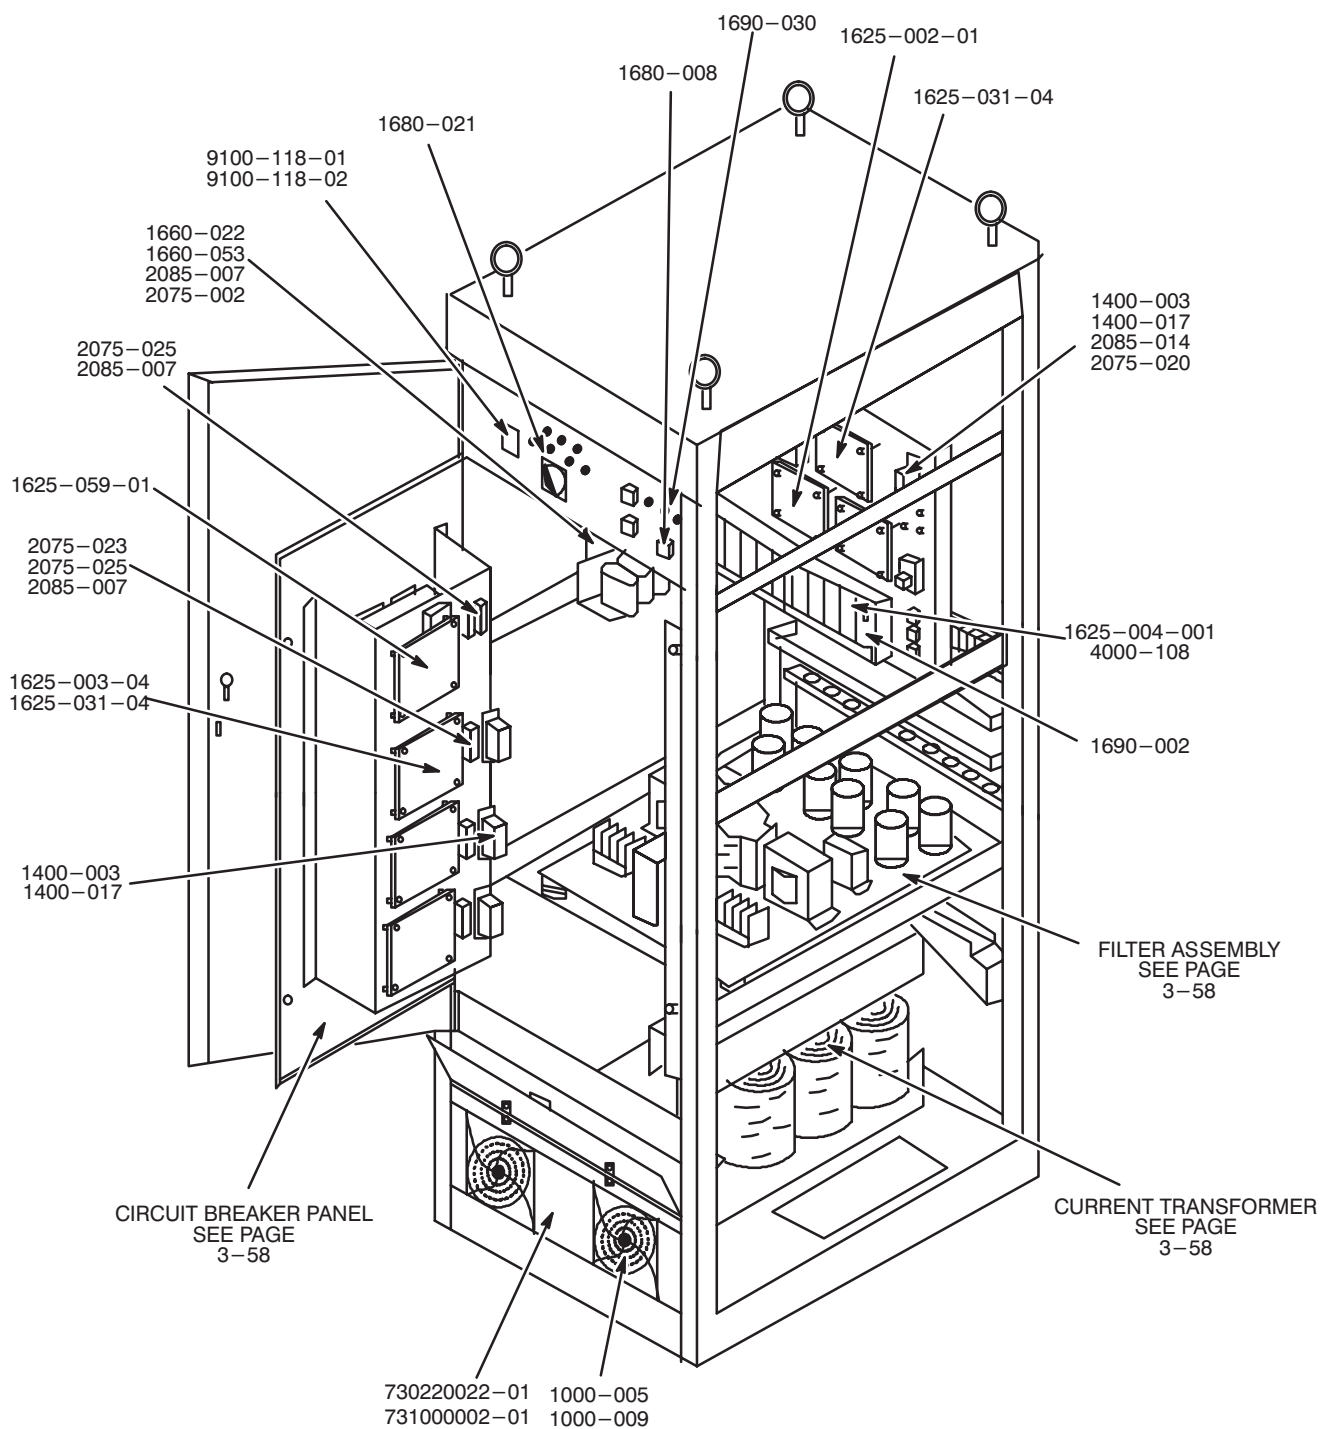

3-5-1 VENDOR PARTS LIST AS OF APRIL 10, 1993 FRUS IN COMPACT PDU

Vendor No.	GE Part NO.	FRU	Vendor	Description (Remarks)
			OnLine Power	CIRCUIT BREAKER PANEL, SEE SECTION 3-5-2
			OnLine Power	FILTER ASSEMBLY, USED ON P1/P2, SEE SECTION NO TAG
			OnLine Power	TRANSFORMER, CURRENT, 3 USED, USED ON P1/P2, SEE SECTION 3-5-3
1000-005	46-307819P37	1	OnLine Power	FAN, 115VAC 115 CFM, 2 USED
1000-009	46-307819P76	2	OnLine Power	FILTER, FAN, 4.5 in. MUFFIN, 2 USED
1400-003	46-307819P3	1	OnLine Power	TRANSFORMER, REFERENCE 480 VIN 40 VCT OUT 40 VA, 4 USED ON P8, P10, P15, and P16, 1 USED P12
1400-017	46-307819P4	1	OnLine Power	TRANSFORMER, 25VA, 415/380VIN, 40 OUT C.T., 4 USED ON P9, P11, P13, P14, and P16, 1 EACH USED ON P12
1625-002-01	46-307819P53	1	OnLine Power	BOARD, SCR DRIVER, 3 USED ON P8 THROUGH P16 EXCEPT P12
1625-003-04	46-307819P12	1	OnLine Power	BOARD, CONTROL LOGIC, 3 USED ON P8 THROUGH P16 EXCEPT P12
1625-004-001	46-307819P13	1	OnLine Power	BOARD, SCR SNUBBER, 18 USED ON P8 THROUGH P16 EXCEPT P12
1625-031-04	46-307819P15	1	OnLine Power	BOARD, SCR FAILURE SENSE, USED ON P8 THROUGH P16 EXCEPT P12
1625-059-01	46-307819P46	1	OnLine Power	BOARD, PDU CONTROLLER
1680-008	46-307819P36	1	OnLine Power	SWITCH, PUSHBUTTON, 3 USED ON P8 THROUGH P16, 2 USED P12
1680-021	46-307819P19	1	OnLine Power	SWITCH, BYPASS 3 PH 18.5 KW 600V 55A, USED ON P8 THROUGH P16 EXCEPT P12
2075-002	46-307819P54	1	OnLine Power	FUSE, 1A 600V, 4 USED (NOT SHOWN)
2075-020	46-307819P28	1	OnLine Power	FUSE AND CAP, .5A 300V SLO BLO, 3 USED, USED ON P8 THROUGH P16 EXCEPT P12
2075-023	46-307819P43	1	OnLine Power	FUSE, .25A 500V DUAL ELEMENT SLO BLO, 5 USED USED ON P8 THROUGH P16, 2 USED ON P12
2085-007	46-307819P48	1	OnLine Power	HOLDER, FUSE, FLAT MOUNT, 7 USED ON P8 THROUGH P16 EXCEPT P12
2085-014	46-307819P54	1	OnLine Power	HOLDER, FUSE, PANEL MOUNT, .5A 300V, 3 USED ON P8 THROUGH P16 EXCEPT P12
4000-108	46-307819P31	1	OnLine Power	WIRE, BUS (FUSELINK) 18 GAGE, USED ON P8 THROUGH P16 EXCEPT P12
730220022-01	46-307819P50	1	OnLine Power	FUSE, 2A 600V SLO BLO, 2 USED
731000002-01	46-307819P49	1	OnLine Power	HOLDER, FUSE, FLAT MOUNT, 2 USED
9100-118-01	46-307819P86	1	OnLine Power	BREAKER, CIRCUIT 3P 80A 480VAC 24VDC SHUNT,

COMPACT PDU (continued)

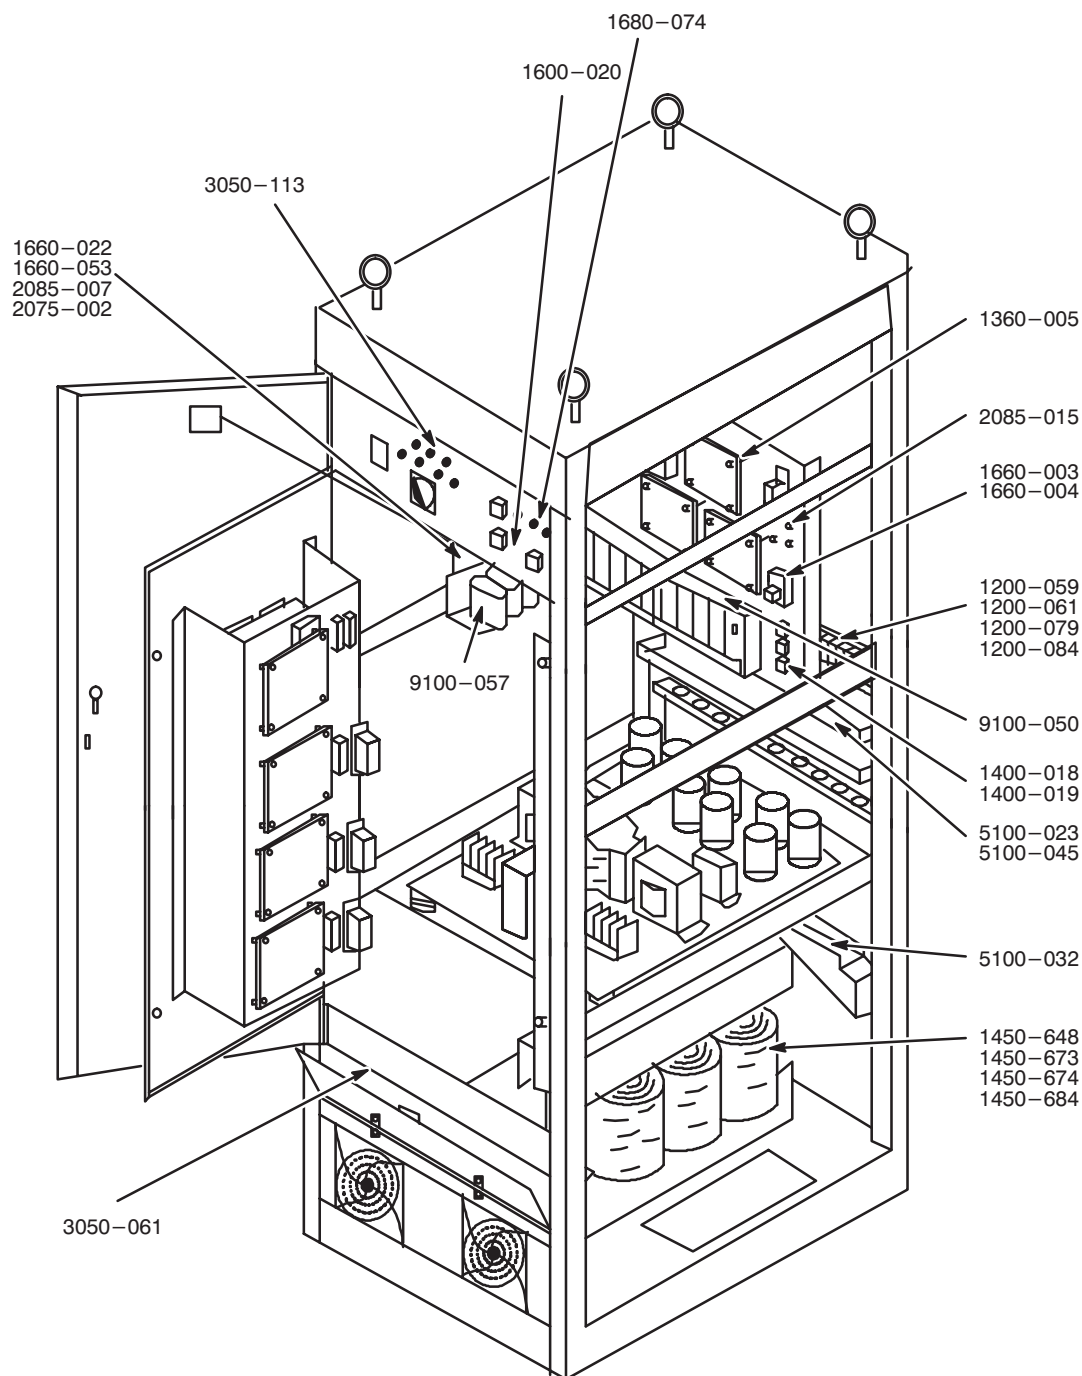


3-5-1 VENDOR PARTS LIST AS OF APRIL 10, 1993 USED IN COMPACT PDU (continued)


Vendor No.	GE Part NO.	FRU	Vendor	Description (Remarks)
1200-059	46-307819P69	2	OnLine Power	TERMINAL BLOCK, 600V, AWG# 3, UK16N, 16 USED
1200-061	46-307819P70	2	OnLine Power	TERMINAL BLOCK, 600V, AWG# 8, UK 10, 13 USED
1200-079	46-307819P71	2	OnLine Power	TERMINAL BLOCK, #2 AWG, 9 USED
1200-084	46-307819P72	2	OnLine Power	TERMINAL BLOCK, #4 AWG TO 3/0
1360-005	46-307819P77	2	OnLine Power	STANDOFF, NYLON, HEX, 1 in. x 6-32, 24 USED, USED ON P8 THROUGH P16 EXCEPT P12
1400-018	46-307819P5	2	OnLine Power	TRANSFORMER, CONTROL, 1VA, 40VIN, 9.6VOUT, 50/60 HZ, 3 USED, USED ON P1
1400-019	46-307819P6	2	OnLine Power	TRANSFORMER, CONTROL, 1VA, 40VIN, 9.6VOUT, 50/60 HZ, 3 USED, USED ON P2
1450-648		N	OnLine Power	3 PH 50 KVA 480 VIN 208Y/120 VOUT 60 Hz, USED ON P8, P10, P15, P16
1450-673		N	OnLine Power	3 PH 50 KVA 380/415 VIN 208Y/120 VOUT 50 HZ, USED ON P9, P11, P13, P14
1450-674		N	OnLine Power	3 PH 50 KVA 480 VIN 208Y/120 VOUT 60 HZ ISOLATION ONLY, USED ON P12
1600-020	46-307819P10	2	OnLine Power	LED(RED) 6V, 10 mA, USED ON P8 THROUGH P16 EXCEPT P12
1660-003	46-307819P17	1	OnLine Power	RELAY 24VDC 10A, USED ON P8 THROUGH P16 EXCEPT P12
1660-004	46-307819P79	2	OnLine Power	RELAY SOCKET, USED ON P8 THROUGH P16 EXCEPT P12
1660-022			OnLine Power	RELAY SOCKET, USED ON P8 THROUGH P16 EXCEPT P12
1660-053			OnLine Power	RELAY, 120VAC, 10A, USED ON P8 THROUGH P16 EXCEPT P12
1680-005	46-307819P60	2	OnLine Power	COVERS FOR EPO SWITCHES, 3 USED ON P8 THROUGH P16, 2 USED P12
1680-007	46-307819P62	2	OnLine Power	LENSES FOR EPO SWITCHES YELLOW, 2 USED ON P8 THROUGH P16, 1 USED P12
1680-074	46-307819P61	2	OnLine Power	LENS, EPO, WHITE
2085-015	46-307819P68	2	OnLine Power	FUSE CLIP, USED FOR #2075-020, 3 USED, USED ON P8 THROUGH P16 EXCEPT P12
3050-081	46-307819P65	2	OnLine Power	RECEPTACLE L21-30R1, 2 USED
3050-113	46-307819P58	2	OnLine Power	TEST JACK RED, 7 USED ON P8 THROUGH P16 EXCEPT P12
5100-023	46-307819P74	2	OnLine Power	BUS BAR
5100-032	46-307819P75	2	OnLine Power	TRANSFORMER STRAP, 2 USED
5100-045	46-307819P73	2	OnLine Power	BUS BAR-2
7060-005	46-307819P33	2	OnLine Power	12 in. LOGIC TO DRIVER BOARD HARNESS, 3 USED, USED ON P8 THROUGH P16 EXCEPT P12 (NOT SHOWN)
7060-012	46-307819P34	2	OnLine Power	6 in. SCR HARNESS 22/4X6, 18 USED, USED ON P8 THROUGH P16 EXCEPT P12 (NOT SHOWN)
7060-089	46-307819P67	2	OnLine Power	MAIN HARNESS ASSEMBLY #:7060-089, USED ON P8 THROUGH P16 EXCEPT P12 (NOT SHOWN)
7060-122	46-307819P66	2	OnLine Power	HARNESS, HIGH VOLTAGE WIRING, PRIMARY, GE PDU, USED ON P12 (NOT SHOWN)
7060-123	46-307819P59	2	OnLine Power	HARNESS, HIGH VOLTAGE, SECONDARY, GE PDU, USED ON P12 (NOT SHOWN)
7060-124	46-307819P63	2	OnLine Power	HARNESS, LOW VOLTAGE, GE PDU, USED ON P12 (NOT SHOWN)
9100-050	46-307819P78	2	OnLine Power	ASSEMBLY, THERMAL SWITCH, USED ON P8 THROUGH P16 EXCEPT P12

3-5-1 VENDOR PARTS LIST AS OF APRIL 10, 1993 FRUS IN COMPACT PDU (continued)


CIRCUIT BREAKER PANEL

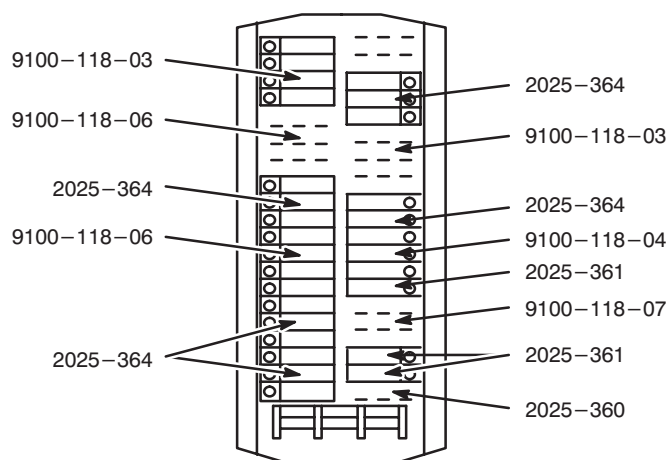

FILTER ASSEMBLY

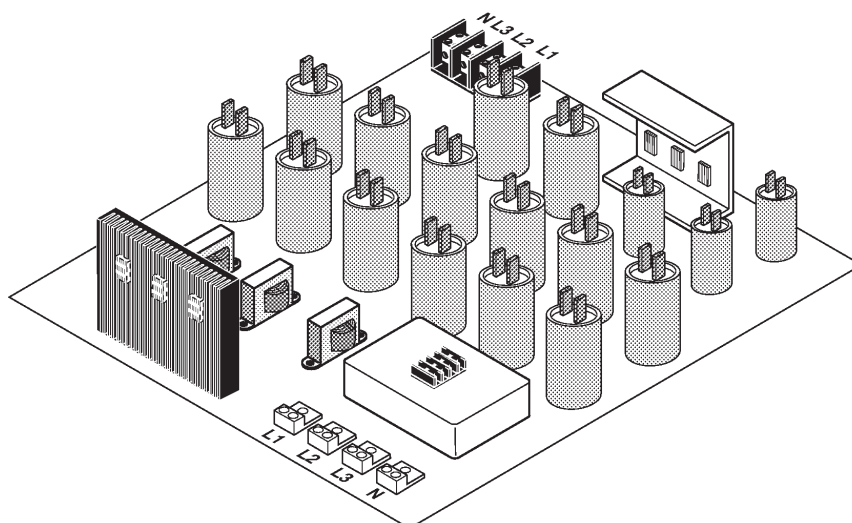

CURRENT TRANSFORMER, MODELS 46-317099 P8 THROUGH P16 EXCEPT P12

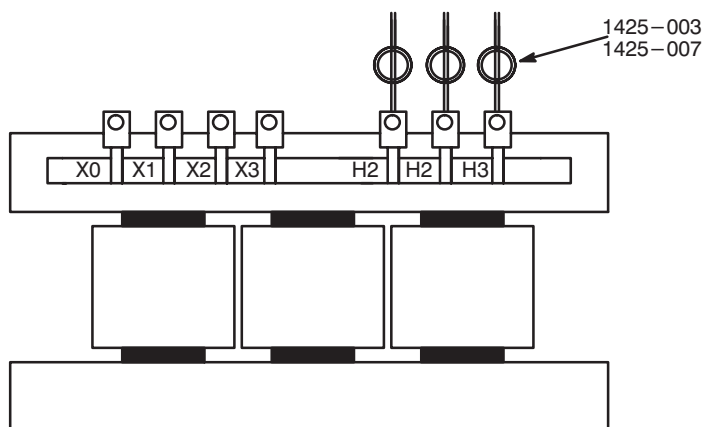

3-5-2 Circuit Breaker Panel

Vendor No.	GE Part NO.	FRU	Vendor	Description (Remarks)
2025-361	46-307819P42	1	OnLine Power	BREAKER, CIRCUIT 1P 15A 120VAC, 3 USED
2025-364	46-307819P40	1	OnLine Power	BREAKER, CIRCUIT 3P 30A 240VAC, 5 USED
9100-118-03*	46-307819P82	1	OnLine Power	BREAKER, CIRCUIT 3P 60A 240VAC 24VDC SHUNT
9100-118-04	46-307819P83	1	OnLine Power	BREAKER, CIRCUIT 1P 40A 120VAC 24VDC SHUNT
9100-118-07*	46-320337P4	1	OnLine Power	BREAKER, CIRCUIT 2P 15A 240VAC 24VDC SHUNT (OPTION)
9100-118-06*	46-320337P1	1	OnLine Power	BREAKER, CIRCUIT 3P 30A 240VAC 24VDC SHUNT

* Breakers shown in outline form are options.

3-5-3 Current Transformer, Models 46-317099 P8 THROUGH P16 EXCEPT P12

Vendor No.	GE Part NO.	FRU	Vendor	Description (Remarks)
1425-003	46-307819P8	1	OnLine Power	TRANSFORMER, CURRENT 100:5, 3 USED, USED ON P8, P10, P15, P16
1425-007	46-307819P9	1	OnLine Power	TRANSFORMER, CURRENT 200:5, 3 USED, USED ON P9, P11, P13, P14